

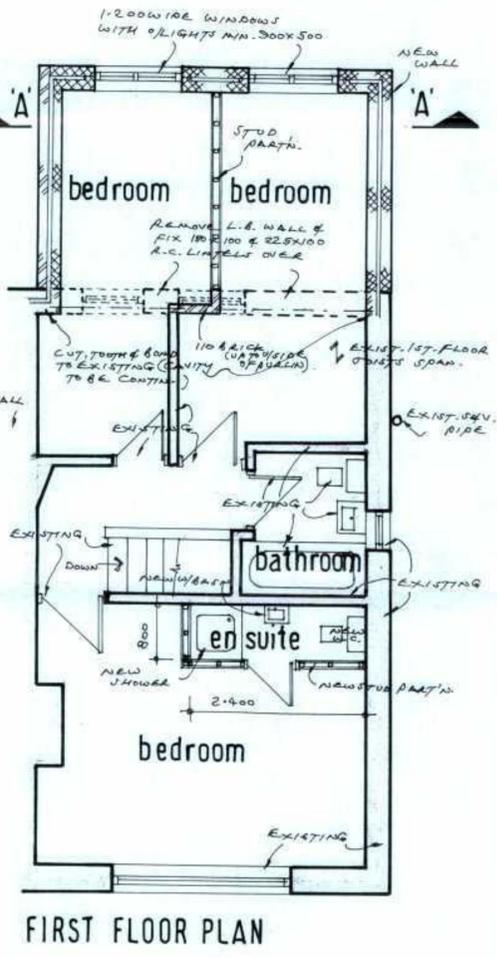


LOCATION PLAN

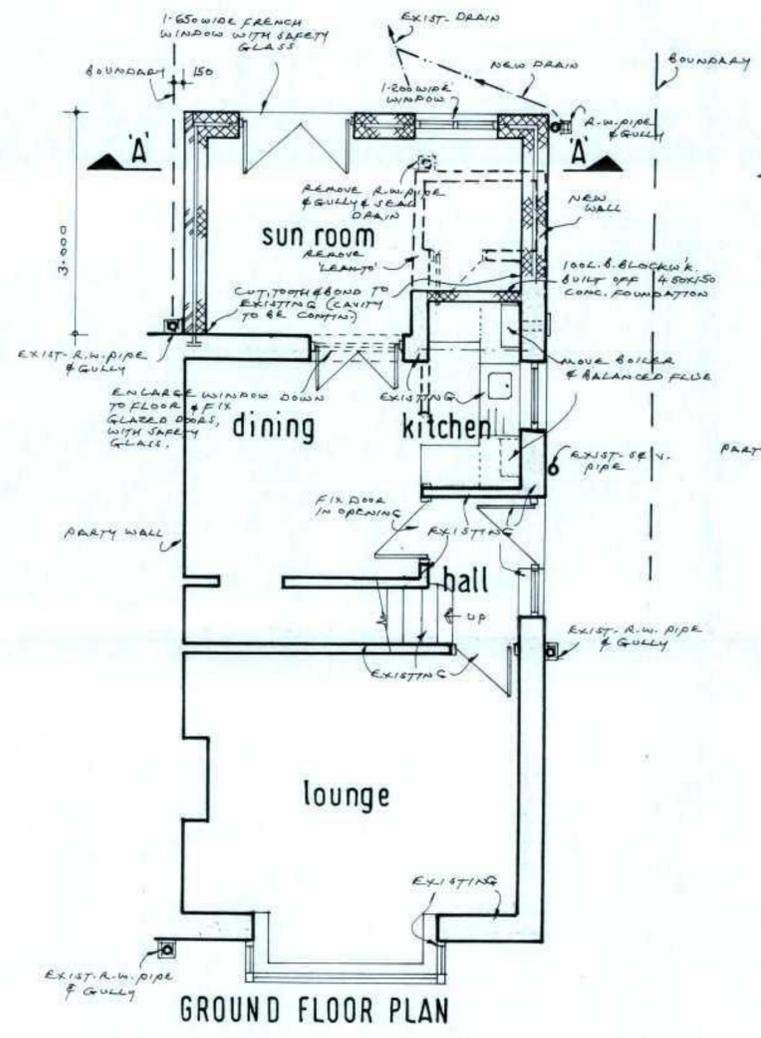

WHERE NEW ROOF SLATES EXISTING REMOVE EXIST. SLATES, BATTENS & FELT. FIX LAY-BORDS TO EXIST. RAFTERS & SPIKE NEW RAFTERS TO LAY-BORDS. FORM VALLEYS WITH LEAD SHEET.

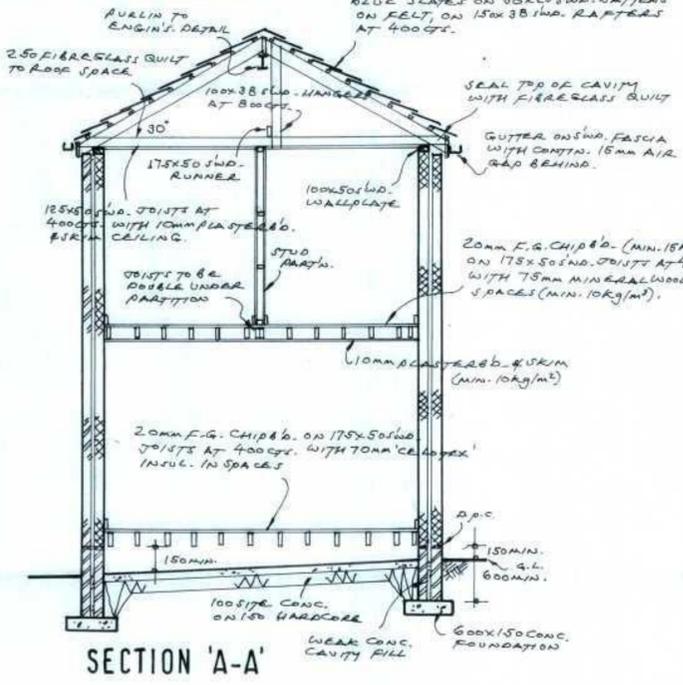

SECTION 'A-A'

WHERE LOADING INCREASES, EXISTING FOUNDATION TO BE EXPOSED & APPROVED BY L.A. BEFORE WORK COMMENCES & ALTERED IF REQ'D.

GENERAL NOTES:-

- NEW DRAINS TO BE 100DIA. VITR. CLAY WITH MIN. FALL (IN 40).
- ANY DRAIN PASSING UNDER EXTENSION TO BE EXCAVATED WITH 150 CONC. & WHEEL DRIVEN PAVES UNDER WALL FOR 'BRIDGE' OVER WITH CONC. LINTELS & TRAP FOUNDATION DOWN TO MAIN LEVEL.
- NEW RAINWATER PIPE TO BE 75 DIA. INTO EACH INLET GULLY.
- NEW EXT. WALL TO CONSIST 110 BRICK, OR 2 COATS RENDER ON 100 DENSE CONC. BLOCKS, BS CAVITY WITH 'KINGS PAN TWO 50' INSUL. & 100 L.B. BLOCKS INT. WITH GALV'D. FI SH-TAIL TILES AT 750CFS. HORIZ. & 4-50 CFS. VERT.
- OPENINGS IN EXT. WALL TO HAVE R.C. LINTELS.
- ALL NEW EXPOSED HEADS, REVERIES & CILLS TO HAVE 200 GAUGE D.P.C.
- NEW WINDOWS TO BE DOUBLE GLAZED WITH 'PILKINGTON'S K' GLASS (6mm GAP) & HAVE OPENING AREA MIN. 1/20TH FLOOR AREA OF ROOM SERVED.
- SUN ROOM & ALTERED BEDROOMS TO HAVE 8000mm² TRICKLE VENT. IN SUITE TO HAVE 4,000mm² TRICKLE VENT & MECHAN. VENTIL. TO GIVE MIN. 15 LITRES/HOUR.
- MAINS POWERED SMOKE DETECTORS TO BE FITTED OVER HALL & LANDING TO B.S. 5446 (INTER CONNECTED).
- STUD PARTITIONS TO CONSIST 75X50 S.W.D. STUDDING AT 400CFS. WITH MINERAL WOOL IN SPACES & 10mm PLASTER & SKIM & SKIM BOTH SIDES. AIR GATES TO HAVE TERRA-COTTA CAVITY LINERS WITH 'FRAY' D.P.C. OVER.
- NEW ROOF & 1ST. FLOOR TO BE FIXED TO WALL WITH 30X5X1m LONG STEEL STRAPS AT 2m CFS. EXTENDING OVER MIN. 3 MEMBERS.
- USE ENERGY EFFICIENT LIGHTING.
- ALL ELECTRICAL WORK TO BE DESIGNED, INSTALLED, INSPECTED & TESTED BY AN APPROVED ELECTRICIAN.

PLUMBING NOTES:-

- W.C. - 1/4" TRAP WITH SWEEP CONN. TO S.W. PIPE. (NO OTHER CONN. TO BE WITHIN 200 BELOW).
- SHOWER - 38 DIA. OUTLET WITH APPROVED RE-SEALING TRAP, INTO 50 DIA. A.V.C. WASTE PIPE (MIN. FALL IN 40) TO S.W. PIPE.
- WASHBASIN - 32 DIA. OUTLET WITH APPROVED RE-SEALING TRAP, INTO 38 DIA. A.V.C. WASTE PIPE (MIN. FALL IN 40) TO S.W. PIPE.
- ALL PIPES TO BE RODDABLE.

RECEIVED
13 FEB 2006

PROPOSED EXTENSION AT 3 STOCKERHEAD LANE, SLAITHWAITE, HUDDERSFIELD, FOR MRS. RAJONES.
date: 7-2-06 scale: 1:50, 1:100, 1:1250.
drawn: D. Revitt MCI.OB.