


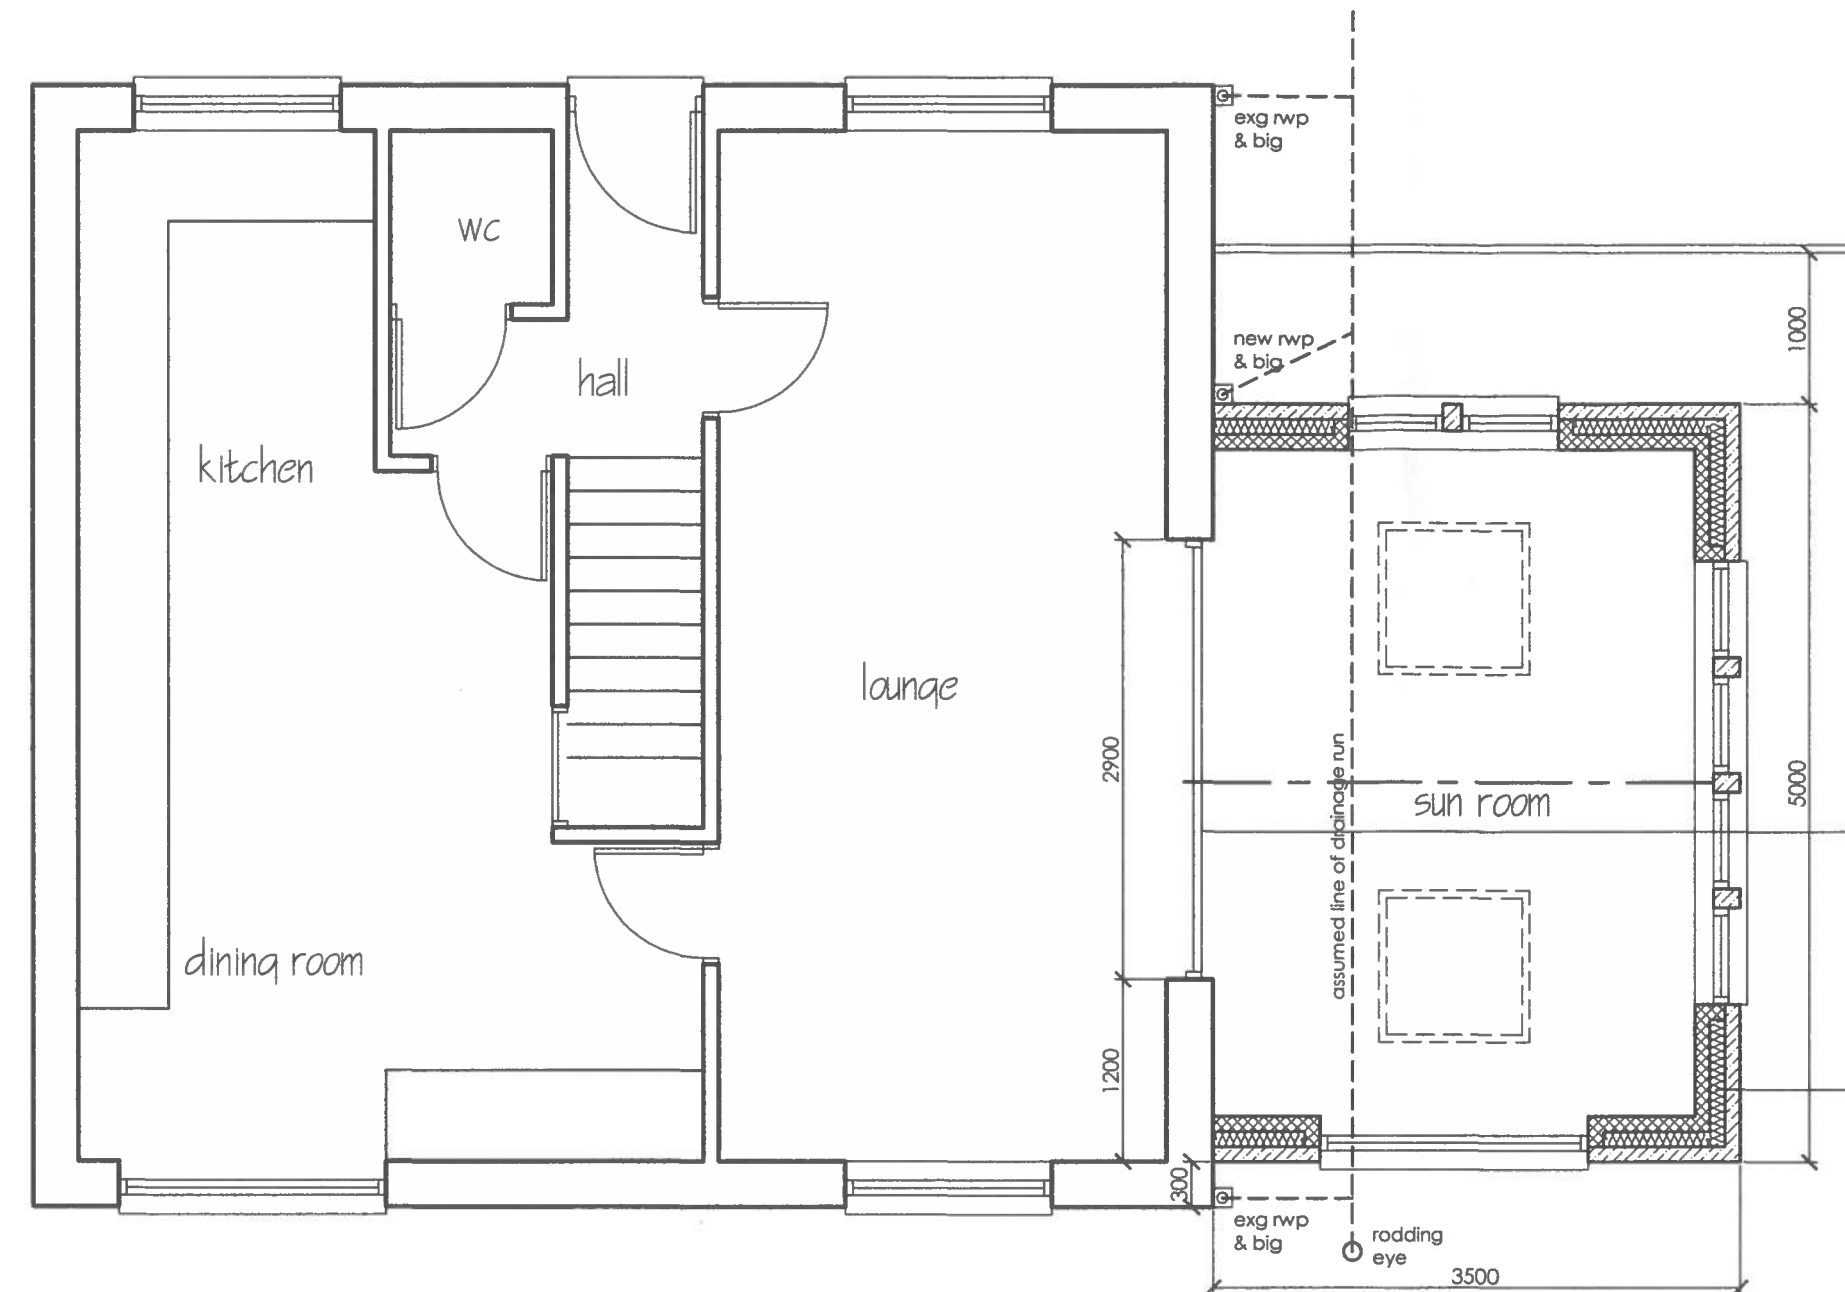

EXTERNAL LIGHTING TO BE MAX. 100 WATT AND HAVE DAY NIGHT CONTROLS

ALL NEW LIGHTING TO BE INSTALLED TO BE LOW ENERGY UP TO 70% OF NEW FITTINGS INSTALLED

BOILER TO BE INSTALLED AND COMMISSIONED BY APPROVED PERSON AND CERTIFICATE TO BE PROVIDED TO BUILDING INSPECTOR

CATNIC LINTELS TO BE USED TO ALL NEW DOOR AND WINDOW OPENINGS AND INSULATED DPC TO ALL WINDOW REVEALS

EXISTING FOUNDATIONS TO BE EXPOSED FOR BUILDING INSPECTOR TO CHECK IF ADEQUATE TO SUPPORT ADDITIONAL LOADS

ALL ELECTRICAL WORKS REQUIRED TO MEET THE REQUIREMENTS OF PART P (ELECTRICAL SAFETY) MUST BE DESIGNED, INSTALLED, INSPECTED AND TESTED BY A PERSON COMPETENT TO DO SO

ALL NEW RADIATORS TO HAVE THERMOSTATIC VALVES

ALL RIGID INSULATION TO BE KING SPAN INSULATION OR SIMILAR TO APPROVAL OF BUILDING INSPECTOR

ALLOW FOR WALL PLASTER AND SKIM TO NEW WALLING

ALLOW FOR SAW CUT DPC AT NEW AND EXISTING WALL ABUTMENT

ALL DIMENSION AND SETTING OUT TO BE CHECKED ON SITE AND ANY DECREPANIES TO BE HIGHLIGHTED TO ARCHITECT

INSTALL MAINS OPERATED AND INTER LINKED SMOKE DETECTOR / ALARM TO LOCATIONS SHOWN TO BS 5446

SUPPLY AND FIX GABLE STRAPS AT 1.25m CRS FIX IN ACCORDANCE WITH MANUFACTURERS DETAILS.

SUPPLY AND FIX WALL PLATE HOLDING DOWN STRAPS AT 1.25m CRS FIX IN ACCORDANCE WITH MANUFACTURERS DETAILS.

FORM NEW OPENING EXISTING WALL AND BUILD IN LINTOL OVER AND SUPPLYA ND FIX NEW GLAZED ROOM DIVIDER FOLDING DOORS AND FRAEM AS CLIENTS SPECIFACTON

GENERAL WALL CONSTRUCTION TO BE STONE WORKS TO MATCH EXISTING,50MM CLEAR CAVITY 50MM THICK PARTIAL FILL CAVITY INSULATION, 100MM THICK BLOCK WORK INNER SKIN. WALL TIES TO BE VERTICAL TWIST TYPE AT 750MM MIN. CRS. AND 450MM CRS VERTICALLY. USE CROCODILE CLIPS AT NEW AND EXISTING WALL ABUTMENT

GROUND FLOOR PLAN



BIRCHLEIGH
468 SHADWELL LANE
SHADWELL
LEEDS
LS17 8BA

Email: s-eccles1@sky.com

Tel: 0113 808 4157
eFax: 0113 322 4639
Mob: 0794 6537770

TERMS & CONDITIONS

1. THIS DRAWING IS DETAILED SUFFICIENTLY ,IN ACCORDANCE WITH CURRANT ARCHITECTURAL PRACTICE TO SATISFY A BUILDING SUBMISSION. NO LIABILITY IS ACCEPTED FOR ANY LOSS OF ANY SORT OF ADDITIONAL EXPENSE INCURRED CONSEQUENT ON ANY FAILURE,REAL OR REGULATIONS ALLEGED,OF THE DRAWING TO MEET THE REQUIREMENTS OF ANY BODY,STATUTORY OR OTHERWISE.
2. THE LAYOUT AND SPECIFICATION ON THIS DRAWING IS A GUIDE AS TO WHAT MAY BE REQUIRED TO SATISFY A BUILDING REGULATIONS SUBMISSION.THIS DOES NOT IMPLY THAT THIS IS THE ONLY ACCEPTABLE WAY OF ACHIEVING BUILDING REGULATION CONSENT.NO LIABILITY IS ACCEPTED FOR LOSS OF ANY SORT OR ADDITIONAL EXPENSE INCURRED CONSEQUENT ON ANY VARIATION TO THE LAYOUT OR SPECIFICATION THAT MAY BE REQUIRED AS A RESULT OF SITE CONDITIONS,AVAILABILITY OF MATERIALS,CUSTOM AND PRACTICE,THE REQUIREMENTS OF THE BUILDING CONTROL OFFICER,OR OTHER CIRCUMSTANCES.
3. DO NOT SCALE THIS DRAWING.ANY DISCREPANCIES TO BE REPORTED TO THE PROJECT CO-ORDINATOR IMMEDIATELY.
4. ALL DIMENSIONS AND LEVELS TO BE CHECKED ON SITE BY THE CONTRACTOR PRIOR TO COMMENCING ANY WORKING DRAWINGS OR COMMENCING WORK ON SITE.
5. THE CONTRACTOR MUST ENSURE AND WILL BE CONSIDERED RESPONSIBLE FOR THE OVERALL STABILITY OF THE BUILDING STRUCTURE,EXCAVATIONS ETC. AT ALL STAGES OF THE WORK.
6. ALL WORK TO BE CARRIED OUT IN COMPLIANCE WITH THE REQUIREMENTS OF THE RELEVANT STATUTORY AUTHORITIES AND REGULATIONS.
7. ALL WORK BY THE CONTRACTOR MUST BE CARRIED OUT IN SUCH A WAY THAT ALL REQUIREMENTS UNDER THE HEALTH AND SAFETY AT WORK ACT ARE SATISFIED.

RESIDENTIAL DEVELOPMENT			
101 CLIFF HOLLINS LANE, OAKENSHAW			
BD12 7ET			
for			
Miss. A. PEARSON			
PROPOSED PLANS			
SIDE EXTENSION			
Date:	Drawn By:	Checked By:	Scale:
JULY 2016	SDE		1:50
Project No:	Drawing No:	Revision:	
J26 - 30	002		