




The diagram below shows a basic example.
Explanation of particular details is given in the installation manuals etc.




Dimensions of space needed for service access are shown in the below diagram.





Please secure the unit firmly with 4 foundation (M10) bolts. (Bolts and washers must be purchased locally.)



Piping and wiring connections can be made from 4 directions: front, right, rear and below.

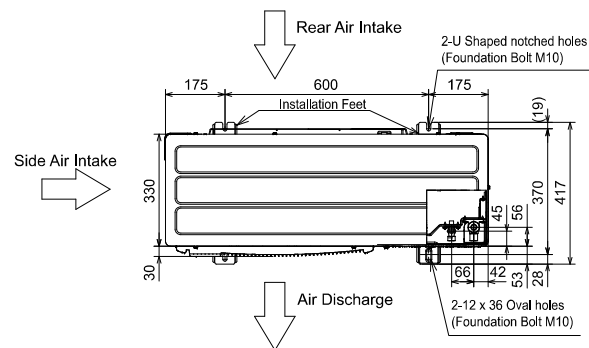

①...Refrigerant GAS pipe connection (FLARE)φ15.88(5/8 inch)
②...Refrigerant LIQUID pipe connection (FLARE)φ 9.52(3/8 inch)
*1 ...Indication of STOP VALVE connection location.

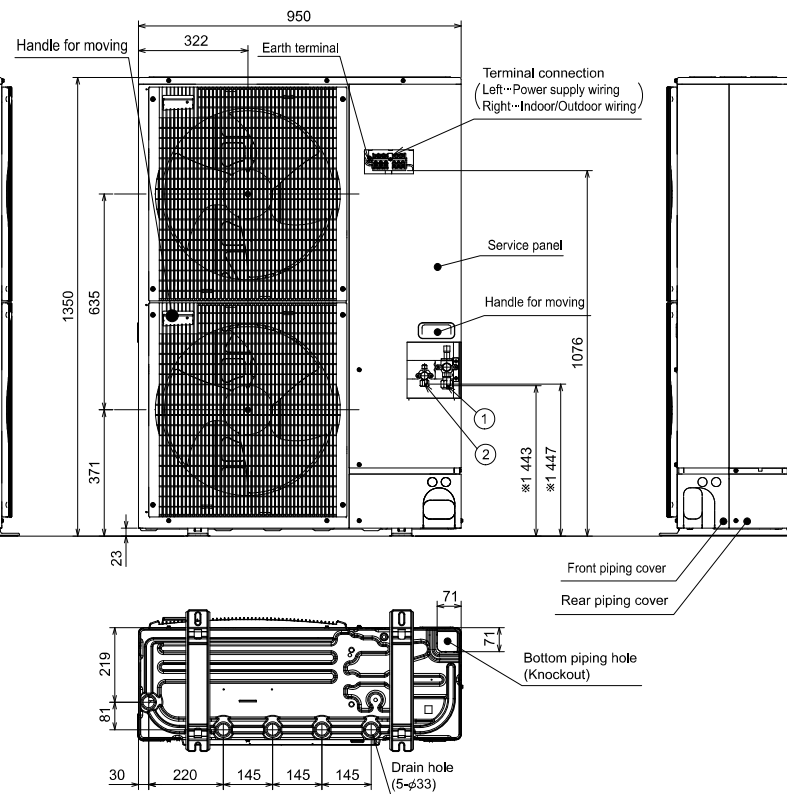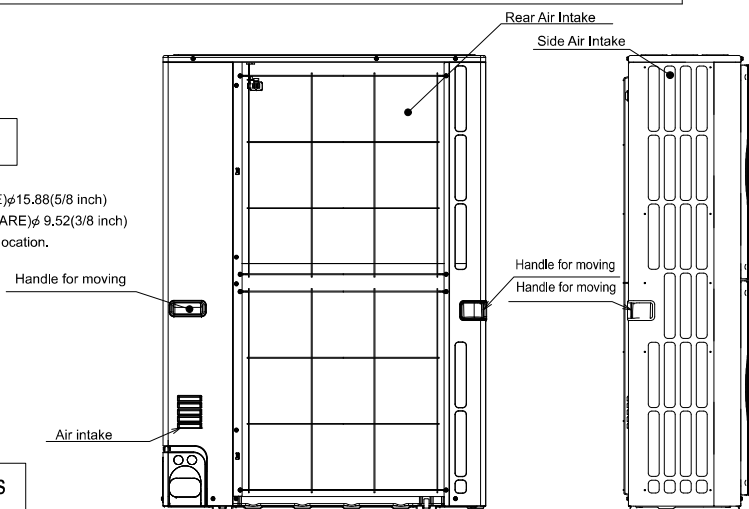

Unit : mm(inch)

PUHZ-P125VHA2.UK
PUHZ-P140VHA2.UK
PUHZ-P125VHA2.1.UK
PUHZ-P140VHA2.1.UK
PUHZ-P125VHA3.UK
PUHZ-P140VHA3.UK