




KEY

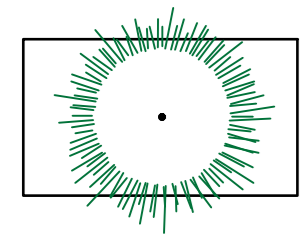


Proposed tree planting

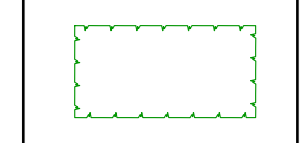


Proposed shrub planting

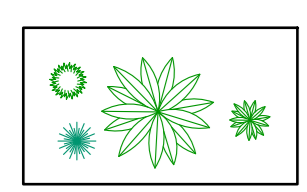


Proposed specimen shrubs

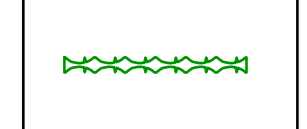


Proposed hedges

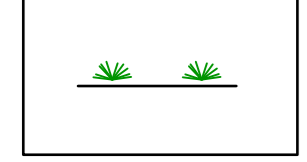

Climbers, Supplied ready trained on fan trellis.

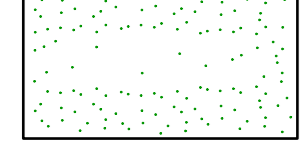

Grass

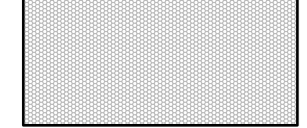

Decorative gravel / slate chippings over membrane

Plant Schedule						
Abbreviation	Species	Specification	Height	Pot Size	Density	Number of Plants
Trees						
BT	Betula utilis jacquemonti	150-425cm 12-14cm Heavy Standard: 3x	150-425cm	12 No.	12 No.	12 No.
MAGKO	Magnolia kobus	425-600cm 14-16cm Extra Heavy Standard: 3x	425-600cm	14 No.	14 No.	14 No.
MR	Malus 'Rudolph'	300-350cm 10-12cm Selected Standard: 2x	300-350cm	10 No.	10 No.	10 No.
PCC	Pinus callyeriana 'Chantrelle'	300-350cm 12-14cm Heavy Standard: 3x	300-350cm	12 No.	12 No.	12 No.
SALIN	Salix integra 'Hakuro-Nishiki'	150-175cm 1 Top grafted at 120cm	150-175cm	1 No.	1 No.	1 No.
Shrubs						
BTR	Berberis thunbergii 'Red Chief'	7 brks	30-40cm	3L	63 No.	63 No.
HAW	Hebe 'Mrs Winder'	7 brks	30-40cm	3L	63 No.	63 No.
PRULA	Prunus laurocerasus	30-40cm	3L	63 No.	63 No.	63 No.
HRE	Hebe 'Red Edge'	7 brks	30-40cm	3L	50 No.	50 No.
ESQ	Eumyrtus fortunei 'Silver Queen'	9 brks	30-40cm	3L	50 No.	50 No.
SS	Senecio 'Sunshine'	6 brks	30-40cm	3L	50 No.	50 No.
CARMO	Carex morrowii	TRIPLE CROWN	40-60cm	5.7.5L	161 No.	161 No.
PE	Potentilla fruticosa 'Elizabeth'	TRIPLE CROWN	40-60cm	5L	19 No.	19 No.
HYDPE	Hydrangea petiolaris	Ready trained on trellis	60-80cm	5L	19 No.	19 No.
SR	Skimmia japonica 'Rubella'	6 brks	40-60cm	5L	38 No.	38 No.
PLU	Prunus lusitanica	Double staggered row	60-80cm	5L	205 No.	205 No.
BS	Buxus sempervirens	Double staggered row	30-40cm	5L	552 No.	552 No.
RSK	Ribes sanguineum 'King Edward VII'	60-80cm	10L	15 No.	15 No.	15 No.
PF	Pieris 'Forest Flame'	60-80cm	10L	9 No.	9 No.	9 No.
EDS	Escallonia 'Donna's Sealing'	60-80cm	10L	13 No.	13 No.	13 No.
AV	Aucuba japonica 'Variegata'	60-80cm	10L	10 No.	10 No.	10 No.
CLEMOR	Clematis montana rubens	Ready trained on trellis	100-150cm	10L	4 No.	4 No.
BSS	Buxus sempervirens	supplied as a ball	30-40cm	10L	56 No.	56 No.
HELMIPP	Heuchera micrantha 'Palace Purple'	60-80cm	10L	29 No.	29 No.	29 No.
CHOAG	Choisya 'Artic Gold'	80-100cm	10L	33 No.	33 No.	33 No.
HYDPA	Hydrangea paniculata 'Little Lime'	Double Crown	60-100cm	10L	27 No.	27 No.
PSJ	Phormium 'Sunderland'	60-80cm	10L	12 No.	12 No.	12 No.
LMU	Lavandula angustifolia 'Munstead'	40-60cm	10L	86 No.	86 No.	86 No.
HEBWG	Hebe 'White Gem'	7 brks	40-60cm	10L	86 No.	86 No.
PHSP	Phormium 'Faint's Black'	Double Crown	60-80cm	10L	12 No.	12 No.
COE	Carex oshimensis 'Evergold'	60-80cm	10L	3 No.	3 No.	3 No.
BSC	Buxus sempervirens	supplied as a cone	80-100cm	15L	25 No.	25 No.
THUCORPA	Thuja orientalis 'Pyramidalis Aurea'	150-175cm	15L	18 No.	18 No.	18 No.
PHOB	Phormium 'Stonehenge Baby'	25L	5 No.	5 No.	5 No.	5 No.
PHOTEV	Phormium tenax 'Variegatum'	25L	5 No.	5 No.	5 No.	5 No.
Total: 1866 No.						
Conifers						
THUCORPA	Thuja orientalis 'Pyramidalis Aurea'	150-175cm	15L	No.	No.	18 No.
Total: 18 No.						

Climbers						
Abbreviation	Species	Specification	Height	Girth	Pot Size	Density
CLEMOR	Clematis montana rubens	Ready trained on trellis	100-150cm	10L	Counted	4 No.
HYDPE	Hydrangea petiolaris	Ready trained on trellis	60-80cm	5L	Counted	19 No.
Total: 13 No.						

Hedges						
Abbreviation	Species	Specification	Height	Girth	Pot Size	Density
BS	Buxus sempervirens	Double staggered row	30-40cm	5L	6m	552 No.
PLU	Prunus lusitanica	Double staggered row	60-80cm	5L	4m	205 No.
Total: 757 No.						

SEASON
 Work shall be carried out in accordance with the weather and soil conditions. Work shall not be carried out in exceptional dry or frosty weather or on other unsuitable conditions.

GROUND PREPARATION - GENERAL
 Preparing for topsoil
 Grading and cultivation shall be in accordance with BS 4428:1988 section 4. Subsoil shall be broken up to a depth of 12-14cm. Topsoil shall be brought to the surface by hand, by heavy rotary, by subsoil or by other means. A depth of 100mm of topsoil shall be laid over the subsoil. The topsoil shall be broken up to a depth of 100mm. The topsoil shall be broken up to a depth of 100mm. The topsoil shall be broken up to a depth of 100mm.

Subsoil grading
 Subsoil shall only be graded after loosening the soil, and the shall be undertaken by the use of a tractor and blade grader or larger areas and by a small mechanical grader or by hand. Subsoil shall be broken up to a depth of 100mm. The topsoil shall be broken up to a depth of 100mm. The topsoil shall be broken up to a depth of 100mm.

Supply of topsoil
 Topsoil shall be supplied to the site in accordance with BS 4428:1988 section 4. The topsoil shall be broken up to a depth of 100mm. The topsoil shall be broken up to a depth of 100mm. The topsoil shall be broken up to a depth of 100mm.

Temporary topsoil heaps
 Temporary topsoil heaps shall be provided in order that topsoil may be made before delivery commences. Topsoil shall conform to BS 4428:2015. Recommendations and classification for storage, class 1. The topsoil shall be free of weeds, roots or perennial weeds, pests, diseases, debris, tree roots, sticks, tubular and long metal, but shall be capable of being broken down to a 5th.

Spreading topsoil
 Prior to topsoil spreading the formation level shall be cleared of all stones, rubble, debris with any one dimension greater than 75mm. Areas to be seeded or turfed shall be covered by topsoil 100mm thick and areas to be planted shall be covered by topsoil 150mm thick. Topsoil shall be spread in an evenly compacted layer and shall be left to settle for 48 hours. Areas to be seeded with turf shall be dimension greater than 50mm throughout its depth. Unless otherwise stated the topsoil shall be 100mm above ground level. Topsoil shall be spread until the ground grade has been inspected by a Landscape Architect.

Planting
 The level of shrub bed topsoil to be finished 100mm below the proposed paving and grass and that when backfill is applied it does not rise above ground level. The level of shrub bed topsoil to be finished 100mm below the proposed paving and grass and that when backfill is applied it does not rise above ground level. The level of shrub bed topsoil to be finished 100mm below the proposed paving and grass and that when backfill is applied it does not rise above ground level.

Soil preparation
 Where directed compost, fertilisers or other additives shall be incorporated into the soil. Spent mushroom compost or other shall be spread to the specified thickness and incorporated by rotavating, into the 150mm. Fertilisers, organic or inorganic, shall be spread to the top 20mm.

Rejection of plants
 Plants not meeting the minimum requirements in BS 3088-1:1992 Specification for trees and shrubs and BS 3088-2:2007 Specification for trees and shrubs, which are the minimum requirements for landscape planting, do not meet the requirements of the Specification, or is unsuitable, or defective in any other way, shall be rejected. The minimum specification for the plants shall be as follows: Plants shall be healthy, well established, and free from any signs of disease, pests, or other damage. Plants shall be free from any signs of disease, pests, or other damage. Plants shall be free from any signs of disease, pests, or other damage.

Planting
 All plant material shall generally be planted between November and March in open cool weather. Planting shall be done in the morning, cloudy or overcast conditions. Where approved, pot or container grown plants may be planted outside the specified season, but adequate watering shall be applied. Torn or damaged roots and branches shall be clearly removed prior to planting.

Planting of shrubs, trees and plants
 The return of the material to be planted is variable and the contractor shall allow for watering in proper accordance with BS 4428:1988 section 7.7. Plants shall be planted in accordance with BS 4428:1988 section 7.7. Plants shall be planted in accordance with BS 4428:1988 section 7.7. Plants shall be planted in accordance with BS 4428:1988 section 7.7.

Planting within soft landscape areas
 The return of the material to be planted is variable and the contractor shall allow for watering in proper accordance with BS 4428:1988 section 7.7. Plants shall be planted in accordance with BS 4428:1988 section 7.7. Plants shall be planted in accordance with BS 4428:1988 section 7.7.

Compost for planting pits
 Compost shall be a proprietary product, bark based incorporating fertilisers and improving additive. The type of compost shall be approved before its delivery on site, and the supplier shall be approved. Compost shall be applied to the planting pits in accordance with the manufacturer's instructions. Compost shall be applied to the planting pits in accordance with the manufacturer's instructions.

Stakes for trees
 Stakes shall be poles round softwood, pointed, minimum diameter 70mm. The stakes shall be driven into the base of the tree and to planting the tree and backing. Stakes shall be driven into the base of the tree and to planting the tree and backing. Stakes shall be driven into the base of the tree and to planting the tree and backing.

Tree ties
 Tree ties shall be set straight and at the same depth as grown in the nursery. The ties shall be set straight and at the same depth as grown in the nursery. The ties shall be set straight and at the same depth as grown in the nursery.

Mulching
 A 75mm compacted layer of medium grade screened bark, with a particle size of not more than 100mm and containing no more than 10% fines, shall be spread to form a continuous layer covering the area of the tree, or the area of adjacent trees within grass shall be in the form of a circle of 600mm diameter around the base of the tree. Whips and standards shall be mulched with a 300mm diameter circle around the base of the tree. Where trees are planted within grass a circular heavy mulch shall be required beneath the tree, the mulch shall be the diameter of the tree, or the area of adjacent trees within grass shall be in the form of a circle of 600mm diameter around the base of the tree.

Soil preparation and cultivation
 All areas to be planted shall be cultivated to a depth of at least 100mm. All weeds, stones and refuse larger than 50mm shall be removed to Contractor's 10, and shall be brought to a site 100m. Allow for hand cultivation where machine work is not possible.

Turf
 Turf shall be extra-quality meadow turf and shall comply to BS 3089:1998 4.1:2013 and shall be laid in accordance with BS 4428:1988 section 6.5. Turfing. The Contractor shall supply a sample of the turf proposed to be used for approval. The Contractor shall ensure that all turfs are similar to the approved sample. The Contractor shall ensure that all turfs are similar to the approved sample.



Approved by: _____ Date: _____
 Copyright reserved

tba
 Landscape Architecture
 Trevor Bridge Associates Ltd
 Ashby Old Batts
 Stamford Street West
 Ashton-under-Lyne
 Lancs OL6 7FW
 Tel: 0161-804-2009
 E-mail: info@trevorbridge.co.uk

Project: **Union Street, Heckmondwike BAK Contracts**
 Title: **Landscape Proposals**

Date: **JULY 19** Scale(s): **1:200** Dwg no: **6065.01** Rev: **@**
 Dwn: **CW** Chk: **NC**