

Kirklees Flood Management & Drainage (Lead Local Flood Authority) – Statutory Consultation

Consultation on Application Number: 2018/91661

Address: Outline permission for residential development and facilitating engineering operations and full planning permission for access and spine road

Proposal: Land at Walkey Terrace and Brunswick Street, Heckmondwike

DC Officer: Glenn Wakefield

Drainage Officer: Paul Farndale

Comments

Kirklees Flood Management & Drainage OBJECTS to this application requiring FURTHER INFORMATION and DISCUSSION prior to finalising comments on this application.

Summary

Due to the size of the site an official Flood Risk Assessment should be submitted. This should concentrate on surface water flood risk mapping and drainage design against existing and proposed scenarios.

The application states an intention to discharge surface water to sewer. A drainage discussion document states two other possibilities that are preferable in the hierarchy of disposal. Both these systems require further investigation before consent to discharge can be granted.

An estimate of storage requirements and how and where these will be placed in the indicative layout plans is required, remembering that structures 1500mm or greater under the highway may preclude adoption agreements being signed with the Council.

A watercourse is shown to cross the site. Its size, condition and current and potential depth needs to be assessed so an appropriate stand off distance can be conditioned.

Land drainage to filled sections has to be considered at regular intervals as compaction takes place.

The site is subject to catchment surface water routes as well as on site flood routing through the design. The estate road is shown to fall toward properties at a lower level. A discussion around driveways falling to the road to create a through conduit is required.

Long sections for flood routing should not only be considered for the road but for the valley created to the bottom of the 'western' properties gardens. The flood risk assessment should describe areas of ponding and its safety and how property and curtilage should be avoided.

Land drainage for the toe of embankments should be considered. All these require outfalls (see above for acceptability).

SUDS drawings for driveways have been submitted. Unless these are looked after by a management company, the LLFA has to assume they will fail over time. They should also be removed from permitted development. Yorkshire Water currently does not accept permeable paving as a reduction of impermeable areas in section 104 agreements. The applicant therefore could find that attenuation has to include these areas and it should be clearly demonstrated that space can be made for water prior to agreeing detailed design under condition.

Suggested Conditions/ Section 106 Agreement

A meeting with the planning officer is now required to discuss the next actions and appropriate conditions going forward.

A section 106 agreement to manage drainage on site should it remain private or up to the date surface water drainage is formally adopted by an appropriate body (Statutory Undertaker). House of Commons Written Statement 161 which obliges the LPA to ensure this happens is now incorporated into NPPF

Signed: Paul Farndale

Date: 4th August 2018



FLOOD RISK ASSESSMENT

ON
**DEVELOPMENT OF RAILWAY CUTTING
HORTON STREET, HECKMONDWIKE**

ON BEHALF OF
YORKDALES 2 LTD

ARP ASSOCIATES

CHARTERED CONSULTING ENGINEERS

Northwest House 5/6 Northwest Business Park Servia Hill Leeds LS6 2QH




☎ 0113 245 8498

☎ 0113 244 3864

✉ leeds@arpassociates.co.uk

🌐 www.arpassociates.co.uk

Flood Risk Assessment on Development of Railway Cutting, Horton Street, Heckmondwike
1471/01r1

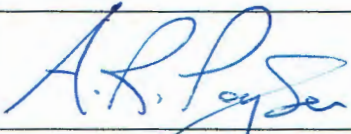Revision/Date	Initial Issue 10th November 2017	Revision A	Revision B	Revision C
Prepared By:	A R Poyser BSc (Hons) CEng MICE FCIHT			
Signature				
Checked By:	W M Walker BSc (Hons)			
Signature				
Reviewed By:	A Radcliffe BEng (Hons) CEng MIStructE			
Signature				

CONTENTS

		Page
1.0	Introduction	4
2.0	Walkover Survey	
	General	2.1 - 2.2 5
	Current Use	2.3 - 2.4 5
	Boundaries	2.5 - 2.6 5 - 6
	Topography	2.7 - 2.8 6
	Vegetation	2.9 - 2.10 6
	Drainage	2.11 - 2.12 6 - 7
3.0	Environment Agency Consultation	8 - 9
4.0	Water Authority Consultation	10 - 11
5.0	Land Drainage Authority Consultation	12 - 13
6.0	Material Consideration in Respect of NPPF and PPG	
	Flood Classification	6.1 - 6.2 14
	End Use	6.3 - 6.4 14
	Sequential Test	6.5 - 6.6 14
	Flood Sources	6.7 - 6.13 15 - 16
	Climate Change	6.14 - 6.16 16
	Flood Mitigation	6.17 16 - 17
	Sustainable Drainage	6.18 17 - 18
	Drainage	6.19 18
	Surface Water Discharge	6.20 18
	Proposed Surface Water Drainage	6.21 - 6.22 18 - 19
	Foul Drainage	6.23 19
	Emergency Egress During Times of Flood	6.24 - 6.25 19
7.0	Comments	20 - 21
APPENDICES		
Appendix A	Site Location Plan	
Appendix B	Topographical Survey	
Appendix C	Environment Agency Consultation	
Appendix D	Water Authority Consultation	
Appendix E	Land Drainage Authority Consultation	
Appendix F	Masterplan Layout	
Appendix G	Overflow Culvert Calculations	
Appendix H	Indicative Surface Water Calculations	

1.0 INTRODUCTION

- 1.1 Yorkdales 2 Ltd is proposing to redevelop the site of the former railway cutting at Heckmondwike for new residential dwellings. As part of the development appraisal and due to the evidence of water flow along the dismantled railway cutting, it was decided that a Flood Risk Assessment Report should be undertaken.
- 1.2 It is within the general development strategy of the country for development in areas where there is a risk of flooding to be assessed to avoid unnecessary increase in the requirement for flood defence. Under the National Planning Policy Framework (NPPF) and the Planning Practice Guidance (PPG), consultation is required with the Environment Agency, Land Drainage Authority and Water Authority and a Flood Risk Assessment Report should be prepared considering the development proposals and make recommendations for any flood mitigation measures.
- 1.3 ARP Associates have been appointed to carry out an assessment of the site, implement appropriate consultations and prepare a Flood Risk Assessment Report, in accordance with NPPF, to satisfy the requirements of the Planning Authority.
- 1.4 The consultations and walkover survey have been undertaken in September and October 2017.
- 1.5 The report has been initially prepared for the use and reliance of the Client only. The report shall not be relied upon or transferred to any other parties without the written agreement of ARP Associates. For the avoidance of any doubt, where ARP Associates enters into a letter of reliance for the benefit of a third party, that third party will be permitted to rely on the report. No responsibility will be accepted where this report is used, either in its entirety or in part, by any other party without ARP Associates consent.

2.0 WALKOVER SURVEY

General

- 2.1 The former dismantled railway cutting in Heckmondwike is a long narrow, approximately rectangular shaped, piece of land equating to an area of 2.58ha. The Ordnance Survey Grid Reference is 421950 423200.
- 2.2 A site location plan is presented in Appendix A.

Current Use

- 2.3 The site is currently derelict with no current use and is overgrown. The deep cutting of the former railway can be seen and there is a flat base at the bottom of the cutting where an informal walkway has been created. This is used for dog walkers and, apparently, during times of heavy storm, water flows along the rail track in a north to south direction. Access to the base of the cutting is from beyond Walkley Lane and then under the bridge.
- 2.4 It is also noted there is a worn trackway along the northern boundary used to link Walkley Terrace and Horton Lane, which is to the northeastern corner.

Boundaries

- 2.5 The site is situated in the residential and industrial area of Heckmondwike, and extends between bridges on Brunswick Street and Walkley Lane. The northwestern boundary is formed by the single arched stone bridge under Brunswick Street, whilst the southeast is formed by a double spanned steel beam construction under Walkley Lane. At this latter location, there is a large pipe conduit passing adjacent to the bridge and over the cutting.
- 2.6 The long northeastern boundary is formed by a post and wire fence, generally with woodland beyond, although residential development behind walls, fences and hedges is

present to the far northeastern and southeastern corners. Horton Street provides access from Brunswick Street to the new development and creates a step in the boundary of the development site. On the long southwestern boundary, this is formed by fences, walls and hedges of residential and industrial development.

Topography

- 2.7 The former cutting is very deep extending to around 18m below the northeastern boundary and around 10m below the southwestern boundary. There is a general fall from northwest to southeast, although the northeastern boundary rises up to a high point at around mid-point along the elevation and falls in both directions towards Brunswick Street and Walkley Terrace. A topographical survey is presented in Appendix B.
- 2.8 It should be noted that the earth level under and adjacent to Walkley Lane Bridge is higher than the general channel level to the former railway cutting and will act as a "dam" to any surface water flow through the site.

Vegetation

- 2.9 The site is overgrown with bushes, small trees, brambles and other similar plant growth. Some mature trees are located at isolated points along the southwestern boundary and there is woodland beyond the northeastern boundary.
- 2.10 Overhead electricity cables start from a timber pole towards the northeastern corner at Horton Lane and these pass over the woodland to the northeast. It is presumed that an underground cable extends to this point from Horton Lane.

Drainage

- 2.11 There is no obvious signs of a positive drainage system within the site and it is unlikely that land drainage will be present. Due to the steeply sliding slopes on the cutting, it is anticipated that a drainage system would have been present when the system was used for

the railway line. This could have been an open ditch, watercourse or pipeline extending towards the southwest.

2.12 The nearest watercourse is the River Spen approximately 500m to the south.

3.0 ENVIRONMENT AGENCY CONSULTATION

- 3.1 A consultation was requested from the Environment Agency (EA) and a copy of their response, under reference RFI/2017/61406, dated 23rd October 2017, is presented in Appendix C for reference purposes. The flood map for planning shows areas of land that may flood from rivers or sea. These areas do not take into account defences, as these can overtop or fail in extreme conditions.
- 3.2 The Flood Map for planning shows that the site falls within land assessed as having less than a 1 in 1000 annual probability of river or sea flooding in any year (less than 0.1%).
- 3.3 There is no flood history available and any records held by the Environment Agency are from watercourses which were surveyed after flood occurs. Therefore, other flooding may have occurred which is not shown on the plan.
- 3.4 Asset defences are located on the River Spen to the south and southwest of the site and those defences nearest to the site have a condition rating of 3 and 4. It is unlikely, however, for the site to benefit from these defences as no flooding from this source is likely to occur.
- 3.5 Extracts from the River Spen Flood Warning Improvement Study dated March 2009 was included and the two nodes closest to the site show the 1% plus climate change flood level as 51.384m and 50.002m A.O.D. The topographical survey for the development site shows levels well above the flood levels and, it is unlikely that flooding would affect the development area.
- 3.6 Reference is made to the new guidance on Climate Change Allowances for Flood Risk Assessments published in February 2016.

3.7 The risk of flooding from overland surface water was also provided and the map shows a 1 in 30 chance of flood extent on the base of the former cutting along the full length of the development. It is considered that this is the most suitable outlet for surface water from Heckmondwike to the north running mainly off Market Street, along the embankment and outfalling to the River Spen to the south of the scheme.

4.0 WATER AUTHORITY CONSULTATION

- 4.1 A consultation was requested from Yorkshire Water, who are the Water Authority for this area and a copy of their correspondence, under reference T016220 dated 1st October 2017, is presented in Appendix D for reference purposes.
- 4.2 Foul water can discharge to the 375mm diameter public combined sewer recorded in Walkley Terrace adjacent to the southeastern corner of the site.
- 4.3 In respect of surface water, attenuation is drawn to requirement H3 of the Building Regulations 2000. This establishes a preferred hierarchy for surface water disposal with consideration firstly be given to discharge to soakaway, infiltration system and watercourse in that priority order before consideration of discharge to sewers. Reference is also made to Sustainable Drainage Systems.
- 4.4 As the proposal site is currently undeveloped, no surface water is known to discharge to the public sewer network. As such, the local public sewer network does not have capacity to accept any surface water from the proposal site.
- 4.5 Yorkshire Water understand that culverted watercourses are located through the northern and southern parts of the site, and this appears to be the obvious place for surface water disposal.
- 4.6 Consultations are recommended from then Environment Agency, Land Drainage Authority/Internal Drainage Board with regard to surface water disposal from the development site with regard to surface water disposal from the development site.

4.7 Land and highway drainage have no right of connection to the public sewer network and no land drainage is to be connected or discharged to the public sewer. Yorkshire Water may accept highway drainage under certain circumstances if it can be demonstrated through satisfactory evidence that Sustainable Drainage Systems are not a viable option and there are no suitable watercourses to receive highway drainage. This may require a formal agreement with Yorkshire Water services under Section 114 of the Water Industry Act 1991.

5.0 LAND DRAINAGE AUTHORITY CONSULTATION

- 5.1 A consultation was requested from Kirklees Council, who are the Land Drainage Authority for this area, and a copy of their e-mail response, dated 26th September 2017, is presented in Appendix E for reference purposes.
- 5.2 It is confirmed that the site falls within Flood Zone 1 - low risk.
- 5.3 However, the site is subject to surface water flood risk for the 1 in 100 year event with significant flooding in the cutting as all surface water in the district falls to this low spot. There is ponding shown upstream of Brunswick Street and adjacent to Artillery Street to around 1.2m in flat areas before the flow splits and flows through the site. Depths for the 1 in 30 year event are also just as significant and only get worse for the 1 in 1000 year event.
- 5.4 Properties will have to be significantly raised for safety and an estimation on depths given against current topography is required to see if the same volumes can be accommodated in a clear through route. It will be necessary to assess levels along the slope on the site to avoid low spots where ponding may occur and affect property curtilage. It is important that the road and footpaths only become the conduits, and curtilage is safe.
- 5.5 A full assessment of the catchment is recommended remembering that it is assumed that sewers have some capacity before surcharging.
- 5.6 In respect of surface water disposal, the BGS data suggests infiltration will be problematic. A connection to watercourse should be explored but the nearest is the River Spen and 500m to the south. There is a possibility of tributaries and open ditches that are not recorded or part-recorded closer to the site and the Authority is aware of a surcharging system across the greenway, but are unsure of its status. An investigation from the River Spen for outfalls that could be traced to be located nearer to the site will be required. If this research comes up with no viable opportunities, then a combined sewer can be considered.

- 5.7 Reference is made to a large combined trunk sewer located under the Spen valley greenway but Yorkshire Water will have to be consulted on possibilities for connection. Greenfield discharge rates of 5l/s/ha would be the maximum permitted to any system and the figure could be much lower resulting in increased demands on attenuation. Any attenuation structure of 1500mm or greater in span under the highway will result in problems in forming a Section 38 Agreement with Kirklees Council. It is recommended that exploration of locating attenuation under landscaped areas is required. It will be necessary show that the drainage infrastructure is maintained and managed for the lifetime of the development. Even if the systems are offered for adoption under a Section 104 Agreement, this may not happen for a number of years and, therefore, an undertaking to form a Management Company with appropriate maintenance and management plans is to be provided, but this can cease at the point of adoption by the Statutory Undertaker.
- 5.8 A scheme to prevent pollution and flooding during the construction phase will be required as part of any Planning Condition.

6.0 MATERIAL CONSIDERATION IN RESPECT OF NPPF AND PPG

Flood Classification

- 6.1 The consultation with the Environment Agency and Land Drainage Authority has identified that the site falls within land assessed as having greater than a 1 in 1000 (0.1%) or greater annual probability of river or sea flooding. In accordance with Table 1 of the PPG, the site falls within Flood Zone 1 "low probability".
- 6.2 All forms of development are satisfactory within this Flood Zone, but consideration of surface water affects should be considered within any Flood Risk Assessment.

End Use

- 6.3 The development proposal is for the construction of residential development on the site, and a copy of the proposed masterplan layout is presented in Appendix F for reference.
- 6.4 When applying Table 2 of the PPG, the flood risk vulnerability classification shows that the proposed end use will fall into a "more vulnerable" classification.

Sequential Test

- 6.5 As set out in the NPPF, the aim of the Sequential Test is to steer new development to areas with the lowest probability of flooding (Zone 1).
- 6.6 When the site is evaluated in accordance with Table 3 of the PPG, the development shows that the Sequential Test is satisfied.

Flood Sources

- 6.7 Flooding from Rivers - The River Spen is around 500m to the south of the site and flooding from this source is considered to be unlikely.
- 6.8 Flooding from Local Watercourses - There are no known watercourses within or adjacent to the proposed development site although there may be informal tributaries providing routes for surface water to the River Spen and, if any of these are identified within or adjacent to the site, then flooding from this source will need to be considered.
- 6.9 Flooding from the Sea - The site is not located near enough to the sea to cause a problem of flooding from this source.
- 6.10 Flooding from Land - The land is situated within the residential and industrial areas on the site and these areas will have positive drainage systems. However, surface water overflow occurs from the northwest where surface water flows into the cutting and continues along through the site to the southeast. Therefore, flooding from this source will need to be considered.
- 6.11 Flooding from Groundwater - Whilst there is no ground investigation report, the Geological Survey Map of Great Britain for the area shows that the site is located on undifferentiated strata (siltstones, mudstones and sandstones) of the Lower Coal Measures with the upper stratum likely to be weathered to a cohesive material (Clay). These soils are likely to have poor infiltration properties and the presence of the surface water overflows over the land would confirm that these soils will be impermeable. Therefore, flooding from this source is considered to be low risk.
- 6.12 Flooding from Sewer - A new drainage system will need to be introduced onto the site and it is possible that any blockage will result in flooding from the lowest cover level of manholes or gullies. This will need to be considered as part of any proposed development.

- 6.13 Flooding from Reservoirs, Canals or Artificial Sources - There are no other reservoirs, canals or artificial sources which will result in flooding on the site.

Climate Change

- 6.14 The NPPF and PPG has indicated that the Global sea level will continue to rise, depending on greenhouse gas emissions, and the sensitivity of the climate system and there will be an increase in rainfall across the country. The PPG makes reference to the Environment Agency guidance for Climate Change and Table 2 makes an assessment of the increase in peak rainfall intensity. The guidance was changed in February 2016, and increases in rainfall of up to 40% should be considered in certain areas of the country.
- 6.15 Whilst no surface water is likely to extend into the site from the developed areas, water flow from the northwest along the base of the former railway cutting will need to be considered and some form of culvert to provide a route through for the water without causing upstream or downstream flooding will need to be considered. This being the case, only rainfall falling within the site boundaries will need to be considered in respect of climate change.
- 6.16 In accordance with the revised climate change figures, for an expected life of greater than 50 years for any new development, the anticipated increase in rainfall will be 30% at this location, and the drainage system should be designed in accordance with this requirement.

Flood Mitigation

- 6.17 The site falls within Flood Zone 1, and the Sequential Test is satisfied. Therefore, it is only necessary to take account of precautionary mitigation measures in relation to a catastrophic storm blockage of the proposed drainage system on the site, although details need to be prepared to accommodate the overland surface water flows during times of heavy storm. Therefore, the mitigation measures proposed are as follows:-

- 6.17.1 It is reported that water flows upstream of the site and adjacent to Artillery Street where the channel is flat, are in the order of 1.2m deep during times of storm and a calculation showing the section of culvert required to accommodate this flow through the bottom of the cutting is presented in Appendix G. This shows that a 1.65m diameter culvert will need to be placed along a straight grade from Brunswick Street to Walkley Lane to enable the capacity of the flow of water to continue as present. Due to the size of the culvert, it will also be necessary to prevent unauthorised access and appropriate grills/steel fencing will need to be installed on both ends of the culvert. It will also have to be located outside any highway boundary.
- 6.17.2 Floor levels to the properties shall be lifted above the top of the soffit of the culvert with no development located over the line of the pipe. On this basis, it is recommended that the finished floor level will be 600mm above the soffit of the culvert as a minimum.
- 6.17.3 Properties shall be designed without any basements and ground floors shall comprise solid concrete slabs or beam and block with screed construction.
- 6.17.4 Incoming electricity supplies shall be raised above ground floor level and ground floor electric sockets shall be served by loops from first floor level.
- 6.17.5 In the event of surface water run-off over the site, it would be necessary to design external levels to allow the flow to run to the southwestern corner following the natural fall of the land or to non-sensitive areas such as Public Open Space.

Sustainable Drainage

- 6.18 In order to comply with the requirements of NPPF, it is necessary to consider aspects of Sustainable Drainage techniques for the new development. No intrusive investigation of the ground conditions has been undertaken, but the Geological Survey Map of Great Britain

shows that the site is located on undifferentiated strata (siltstones, mudstones and sandstones) of the Lower Coal Measures with the upper stratum likely to be weathered to a cohesive material (Clay). These soils are likely to have poor infiltration characteristics and the known flow of water over the land during times of flood would suggest that the soils will not allow infiltration. Furthermore, it is known that the site will be infilled to a significant depth and any soakaways used on the site are likely to filter through the backfill and create potential problems around the culvert in relation to settlement of fill above. Therefore, it is assumed, for the purposes of this report, that a positive drainage system will be required.

Drainage

- 6.19 It is a requirement to ensure that surface water run-off from any proposed development has negligible consequence on downstream areas either in sewer capacity or discharge to watercourse.

Surface Water Discharge

- 6.20 In consultation with the Land Drainage Authority, the greenfield discharge rate shall be limited to 5l/s/ha. Based on the site area of 2.58ha, the proposed surface water discharge rate is 12.9l/s.

Proposed Surface Water Drainage

- 6.21 Whilst it will be necessary to undertake infiltration testing on the site to determine if the natural soils are suitable for soakaways, the known overflow of water during times of flood would suggest that the soils are impermeable. Furthermore, the site will be infilled to make the development construction practical, and it would be inappropriate to allow water to percolate through the fill over impermeable strata creating a "Well effect" below the development. Therefore, soakaways are considered to be an impractical solution for surface water discharge at this site. Furthermore, the nearest watercourse is 500m to the south and there is no obvious tributary to the River from the development on viewing the immediate

area. Therefore, consultations have commenced with Yorkshire Water to consider the possibility of a discharge to the public combined sewers in the vicinity around Walkley Lane. This correspondence is presented in Appendix D for reference purposes.

- 6.22 On the basis that an agreed surface water discharge rate of 12.9l/s can be negotiated, indicative calculations have been undertaken to determine the likely attenuation requirements for the new development site. The proposed development plan, which is presented in Appendix F, is insufficient to undertake detailed calculations of the proposed impermeable area and, therefore, it is assumed that 50% of the total site area (1.29ha) will become impermeable on completion of the development. On this basis, the indicative calculations have been carried out using the WinDES Source Control Computer Program and this shows that a volume of 324.7m³ will be required to be attenuated for the 1 in 30 year storm. This can be achieved by several methods, including oversize pipes, underground tanks or balance ponds. One such option would be to provide 113m of 2.4m x 1.2m box culvert or equivalent. It will also be necessary to show that the 1 in 100 year event plus 30% allowance for climate change can be retained on site without causing flooding of buildings or third party land. In a worst case scenario, the attenuation volume would need to increase to 649.9m³. The indicative surface water drainage calculations are presented in Appendix H, but detailed calculations and proposals will need to be prepared and submitted to the Planning Authority for approval prior to construction on site.

Foul Drainage

- 6.23 Foul drainage can discharge to the 375mm diameter public combined sewer recorded in Walkley Terrace adjacent to the southeast corner of the site.

Emergency Egress During Times of Flood

- 6.24 It is a requirement under the PPG that occupants should be able to egress any building during times of flood, without being trapped by flood conditions.
- 6.25 As the site falls within Flood Zone 1, no special mitigation measures are required in respect of emergency egress.

7.0 COMMENTS

- 7.1 The site falls within Flood Zone 1 and the Sequential Test is satisfied.
- 7.2 Flood mitigation measures are recommended in relation to the surface water overflow from the railway cutting, a catastrophic storm or blockage of the proposed drainage system. In these circumstances, the following mitigation measures are recommended.
- 7.2.1 The calculations show that a 1650mm diameter surface water culvert is required to be laid at a constant grade between the levels under Brunswick Street bridge and Walkley Lane bridge to accommodate overland surface water during times of storm.
- 7.2.2 Properties shall be raised a minimum of 600mm above the soffit of the new culvert.
- 7.2.3 Properties shall be designed without any basements and ground floors shall comprise solid concrete slabs or beam and block with screed construction.
- 7.2.4 Incoming electricity supplies shall be raised above ground floor level and ground floor electric sockets shall be served by loops from first floor level.
- 7.2.5 In the event of flooding of the site, it will be necessary to ensure that there is a route for flood water through to the southeastern corner or to non-sensitive areas such as Public Open Space without causing flooding to buildings.
- 7.3 A 30% increase in rainfall shall be incorporated into any new positive drainage system to satisfy the requirements of climate change.
- 7.4 Sustainable Drainage Systems of infiltration techniques are considered to be unsuitable on this particular site and there are no suitable watercourse outlets in the vicinity of the site. Therefore, the proposed surface water drainage system shall be restricted to the existing 5l/s/ha greenfield run-off rate and shall be attenuated for a minimum 1 in 30 year storm.

The 1 in 100 year storm plus climate change event shall also be accommodated within the system without causing flooding of buildings or third party land. Outfall into the combined sewers to the south of the site is being negotiated with Yorkshire Water at this time. The design, details and calculations shall be submitted to the Planning Authority for approval prior to construction on site.


- 7.5 Foul water can discharge to the existing 375mm diameter public combined sewer in Walkley Terrace.
- 7.6 There are no special requirements for emergency egress.
- 7.7 Subject to compliance with the above, the proposed development can satisfy the requirements of the National Planning Policy Framework and the Planning Practice Guidance in relation to flood risk.

APPENDIX A

SITE LOCATION PLAN



Location Plan 1:2500 @ A4



APPENDIX B

TOPOGRAPHICAL SURVEY



1	2	3	4	5
6	7	8	9	10
11	12	13	14	15
16	17	18	19	20

423200 N

423150 N

423100 N

423050 N

423000 N

423100 N

423050 N

423000 N

421800 E

421860 E

421900 E

421960 E

421960 E

APPENDIX C

ENVIRONMENT AGENCY CONSULTATION

Allan Poyser

From: Andrew Radcliffe
Sent: Monday 23 October, 2017 1:09 pm
To: Allan Poyser; Wayne Walker
Subject: FW: Your Enquiry: RFI/2017/61406
Attachments: flood risk & flood consequence assessments.pdf; Asset Defence Map - 61406.pdf; Asset Information - 61406.pdf; Flood Map for Planning - 61406.pdf; Modelled Measurements - 61406.pdf; Node Point Map - 61406.pdf; Surface Water - 61406.pdf

fyi

Kind Regards


Andrew
0113 245 8498
andrewradcliffe@arpassociates.co.uk



**ARP ASSOCIATES &
ARP GEOTECHNICAL LTD**

www.arpassociates.co.uk

5 & 6 Northwest Business Park, Servia Hill, Leeds LS6 2QH
Pre-planning Geotechnical Civil Engineering Structural Engineering

 Please consider the environment before printing this e-mail.

This e-mail is intended for the exclusive use of the individual(s) or entity to which it is addressed and contains confidential and/or privileged information. Any form of distribution, copying or use of this communication by anyone else is strictly prohibited. If you have received this communication in error please delete from your system and notify us immediately so that we can arrange for its return. Viruses: Although this e-mail and its attachments are believed to be free from any virus, it is the responsibility of the recipient(s) to conduct their own virus checks on all parts of this communication. ARP Associates and ARP Geotechnical Ltd accept no liability for loss or damage arising from their presence. ARP Associates is a trading division of ARP Geotechnical Ltd, a company registered in England and Wales with company number 3771811, whose registered office is at 5/6 Northwest Business Park, Servia Hill, Leeds LS6 2QH.

From: Reilly, Hilary [mailto:Hilary.Reilly@environment-agency.gov.uk]
Sent: Monday 23 October, 2017 11:47am
To: Leeds Assoc
Subject: Your Enquiry: RFI/2017/61406

Our Ref: RFI/2017/61406

Your Ref:

Dear Mr. Poyser

Provision of Product 4 (Ernest Gordon Ltd - Disused Railway Cutting, Heckmondwike)

Thank you for your request of 22nd September to use Environment Agency data, in the development of the above site. The information is attached.

If you have requested this information to help inform a development proposal, then you should note the detail in the attached advisory text on the use of Environment Agency Information for Flood Risk Assessments.

Supporting Information

The Flood Map for Planning

The Environment Agency provides the Flood Map (see enclosed extract).

What is the Flood Map for Planning?

The Flood Map for Planning provides information on flooding from rivers and the sea for England and Wales. The Flood Map also has information on flood defences and the areas benefiting from those flood defences.

The Flood Map for Planning shows the following:

1. Flood Zone 3 (dark blue area on the enclosed map): natural flood plain area that could be affected by flooding from rivers and/or the sea – not taking into account the presence of any flood defences
 - For flooding from rivers the map indicates the extent of a flood with a 1% (1 in 100) chance of happening each year;
 - For flooding from the sea the map shows the extent of a flood with a 0.5% (1 in 200) chance of happening each year.
2. Flood Zone 2 (light blue area): natural flood plain area that could be affected by flooding from rivers and/or the sea – not taking into account the presence of any flood defences. Flood Zone 2:
 - indicates the extent of a flood with a 0.1% (1 in 1000) chance of happening each year.
 - and/or indicates the greatest recorded historic flood, whichever is greater.
3. Flood defences built in the last five years to protect against river floods with a 1% (1 in 100) chance of happening each year, together with some natural or constructed entities which retain, store or channel water and which may protect against smaller floods.
4. Areas benefiting from flood defences - areas that benefit from the flood defences shown, in the event of a river flood with a 1% (1 in 100) chance of happening each year, or a flood from the sea with a 0.5% (1 in 200) chance of happening each year. If the defences were not there, these areas would flood.

Flood History

Flood History – None available

To the best of our knowledge there is no known flood history for this site. The extent of flooding, and/or flood level information is only shown for those watercourses surveyed after the flood. Other flooding may have occurred which is not shown. This is the best information currently available. For local drainage information please contact your water utility company and your local council.

Water causing flooding can come from different places, for example from rivers or the sea; surface water (i.e. rainwater flowing over or accumulating on the ground before it is able to enter rivers or the drainage system); overflowing or backing up of sewers or drainage systems which have been overwhelmed or from groundwater rising up from underground aquifers.

Currently the Environment Agency can only supply flood risk data relating to the risk of flooding from rivers or the sea. However you should be aware that in recent years, there has been an increase in flood damage caused by surface water flooding or drainage systems that have been overwhelmed. Local Authorities and/or Water Companies may be able to provide some knowledge on the risk of flooding from sources other than rivers and the sea and we are working with these organisations to improve knowledge and understanding of surface water flooding.

Assets

If no formal flood defences use:

We have no record of flood defences helping to reduce flood risk in your area of interest. However please find attached a map and asset information of the closest defences.

Asset Location Map

Please find attached asset map(s) showing location of all (Agency and non-Agency maintained) flood defences and channels.

Description of Works

See attached table with description of the defences and structures shown on the above drawing, including condition ratings, upstream and downstream crest levels, where available.

Risk of Flooding – Environment Agency Defences

The risk of flooding in this area is now reduced by the presence of flood defences that we maintain, but there still is a residual risk of flooding if these were to breach or be overtopped by a flood greater than that for which they were designed.

Risk of Flooding – Privately Maintained Defences

You will see that the Environment Agency does not maintain any of those defences. However we undertake regular risk based visual inspections. We do not hold design levels and have no height information on these defences or structures.

Asset Condition Ratings

The performance of a flood defence asset is recorded as the condition of the asset. Our asset inspectors subjectively assess the conditions of assets (during visual inspection site visits) with reference to a national standard template. Each asset is given a rating between one and five with one being very good condition and five being very poor. A condition rating of 3, or 'fair' is the minimal acceptable standard for a critical asset, such as a defence wall that protects properties. We are striving to improve all assets below 'fair' to an acceptable standard.

Asset inspections are done on average every six months, although some critical assets are assessed on a more regular basis. It is possible that adjacent assets are inspected on different dates, which may result in two assets of a similar state of repair having different condition ratings.

Condition ratings of assets may also be affected by the time of year the surveys are conducted, as vegetation may obscure the asset in the summer months, or accessibility may be an issue during winter months. These factors would not usually affect the recorded condition rating of an asset unless the asset is on a borderline between two ratings.

Asset Standard of Protection

Please note that the provided Design Standard of Protection is an estimate and should not be relied on. Please note that where available the defended flood extents provide more reliable information relating to the protection offered by the defence (i.e. at which return period the water levels are likely to overtop the defence). If available and required the defended flood extents can be provided on request.

Modelling

Modelling: Detailed Flood Plain Mapping Report

See enclosed extracts from River Spen Flood Warning Improvement Study produced by JBA in March 2009. Extracts include 20%, 10%, 4%, 2%, 1.33%, 1%, 1% +climate change and 0.1% annual probabilities.

Climate Change

Please note that new guidance on climate change allowances for Flood Risk Assessments has been published in February 2016.

The new guidelines are available from:

<https://www.gov.uk/guidance/flood-risk-assessments-climate-change-allowances>

Other

Surface Water Map

Risk of flooding from surface water information for Heckmondwike WF16 0LW

Thank you for your enquiry dated 28/09/17 regarding the above location.

Enclosed is a map of showing the risk of flooding from surface water for this area, produced in partnership with Local Authorities.

Surface water flood risk is widely distributed and can happen far from rivers and the sea. It's sometimes hard to say whether you're in an area at risk of flooding from surface water because surface water flooding can follow many more paths and can be affected by very small features such as kerb height and even speed bumps. We recommend you consider not only whether your property is shown in or near an area at risk, but also the broader scale and pattern of surface water flooding shown in your area. You may also wish to view this and other flood risk maps on our website.

Whether your property is at risk will depend on the accuracy of the mapping in this area, and on the details of your property – for example, how waterproof the structure is, the levels of doors and airbricks, and whether you have installed any flood resilience measures such as airbrick covers and flood boards.

If you require information on what is being done to manage surface water flood risk in your local area, please contact Kirklees Council.

Information Warning

Please note:

It is not possible to say for certain what the flood risk is but we use the best information available to provide an indication so that people can make informed choices about living with or managing the risks. The information we supply does not provide an indicator of flood risk at an individual property / site level.

The flood risk information provided on the attached map does not cover other sources of flooding such as from rivers and sea.

Risk of Flooding from Reservoirs Map

Outlines and simplified depth and velocity maps can be viewed on our website:

<http://watermaps.environment-agency.gov.uk/wiyby/wiyby.aspx?topic=reservoir&scale=1&textonly=off&ep=map&layerGroups=default&lang=e&y=355134&x=357683#x=438988&y=406600&scale=2>

Please, zoom into the location of interest, and then click on the inundated location for details. As a result a list of reservoirs will be provided with supporting information and a links to other data, such as estimated depths and speed of flooding, at the bottom of the result page.

A map of showing the outlines can also be provided on request.

Flood Warning

The site is covered by a Flood Warning. To register to receive this service, you can call Floodline 24 hours a day on 0845 988 1188.

LIDAR Data

Please note that our LiDAR data is now available free of charge (Open Data) from <http://environment.data.gov.uk/ds/survey/index.jsp#/survey> (once zoomed to the relevant location the available LiDAR products will be listed below the map).

Two LIDAR products are available:

1. Tiled LIDAR data - The full tiled dataset consists of historic LIDAR data which has been gathered since 1998. For some areas we have carried out repeat surveys and data is available in a range of resolutions.
2. Composite LIDAR data - The composite dataset is derived from a combination of our full tiled dataset which has been merged and re-sampled to give the best possible spatial coverage.

Light Detection and Ranging (LIDAR) is an airborne mapping technique, which uses a laser to measure the distance between the aircraft and the ground. This technique results in the production of an accurate, cost-effective terrain model suitable for assessing flood risk and other environmental applications.

The Environment Agency owns two LIDAR systems, which are installed in a survey aircraft along with its other operational remote sensing instruments.

The aircraft is positioned and navigated using Global Positioning System (GPS) corrected to known ground reference points. The aircraft typically flies at a height of about 800 metres above ground level and a scanning mirror allows a swath width of about 600 metres to be surveyed during a flight.

The Rights & Responsibilities of a Riverside Owner

The owner of property adjacent to a watercourse is usually deemed to be the riparian owner and, as such, has both riparian rights and responsibilities with regard to the watercourse within their ownership.

The responsibility for general maintenance and repair of the watercourse and its banks rests with the riparian owner. For more information on Rights and Responsibilities of a riverside owner, you can visit our website at: <https://www.gov.uk/government/organisations/environment-agency> go to the Flooding and coastal change section and click on 'Riverside ownership: rights and responsibilities ('living on the edge') under the River maintenance section and download the 'Living on the Edge' booklet.

Alternatively type the following address into your web browser:

<https://www.gov.uk/government/publications/riverside-ownership-rights-and-responsibilities>

Ordnance Survey Data

Under the terms of our licence agreement with the Ordnance Survey, we are unable to supply the OS data. Under this agreement we can only supply OS data to consultants/contractors carrying out work on our behalf.

Flood Portal

It's a new 'one-stop shop' web portal providing guidance and information on flood risk management in the UK. Arup have written and designed the site, in conjunction with CIRIA, the Local Government Association, the EA and Defra, primarily as a resource for local authority officers, flood risk management professionals, and others with an interest in flood risk. It's a part of the Capacity Building Strategy.

<http://www.local.gov.uk/floodportal>

This information is provided subject to the Open Government Licence ([here](#)) - please read for details of permitted use.

If you have any queries or would like to discuss the content of this letter further please contact us on the telephone number below.

We would be really grateful if you could spare five minutes to help us improve our service. Please click on the link below and fill in our survey – we use every piece of feedback we receive:

<http://www.smartsurvey.co.uk/s/EnvironmentAgencyCustomerSurvey/?a=Y>

Yours sincerely,

Hilary Reilly/Customer Engagement Team

Environment Agency | Lateral, 8 City Walk, Leeds, LS11 9AT

Enquiries Team Tel: 0208 4748174 / Email: neyorkshire@environment-agency.gov.uk


Direct Tel: 0208 4747695 / Email: hilary.reilly@environment-agency.gov.uk

Information in this message may be confidential and may be legally privileged. If you have received this message by mistake, please notify the sender immediately, delete it and do not copy it to anyone else.

We have checked this email and its attachments for viruses. But you should still check any attachment before opening it.

We may have to make this message and any reply to it public if asked to under the Freedom of Information Act, Data Protection Act or for litigation. Email messages and attachments sent to or from any Environment Agency address may also be accessed by someone other than the sender or recipient, for business purposes.

Click [here](#) to report this email as spam

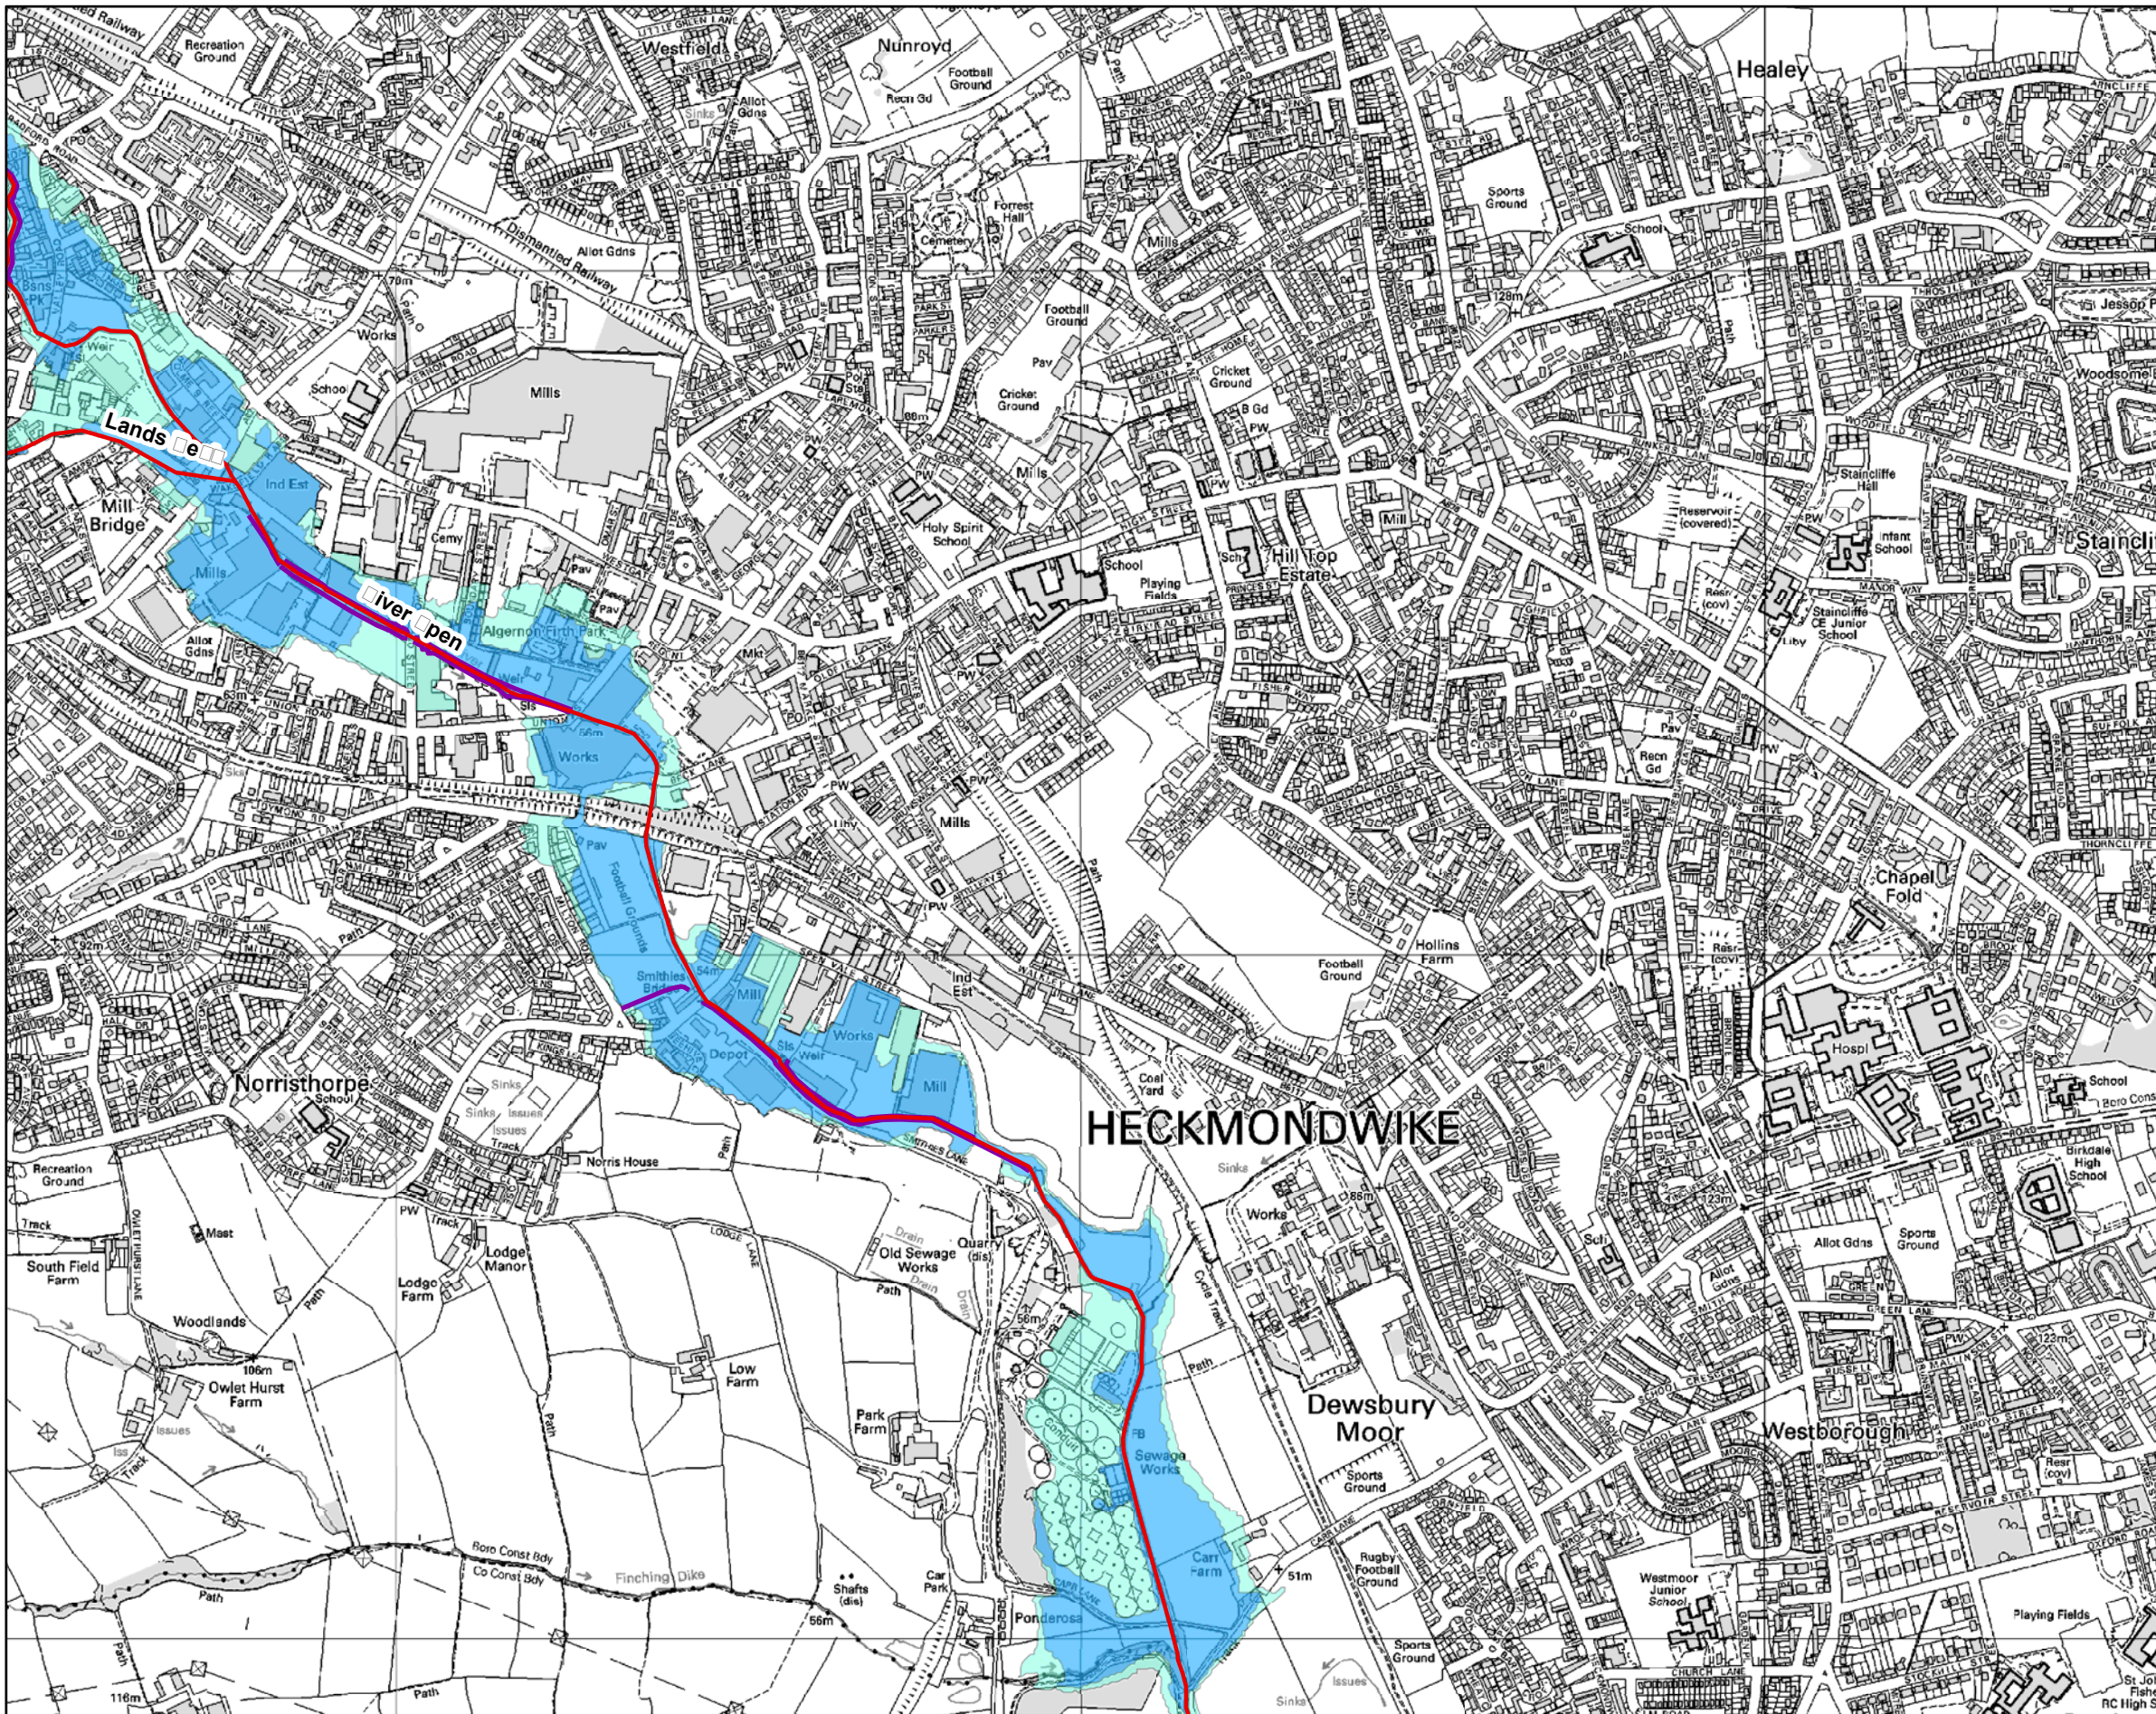

www.environment-agency.gov.uk

Scale: 1:10,000

when reproduced @ A3



- L □ □ □ □ D**
- Main River
 - Flood Map Flood Defences
 - Areas Benefiting From Flood Defences
 - Flood Storage Areas
 - Flood Zone 3 (F03)
 - Flood Zone 2 (F02)

Asset Information




Asset ID	Asset Type	Asset Sub-Type	Maintainer	Description	Span	Design Standard Elevation m	Downstream Rest Level m	Upstream Rest Level m	Condition Rating
50691	Defence	High Ground	Private	Natural Channel With Gabions D/S	Left	50	No data	No data	4
54042	Defence	Wall	Private	Open Channel With Flood Wall	Right	No data	No data	No data	4
28299	Defence	Wall	Environment Agency	Walled Channel	Left	50	53.150	53.150	4
28351	Defence	Wall	Environment Agency	Sheet Piles And Masonry Wall	Right	50	53.300	54.260	3
52203	Defence	Embankment	Environment Agency	Floodbank. Raised Floodbank Boundary To The Playing Field Washland, Protects Housing Adjacent To Smithies Bridge.	Right	50	54.502	55.230	2
28352	Defence	High Ground	Private	Open And Natural Channel	Right	50	No data	No data	3
28300	Channel	Simple Culvert	Private	Culvert	n/a	50	No data	No data	3
52535	Channel	Simple Culvert	Private	Box Culvert.	n/a	50	No data	No data	4
28228	Channel	Simple Culvert	Local Authority	Road Bridge	n/a	50	No data	No data	4
174748	Defence	High Ground	Private	Natural Channel	Right	50	No data	No data	4
143963	Defence	High Ground	Private	Maintained Channel With Walls	Left	50	53.150	54.760	4
401213	Defence	Bridge Abutment	Private	Bridge Abutment	Right	No data	No data	No data	2
401215	Defence	Wall	Environment Agency	Wall. (Between Bridge And House)	Right	No data	54.595	54.595	2
401216	Defence	Wall	Private	Terrace House End Wall Acting As Flood Defence.	Right	No data	No data	No data	1
401219	Defence	Wall	Environment Agency	Wall (Tie In Between House And Embankment)	Right	No data	54.575	54.575	2
143030	Defence	High Ground	Private	Walled Channel Side	Left	50	No data	No data	4
143031	Defence	High Ground	Private	Walled Channel Side	Right	50	No data	No data	3
52204	Defence	Wall	Private	Walled Channel With Culvert	Right	50	57.080	58.560	3
50692	Defence	Wall	Private	Walled Channel - Includes Culvert And Road Bridges	Left	50	57.070	57.600	3


Modelled Measurements

2009 River Spen Model Results

Label	annal pro a ilit		ann al pro a ilit		ann al pro a ilit		ann al pro a ilit		ann al		ann al pro a ilit		ann al		ann al pro a ilit	
	Ma ta e	Ma lo	Ma ta e	Ma lo	Ma ta e	Ma lo	Ma ta e	Ma lo	Ma ta e	Ma lo	Ma ta e	Ma lo	Ma ta e	Ma lo	Ma ta e	Ma lo
SPEN013899u	55.15	18.66	55.307	20.361	55.509	22.907	55.632	24.258	55.717	24.575	55.776	24.857	56.041	26.096	56.889	26.511
SPEN013899d	55.15	18.66	55.307	20.361	55.508	22.907	55.625	24.258	55.676	24.575	55.72	24.857	55.988	26.096	56.843	26.511
SPEN013713	54.081	12.785	54.165	13.421	54.25	15.256	54.296	16.665	54.319	17.364	54.333	17.918	54.402	21.233	54.63	34.413
SPEN013485	53.169	20.257	53.214	21.71	53.331	23.261	53.387	24.417	53.419	25.121	53.441	25.426	53.56	28.231	54.065	32.574
SPEN013233	51.925	20.252	52.018	21.638	52.369	26.679	52.525	28.918	52.622	29.074	52.672	29.297	52.934	30.185	53.827	31.348
SPEN012989u	49.97	20.233	50.092	21.612	50.563	26.948	50.767	28.634	50.926	29.354	51.014	29.414	51.384	29.638	52.042	30.629
SPEN012784u	49.115	18.383	49.198	18.773	49.436	20.086	49.551	20.719	49.648	20.731	49.718	20.706	50.002	20.506	50.663	25.082
SPEN012784d	49.11	18.383	49.187	18.773	49.396	20.086	49.494	20.719	49.58	20.731	49.631	20.706	49.885	20.506	50.536	25.082
SPEN012539u	48.021	21.856	48.124	22.641	48.33	23.747	48.458	24.202	48.536	24.433	48.586	24.52	48.824	25.076	49.465	26.698
LAND010335	64.691	2.14	64.772	2.53	64.868	3.05	64.934	3.45	64.972	3.69	64.998	3.86	65.115	4.632	65.474	8.08
LAND010297	64.065	2.137	64.12	2.53	64.185	3.05	64.23	3.449	64.257	3.689	64.271	3.859	64.482	4.63	64.74	7.906
LAND010249	62.258	2.138	62.355	2.53	62.626	3.049	63.25	3.43	63.612	3.67	63.815	3.834	64.373	4.259	64.626	4.333
LAND010189	60.741	2.138	60.881	2.53	61.229	3.048	61.611	3.43	61.733	3.67	61.766	3.834	61.869	4.259	62.084	4.333
LAND010162	60.135	2.138	60.256	2.53	60.878	3.044	61.397	3.418	61.549	3.541	61.59	3.562	61.71	3.573	61.907	3.503

Legend

-  Flood Extent 1 in 30
-  Flood Extent 1 in 100
-  Flood Extent 1 in 1000



**Use of Environment Agency Information for Flood Risk and Flood
Consequence Assessments**

Important

If you have requested this information to help inform a development proposal, then we recommend that you undertake a formal pre-application enquiry using the form available from our website:-

<http://www.environment-agency.gov.uk/research/planning/33580.asp>

Depending on the enquiry, we may also provide advice on other issues related to our responsibilities including flooding, waste, land contamination, water quality, biodiversity, navigation, pollution, water resources, foul drainage or Environmental Impact Assessment.

In **England**, you should refer to the Environment Agency's Flood Risk Standing Advice, the technical guidance to the National Planning Policy Framework and the existing PPS25 Practice Guide for information about what flood risk assessment is needed for new development in the different Flood Zones. These documents can be accessed via:

<http://www.environment-agency.gov.uk/research/planning/82587.asp>

<http://www.communities.gov.uk/publications/planningandbuilding/nppftechnicalguidance>

<http://www.communities.gov.uk/publications/planningandbuilding/pps25guideupdate>

You should also consult the Strategic Flood Risk Assessment produced by your local planning authority.

In **Wales** you should refer to TAN15 for information about what flood consequence assessment is needed for new development in the different flood zones

<http://new.wales.gov.uk/splash?sessionid=8ylGTfG&thmB0t2vhp6hS1GcB1L&v=B3Ylc&f20&n7LK3&K0nMk981825250&orig=/topics/planning/policy/tans/tan15/>

You should also consult the Strategic Flood Consequence Assessment if one has been produced by your local planning authority.

In both **inland and Wales** you should note that:

1. Information supplied by the Environment Agency may be used to assist in producing a Flood Risk / Consequence Assessment (FRA / FCA) where one is required, but does not constitute such an assessment on its own.
2. This information covers flood risk from main rivers and the sea, and you will need to consider other potential sources of flooding, such as groundwater or overland runoff. The information produced by the local planning authority referred to above may assist here.
3. Where a planning application requires a FRA / FCA and this is not submitted or deficient, the Environment Agency may well raise an objection.
4. For more significant proposals in higher flood risk areas, we would be pleased to discuss details with you ahead of making any planning application, and you should also discuss the matter with your local planning authority.

APPENDIX D

WATER AUTHORITY CONSULTATION



YorkshireWater

Mr Poyser
Partners
Unit 10 Portwest Business Park
100 Liversia Hill
Woodhouse
Leeds
LS11 3JL

Yorkshire Water Services
Developer Services
Engineering & Technical Team
PO Box 100
Bradford
BD7 4DQ

Telephone 0113 275 1000
Fax 0113 275 1001

Our reference 1000000000
Our ref 1000000000

mail
Engineering & Technical Services
Yorkshire Water Services

For telephone enquiries ring
Chris Roberts on 0113 275 1000

St Peter

Dear Mr Poyser,

Disused Millfield Mill Lane Woodhouse Lane Woodhouse Lane Woodhouse Lane
Woodhouse Lane

Thank you for your recent enquiry. Our charge of £153.00 (plus VAT) will be added to your account with us, reference ARP013. You will receive an invoice for your account in due course.

Please find enclosed a complimentary extract from the Statutory Sewer Map which indicates the recorded position of the public sewers. Please note that as of October 2011 and the private to public sewer transfer, there are many uncharted Yorkshire Water assets currently not shown on our records. The following comments reflect our view, with regard to the public sewer network only, based on a 'desk top' study of the site and are valid for a maximum period of twelve months.

Development of the site should take place with separate systems for foul and surface water drainage. The separate systems should extend to the points of discharge to be agreed.

Foul Water

Foul water domestic waste should discharge to the 375 mm diameter public combined sewer recorded in Walkley Terrace, at a point to the south east the site.

Surface Water

The developer's attention is drawn to Requirement H3 of the Building Regulations 2000. This establishes a preferred hierarchy for surface water disposal. Consideration should firstly be given to discharge to soakaway, infiltration system and watercourse in that priority order.

Sustainable Drainage Systems (SuDS), for example the use of soakaways and/or permeable hardstanding etc, may be a suitable solution for surface water disposal appropriate in this situation. You are advised to seek comments on the suitability of SuDS in this instance from the appropriate authorities.

As the proposal site is currently undeveloped no surface water is known to discharged to the public sewer network





As such, the local public sewer network does not have capacity to accept any surface water from the proposed site. If SuDS are not viable, the developer is advised to contact the Environment Agency/local Land Drainage Authority/Internal Drainage Board with a view to establishing a suitable watercourse for discharge.

It is understood that a culverted watercourse is located through the northern and southern parts of the site. This appears to be the obvious place for surface water disposal (if SuDS are not viable).

Please note further restrictions on surface water disposal from the site may be imposed by other parties. You are strongly advised to seek advice/comments from the Environment Agency/Land Drainage Authority/Internal Drainage Board, with regard to surface water disposal from the site.

Other observations

Any new connection to an existing public sewer will require the prior approval of Yorkshire Water. You may obtain an application form from our website (www.yorkshirewater.com) or by telephoning 0345 120 84 82.

An off-site foul and surface water sewer may be required which may be provided by the developer and considered for adoption under Section 104 of the Water Industry Act 1991. Please telephone 0345 120 84 82 for advice on sewer adoptions. Alternatively, the developer may in certain circumstances be able to requisition off-site sewers under Section 98 of the Water Industry Act 1991 for which an application must be made in writing. For further information, please telephone 0345 120 84 82.

Prospectively adoptable sewers and pumping stations must be designed and constructed in accordance with the WRc publication "Sewers for Adoption - a design and construction guide for developers" 6th Edition as supplemented by Yorkshire Water's requirements, pursuant to an agreement under Section 104 of the Water Industry Act 1991. An application to enter into a Section 104 agreement must be made in writing prior to any works commencing on site. Please contact our Developer Services Team (telephone 0345 120 84 82) for further information.

The public sewer network is for domestic sewage purposes. This generally means foul water for domestic purposes and, where a suitable surface water or combined sewer is available, surface water from the roofs of buildings together with surface water from paved areas of land appurtenant to those buildings. Land and highway drainage have no right of connection to the public sewer network. No land drainage to be connected/discharged to public sewer.

As a last resort, highway drainage may be accepted under certain circumstances. If it can be demonstrated, through satisfactory evidence, that SuDS are not a viable option, there are no watercourses or highway drains available and if capacity is available within the public sewer network, highway drainage discharges to the public sewer network may be permitted. In this event, the developer may be required to enter into a formal agreement with Yorkshire Water Services under Section 115 Water Industry Act 1991 to discharge non-domestic flows into the public sewer network.

All the above comments are based upon the information and records available at the present time. The information contained in this letter together with that shown on any extract from the Statutory Sewer Map that may be enclosed is believed to be correct and is supplied in good faith.



YorkshireWater

Please note that capacity in the public sewer network is not reserved for specific future development. It is used up on a 'first come, first served' basis. You should visit the site and establish the line and level of any public sewers affecting your proposals before the commencement of any design work.

Yours sincerely

Chris Roberts
Senior Project Engineer
Developer Services





ARP Associates 5 & 6 Northwest Business Park, Servia Hill, Leeds, LS6 2QH
c 0113 245 8498 a 0113 244 3864 m leeds@arpassociates.co.uk w www.arpassociates.co.uk

Mr C Roberts
Yorkshire Water Services Ltd
Developer Services
PO Box 52
Bradford
BD3 7AY

BY E-MAIL

Your Ref: T016220

Our Ref: 1471/01/ARPjc

9th November 2017

Dear Chris

Yorkdales 2 Ltd
Disused Railway Cutting off Walkley Lane, Heckmondwike
Pre-Planning Sewerage Enquiry on R713401

We refer to your pre-planning consultation of the 1st October 2017, regarding the development of the above site.

We note your comments regarding Requirement H3 of Building Regulations 2000 and the standard hierarchy of surface water disposal from the new development. Whilst no intrusive soils investigation or infiltration testing has been undertaken, it is known that the general geology of the site is undifferentiated strata (siltstones, mudstones and sandstones) of the Lower Coal Measures with the upper stratum likely to be weathered to a cohesive material (clay). These soils are likely to have poor infiltration properties and the presence of surface water overflow over the bottom of the railway cutting, during times of storm, suggests that the natural soils are impermeable. Furthermore, there are no suitable watercourses in the immediate vicinity of the site with the River Spen in the order of 500m to the south. You refer to a culverted watercourse through the northern and southern parts of the site, but this has not been identified by Kirklees Council, as Land Drainage Authority.

Therefore, we accept that the site is currently undeveloped and no surface water is known to discharge to the public sewer network, but would request that consideration is given to a connection to the combined sewers in either Walkley Lane or Walkley Terrace at an appropriate discharge rate.

Based on a rate of 5l/s/ha, the 2.58ha site would realise a discharge rate of 12.9l/s. This would be an ideal discharge rate for the development, but appreciate that this is dependent upon the capacity of the existing drainage system within the vicinity of the development to receive surface water discharge.



We thank you for your consideration of the above proposal and look forward to your early response. However, if you wish to discuss the matter over the telephone, please do not hesitate to contact us.

Yours sincerely
for ARP ASSOCIATES

A R Poyser

APPENDIX E

LAND DRAINAGE AUTHORITY CONSULTATION

Allan Poyser

From: Paul Farndale <Paul.Farndale@kirklees.gov.uk>
Sent: Tuesday 26 September, 2017 4:17 pm
To: Allan Poyser
Subject: RE: 800/582 Disused Railway cutting, Heckmondwike

Hello Allan,

Hope you are well.

Main River Flood Zone 1 – Low Risk

Surface Water Flood Risk Mapping 3rd generation 1 in 100 year event shows significant flooding in the cutting as all surface water in the district falls to the low spot. There is ponding prior to the site with depths shown upstream of Brunswick Street upto 1.2m deep. Depths along the central valley thereafter vary but show over 1.2 metres deep adjacent to Artillery Street before flows split, depths continue to be significant as flows converge thereafter.

Depths for the 1 in 30 year event are also just as significant and only get worse for the 1 in 1000.

If this site is to be promoted properties will have to be significantly raised for safety. Looking at the layout, an estimation on depths given against current topography is required and to see if the same volumes can be accommodated in a clear through route.

It is noted that there is generally a slope toward the footpath and a slope along the site. However there are some low spots that will cause ponding and affect property curtilage. Such area should be adjusted so that the road and footpath only become the conduits and curtilage is safe. E.g. Lateral Street C to become the low spot and not across plots 70-75 putting them at risk.

A full assessment of the catchment is recommended remembering that it is assumed that sewers have some capacity but are surcharging.

Surface Water Disposal

BGS Data suggests infiltration will be problematic.

A connection to watercourse can be explored. However the enmaind watercourse River Spen is 500m to the south. There is a possibility of tributaries and open ditches that are not recorded or part recorded closer to the site. We are aware of a surcharging system across the Greenway but are unsure of its status, it is currently not fit for purpose to accept discharges from a large development. We expect an investigation from the Spen for outfalls that could be traced to be located closer to the site.

If this research comes up with no viable opportunities then combined sewer can be considered. Please note there is a large combined trunk sewer located under the Spen Valley Greenway. Yorkshire Water will have to be consulted on the possibilities for connection. This is a recently laid trunk sewer diverting flows from a defunct treatment works to an alternative.

It is likely therefore that greenfield discharge rates of 5l/s/ha will be the maximum permitted to any system and the figure could be much lower resulting in increased demands on attenuation. Any attenuation 1500mm or greater in span under the highway will result in problems in forming a section 38 agreement with Kirklees Council. An exploration of locating attenuation under land scaped areas is required. Liaison with Landscape Management as well as drainage is advised so this area can perform two roles, storage and public amenity.

Section 106 Undertaking/Agreement

The LPA is obligated to ensure that the drainage infrastructure is maintained and managed for the lifetime of the development. Even if it is proposed that surface water systems will be offered for adoption, this may not happen for a number of years or agreements are not arrived at or the statutory undertaker is unhappy with aspects of construction. It is expected therefore that an undertaking to form a management company with an appropriate maintenance and management plan is provided which can cease at the point of adoption by the statutory undertaker.

Temporary Drainage

A scheme to prevent pollution and flooding during the construction phase will be required but can be conditioned.

Regards,

Paul Farndale
Principal Engineer
Flood Management & Drainage
Investment & Regeneration Service
Kirklees Council
01484 221000

From: Allan Poyser [mailto:AllanPoyser@arpassociates.co.uk]
Sent: 21 September 2017 08:25
To: Paul Farndale
Cc: Wayne Walker; Paul Carter
Subject: 800/582 Disused Railway cutting, Heckmondwike

Dear Paul

Please see the attached request for a pre-planning consultation for the above site. We are aware a surface water flow through the site and would appreciate your comment on the situation.


Kind Regards

Allan Poyser
0113 245 8498
allanpoyser@arpassociates.co.uk

**ARP ASSOCIATES &
ARP GEOTECHNICAL LTD**

www.arpassociates.co.uk

5/6 Northwest Business Park, Servia Hill, Leeds LS6 2QH
Pre-planning Geotechnical Civil Engineering Structural Engineering

 Please consider the environment before printing this email.

This email is intended for the exclusive use of the individual(s) or entity to which it is addressed and contains confidential and/or privileged information. Any form of distribution, copying or use of this communication by anyone else is strictly prohibited. If you have received this communication in error please delete from your system and notify us immediately so that we can arrange for its return. Viruses: Although this email and its attachments are believed to be free from any virus, it is the responsibility of the recipient(s) to conduct their own virus checks on all parts of this communication. ARP Associates and ARP Geotechnical

Ltd accept no liability for loss or damage arising from their presence. ARP Associates is a trading division of ARP Geotechnical Ltd, a company registered in England and Wales with company number 3771811, whose registered office is at 5/6 Northwest Business Park, Servia Hill, Leeds LS6 2QH.




[Website](#) | [News](#) | [Email Updates](#) | [Facebook](#) | [Twitter](#)

This email and any attachments are confidential. If you have received this email in error – please notify the sender immediately, delete it from your system, and do not use, copy or disclose the information in any way. Kirklees Council monitors all emails sent or received.


APPENDIX F

MASTERPLAN LAYOUT



- 3 Bedroom 4P Dwelling - 41
- 3 Bedroom 6P Dwelling - 24
- 4 Bedroom 7P Dwelling - 25
- 5 Bedroom 8P Dwelling - 6

Each dwelling has 2 off road parking spaces.

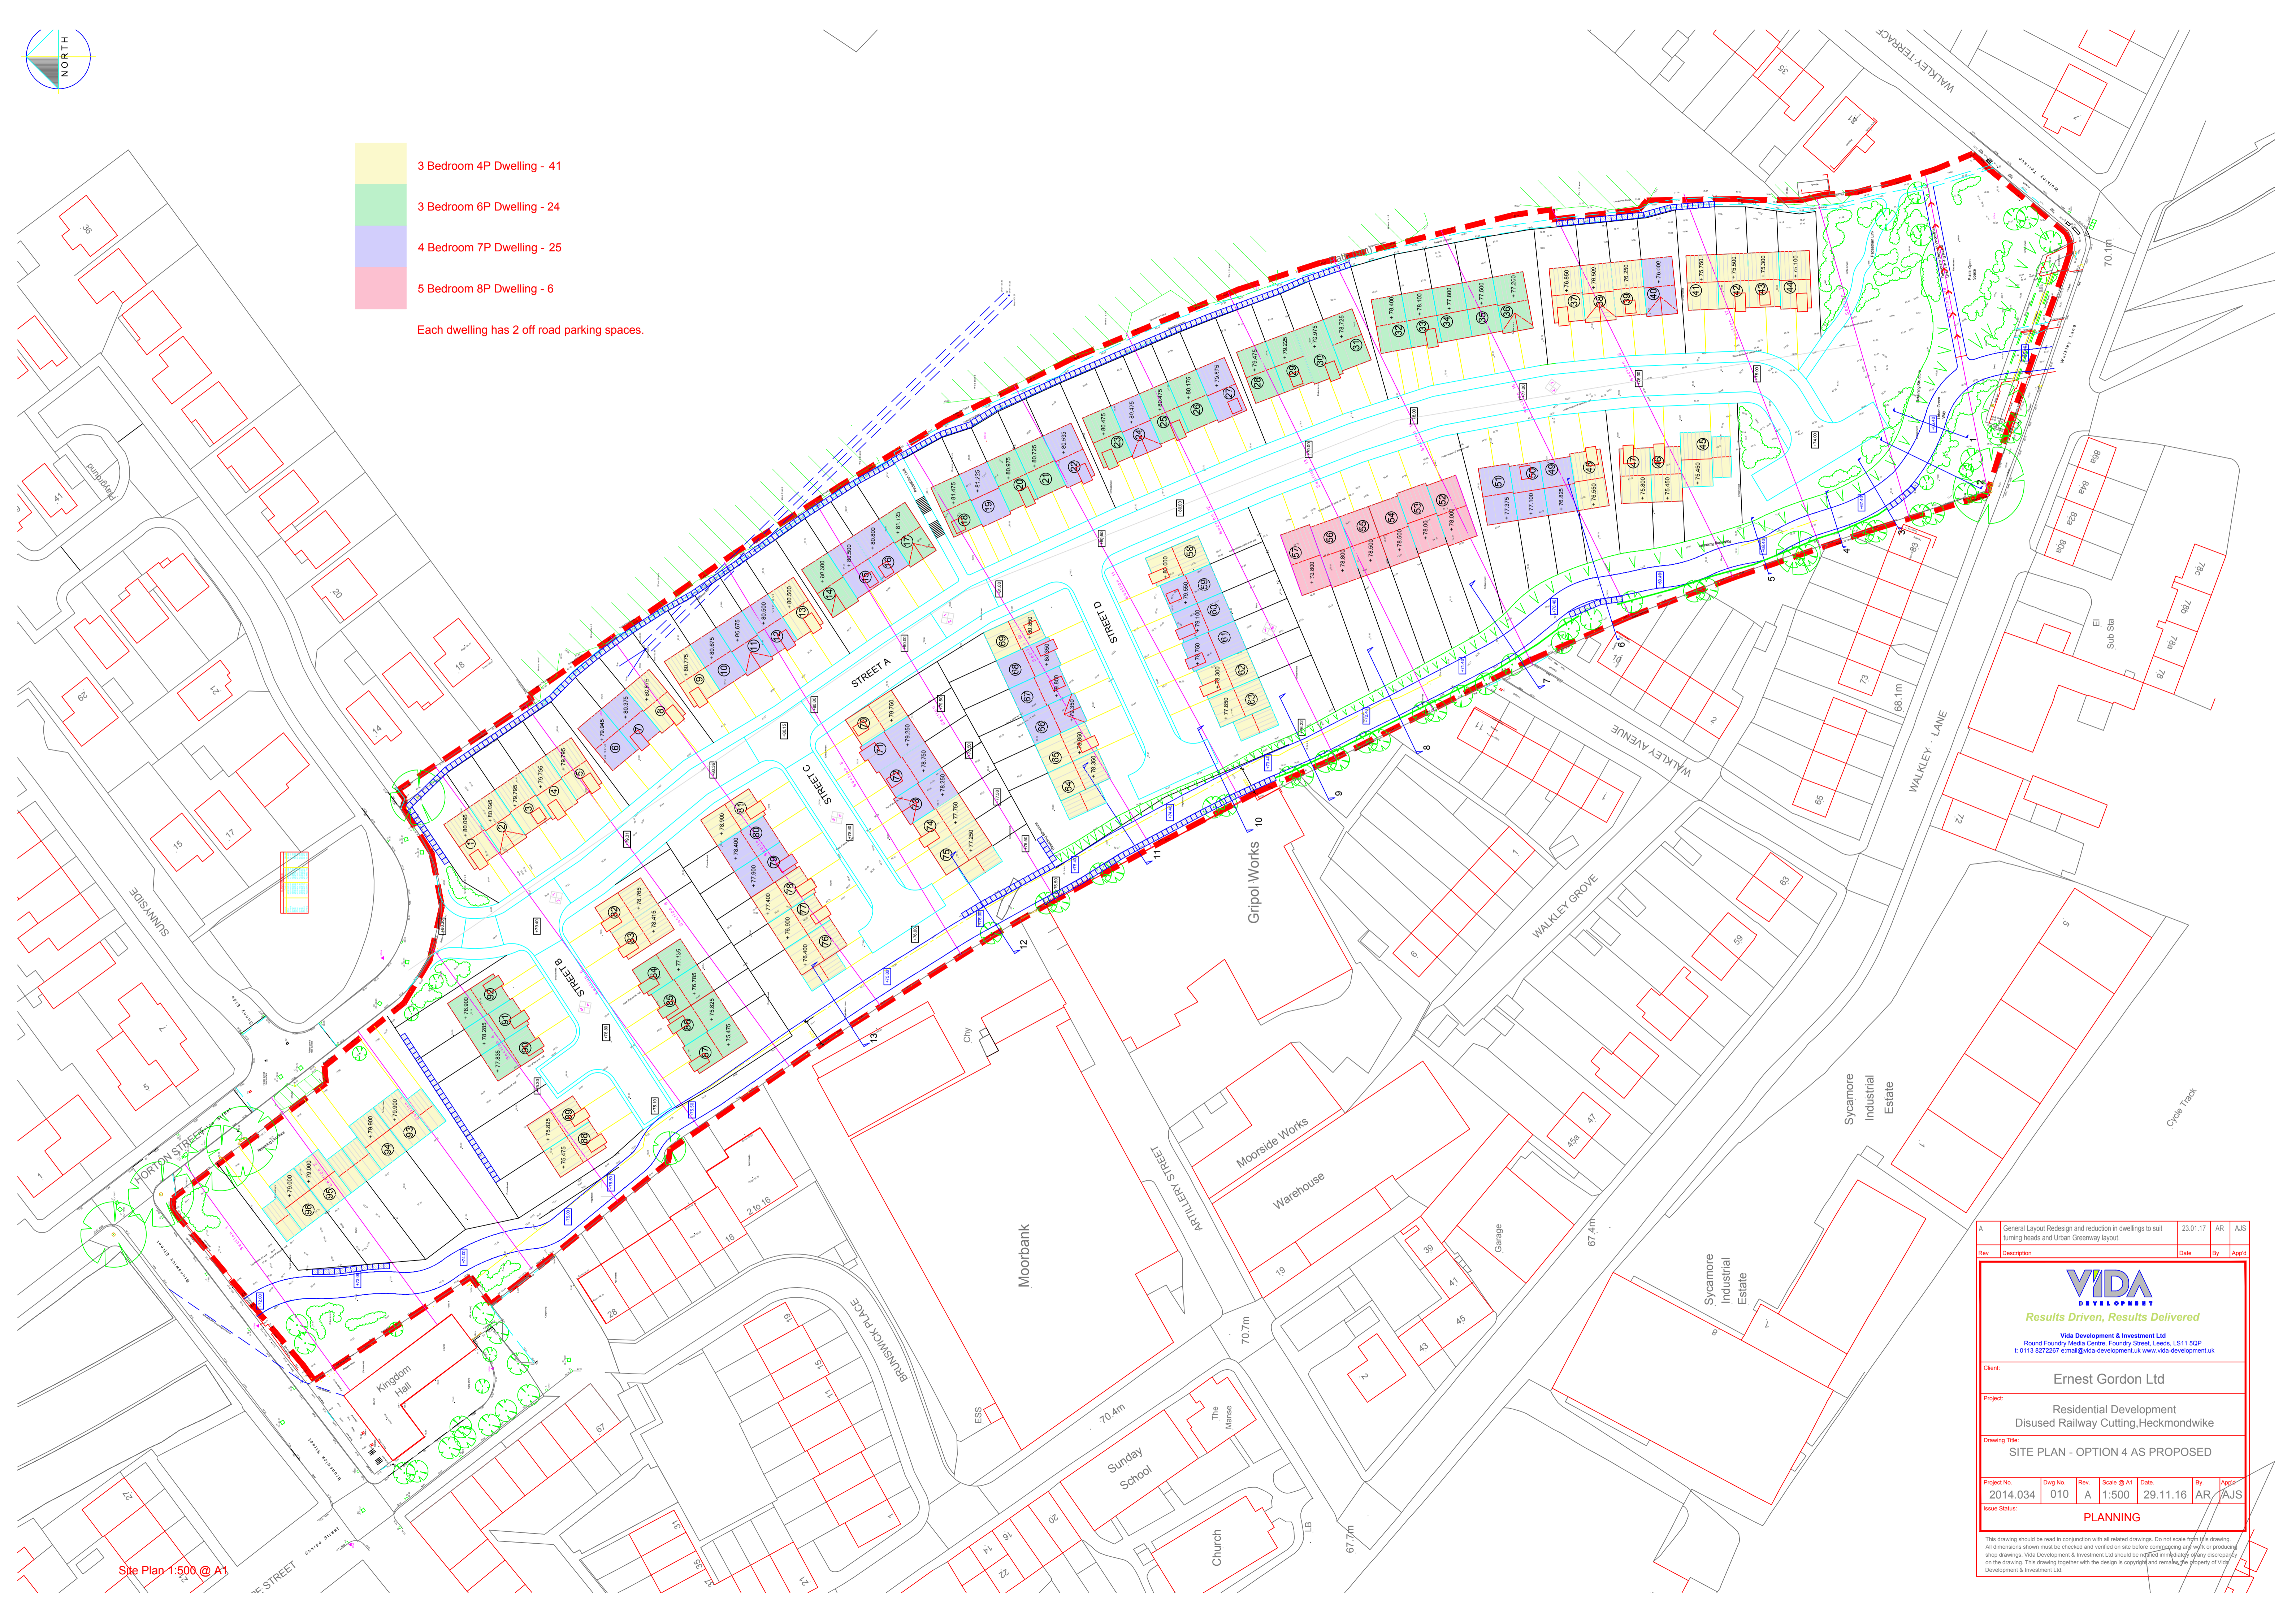

Site Plan 1:500 @ A1

A		General Layout Redesign and reduction in dwellings to suit turning heads and Urban Greenway layout.			23.01.17	AR	AJS
Rev	Description	Date	By	App'd			
 Results Driven, Results Delivered Vida Development & Investment Ltd Round Foundry Media Centre, Foundry Street, Leeds, LS11 5QP T: 0113 6272267 e: mail@vida-development.uk www.vida-development.uk							
Client: Ernest Gordon Ltd							
Project: Residential Development Disused Railway Cutting, Heckmondwike							
Drawing Title: SITE PLAN - OPTION 4 AS PROPOSED							
Project No.	2014.034	Draw No.	010	Rev.	Scale @ A1	Date.	29.11.16
Issue Status:	By		AR	App'd	AJS		
PLANNING							
This drawing should be read in conjunction with all related drawings. Do not scale from the drawing. All dimensions shown must be checked and verified on site before commencing any work or producing shop drawings. Vida Development & Investment Ltd should be notified immediately of any discrepancy on the drawing. This drawing together with the design is copyright and remains the property of Vida Development & Investment Ltd.							

APPENDIX G

OVERFLOW CULVERT CALCULATIONS



Client: YORKDALES 2.

Project No. 1471/01

Sheet 1 of 2

Project: RAILWAY CUTTING, HECKMOND WILKE

Calc By: ARP

Date: 9/11/17

Element: FLOOD WATER OVERFLOW

Chkd By:

Date:

EXISTING FLOW (Q_{EX})

Reports of flood water at 1.2m deep to the North of Brunswick Street and within the site adjacent to Artillery Street are due to flat or very shallow slopes along the channel. Therefore, to assess Q_{EX} we use Mannings formula.

$$Q_{EX} = \frac{w \times d}{n} \left(\frac{w \times d}{w + 2d} \right)^{2/3} (i)^{1/2}$$

- where:
- w = width of base = 10m approx
 - d = depth of flood water = 1.2m
 - n = Mannings number = 0.035 for rough rock
 - i = grade of channel = 1/1000

Inserting figures:

$$\begin{aligned} Q_{EX} &= \frac{100 \times 12}{0.035} \times \left(\frac{10 \times 1.2}{10 + 2.4} \right)^{2/3} \times \left(\frac{1}{1000} \right)^{1/2} \\ &= 342.86 \times 0.978 \times 0.032 \\ Q_{EX} &= \underline{\underline{1073 \text{ L/s.}}} \end{aligned}$$



Client: YORKDALES 2	Project No. 1471/01	Sheet 2 of 2
Project: RAILWAY CUTTING, HECKMOND WIKK	Calc By: ARP	Date: 9/11/17
Element: FLOOD WATER OVERFLOW	Chkd By:	Date:

PROPOSED CULVERT

Ground level at Brunswick Street \approx 68.0 m

Ground level at Walkley Street \approx 64.0 m

Fall \approx 4.0 m

Length from topographical survey \approx 260 m

Grade of new pipe = $\frac{260}{4} = 1/65$

Using the Wallingford and Barr Hydraulic Tables
Table A41 $K_s = 0.6 \text{ mm}$


1500 mm ϕ at 1/65 has $Q_{PROP} = 9.4 \text{ m}^3/\text{s}$

1650 mm ϕ at 1/65 has $Q_{PROP} = \underline{\underline{12.1 \text{ m}^3/\text{s}}}$

\therefore a 1650 mm ϕ culvert can accommodate the overland surface water flow with a 12.8% spare capacity.

APPENDIX H


INDICATIVE SURFACE WATER CALCULATIONS

ARP Associates		Page 1
Northwest House Servia Hill Leeds LS6 2QH	Yorkdales 2 Ltd Railway Cutting, Heckmondwike 1471/01Prelim30yr@12.9l/s	
Date 09-11-17 File 1471-01 preliminary Att...	Designed by ARP Checked by	
Elstree Computing Ltd		Source Control 2015.1

Summary of Results for 30 year Return Period

Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Overflow (l/s)	Max Σ Outflow (l/s)	Max Volume (m³)	Status
15 min Summer	100.685	0.685	12.7	0.0	12.7	155.8	O K
30 min Summer	100.857	0.857	12.7	0.0	12.7	202.6	O K
60 min Summer	101.012	1.012	12.7	0.0	12.7	244.9	O K
120 min Summer	101.119	1.119	12.7	0.0	12.7	273.9	O K
180 min Summer	101.137	1.137	12.7	0.0	12.7	278.8	O K
240 min Summer	101.125	1.125	12.7	0.0	12.7	275.6	O K
360 min Summer	101.093	1.093	12.7	0.0	12.7	267.0	O K
480 min Summer	101.060	1.060	12.7	0.0	12.7	258.0	O K
600 min Summer	101.026	1.026	12.7	0.0	12.7	248.6	O K
720 min Summer	100.990	0.990	12.7	0.0	12.7	238.8	O K
960 min Summer	100.915	0.915	12.7	0.0	12.7	218.4	O K
1440 min Summer	100.736	0.736	12.7	0.0	12.7	169.6	O K
2160 min Summer	100.498	0.498	12.7	0.0	12.7	105.0	O K
2880 min Summer	100.343	0.343	12.7	0.0	12.7	62.6	O K
4320 min Summer	100.200	0.200	12.2	0.0	12.2	24.1	O K
5760 min Summer	100.159	0.159	10.4	0.0	10.4	15.3	O K
7200 min Summer	100.136	0.136	8.8	0.0	8.8	11.2	O K
8640 min Summer	100.121	0.121	7.7	0.0	7.7	8.8	O K
10080 min Summer	100.111	0.111	6.9	0.0	6.9	7.5	O K
15 min Winter	100.759	0.759	12.7	0.0	12.7	176.0	O K
30 min Winter	100.954	0.954	12.7	0.0	12.7	229.1	O K


Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Overflow Volume (m³)	Time-Peak (mins)
15 min Summer	68.836	0.0	166.5	0.0	22
30 min Summer	45.828	0.0	221.7	0.0	37
60 min Summer	29.238	0.0	282.9	0.0	66
120 min Summer	18.112	0.0	350.5	0.0	126
180 min Summer	13.534	0.0	392.8	0.0	184
240 min Summer	10.952	0.0	423.8	0.0	214
360 min Summer	8.106	0.0	470.5	0.0	278
480 min Summer	6.544	0.0	506.5	0.0	346
600 min Summer	5.539	0.0	535.9	0.0	414
720 min Summer	4.832	0.0	561.0	0.0	486
960 min Summer	3.892	0.0	602.5	0.0	624
1440 min Summer	2.866	0.0	665.5	0.0	886
2160 min Summer	2.108	0.0	734.0	0.0	1236
2880 min Summer	1.693	0.0	786.2	0.0	1564
4320 min Summer	1.242	0.0	865.1	0.0	2212
5760 min Summer	0.996	0.0	925.1	0.0	2936
7200 min Summer	0.839	0.0	974.0	0.0	3672
8640 min Summer	0.730	0.0	1016.5	0.0	4400
10080 min Summer	0.648	0.0	1053.9	0.0	5104
15 min Winter	68.836	0.0	186.5	0.0	22
30 min Winter	45.828	0.0	248.3	0.0	36

ARP Associates		Page 2
Northwest House Servia Hill Leeds LS6 2QH	Yorkdales 2 Ltd Railway Cutting, Heckmondwike 1471/01Prelim30yr@12.9l/s	
Date 09-11-17 File 1471-01 preliminary Att...	Designed by ARP Checked by	
Elstree Computing Ltd		Source Control 2015.1

Summary of Results for 30 year Return Period

Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Overflow (l/s)	Max Σ Outflow (l/s)	Max Volume (m³)	Status
60 min Winter	101.136	1.136	12.7	0.0	12.7	278.6	O K
120 min Winter	101.290	1.290	12.7	0.0	12.7	315.7	O K
180 min Winter	101.367	1.367	12.7	0.0	12.7	324.7	O K
240 min Winter	101.345	1.345	12.7	0.0	12.7	322.8	O K
360 min Winter	101.263	1.263	12.7	0.0	12.7	310.9	O K
480 min Winter	101.209	1.209	12.7	0.0	12.7	298.3	O K
600 min Winter	101.156	1.156	12.7	0.0	12.7	284.0	O K
720 min Winter	101.100	1.100	12.7	0.0	12.7	268.9	O K
960 min Winter	100.984	0.984	12.7	0.0	12.7	237.1	O K
1440 min Winter	100.692	0.692	12.7	0.0	12.7	157.7	O K
2160 min Winter	100.355	0.355	12.7	0.0	12.7	66.1	O K
2880 min Winter	100.206	0.206	12.3	0.0	12.3	25.6	O K
4320 min Winter	100.144	0.144	9.4	0.0	9.4	12.6	O K
5760 min Winter	100.120	0.120	7.6	0.0	7.6	8.7	O K
7200 min Winter	100.106	0.106	6.4	0.0	6.4	6.8	O K
8640 min Winter	100.097	0.097	5.6	0.0	5.6	5.7	O K
10080 min Winter	100.090	0.090	5.0	0.0	5.0	5.0	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Overflow Volume (m³)	Time-Peak (mins)
60 min Winter	29.238	0.0	316.8	0.0	66
120 min Winter	18.112	0.0	392.5	0.0	122
180 min Winter	13.534	0.0	440.0	0.0	178
240 min Winter	10.952	0.0	474.7	0.0	232
360 min Winter	8.106	0.0	527.0	0.0	292
480 min Winter	6.544	0.0	567.3	0.0	368
600 min Winter	5.539	0.0	600.2	0.0	448
720 min Winter	4.832	0.0	628.3	0.0	524
960 min Winter	3.892	0.0	674.9	0.0	678
1440 min Winter	2.866	0.0	745.4	0.0	954
2160 min Winter	2.108	0.0	822.1	0.0	1260
2880 min Winter	1.693	0.0	880.6	0.0	1532
4320 min Winter	1.242	0.0	968.9	0.0	2208
5760 min Winter	0.996	0.0	1036.1	0.0	2936
7200 min Winter	0.839	0.0	1090.9	0.0	3672
8640 min Winter	0.730	0.0	1138.4	0.0	4400
10080 min Winter	0.648	0.0	1180.4	0.0	5128

ARP Associates		Page 3
Northwest House Servia Hill Leeds LS6 2QH	Yorkdales 2 Ltd Railway Cutting, Heckmondwike 1471/01Prelim30yr@12.9l/s	
Date 09-11-17 File 1471-01 preliminary Att...	Designed by ARP Checked by	
Elstree Computing Ltd	Source Control 2015.1	


Rainfall Details

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	30	Cv (Summer)	0.750
Region	England and Wales	Cv (Winter)	0.840
M5-60 (mm)	19.000	Shortest Storm (mins)	15
Ratio R	0.350	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+0

Time Area Diagram

Total Area (ha) 1.290

Time (mins) Area			Time (mins) Area		
From:	To:	(ha)	From:	To:	(ha)
0	4	0.000	4	8	1.290

ARP Associates		Page 4
Northwest House Servia Hill Leeds LS6 2QH	Yorkdales 2 Ltd Railway Cutting, Heckmondwike 1471/01Prelim30yr@12.9l/s	
Date 09-11-17 File 1471-01 preliminary Att...	Designed by ARP Checked by	
Elstree Computing Ltd		Source Control 2015.1

Model Details

Storage is Online Cover Level (m) 102.500

Box Culvert Structure

Height (m) 1.200 Slope (1:X) 500.000 Downstream Invert (m) 100.000
Width (m) 2.400 Length (m) 113.000

Hydro-Brake Optimum® Outflow Control

Unit Reference MD-SCL-0147-1290-1426-1290
Design Head (m) 1.426
Design Flow (l/s) 12.9
Flush-Flo™ Calculated
Objective Minimise blockage risk
Diameter (mm) 147
Invert Level (m) 100.000
Minimum Outlet Pipe Diameter (mm) 225
Suggested Manhole Diameter (mm) 1200


Control Points	Head (m)	Flow (l/s)
Design Point (Calculated)	1.426	12.8
Flush-Flo™	0.322	12.7
Kick-Flo®	0.791	9.7
Mean Flow over Head Range	-	10.8

The hydrological calculations have been based on the Head/Discharge relationship for the Hydro-Brake Optimum® as specified. Should another type of control device other than a Hydro-Brake Optimum® be utilised then these storage routing calculations will be invalidated

Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)
0.100	5.8	1.200	11.8	3.000	18.2	7.000	27.2
0.200	12.2	1.400	12.7	3.500	19.5	7.500	28.2
0.300	12.7	1.600	13.5	4.000	20.8	8.000	29.0
0.400	12.6	1.800	14.3	4.500	22.0	8.500	29.9
0.500	12.3	2.000	15.0	5.000	23.2	9.000	30.7
0.600	11.8	2.200	15.7	5.500	24.3	9.500	31.5
0.800	9.8	2.400	16.3	6.000	25.3		
1.000	10.8	2.600	17.0	6.500	26.3		

Weir Overflow Control

Discharge Coef 0.544 Width (m) 2.400 Invert Level (m) 101.424

ARP Associates		Page 5
Northwest House Servia Hill Leeds LS6 2QH	Yorkdales 2 Ltd Railway Cutting, Heckmondwike 1471/01Prelim100yr+CC@12.9l/s	
Date 09-11-17 File 1471-01 preliminary Att...	Designed by ARP Checked by	
Elstree Computing Ltd		Source Control 2015.1

Summary of Results for 100 year Return Period (+30%)


Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Overflow (l/s)	Max Σ Outflow (l/s)	Max Volume (m³)	Status
15 min Summer	100.694	0.694	12.8	0.0	12.8	268.1	O K
30 min Summer	100.854	0.854	12.8	0.0	12.8	355.1	O K
60 min Summer	101.016	1.016	12.8	0.0	12.8	443.2	O K
120 min Summer	101.156	1.156	12.8	0.0	12.8	519.6	O K
180 min Summer	101.212	1.212	12.8	0.0	12.8	549.8	O K
240 min Summer	101.231	1.231	12.8	0.0	12.8	559.8	O K
360 min Summer	101.225	1.225	12.8	0.0	12.8	556.7	O K
480 min Summer	101.200	1.200	12.8	0.0	12.8	543.2	O K
600 min Summer	101.176	1.176	12.8	0.0	12.8	530.0	O K
720 min Summer	101.152	1.152	12.8	0.0	12.8	517.4	O K
960 min Summer	101.108	1.108	12.8	0.0	12.8	493.2	O K
1440 min Summer	101.018	1.018	12.8	0.0	12.8	444.4	O K
2160 min Summer	100.862	0.862	12.8	0.0	12.8	359.3	O K
2880 min Summer	100.714	0.714	12.8	0.0	12.8	279.1	O K
4320 min Summer	100.492	0.492	12.8	0.0	12.8	158.3	O K
5760 min Summer	100.351	0.351	12.8	0.0	12.8	83.5	O K
7200 min Summer	100.255	0.255	12.4	0.0	12.4	44.0	O K
8640 min Summer	100.193	0.193	11.7	0.0	11.7	25.4	O K
10080 min Summer	100.166	0.166	10.6	0.0	10.6	18.8	O K
15 min Winter	100.756	0.756	12.8	0.0	12.8	301.9	O K
30 min Winter	100.939	0.939	12.8	0.0	12.8	401.2	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Overflow Volume (m³)	Time-Peak (mins)
15 min Summer	115.731	0.0	279.9	0.0	23
30 min Summer	77.804	0.0	376.4	0.0	37
60 min Summer	49.937	0.0	483.1	0.0	68
120 min Summer	30.956	0.0	599.0	0.0	126
180 min Summer	23.058	0.0	669.3	0.0	186
240 min Summer	18.577	0.0	718.9	0.0	246
360 min Summer	13.656	0.0	792.7	0.0	364
480 min Summer	10.974	0.0	849.4	0.0	426
600 min Summer	9.254	0.0	895.3	0.0	492
720 min Summer	8.046	0.0	934.2	0.0	558
960 min Summer	6.447	0.0	998.0	0.0	688
1440 min Summer	4.709	0.0	1093.5	0.0	970
2160 min Summer	3.432	0.0	1195.4	0.0	1368
2880 min Summer	2.739	0.0	1271.8	0.0	1732
4320 min Summer	1.989	0.0	1385.3	0.0	2424
5760 min Summer	1.583	0.0	1470.1	0.0	3064
7200 min Summer	1.325	0.0	1538.3	0.0	3744
8640 min Summer	1.147	0.0	1597.8	0.0	4408
10080 min Summer	1.015	0.0	1650.2	0.0	5136
15 min Winter	115.731	0.0	313.5	0.0	22
30 min Winter	77.804	0.0	421.5	0.0	37

Summary of Results for 100 year Return Period (+30%)

Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Overflow (l/s)	Max Σ Outflow (l/s)	Max Volume (m³)	Status
60 min Winter	101.123	1.123	12.8	0.0	12.8	501.7	O K
120 min Winter	101.302	1.302	12.8	0.0	12.8	591.9	O K
180 min Winter	101.421	1.421	12.8	0.0	12.8	630.3	O K
240 min Winter	101.501	1.501	12.8	0.0	12.8	645.7	O K
360 min Winter	101.538	1.538	12.8	0.0	12.8	649.9	O K
480 min Winter	101.459	1.459	12.8	0.0	12.8	638.9	O K
600 min Winter	101.385	1.385	12.8	0.0	12.8	620.8	O K
720 min Winter	101.334	1.334	12.8	0.0	12.8	604.1	O K
960 min Winter	101.256	1.256	12.8	0.0	12.8	571.6	O K
1440 min Winter	101.121	1.121	12.8	0.0	12.8	500.4	O K
2160 min Winter	100.887	0.887	12.8	0.0	12.8	373.1	O K
2880 min Winter	100.652	0.652	12.8	0.0	12.8	245.4	O K
4320 min Winter	100.355	0.355	12.8	0.0	12.8	85.6	O K
5760 min Winter	100.197	0.197	11.8	0.0	11.8	26.3	O K
7200 min Winter	100.157	0.157	10.1	0.0	10.1	16.7	O K
8640 min Winter	100.137	0.137	8.7	0.0	8.7	12.7	O K
10080 min Winter	100.123	0.123	7.7	0.0	7.7	10.4	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Overflow Volume (m³)	Time-Peak (mins)
60 min Winter	49.937	0.0	541.1	0.0	66
120 min Winter	30.956	0.0	670.9	0.0	124
180 min Winter	23.058	0.0	749.6	0.0	182
240 min Winter	18.577	0.0	805.2	0.0	240
360 min Winter	13.656	0.0	887.9	0.0	350
480 min Winter	10.974	0.0	951.3	0.0	458
600 min Winter	9.254	0.0	1002.8	0.0	554
720 min Winter	8.046	0.0	1046.3	0.0	580
960 min Winter	6.447	0.0	1117.8	0.0	736
1440 min Winter	4.709	0.0	1224.7	0.0	1044
2160 min Winter	3.432	0.0	1338.9	0.0	1492
2880 min Winter	2.739	0.0	1424.4	0.0	1824
4320 min Winter	1.989	0.0	1551.6	0.0	2468
5760 min Winter	1.583	0.0	1646.5	0.0	3000
7200 min Winter	1.325	0.0	1722.9	0.0	3672
8640 min Winter	1.147	0.0	1789.5	0.0	4392
10080 min Winter	1.015	0.0	1848.2	0.0	5136

ARP Associates		Page 7
Northwest House Servia Hill Leeds LS6 2QH	Yorkdales 2 Ltd Railway Cutting, Heckmondwike 1471/01Prelim100yr+CC@12.9l/s	
Date 09-11-17 File 1471-01 preliminary Att...	Designed by ARP Checked by	
Elstree Computing Ltd		Source Control 2015.1


Rainfall Details

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	100	Cv (Summer)	0.750
Region	England and Wales	Cv (Winter)	0.840
M5-60 (mm)	19.000	Shortest Storm (mins)	15
Ratio R	0.350	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+30

Time Area Diagram

Total Area (ha) 1.290

Time (mins) Area			Time (mins) Area		
From:	To:	(ha)	From:	To:	(ha)
0	4	0.000	4	8	1.290

ARP Associates		Page 8
Northwest House Servia Hill Leeds LS6 2QH	Yorkdales 2 Ltd Railway Cutting, Heckmondwike 1471/01Prelim100yr+CC@12.9l/s	
Date 09-11-17 File 1471-01 preliminary Att...	Designed by ARP Checked by	
Elstree Computing Ltd		Source Control 2015.1

Model Details

Storage is Online Cover Level (m) 102.500

Box Culvert Structure

Height (m) 1.200 Slope (1:X) 500.000 Downstream Invert (m) 100.000
Width (m) 2.700 Length (m) 201.000

Hydro-Brake Optimum® Outflow Control

Unit Reference	MD-SFP-0150-1290-1602-1290
Design Head (m)	1.602
Design Flow (l/s)	12.9
Flush-Flo™	Calculated
Objective	Future Proof
Diameter (mm)	150
Invert Level (m)	100.000
Minimum Outlet Pipe Diameter (mm)	225
Suggested Manhole Diameter (mm)	1500

Control Points Head (m) Flow (l/s)

Design Point (Calculated)	1.602	12.9
Flush-Flo™	0.404	12.8
Kick-Flo®	0.925	9.9
Mean Flow over Head Range	-	11.1

The hydrological calculations have been based on the Head/Discharge relationship for the Hydro-Brake Optimum® as specified. Should another type of control device other than a Hydro-Brake Optimum® be utilised then these storage routing calculations will be invalidated

Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)
0.100	5.7	1.200	11.2	3.000	17.3	7.000	26.0
0.200	11.8	1.400	12.1	3.500	18.6	7.500	26.8
0.300	12.6	1.600	12.8	4.000	19.8	8.000	27.7
0.400	12.8	1.800	13.6	4.500	21.0	8.500	28.5
0.500	12.7	2.000	14.3	5.000	22.1	9.000	29.3
0.600	12.5	2.200	14.9	5.500	23.1	9.500	30.1
0.800	11.4	2.400	15.6	6.000	24.1		
1.000	10.3	2.600	16.2	6.500	25.0		

Weir Overflow Control

Discharge Coef 0.544 Width (m) 2.700 Invert Level (m) 101.602

Subject: 1471/01 RE: Re Heckmondwike Railway cutting.
Date: Wednesday, 7 February 2018 at 07:52:20 Greenwich Mean Time
From: Allan Poyser
To: Andrew Redmile
CC: Wayne Walker
Attachments: image007.png, image008.png, image009.png, image010.jpg, image001.jpg, 147101r2 - BOUND.pdf

Andrew

Apologies for not responding sooner, but our response to the Local Land Drainage Authority comments is as follows:-

1. We have consulted with the Land Drainage Authority regarding the possible outfalls for surface water from the new development and the culverted watercourse through the site is the obvious outfall. We are aware that the recent developments to the west have connected to the watercourse. The culvert is relatively shallow below the level of the cutting and a connection from the development at this location will be relatively straight forward. It is accepted that once a connection location has been determined and the culvert opened up, an intrusive investigation by camera will be undertaken and a report prepared for the approval of the Planning authority identifying any remedial works downstream. If this culverted watercourse is shown to be unsuitable there is an alternative as identified in the Drainage Strategy for a culverted watercourse on Walkley Terrace through to the Greenway. We have attached a copy of the Drainage Strategy Report in case the Land Drainage Authority has not seen this previously in formulating their response. You will also note that in the Drainage Strategy, Land Drainage, under consultations in December 2017, stated at paragraph 3.3 they would not object to a connection to the culverted watercourse in the site but did indicate that there was evidence of a blockage in the past which would need to be addressed.
2. The culvert provided through the site is only to accommodate flood water from the north off third party land. There is no open watercourse present at this time and culvert will prevent water from flooding upstream areas. This is proposed purely to assist in reducing flooding in the District. At present the water during times of extreme storm flows in from the north and out to the south. This will continue through the proposed culvert and will have any increased flow and overflows to the south as exists at the present.
3. We disagree with the premise that only 50% of the proposed site area should be considered for a proposed surface water discharge rate. It is accepted that only 50% of the site area will become impermeable as houses, drives and roads, but the garden or soft landscape areas are "encased" by the development and rainfall will either be retained on the soft areas or will run off into the positive drainage system. Therefore, the calculations in the FRA and the Drainage Strategy reports are considered to be correct. However, if there is an insistence on reducing the greenfield run off to 50% then the proposed surface water attenuation for a 1 in 100 year storm plus climate change will just increase and the calculations and details will be submitted to the Planning Authority for approval under Condition as is the norm.

We trust that the above response is satisfactory for your presentation at Planning Committee and for discussions with Land Drainage.

Kind Regards

Allan Poyser
0113 245 8498



DRAINAGE STRATEGY

ON
**DEVELOPMENT OF RAILWAY CUTTING
HORTON STREET, HECKMONDWIKE**

ON BEHALF OF
YORKDALES 2 LTD

ARP ASSOCIATES

CHARTERED CONSULTING ENGINEERS

Northwest House 5/6 Northwest Business Park Servia Hill Leeds LS6 2QH

☎ 0113 245 8498




☎ 0113 244 3864

✉ leeds@arpassociates.co.uk

🌐 www.arpassociates.co.uk

Drainage Strategy on Development of Railway Cutting, Horton Street, Heckmondwike

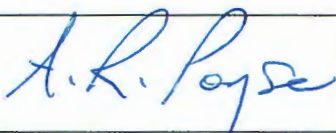1471/01r2

Revision/Date	Initial Issue 17 th January 2018	Revision A	Revision B	Revision C
Prepared By:	A R Poyser BSc (Hons) CEng MICE FCIHT			
Signature				
Reviewed By:	W M Walker BSc (Hons)			
Signature				
Authorised By:	A Radcliffe BEng (Hons) CEng MIStructE			
Signature				

CONTENTS

	Page
1.0 Introduction	4
2.0 Flood Risk Assessment	5 - 6
3.0 Further Consultations	7
4.0 Drainage Strategy	
Surface Water	8
Foul Drainage	9
5.0 Summary	10

APPENDICES

Appendix A	Site Location Plan
Appendix B	Yorkshire Water Consultation
Appendix C	Land Drainage Authority Consultation
Appendix D	Surface Water Drainage Calculations
Appendix E	Indicative Drainage Proposal

1.0 INTRODUCTION

- 1.1 Yorkdales 2 Ltd is proposing to redevelop the site of the former Railway Cutting at Heckmondwike for new residential developments. A site location plan is presented in Appendix A. As part of the development appraisal, a Flood Risk Assessment Report was prepared by ARP Associates, under reference 1471/01r1 dated 10th November 2017.
- 1.2 In order to undertake further viability of the site and to supplement a Planning Application for the proposed development, it was decided that a Drainage Strategy should be prepared for both foul and surface water discharge from the proposed scheme.
- 1.3 ARP Associates have been appointed to review the Flood Risk Assessment and prepare a Drainage Strategy and agree the proposals with the Regulatory Authority.
- 1.4 The further consultations with the Regulatory Authorities and preparation of the report has been undertaken in November and December 2017.
- 1.5 The report has been initially prepared for the use and reliance of the Client only. The report shall not be relied upon or transferred to any other parties without the written agreement of ARP Associates. For the avoidance of any doubt, where ARP Associates enters into a letter of reliance for the benefit of a third party, that third party will be permitted to rely on the report. No responsibility will be accepted where this report is used, either in its entirety or in part, by any other party without ARP Associates consent.

2.0 FLOOD RISK ASSESSMENT

- 2.1 Reference should be made to the Flood Risk Assessment Report, prepared by ARP Associates under reference 1471/01r1 dated 10th November 2017.
- 2.2 The report was based on consultations from the Environment Agency, Yorkshire Water, as Water Authority for the area, and Kirklees Council, as Land Drainage Authority for the area.
- 2.3 The Environment Agency confirmed that the site falls within Flood Zone 1 and that there was no flood history available from their records. Reference was made, however, to make allowance for climate change in accordance with the latest guidelines dated February 2016.
- 2.4 The consultation with the Water Authority confirmed that foul water could discharge to the 375mm diameter public combined sewer in Walkley Terrace adjacent to the southeastern corner of the site. However, in respect of surface water, the local public sewer network did not have any capacity to accept surface water from the proposal site and reference was made to culverted watercourses within the development. This would appear to be the obvious place for surface water disposal, if infiltration systems, as part of a Sustainable Drainage Assessment, were proved to be unsuitable.
- 2.5 The consultation with Kirklees Council identified that the site was subject to surface water flood risk due to the low lying nature of the cutting and that ponding upstream of Brunswick Street was around 1.2m in flat areas. This water flows through the site in the bottom of the cutting in a northwest to southeast direction during times of storm. An assessment of the catchment was recommended and properties will have to be significantly raised for safety within the development. The consultation did confirm that the British Geological Society data suggests that infiltration would be problematic and the Land Drainage Authority would accept that soakaways or other infiltration systems are unlikely to be appropriate. Therefore, it was recommended that a connection to watercourse should be explored with the nearest river being the River Spen approximately

500m to the south. It is likely that watercourse tributaries to the River are within the site boundaries or close by and it would be appropriate to investigate these to determine a suitable outfall for surface water discharge.

3.0 FURTHER CONSULTATIONS

- 3.1 As a result of the information provided by Yorkshire Water and Kirklees Council, further consultations were undertaken to determine if connection to sewer would be acceptable. A copy of the e-mail correspondence with Yorkshire Water between the 9th and 30th November is presented in Appendix B for reference. This has identified watercourses to the north and south of the site as options for connection of surface water drainage and, only if these are unsuitable, would a discharge be acceptable to the 225mm diameter surface water sewer in Walkley Avenue?
- 3.2 It was identified that the water conduit on the Yorkshire Water plan was actually an overhead support for services and, therefore, there was no outfall for surface water drainage from the development at this location. However, the culverted watercourse which passes under the site in a northeast to southwest direction flowing along the back of houses on Horton Street before crossing the site is a suitable option for consideration with the Land Drainage Authority.
- 3.3 Consultation has since been undertaken with Kirklees Council, as Land Drainage Authority, and the copy correspondence, dated between the 1st and 5th December 2017, is presented in Appendix C for reference. In effect, the Land Drainage Authority would not have an objection to connecting to the culverted watercourse, but confirmed that this is deep and that this was blocked some time ago. It has also been identified that it is worth investigating a surface water culvert off Walkley Lane to the Greenway where a new pipe has been laid across to a ditch and, subject to investigation of all the systems in the vicinity to determine a suitable outfall, discharge of surface water at greenfield run-off rates would be acceptable for the development.

4.0 DRAINAGE STRATEGY

Surface Water

- 4.1 It is accepted that the Geological Survey Map of Great Britain shows that the site is located on undifferentiated strata of the Lower Coal Measures with the upper stratum likely to be weathered to a cohesive material (clay). Therefore, the soil is likely to have poor infiltration characteristics and as the site will be infilled to a significant depth, soakaways on the site are likely to filter through the backfill and create potential problems around a culvert. Therefore, the use of soakaways has been discounted for development on the site.
- 4.2 It will be necessary to carry out an investigation of the known culverted watercourses through the development or in the adjacent land, but outfall to culverted watercourse is a solution which would be acceptable to the Regulatory Authorities.
- 4.3 The surface water discharge rate from the site shall be limited to 5l/s/ha and, based on a site area of 2.58ha, the proposed surface water discharge rate will be 12.9l/s.
- 4.4 For discharge of surface water to watercourse, it is necessary to attenuate the proposed development for a 1 in 30 year storm underground and show that a 1 in 100 year storm event plus 30% for climate change can be retained on site without causing flooding of buildings or third party land. Calculations, based on an assumed 50% impermeable area of the total site on completion showed that an attenuation volume of 324.7m³ will be required for the 1 in 30 year storm and a 640.0m³ volume for the 1 in 100 year storm plus 30% for climate change. If the attenuation is to be placed under the adopted highway, it is a requirement in the Kirklees area that a maximum 1.5m diameter pipe is acceptable. Therefore, to meet the necessary attenuation volume, 364m of the 1.5m diameter pipe is required. A copy of the calculations is presented in Appendix D.
- 4.5 A plan showing the approximate location of attenuation requirements, assuming an outfall to the culverted watercourse crossing the site to the north is presented in Appendix E.

Foul Drainage


- 4.6 Foul drainage can discharge to the 375mm diameter public combined sewer in Walkley Terrace adjacent to the southeastern corner of the site. This outfall is shown on the plan presented in Appendix E.

5.0 SUMMARY


- 5.1 It is considered that the proposed development site will be unsuitable for soakaways or other infiltration drainage systems for surface water discharge.
- 5.2 There are culverted watercourses in the immediate vicinity of the site and a culvert crosses the site towards the north flowing from northeast to southwest along the back of houses to Horton Street before crossing the development under the former railway at depth. An investigation of the condition of the pipes will be required.
- 5.3 Surface water discharge will be restricted to greenfield run-off rate of 12.9l/s with outfall to a culverted watercourse.
- 5.4 Surface water will be attenuated on site for a 1 in 30 year storm in an underground system and the 1 in 100 year storm plus 30% allowance for climate change will be accommodated within the system without causing flooding to buildings or third party land.
- 5.5 Foul drainage will discharge to the 375mm diameter public combined sewer in Walkley Terrace adjacent to the southeastern corner of the site.

APPENDIX A

SITE LOCATION PLAN

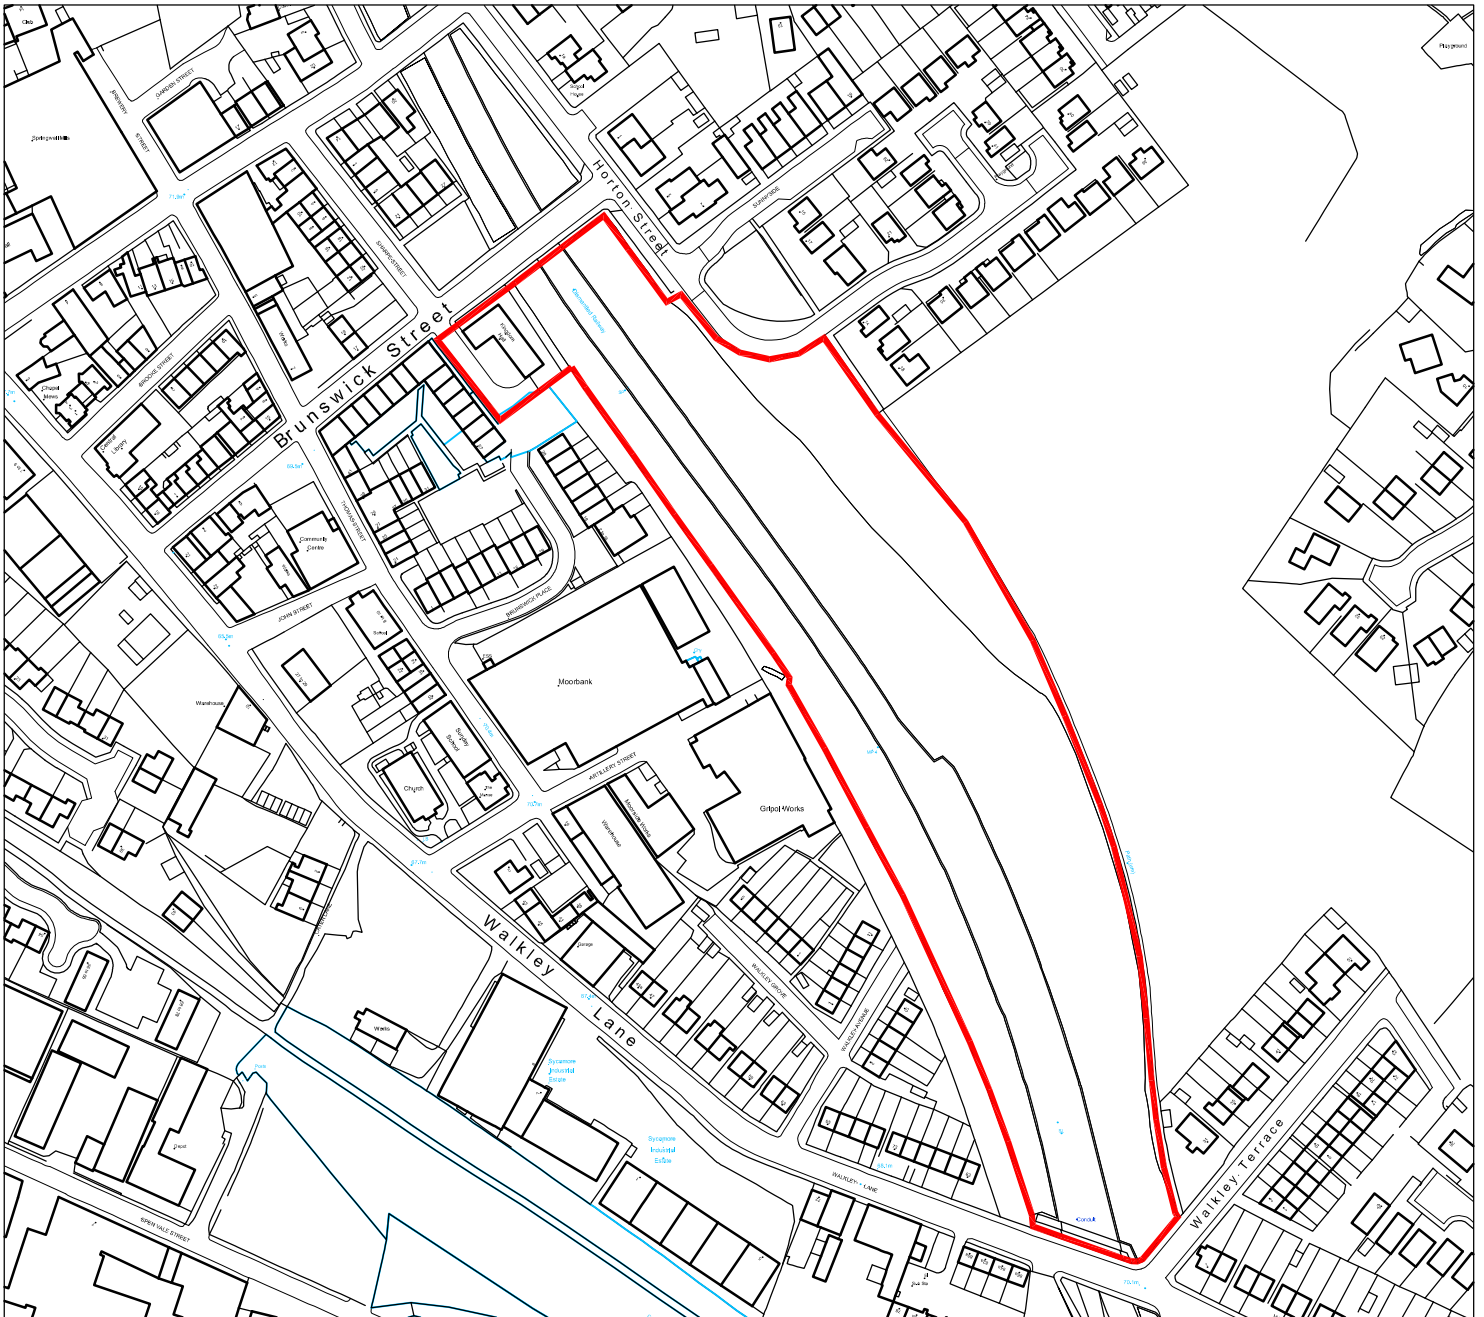

Location Plan 1:2500 @ A4



Rev	Description	Date	By	App'd
-----	-------------	------	----	-------



Results Driven, Results Delivered

Vida Architecture Ltd
 Round Foundry Media Centre, Foundry Street, Leeds, LS11 5QP
 t: 0113 8272267 e:mail@vida-architecture.com www.vida-architecture.com

Client: **Ernest Gordon Ltd**

Project: **Residential Development
 Disused Railway Cutting Heckmondwike**

Drawing Title: **LOCATION PLAN**

Project No.	Dwg No.	Rev.	Scale @ A4	Date.	By.
2014.034	PL01	-	1:2500	30.04.15	SF

Issue Status: **PLANNING**

This drawing should be read in conjunction with all related drawings. Do not scale from this drawing. All dimensions shown must be checked and verified on site before commencing any work or producing shop drawings. Vida Architecture Ltd should be notified immediately of any discrepancy on the drawing. This drawing together with the design is copyright and remains the property of Vida Architecture Ltd.

APPENDIX B

YORKSHIRE WATER CONSULTATION

Allan Poyser

From: Chris.Roberts@yorkshirewater.co.uk on behalf of technical.sewerage@yorkshirewater.co.uk
Sent: Thursday 30 November, 2017 11:29 am
To: Allan Poyser
Subject: RE: 1471/01 RE: Disused Railway Cutting Off Walkley Lane Heckmondwike - Pre Planning Sewerage Enquiry On R713401
Attachments: Untitled.png; YW plan highlighting Watercourse.pdf

Hi Allan,

I was referring to the watercourse to the north. The options are

1. The watercourse to the north
2. The water conduit to the south
3. The 225 mm SW sewer in Walkley Avenue subject to discounting the watercourse/conduit.

(See attached file: Untitled.png)

Kind Regards

Chris

|----->
| From: |
|----->
>-----|
|Allan Poyser <AllanPoyser@arpassociates.co.uk> |
>-----|
|----->
| To: |
|----->
>-----|
|"technical.sewerage@yorkshirewater.co.uk" <technical.sewerage@yorkshirewater.co.uk>,
|
>-----|
|----->
| Cc: |
|----->
>-----|
|Wayne Walker <WayneWalker@arpassociates.co.uk> |
>-----|
|----->
| Date: |
|----->
>-----|
|18/11/2017 11:17 |
>-----|
|----->
| Subject: |
|----->
>-----|

>-----|

Thank you, Chris

I assume you are referring to the watercourse I have highlighted pink on your plan? I am not certain we can get to that location within Highway land, so would need a Requisition and you will appreciate the problems of discharge via a headwall in third party land. Do YW have any surface water sewers in close proximity to the watercourse where we could tap in just before the outfall?

Kind Regards

Allan Poyser
0113 245 8498
allanpoyser@arpassociates.co.uk

ARP ASSOCIATES &
ARP GEOTECHNICAL LTD

http://webdefence.global.blackspider.com/urlwrap/?q=AXicLcs9DslwDAbQT-I-LpQywMSPhMrMCazIIIHTprJDo16AA7GxcjI6MD89XNB-gdUH0Dhv9kymE_UcoktD1hTJpR7T6XZum-t9va13dYMszg_BcSSTIsoPOc5JO_NBpXAWXRI9O_icx0NVIVKIdWSz5MLC9mfg9QZ-1jUrmw&Z

5 & 6 Northwest Business Park, Servia Hill, Leeds LS6 2QH Pre-planning Geotechnical Civil Engineering Structural Engineering

P Please consider the environment before printing this e-mail.

This e-mail is intended for the exclusive use of the individual(s) or entity to which it is addressed and contains confidential and/or privileged information. Any form of distribution, copying or use of this communication by anyone else is strictly prohibited. If you have received this communication in error please delete from your system and notify us immediately so that we can arrange for its return. Viruses: Although this e-mail and it's attachments are believed to be free from any virus, it is the responsibility of the recipient(s) to conduct their own virus checks on all parts of this communication. ARP Associates and ARP Geotechnical Ltd accept no liability for loss or damage arising from their presence. ARP Associates is a trading division of ARP Geotechnical Ltd, a company registered in England and Wales with company number 3771811, whose registered office is at 5/6 Northwest Business Park, Servia Hill, Leeds LS6 2QH.

-----Original Message-----

From: Chris.Roberts@yorkshirewater.co.uk [mailto:Chris.Roberts@yorkshirewater.co.uk] On Behalf Of technical.sewerage@yorkshirewater.co.uk

Sent: Friday 17 November, 2017 2:34pm

To: Allan Poyser

Subject: Fw: 1471/01 RE: Disused Railway Cutting Off Walkley Lane Heckmondwike - Pre Planning Sewerage Enquiry On R713401

Sorry forgot to add plan

(See attached file: roberts4_rad66920.PNG)

----- Forwarded by Chris Roberts/Water Business Unit/YWS/Yorkshire Water on

17/11/2017 14:33 -----

From: Technical Sewerage
To: Allan Poyser <AllanPoyser@arpassociates.co.uk>,
Date: 17/11/2017 14:20
Subject: Re: 1471/01 RE: Disused Railway Cutting Off Walkley Lane
Heckmondwike - Pre
Planning Sewerage Enquiry On R713401

Dear Allan,

Thank you for your email.

I have included a plan showing the watercourse that our surface waters ultimately enter. I would ask that you present this to Kirklees Council to see if this helps them identify the watercourses as under their authority.

I will accept that soakaways would not be feasible.

I would not agree to a surface water discharge to the combined sewer network.

If you can provide written evidence from Kirklees stating that the culverted watercourse and conduit are not under their ownership I may be open to agree a restricted surface water discharge from the site of 5 l/s to the 225 mm public surface water sewer in Walkley Lane.

Kind Regards

Chris Roberts
Sewerage Technician
Yorkshire Water

*** Please note, all correspondence must be sent to technical.sewerage@yorkshirewater.co.uk and will be responded to within 10 working days ***

From: Allan Poyser <AllanPoyser@arpassociates.co.uk>
To: "technical.sewerage@yorkshirewater.co.uk"
<technical.sewerage@yorkshirewater.co.uk>,
Cc: Wayne Walker <WayneWalker@arpassociates.co.uk>
Date: 09/11/2017 17:39
Subject: 1471/01 RE: Disused Railway Cutting Off Walkley Lane
Heckmondwike - Pre
Planning Sewerage Enquiry On R713401

Chris

Please see the attached correspondence regarding surface water discharge from the proposed development

Kind Regards

Allan Poyser
0113 245 8498
allanpoyser@arpassociates.co.uk

ARP ASSOCIATES &
ARP GEOTECHNICAL LTD

http://webdefence.global.blackspider.com/urlwrap/?q=AXicLcs9DslwDAbQT-l-bvgZgAnEUoITWMEiUdOmstNGvQAHYmPIZHRgfnq4of0Cmw-gaXEHJtOZeo7J56FoTuRzj_l6ah98Z7ffHbcORXwYoudEJIWUn3JZsnYWokrllrommjQEUsZz09RaiXVks-zjyvZn4PUGfu6eK-U&Z

5 & 6 Northwest Business Park, Servia Hill, Leeds LS6 2QH Pre-planning Geotechnical Civil Engineering Structural Engineering

P Please consider the environment before printing this e-mail.

This e-mail is intended for the exclusive use of the individual(s) or entity to which it is addressed and contains confidential and/or privileged information. Any form of distribution, copying or use of this communication by anyone else is strictly prohibited. If you have received this communication in error please delete from your system and notify us immediately so that we can arrange for its return. Viruses: Although this e-mail and it's attachments are believed to be free from any virus, it is the responsibility of the recipient(s) to conduct their own virus checks on all parts of this communication. ARP Associates and ARP Geotechnical Ltd accept no liability for loss or damage arising from their presence. ARP Associates is a trading division of ARP Geotechnical Ltd, a company registered in England and Wales with company number 3771811, whose registered office is at 5/6 Northwest Business Park, Servia Hill, Leeds LS6 2QH.

-----Original Message-----

From: Chris.Roberts@yorkshirewater.co.uk [mailto:Chris.Roberts@yorkshirewater.co.uk] On Behalf Of technical.sewerage@yorkshirewater.co.uk
Sent: Sunday 1 October, 2017 12:49pm
To: Allan Poyser
Subject: Disused Railway Cutting Off Walkley Lane Heckmondwike - Pre Planning Sewerage Enquiry On R713401

Dear Mr Poyser,

Please find my response below.

(See attached file: WALK.pdf)(See attached file: roberts4_radF0D88.PNG)

If I can be of any further assistance please contact me on 0345 1 20 84 82.

Regards

Chris Roberts
Sewerage Technical Team

*** Please note, all correspondence must be sent to technical.sewerage@yorkshirewater.co.uk and will be responded to within 10 working days ***

|----->
| From: |
|----->
>-----|

|Allan Poyser <AllanPoyser@arpassociates.co.uk>
|
>-----|

|----->
| To: |
|----->
>-----|

|"technical.sewerage@yorkshirewater.co.uk"
<technical.sewerage@yorkshirewater.co.uk>,
|
>-----|

|----->
| Date: |
|----->
>-----|

|20/09/2017 11:25
|
>-----|

|----->
| Subject: |
|----->
>-----|

|1471/01 Railway Cutting, Heckmondwike
|
>-----|

EXTERNAL SOURCE - THINK BEFORE YOU CLICK

Dear Sirs

Please see the attached Pre-planning Sewerage Enquiry for the above site

Kind Regards

Allan Poyser

0113 245 8498

allanpoyser@arpassociates.co.uk

ARP ASSOCIATES &

ARP GEOTECHNICAL LTD

cid:image001.jpg@01CE1C03.D2DEA7D0

http://webdefence.global.blackspider.com/urlwrap/?q=AXicLcs9DslwDAbQT-I-bvgZgAnEUolTWMEiUdOmstNGvQAHYmPIZHRgfnq4of0Cmw-gaXEHJtOZeo7J56FoTuRzj_l6ah98Z7ffHbcORXwYoudEJIWUn3JZsnYWokrllrommjQEUsZz09RaiXVks-zjyvZn4PUGfu6eK-U&Z

5/6 Northwest Business Park, Servia Hill, Leeds LS6 2QH

Pre-planning Geotechnical Civil Engineering Structural Engineering

P Please consider the environment before printing this email.

This email is intended for the exclusive use of the individual(s) or entity to which it is addressed and contains confidential and/or privileged information. Any form of distribution, copying or use of this communication by anyone else is strictly prohibited. If you have received this communication in error please delete from your system and notify us immediately so that we can arrange for its return. Viruses: Although this email and it's attachments are believed to be free from any virus, it is the responsibility of the recipient(s) to conduct their own virus checks on all parts of this communication. ARP Associates and ARP Geotechnical Ltd accept no liability for loss or damage arising from their presence. ARP Associates is a trading division of ARP Geotechnical Ltd, a company registered in England and Wales with company number 3771811, whose registered office is at 5/6 Northwest Business Park, Servia Hill, Leeds LS6 2QH.

(See attached file: image001.png)(See attached file: PrePlanning_Sewerage_Enquiry.pdf)(See attached file: PL01 Location Plan.pdf)(See attached file: Proposed layout.pdf)

Need any help or advice from us?

Customers can get in touch for free via live chat or by requesting a free call back at

<https://www.yorkshirewater.com> Pay your bill online or update your details

<https://www.yorkshirewater.com/payment>

Find out about issues in your area

<https://www.yorkshirewater.com/inyourarea>

Save money on your utility bills and help conserve water by requesting a free water saving pack

<https://www.yorkshirewater.com/savewater>

Be a community hero!

If you spot a leak please report it immediately. Call us on 0800 57 3553 or go to

<https://www.yorkshirewater.com/leaks>

The information in this e-mail, and any files transmitted with it, is confidential and may also be legally privileged.

The contents are intended solely for the addressee only and are subject to the legal notice available at

<http://www.keldagroup.com/email.htm>. This email does not constitute a binding offer, acceptance, amendment, waiver or other agreement, or create any obligation whatsoever, unless such intention is clearly stated in the body of the email. If you are not the intended recipient, please return the message by replying to it and then delete the message from your computer.

Any disclosure, copying, distribution or action taken in reliance on its contents is prohibited and may be unlawful.


Yorkshire Water Services Limited


Registered Office Western House, Halifax Road, Bradford, BD6 2SZ Registered in England and Wales No 2366682

(See attached file: 14710111.pdf)

(See attached file: YW plan highlighting Watercourse.pdf)



421825 422867	Map Name SE2122NE	Title
	Yorkshire Water, PO Box 500, Hartley Road, Bradford BD6 2LZ Contact Name YorkMap Advisor C ROBERTS Contact Tel 87 2582	Notes
		Partial Key Fou Sewer = F Combined Sewer = C Surface Water Sewer = SW Trade Sewer = TD Partially Depress = PD
		<small>This plan is furnished as a general guide only and no liability is to be accepted by the provider. The user must ensure that 100% of the work is done in accordance with the relevant codes of practice. The issue of property connections are shown.</small>
	Date Req: 17/11/2017, 13:58:23	Date Gen: 17/11/2017, 13:58:39
	Source: Sewer Network Encou	

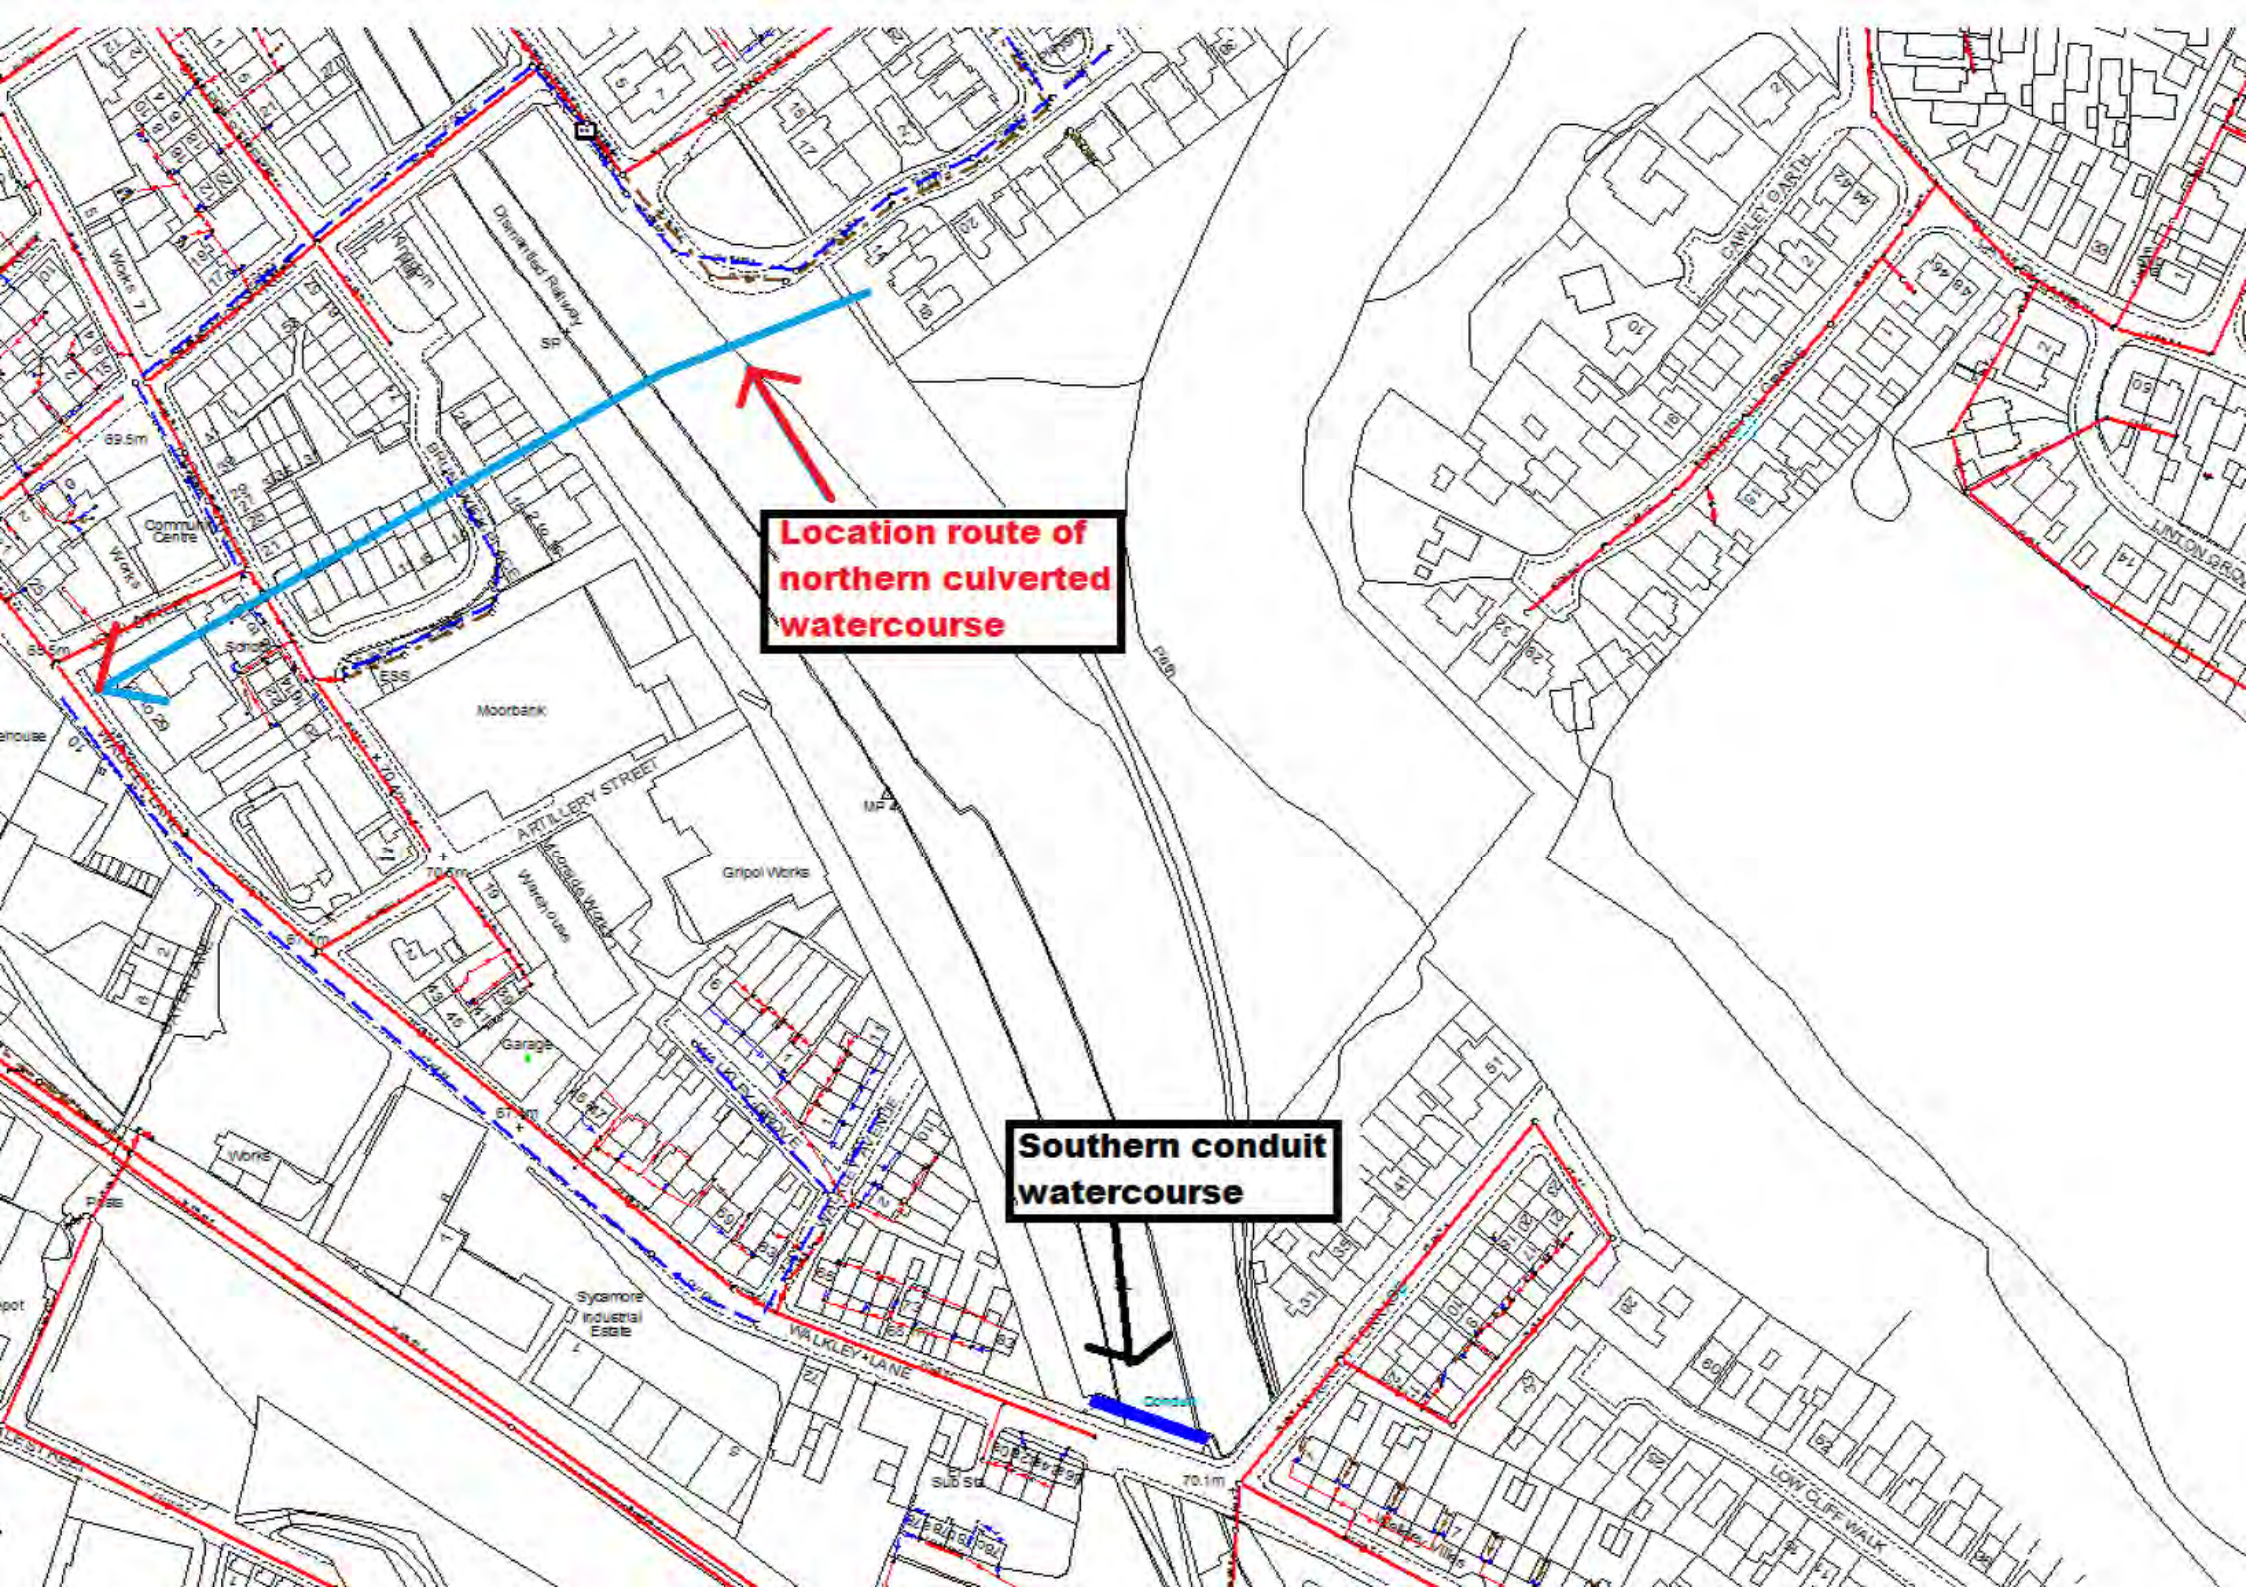

**Location route of
northern culverted
watercourse**

**Southern conduit
watercourse**

APPENDIX C

LAND DRAINAGE AUTHORITY CONSULTATION

Allan Poyser

From: Paul Farndale <Paul.Farndale@kirklees.gov.uk>
Sent: Tuesday 5 December, 2017 9:51 am
To: Allan Poyser
Subject: RE: 800/582 Disused Railway cutting, Heckmondwike

There is a manhole at the bottom of the path off Walkley Lane to the Greenway. This was blocked a while ago so a new pipe has been laid across to a ditch. This is worth investigating as to where it goes next as it could give you an outfall. There is the fish lake at a raised level at the other side. Plenty of water around....just need to research the outfalls.

Greenfield once we can confirm the outfalls.

PF

From: Allan Poyser [mailto:AllanPoyser@arpassociates.co.uk]
Sent: 04 December 2017 16:08
To: Paul Farndale
Subject: RE: 800/582 Disused Railway cutting, Heckmondwike

Paul

Thank you for responding so promptly.

There is no above ground watercourse at the location shown so it must be culverted and I agree it must be deep. However, this is the only feasible outfall for SW (there is nothing to the south) so I will probably request a greenfield run-off to this culverted watercourse for the development. Would you have any objection to this as part of a Drainage Strategy to supplement a Planning Application?

Kind Regards

Allan Poyser
0113 245 8498
allanpoyser@arpassociates.co.uk



**ARP ASSOCIATES &
ARP GEOTECHNICAL LTD**

www.arpassociates.co.uk

5 & 6 Northwest Business Park, Servia Hill, Leeds LS6 2QH
Pre-planning Geotechnical Civil Engineering Structural Engineering

Please consider the environment before printing this e-mail.

This e-mail is intended for the exclusive use of the individual(s) or entity to which it is addressed and contains confidential and/or privileged information. Any form of distribution, copying or use of this communication by anyone else is strictly prohibited. If you have received this communication in error please delete from your system and notify us immediately so that we can arrange for its return. Viruses: Although this e-mail and its attachments are believed to be free from any virus, it is the responsibility of the recipient(s) to conduct their own virus checks on all parts of this communication. ARP Associates and ARP Geotechnical Ltd accept no liability for loss or damage arising from their presence. ARP Associates is a trading division of ARP Geotechnical Ltd, a company registered in England and Wales with company number 3771811, whose registered office is at 5/6 Northwest Business Park, Servia Hill, Leeds LS6 2QH.

From: Paul Farndale [<mailto:Paul.Farndale@kirklees.gov.uk>]
Sent: Monday 4 December, 2017 3:54pm
To: Allan Poyser
Subject: RE: 800/582 Disused Railway cutting, Heckmondwike

Hello Allan,

Hope you are well.

We have the northern one on our maps and it will be from the same historical source as YW got it from as data was readily exchanged in the past. All we can say is that it is unverified given you have a hug cutting meaning we would have excessive depths on this system for it to be present in this location.

That said to the west of the cutting we do have various public surface water sewers connecting to it and some highway drains. Unless it is in an above ground supported structure (Pipe Bridge?)

The southern watercourse is a bit of a mystery. If we put the OS plans up it shades it grey as opposed to blue. Clicking on the line it simply states 'obstructing feature'.

Regards,

Paul Farndale
Principal Engineer
Flood Management & Drainage
Investment & Regeneration Service
Kirklees Council
01484 221000

From: Allan Poyser [<mailto:AllanPoyser@arpassociates.co.uk>]
Sent: 01 December 2017 08:09
To: Paul Farndale
Cc: Wayne Walker
Subject: RE: 800/582 Disused Railway cutting, Heckmondwike

Good Morning Paul

Since receiving your Consultation for the above project, I have revisited the site and been in negotiation with YW to determine a suitable outfall for surface water for the new development.

YW are stating that there is a culverted watercourse to the north ern side of the scheme crossing under the site from Horton Street. I have attached a plan from YW showing this pipe. Are you able to shed any light on this pipe and is it a culverted watercourse? You will appreciate the significance if it is a watercourse.

Please ignore the comment re a southern Conduit. This is an above ground "bridge" carrying services across the old railway.


Thank you in anticipation of your advice

Kind Regards

Allan Poyser
0113 245 8498
allanpoyser@arpassociates.co.uk

APPENDIX D

SURFACE WATER DRAINAGE CALCULATIONS

ARP Associates		Page 1
Northwest House Servia Hill Leeds LS6 2QH	Yorkdales 2 Ltd Railway Cutting, Heckmondwike 1471/01Prelim100yr+CC@12.9l/s	
Date 11-01-18 File 1471-01 preliminary Att...	Designed by ARP Checked by	
Elstree Computing Ltd		Source Control 2015.1

Summary of Results for 100 year Return Period (+30%)


Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Overflow (l/s)	Max Σ Outflow (l/s)	Max Volume (m³)	Status
15 min Summer	101.008	1.008	12.8	0.0	12.8	267.1	O K
30 min Summer	101.173	1.173	12.8	0.0	12.8	353.6	O K
60 min Summer	101.343	1.343	12.8	0.0	12.8	440.8	O K
120 min Summer	101.506	1.506	12.8	0.0	12.8	516.0	O K
180 min Summer	101.579	1.579	12.8	0.0	12.8	545.0	O K
240 min Summer	101.603	1.603	12.8	0.0	12.8	553.7	O K
360 min Summer	101.588	1.588	12.8	0.0	12.8	548.1	O K
480 min Summer	101.547	1.547	12.8	0.0	12.8	532.7	O K
600 min Summer	101.512	1.512	12.8	0.0	12.8	518.8	O K
720 min Summer	101.482	1.482	12.8	0.0	12.8	505.9	O K
960 min Summer	101.428	1.428	12.8	0.0	12.8	481.3	O K
1440 min Summer	101.324	1.324	12.8	0.0	12.8	431.3	O K
2160 min Summer	101.157	1.157	12.8	0.0	12.8	345.1	O K
2880 min Summer	101.008	1.008	12.8	0.0	12.8	267.1	O K
4320 min Summer	100.763	0.763	12.8	0.0	12.8	147.0	O K
5760 min Summer	100.563	0.563	12.8	0.0	12.8	71.5	O K
7200 min Summer	100.403	0.403	12.4	0.0	12.4	32.1	O K
8640 min Summer	100.289	0.289	11.7	0.0	11.7	14.4	O K
10080 min Summer	100.208	0.208	10.7	0.0	10.7	6.4	O K
15 min Winter	101.072	1.072	12.8	0.0	12.8	300.9	O K
30 min Winter	101.262	1.262	12.8	0.0	12.8	399.8	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Overflow Volume (m³)	Time-Peak (mins)
15 min Summer	115.731	0.0	279.9	0.0	23
30 min Summer	77.804	0.0	376.4	0.0	37
60 min Summer	49.937	0.0	483.1	0.0	68
120 min Summer	30.956	0.0	599.0	0.0	126
180 min Summer	23.058	0.0	669.3	0.0	186
240 min Summer	18.577	0.0	718.9	0.0	246
360 min Summer	13.656	0.0	792.7	0.0	364
480 min Summer	10.974	0.0	849.4	0.0	432
600 min Summer	9.254	0.0	895.3	0.0	492
720 min Summer	8.046	0.0	934.2	0.0	560
960 min Summer	6.447	0.0	998.0	0.0	688
1440 min Summer	4.709	0.0	1093.5	0.0	970
2160 min Summer	3.432	0.0	1195.4	0.0	1364
2880 min Summer	2.739	0.0	1271.8	0.0	1732
4320 min Summer	1.989	0.0	1385.3	0.0	2424
5760 min Summer	1.583	0.0	1470.2	0.0	3064
7200 min Summer	1.325	0.0	1538.3	0.0	3744
8640 min Summer	1.147	0.0	1597.8	0.0	4408
10080 min Summer	1.015	0.0	1650.2	0.0	5136
15 min Winter	115.731	0.0	313.5	0.0	22
30 min Winter	77.804	0.0	421.5	0.0	37

Summary of Results for 100 year Return Period (+30%)

Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Overflow (l/s)	Max Σ Outflow (l/s)	Max Volume (m³)	Status
60 min Winter	101.468	1.468	12.8	0.0	12.8	499.7	O K
120 min Winter	101.717	1.717	12.8	0.0	12.8	588.7	O K
180 min Winter	101.900	1.900	12.8	0.0	12.8	625.9	O K
240 min Winter	102.034	2.034	12.8	0.0	12.8	640.0	O K
360 min Winter	102.068	2.068	12.8	0.0	12.8	642.0	O K
480 min Winter	101.926	1.926	12.8	0.0	12.8	629.5	O K
600 min Winter	101.809	1.809	12.8	0.0	12.8	610.2	O K
720 min Winter	101.732	1.732	12.8	0.0	12.8	592.5	O K
960 min Winter	101.622	1.622	12.8	0.0	12.8	559.9	O K
1440 min Winter	101.442	1.442	12.8	0.0	12.8	488.0	O K
2160 min Winter	101.179	1.179	12.8	0.0	12.8	356.7	O K
2880 min Winter	100.943	0.943	12.8	0.0	12.8	233.7	O K
4320 min Winter	100.568	0.568	12.8	0.0	12.8	73.3	O K
5760 min Winter	100.300	0.300	11.8	0.0	11.8	15.7	O K
7200 min Winter	100.175	0.175	10.1	0.0	10.1	4.2	O K
8640 min Winter	100.147	0.147	8.7	0.0	8.7	2.8	O K
10080 min Winter	100.132	0.132	7.8	0.0	7.8	2.1	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Overflow Volume (m³)	Time-Peak (mins)
60 min Winter	49.937	0.0	541.1	0.0	66
120 min Winter	30.956	0.0	670.9	0.0	124
180 min Winter	23.058	0.0	749.6	0.0	182
240 min Winter	18.577	0.0	805.2	0.0	240
360 min Winter	13.656	0.0	887.9	0.0	350
480 min Winter	10.974	0.0	951.3	0.0	458
600 min Winter	9.254	0.0	1002.8	0.0	554
720 min Winter	8.046	0.0	1046.3	0.0	580
960 min Winter	6.447	0.0	1117.8	0.0	736
1440 min Winter	4.709	0.0	1224.7	0.0	1044
2160 min Winter	3.432	0.0	1338.9	0.0	1476
2880 min Winter	2.739	0.0	1424.4	0.0	1824
4320 min Winter	1.989	0.0	1551.6	0.0	2468
5760 min Winter	1.583	0.0	1646.5	0.0	3000
7200 min Winter	1.325	0.0	1722.9	0.0	3672
8640 min Winter	1.147	0.0	1789.5	0.0	4352
10080 min Winter	1.015	0.0	1848.2	0.0	5032

ARP Associates		Page 3
Northwest House Servia Hill Leeds LS6 2QH	Yorkdales 2 Ltd Railway Cutting, Heckmondwike 1471/01Prelim100yr+CC@12.9l/s	
Date 11-01-18 File 1471-01 preliminary Att...	Designed by ARP Checked by	
Elstree Computing Ltd	Source Control 2015.1	


Rainfall Details

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	100	Cv (Summer)	0.750
Region	England and Wales	Cv (Winter)	0.840
M5-60 (mm)	19.000	Shortest Storm (mins)	15
Ratio R	0.350	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+30

Time Area Diagram

Total Area (ha) 1.290

Time (mins) Area			Time (mins) Area		
From:	To:	(ha)	From:	To:	(ha)
0	4	0.000	4	8	1.290

ARP Associates		Page 4
Northwest House Servia Hill Leeds LS6 2QH	Yorkdales 2 Ltd Railway Cutting, Heckmondwike 1471/01Prelim100yr+CC@12.9l/s	
Date 11-01-18 File 1471-01 preliminary Att...	Designed by ARP Checked by	
Elstree Computing Ltd		Source Control 2015.1

Model Details

Storage is Online Cover Level (m) 103.000

Pipe Structure

Diameter (m) 1.500 Length (m) 364.000
Slope (1:X) 500.000 Invert Level (m) 100.000

Hydro-Brake Optimum® Outflow Control

Unit Reference MD-SHE-0147-1290-2088-1290
Design Head (m) 2.088
Design Flow (l/s) 12.9
Flush-Flo™ Calculated
Objective Minimise upstream storage
Diameter (mm) 147
Invert Level (m) 100.000
Minimum Outlet Pipe Diameter (mm) 225
Suggested Manhole Diameter (mm) 1500

Control Points	Head (m)	Flow (l/s)
Design Point (Calculated)	2.088	12.8
Flush-Flo™	0.616	12.8
Kick-Flo®	1.266	10.1
Mean Flow over Head Range	-	11.2

The hydrological calculations have been based on the Head/Discharge relationship for the Hydro-Brake Optimum® as specified. Should another type of control device other than a Hydro-Brake Optimum® be utilised then these storage routing calculations will be invalidated


Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)
0.100	5.3	1.200	10.8	3.000	15.2	7.000	22.9
0.200	10.5	1.400	10.6	3.500	16.4	7.500	23.6
0.300	11.8	1.600	11.3	4.000	17.5	8.000	24.4
0.400	12.4	1.800	12.0	4.500	18.5	8.500	25.1
0.500	12.7	2.000	12.6	5.000	19.5	9.000	25.8
0.600	12.8	2.200	13.2	5.500	20.4	9.500	26.5
0.800	12.7	2.400	13.7	6.000	21.2		
1.000	12.1	2.600	14.2	6.500	22.1		

Weir Overflow Control


Discharge Coef 0.544 Width (m) 3.000 Invert Level (m) 102.088

APPENDIX E

INDICATIVE DRAINAGE PROPOSAL

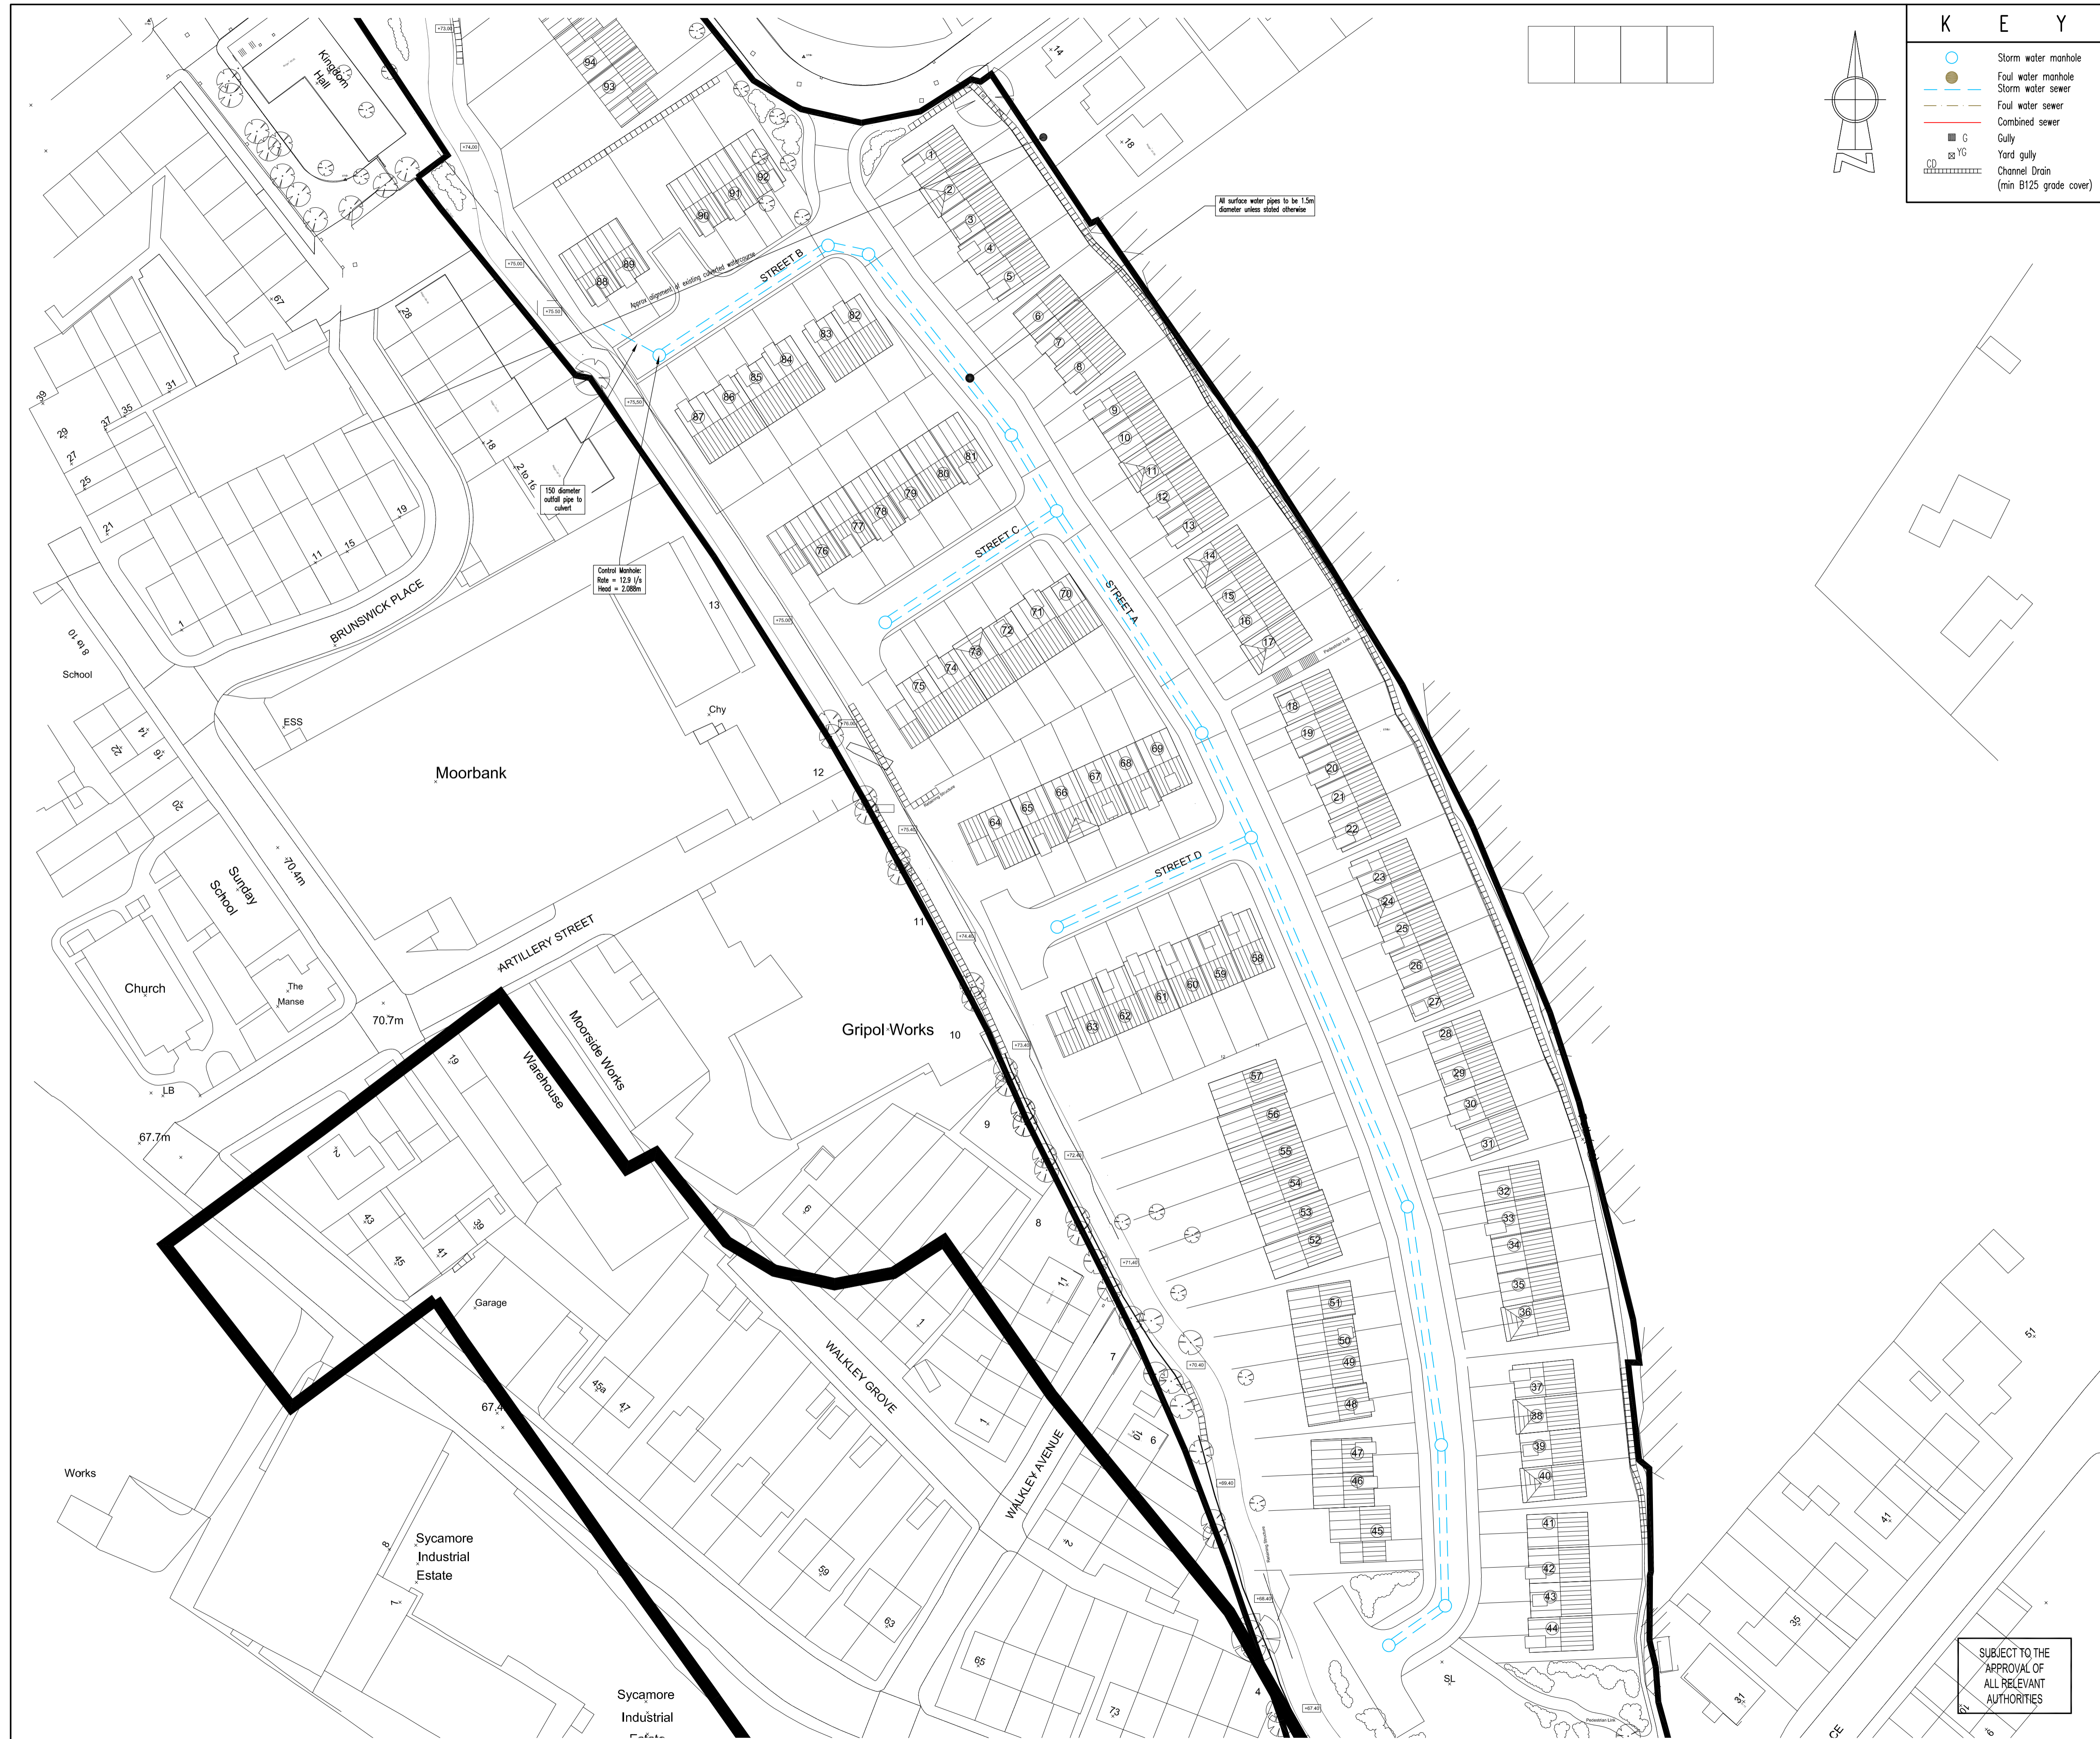

KEY	
	Storm water manhole
	Foul water manhole
	Storm water sewer
	Foul water sewer
	Combined sewer
	Gully
	Yard gully
	Channel Drain (min B125 grade cover)

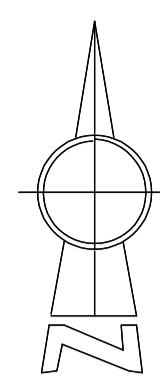

- ### NOTES
- For longitudinal sections refer to drawing 000/00/06.
 - No services are to be sited directly over, or within 1m of, an adoptable sewer or manhole.
 - Private drainage connections to adoptable sewers to be via 45° junction.
 - Off site manholes already built must have invert levels checked prior to connection to the off site drainage.
 - Any connections to existing sewers/manholes are to be supervised by Yorkshire Water.
 - All connections to proposed public sewers to be minimum 150mm#.
 - Any kind drain or water course on site to be diverted as not to pass under proposed buildings. Diversion to be approved and inspected on site by the Local Authority.

- #### Yorkshire Water General Notes
- All adoptable sewer works and material to be in accordance with "Sewers for Adoption" 6th Edition, the relevant British/European and Yorkshire Water's Standards/Requirements/Addendum to the Mechanical and Electrical Specification and Kitemarked.
 - Manhole covers shall have a clear opening of 600mm and shall be Class D400 to BS EN 124 with 150mm deep frames in highways.
 - Filled ground must be filled and consolidated under the supervision, and to the satisfaction, of Yorkshire Water before any sewer works are carried out.
 - Cover slabs must carry the BSI Kitemark or will be rejected by the Yorkshire Water inspector. Where the clear opening of the Kitemarked product is different to that of the cover and frame, a loading bearing slab should be fitted above the cover slab to bring the size down to 600x600mm for the Yorkshire Water specified cover size. Please refer to the Concrete Pipe Systems Association (CPSA), "Technical Bulletin" issued autumn 2004 for Kitemarked cover slab opening sizes.
 - The adoptable sewers should be a minimum of 1m and manholes 0.5m from kerb faces and service margins.
 - Sewers must have 5 metres clearance from trees and hedges, (please also refer to Figure 2.3 on page 33 in "Sewers for Adoption" 6th Edition for restrictions on tree planting adjacent to Sewers).
 - Sewers to be laid in Class "S" bedding (150mm granular bed and surround). Where depth of cover to top of the sewer is less than 1.2m in highways and verges (or less than 900mm in none vehicular access areas) then a concrete slab should be provided above the granular bed and surround.
 - Adoptable plastic sewer pipes to be BSI Kitemarked (Certified to WS 4-35-01 and BS/EN13476). Adoptable sewer pipes to be laid in maximum 3 metre lengths unless there is a specific operational need to lay longer.
 - Plastic channel sections, manholes are not acceptable and clayware is preferable. Plastic channels are difficult to set in concrete and a satisfactory finish cannot be obtained on the bedding.
 - The chamber size of manholes with more than one connection in them may need to be increased an increment to accommodate the connections and bends.
 - Yorkshire Water policy is not to accept type "C" brick manhole and 1050mm dia manhole rings. Instead it is preferred that you use a type "B" manhole with 1200mm dia or 1500mm dia rings, with the opening sited over the channel where depth of cover to pipe soffit is 1-1.5m.
 - Surface water and foul rising mains to be provided with marker tape above the rising mains.
 - If plastic pipes are to be used then the following should apply:
 - All adoptable sewers to be BSI Kitemark (certified to WS 4-35-01).
 - Bedding and backfill material to conform to the requirements of Water industry Specification 4-08-02 (Table A2)
 - Where plastic pipes are proposed for adoptable sewers, structural calculations for the plastic pipes and a site investigation report to prove that the ground condition is suitable for the plastic pipes are to be produced.
 - Where plastic pipes are installed into the ground prior to getting full technical approval, the developer must provide a CCTV survey of the prospectively adoptable sewers and a deformation test (Light-Line test) of the plastic pipes.
 - Demarcation chambers to be a min. 450mm# chamber for 100mm# foul & 150mm# surface water pipes up to 1.2m deep. For depths greater than 1.2m, restricted access opening to 350mm is required for safety reasons.
 - Maximum depth of demarcation chamber to be 2m, where depth exceeds 2m, manhole to be constructed as type B manhole.
 - Where a B125 cover and frame has been approved, this must not be coated in plastic and must have lifting eyes suitably sized to accommodate standard lifting keys. Screw down covers are not acceptable.
 - Yorkshire Water is not obliged to accept filter drain/land drainage runoff into the public sewer network or adoptable drainage system (directly or in-directly). An alternative method of disposal of the land drainage runoff will therefore be required and you will have to liaise with the Land Drainage Authority/Land Drainage Section with regard to the disposal of the filter drain/land drainage runoff is required.
 - Sulphate resisting cement (C20-DC2) and precast concrete products must be used or a laboratory report provided proving that such precautions are not necessary.
 - Strength of vitrified clay pipes (if used) to be 40KN/m for 100#, 40KN/m for 150#, 45KN/m for 225# and 72KN/m for 300#. All concrete pipes to be Class 120 concrete to EN 1916/BS 5911-1:2002.
 - All levels of existing drainage to be confirmed prior to work commencing on site.
 - The contractor must allow for any fee's required for road and sewer opening permits, sewer connections and make the appropriate applications.

Rev	By	Date	Revision	ARP	ARP
/	JMG	16.01.18	Issued for approval	ARP	ARP

ARP ASSOCIATES
Chartered Consulting Engineers

Northwest House • 5 & 6 Northwest Business Park • Servia Hill, Leeds • LS6 2QH
0113 245 9498 • 0113 244 2864 • leeds@arpassociates.co.uk • www.arpassociates.co.uk

ARP Associates is a trading division of ARP Geotechnical Ltd, a company registered in England and Wales with company number 3773813, whose registered office is at 5/6 Northwest Business Park, Servia Hill, Leeds LS6 2QH

TITLE
INDICATIVE DRAINAGE STRATEGY

PROJECT
HORTON STREET, HECKMONDWIKE

CLIENT
YORKDALES 2 LTD

DRAWING STATUS
PRELIMINARY

Scale	Date	Drawn
1:200 @ A1	JAN 18	JMG
	Chk.	ARP

Org. No.	Rev
1471/01/SK01	/

SUBJECT TO THE APPROVAL OF ALL RELEVANT AUTHORITIES