

NOTES

1. Driveway and car park surfacing design and construction to Engineer's Specification (by others).
 2. All dimensions are in millimetres unless otherwise stated.
 3. Pre-cast concrete products shall comply with the relevant provisions of BS EN 12424.
 4. Manhole covers, gully covers, grates and frames shall comply with the relevant provisions of BS EN 124.
 5. D400 class manhole cover to be used within trafficked areas. A15 class manhole cover to be used in untrafficked areas.
 5. Do not scale from this drawing. If in doubt ask.
- Discharge restricted to 6.3litre based on making 1 year runoff rate of 9.00litre minus 30% for climate change. Volume to discharge to Tofishie Water combined sewer.

100%UV-C303, storage volume of 3.0 m3 retained. Storage to be provided within crate tank 20m2 by 0.6m deep located within site.

Operator should undertake inspection of control manholes SW10 and catchpit manholes SW6 & SW9 on a 2 month basis and clean when necessary.

KEY:



REV	DESCRIPTION	DATE
0	For Approval	08/11/19

EWE Associates Ltd

EWE Associates Limited
7 Waverney Close
Burton Upon Stather
Scunthorpe
DN15 9DT
Tel: 07875 972270

Email : lea.favill@eweassociates.com


Proposed Service
Station, Bradley Road,
Huddersfield

CLIENT
Pennine Service Station

DRAWING TITLE
Drainage Layout

SCALE	DATE
1:100	24/10/19
DRAWN BY	CHECKED BY
JF	JF
	REVISION
	0

DRAWING NO
EWE/2497/01

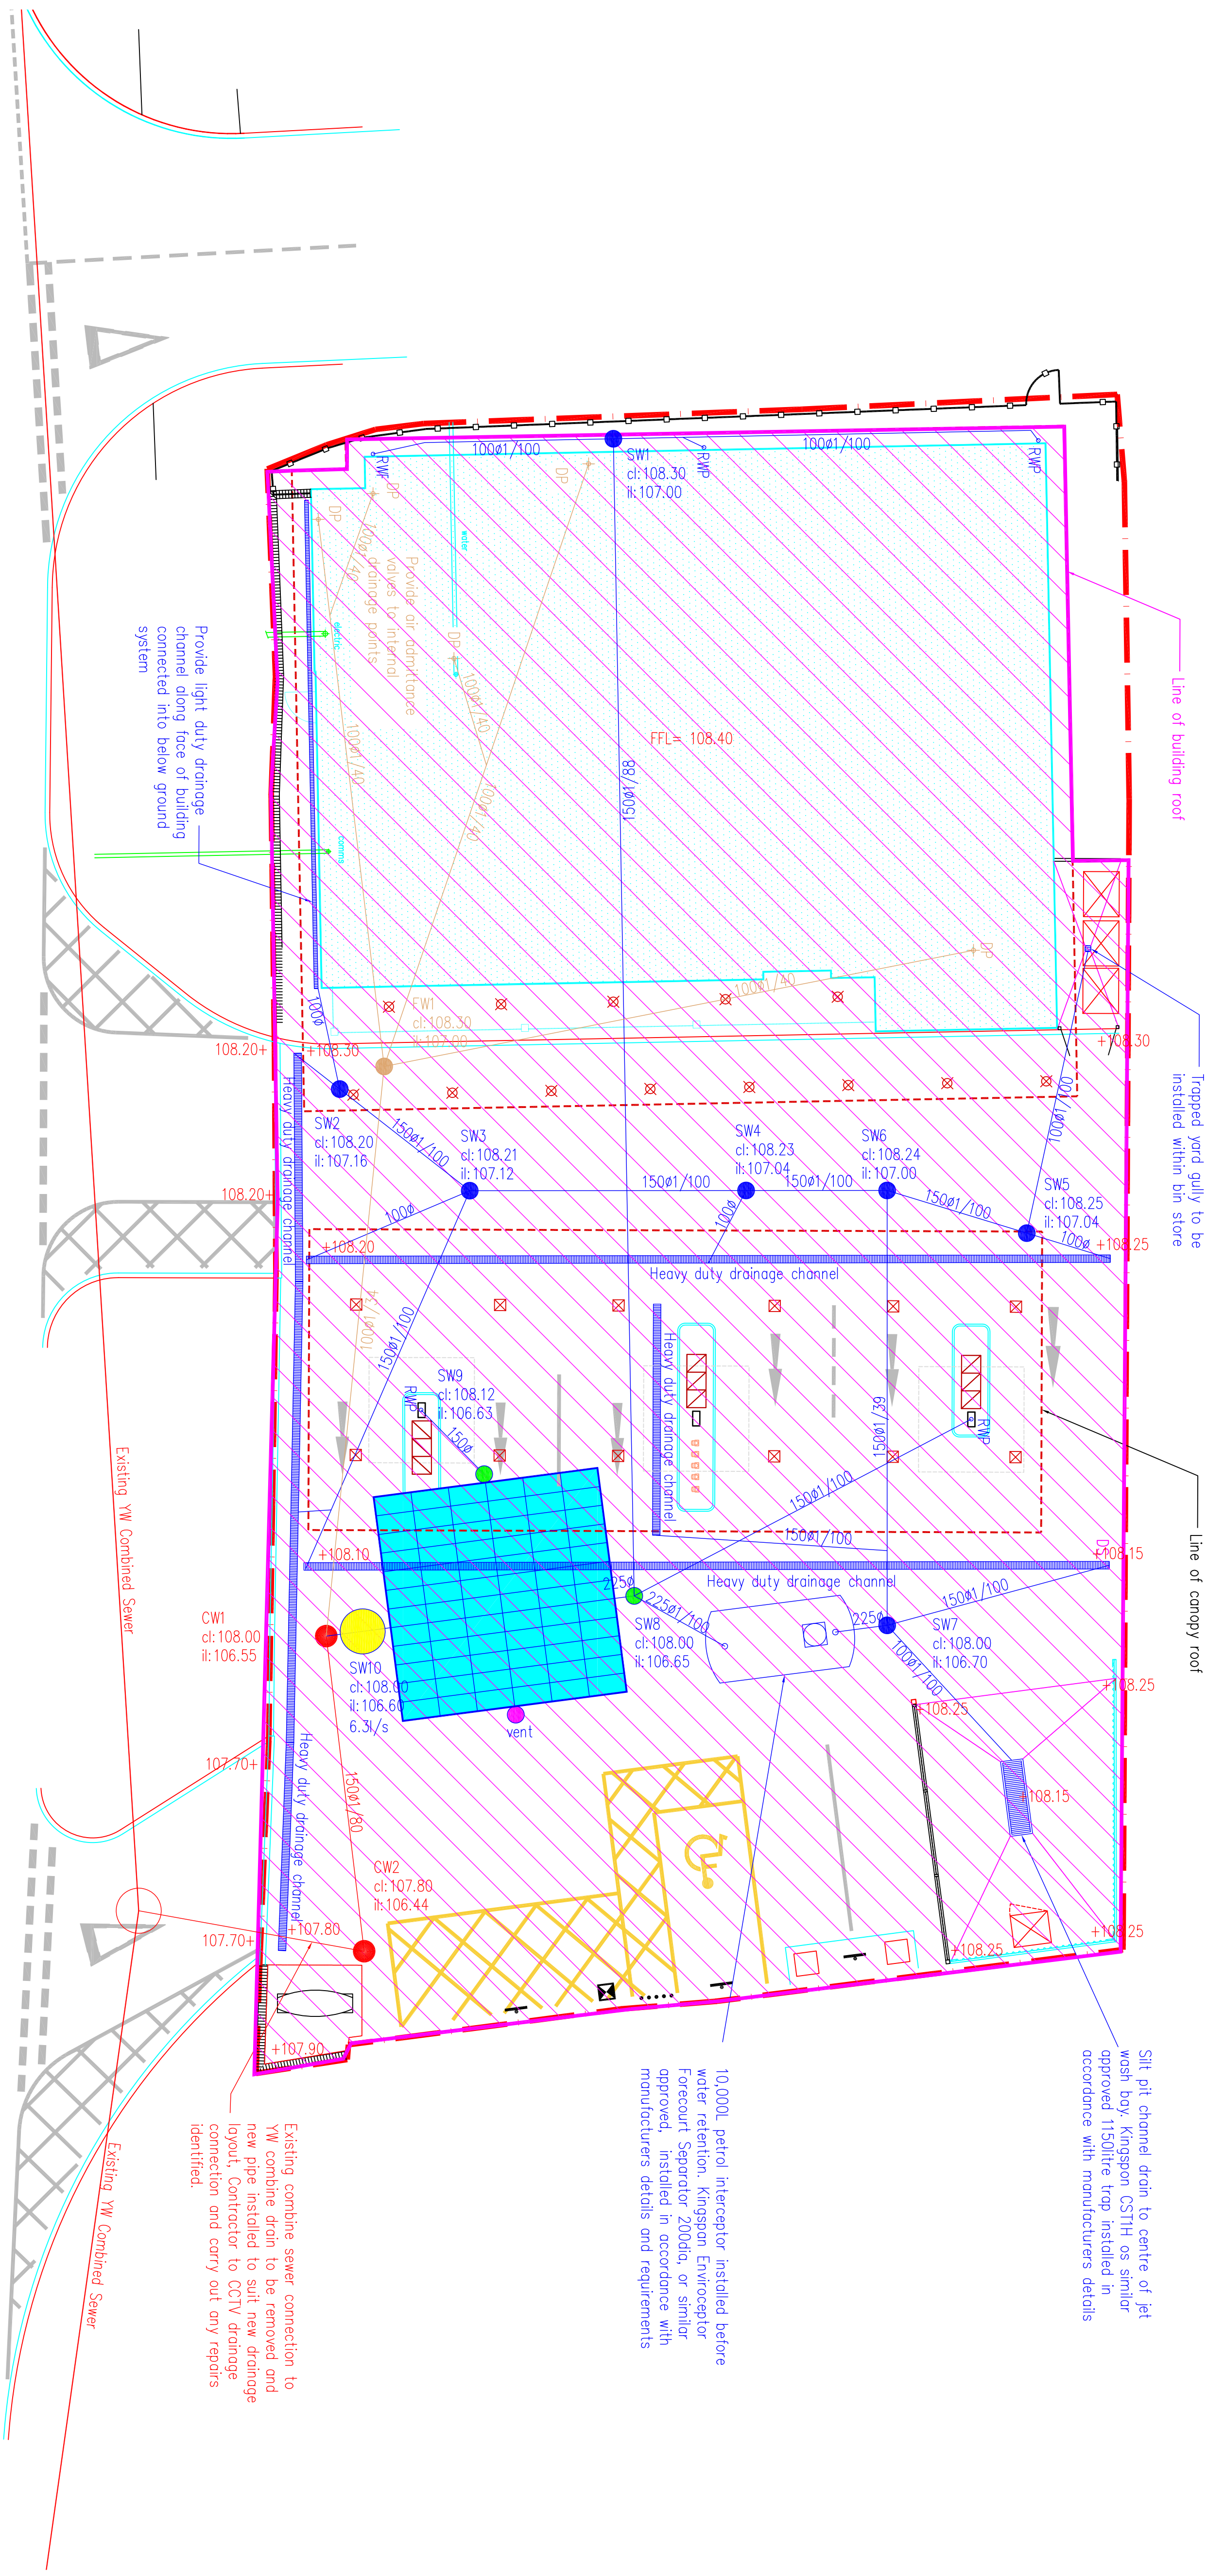

PLANNING CONDITION DISCHARGE DRAWING ONLY