

Background Noise Assessment

Report No: 3751-R2 – Land Off Lady Ann Road, Batley.

Client: D Noble Ltd

Table of Contents

1. Introduction	3
2. Scope	3
3. Site Description	7
4. Survey Information	7
5. Survey Results	8
6. Design Criteria	14
7. Mitigation	15
8. Conclusion	17
9. Appendix	19

<i>Report Revisions</i>	<i>Date</i>		
3751-R1	12/06/2017	Initial Report	
3751-R2	16/06/2017	Updated Layout	
3751-R3	10/11/2022	Updated Layout	
	<i>Produced by:</i>	<i>Checked by:</i>	<i>Authorised by:</i>
Name:	Steve Clow MIOA	Steve Mckeever AMIOA	Steve Clow MIOA

This report is for the exclusive use of the client named on page 1 and may not be reproduced without the authors' permission. The information reported had been prepared with all reasonable care and diligence. Clover Acoustics Ltd disclaims any responsibility to the client and others in respect of matters outside the scope of works agreed. We accept no responsibility to any third party to whom this report or any part of is made available. Any such parties rely upon this report at their own risk.

Aerial images contained in this document are reproduced under license from our Global Imaging System operator. License details are available upon request.

Clover Acoustics Ltd - The Old Vicarage - Barcroft Lane - Askern - Doncaster - DN6 0DS
 Tel: 01302 707 199 - Web: www.cloveracoustics.co.uk - Email: info@cloveracoustics.co.uk

1. Introduction

Clover Acoustics Ltd has been commissioned by D Noble Ltd to undertake a noise assessment of a proposed new build residential development on land off Lady Ann Road, Batley.

A baseline noise survey has been carried out over a typical 24-hour period in order to assess the impact of noise from road traffic in the surrounding area at the proposed development. The survey was conducted at three monitoring locations representative of the proposed façades commencing on Wednesday 7th June 2017.

2. Scope

This report assesses the noise impact generated from existing sources, in this instance the dominant noise source impacting on the proposed development site is road traffic.

The scope for this assessment is as follows:

- a) A description of the sources of noise which the development site is likely to be subject to i.e. Passing traffic, pedestrians etc.
- b) An assessment of the impact which these sources have on the proposed development, including bedrooms, amenity areas and gardens, having regard to the following sources of guidance and assessment methodologies, where appropriate:
 - Noise Policy Statement for England
 - BS8233:2014 – Sound Insulation and Noise Reduction for Buildings.
 - World Health Organisation – Guidelines for Community Noise 1999.
 - Night Noise Guidelines for Europe
 - Local Authority Requirements

Noise Policy Statement for England

A new document dealing with noise was released in March 2012 under the National Planning Policy Framework (NPPF). This document supersedes and replaces Planning Policy Guidance note 24 (PPG24) which previously covered issues related to noise and planning in England. Paragraph 123 of the NPPF states that planning policies and decisions should aim to:

- Avoid noise from giving rise to significant adverse impacts (see Explanatory Note to the Noise Policy Statement for England (DEFRA)) on health and quality of life as a result of new development;
- Mitigate and reduce to a minimum other adverse impacts (see Explanatory Note to the Noise Policy Statement for England (DEFRA)) on health and quality of life arising from noise from new development, including through the use of conditions;

- Recognise that development will often create some noise and existing businesses wanting to develop in continuance of their business should not have unreasonable restrictions put on them because of changes in nearby land use since they were established (Subject to the provisions of the Environmental Protection Act 1990 and other relevant law); and
- Identify and protect areas of tranquility which have remained relatively undisturbed by noise and are prized for their recreational and amenity value for this reason.

The Noise Policy Statement for England (NPSE) was developed by DEFRA and published in March 2010 with the stated aim to ‘Promote good health and good quality of life through the effective management of noise within the context of Government policy on sustainable development.’

Noise Policy Statement England (NPSE)

<p>Noise Policy Aims</p> <p>Through the effective management and control of environmental, neighbour and neighbourhood noise within the context of Government policy on sustainable development:</p> <ul style="list-style-type: none"> • avoid significant adverse impacts on health and quality of life; • mitigate and minimise adverse impacts on health and quality of life; and • where possible, contribute to the improvement of health and quality of life.
--

A further stated aim is outlined in para 2.7:

<p>2.7 In addition, the application of the NPSE should enable noise to be considered alongside other relevant issues and not to be considered in isolation. In the past, the wider benefits of a particular policy, development or other activity may not have been given adequate weight when assessing the noise implications.</p>
--

The Noise Policy Statement further extrapolates on the aims of the policy with a discussion of key phrases and concepts:

“What do the aims of the Noise Policy Statement for England mean?”

2.19 *There are several key phrases within the NPSE aims and these are discussed below.*

“Significant adverse” and “adverse”

2.20 *There are two established concepts from toxicology that are currently being applied to noise impacts, for example, by the World Health Organisation. They are:*

NOEL – No Observed Effect Level

This is the level below which no effect can be detected. In simple terms, below this level, there is no detectable effect on health and quality of life due to the noise.

LOAEL – Lowest Observed Adverse Effect Level

This is the level above which adverse effects on health and quality of life can be detected.

2.21 Extending these concepts for the purpose of this NPSE leads to the concept of a significant observed adverse effect level.

SOAEL – Significant Observed Adverse Effect Level

This is the level above which significant adverse effects on health and quality of life occur.¹

The document goes on to advise that it is “not possible to have a single objective noise-based measure that defines SOAEL that is applicable to all sources of noise in all situations” advising that by not having specific SOAEL values the document retains “necessary policy flexibility until further evidence and guidance is available”²

BS8233:2014: Guidance on Sound Insulation and Noise Reduction for Buildings.

BS8233 gives guidance for internal noise levels within buildings to achieve reasonable or good resting/sleeping conditions within residential properties as follows:

Activity	Location	07:00 to 23:00	23:00 to 07:00
Resting	Living room	35dB $L_{Aeq,16\text{ hour}}$	---
Dining	Dining room/area	40dB $L_{Aeq,16\text{ hour}}$	---
Sleeping	Bedroom	35dB $L_{Aeq,16\text{ hour}}$	30dB $L_{Aeq, 8\text{ hour}}$

The building envelope design will be considered to ensure that these internal criteria are met. With regard to night time noise it is noted that reference to a specific level (45dB L_{Amax} derived from WHO guidelines values 1999) has been removed from BS8233:2014. It does however make comment that such a limit may be desirable for specific events: “NOTE 4 Regular individual noise events (for example, scheduled aircraft or passing trains) can cause sleep disturbance. A guideline value may be set in terms of SEL or $L_{Amax,F}$ depending on the character and number of events per night. Sporadic noise events could require separate values.”

¹ Page 8 NSPE
² Page 9 NPSE

World Health Organisation – Guidelines for Community Noise 1999.

The World Health Organisation gives guidance for maximum recommended noise levels outside residential properties as follows:

Specific Environment	Critical health effect	dB	Time	dB
		L _{Aeq}	(hr)	L _{Amax}
Outdoor living area	Serious annoyance, daytime and evening	55	16	-
	Moderate annoyance, daytime and evening	50	16	-
Outside bedrooms	Sleep disturbance, window open (outdoor values)	45	8	60

The WHO Guidelines for Community Noise 1999 states, *“for a good sleep, it is believed that indoor sound pressure levels should not exceed approximately 45dB L_{Amax} more than 10–15 times per night”*. We would view this as representative of the Significant Observed Adverse Effect Level or SOAEL referred to in NSPE derived on the basis that if noise levels are 45 dB L_{Amax} or less, they will not give rise to significant sleep disturbance effects. This should be regarded as a maximum limit. The Lowest Observed Adverse Effect Level or LOAEL would in our view be 42 dB L_{Amax}, since the WHO Night Noise Guidelines for Europe 2009 state that this is the threshold of any observed effect on night time awakening.

4. Survey Information

Measurement Instrumentation

The measurement instrumentation used on the survey was as follows:

Equipment	Manufacturer & Type	Serial Number	Calibration Certificate
Sound Level Meter	Norsonic 118	30559	5280
Sound Level Meter	Norsonic 118	28952	09739
Sound Level Meter	Cassella CEL 480	089653	14612
Acoustic Calibrator	Norsonic 1251	32856	09734
Acoustic Calibrator	Cassella CEL 110/2	115909	14612

The equipment was calibrated to comply with section 4.2 of BS7445:1-2003 before and after the surveys. The calibration was as follows:

Meter	Serial	Before		After	
Norsonic 118	30559	113.9	-26.1	113.9	-26.2
Norsonic 118	28952	113.9	-26.3	113.9	-26.3
Cassella CEL 480	089653	114.0	-	114.0	-

Measurements & Timescales

During the survey 5-minute measurements were made over a typical 24-hour period commencing Wednesday 7th June 2017. The measurements were subsequently analysed into hourly periods.

The following measurements are reported: $L_{Aeq,T}$, $L_{A90,T}$, $L_{AMAX,T}$

The measurements and their interpretation shall be in accordance with BS 7445: Parts 1 and 2. All sound pressure levels are in dB (re 20 μ Pa).

Meteorology

During the survey the weather was considered to be mainly dry and mild.

Position of Monitoring Equipment


The equipment was mounted free field 1.5m from the ground at a location representative of the residential receivers. Figure 1 shows the site location plan with background monitoring location.

5. Survey Results

Background Noise Summary – Monitoring Location 1

The following tables show the summary of the background noise levels monitored. The reported results represent the free field sound pressure levels.

Hour Start		Hourly Summary		
		LAeq,1hour	LAMax,1hour	Min LA90,5min
07:00	44.9	71.1	37.3	46.2
08:00	43.7	67.0	37.1	45.5
09:00	45.6	68.0	38.0	47.2
10:00	47.6	68.6	37.8	49.6
11:00	47.8	68.5	39.7	49.0
12:00	46.6	70.1	38.6	46.4
13:00	46.2	64.1	41.7	48.3
14:00	47.0	65.4	40.1	48.5
15:00	45.7	66.0	38.6	47.3
16:00	49.1	74.6	39.0	48.1
17:00	46.6	67.3	38.9	47.2
18:00	45.5	66.9	37.2	47.4
19:00	44.7	69.3	35.5	45.2
20:00	44.4	66.5	35.4	45.9
21:00	41.9	65.0	33.9	41.2
22:00	36.5	56.5	33.1	36.7
23:00	38.7	70.3	34.0	38.2
00:00	34.9	67.4	32.7	34.2
01:00	34.1	57.4	32.5	34.2
02:00	36.5	58.2	32.8	35.5
03:00	39.3	59.6	32.5	37.3
04:00	48.1	70.6	37.4	51.1
05:00	43.3	65.3	34.4	45.3
06:00	45.1	70.9	35.0	45.7

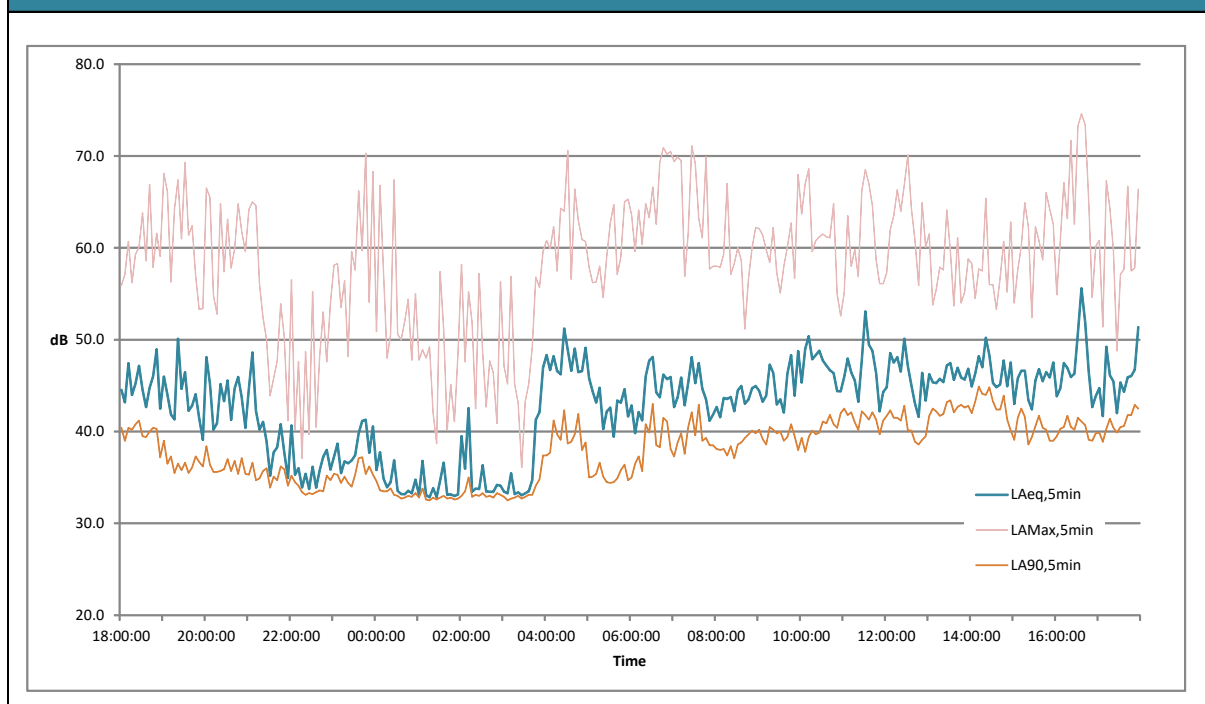

Data Summary Table - Position 1

Monitoring Position 1				
Measurement	Daytime	Hour Ending/ Period	Night-time	Hour Ending/ Period
Minimum dB $L_{Aeq,1hr}$	36	22:00	34	01:00
Maximum dB $L_{Aeq,1hr}$	49	16:00	48	04:00
Average dB $L_{Aeq,16hr}/L_{Aeq,8hr}$	46	07:00 – 23:00	43	23:00 – 07:00
Night dB L_{Amax}^3	–	–	65	06:20

The daytime hourly equivalent continuous sound pressure levels at the proposed façade ranged between 36dB $L_{Aeq,1hr}$ and 49dB $L_{Aeq,1hr}$ with an average level during the daytime period of 46dB $L_{Aeq,16hr}$.

The night-time hourly equivalent continuous sound pressure levels at the proposed façade ranged between 34dB $L_{Aeq,1hr}$ and 48dB $L_{Aeq,1hr}$ with an average level during the night-time period of 43dB $L_{Aeq,8hr}$. The 15th highest³ night-time individual noise event between the hours of 23:00 and 07:00 was 65dB L_{Amax} .

³ The 15th highest LAMAX has been selected as in line with good sleep conditions identified in “The Guidelines for Community Noise” Section 3.4 Sleep Disturbance.

Background Noise Summary – Monitoring Location 2



Site: Land off Lady Anne Road, Batley.


Table 2: Position 2

Start Date: 07/06/2017

Report: 3751-R1

End Date: 07/06/2017

Hourly Summary				
Hour Start	LAeq,1Hour	LAMax,1hour	Min LA90,5min	LA10,1hour
07:00	46.0	74.2	38.0	45.5
08:00	42.3	68.8	37.9	43.0
09:00	42.1	68.8	37.8	43.3
10:00	43.8	61.7	38.2	45.3
11:00	44.1	71.0	39.2	45.0
12:00	44.6	64.2	38.9	44.9
13:00	47.2	67.2	40.7	47.2
14:00	46.0	65.7	37.5	46.5
15:00	43.2	62.4	37.8	44.2
16:00	44.3	68.6	38.2	44.4
17:00	45.0	69.1	38.7	45.4
18:00	45.5	70.1	35.0	43.9
19:00	46.0	71.1	34.7	43.8
20:00	49.6	84.0	34.0	43.0
21:00	37.2	57.1	33.0	37.9
22:00	37.2	66.3	32.8	37.2
23:00	37.2	60.9	33.8	38.1
00:00	34.4	59.8	32.5	35.0
01:00	34.6	56.5	32.1	34.5
02:00	36.2	61.7	32.1	34.8
03:00	41.0	61.0	32.0	38.9
04:00	37.5	55.5	33.0	38.5
05:00	37.8	68.4	33.4	38.2
06:00	45.7	84.4	36.3	44.2

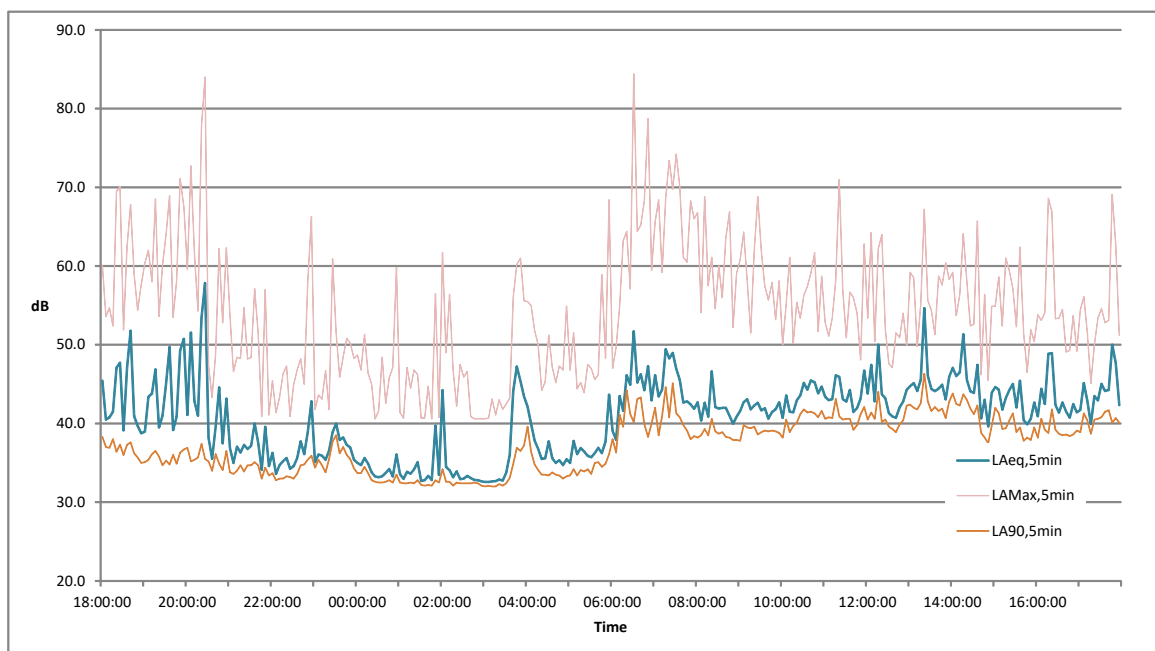


Data Summary Table - Position 2

Monitoring Position 2				
Measurement	Daytime	Hour Ending/ Period	Night-time	Hour Ending/ Period
Minimum dB $L_{Aeq,1hr}$	37	22:00	34	00:00
Maximum dB $L_{Aeq,1hr}$	50	20:00	46	06:00
Average dB $L_{Aeq,16hr}/L_{Aeq,8hr}$	45	07:00 – 23:00	40	23:00 – 07:00
Night dB $L_{Amax,}^3$	–	–	59	05:45

The daytime hourly equivalent continuous sound pressure levels at the proposed façade ranged between 37dB $L_{Aeq,1hr}$ and 50dB $L_{Aeq,1hr}$ with an average level during the daytime period of 45dB $L_{Aeq,16hr}$.

The night-time hourly equivalent continuous sound pressure levels at the proposed ranged between 34dB $L_{Aeq,1hr}$ and 46dB $L_{Aeq,1hr}$ with an average level during the night-time period of 40dB $L_{Aeq,8hr}$. The 15th highest³ night-time individual noise event between the hours of 23:00 and 07:00 was 59dB L_{Amax} .

Background Noise Summary – Monitoring Location 3

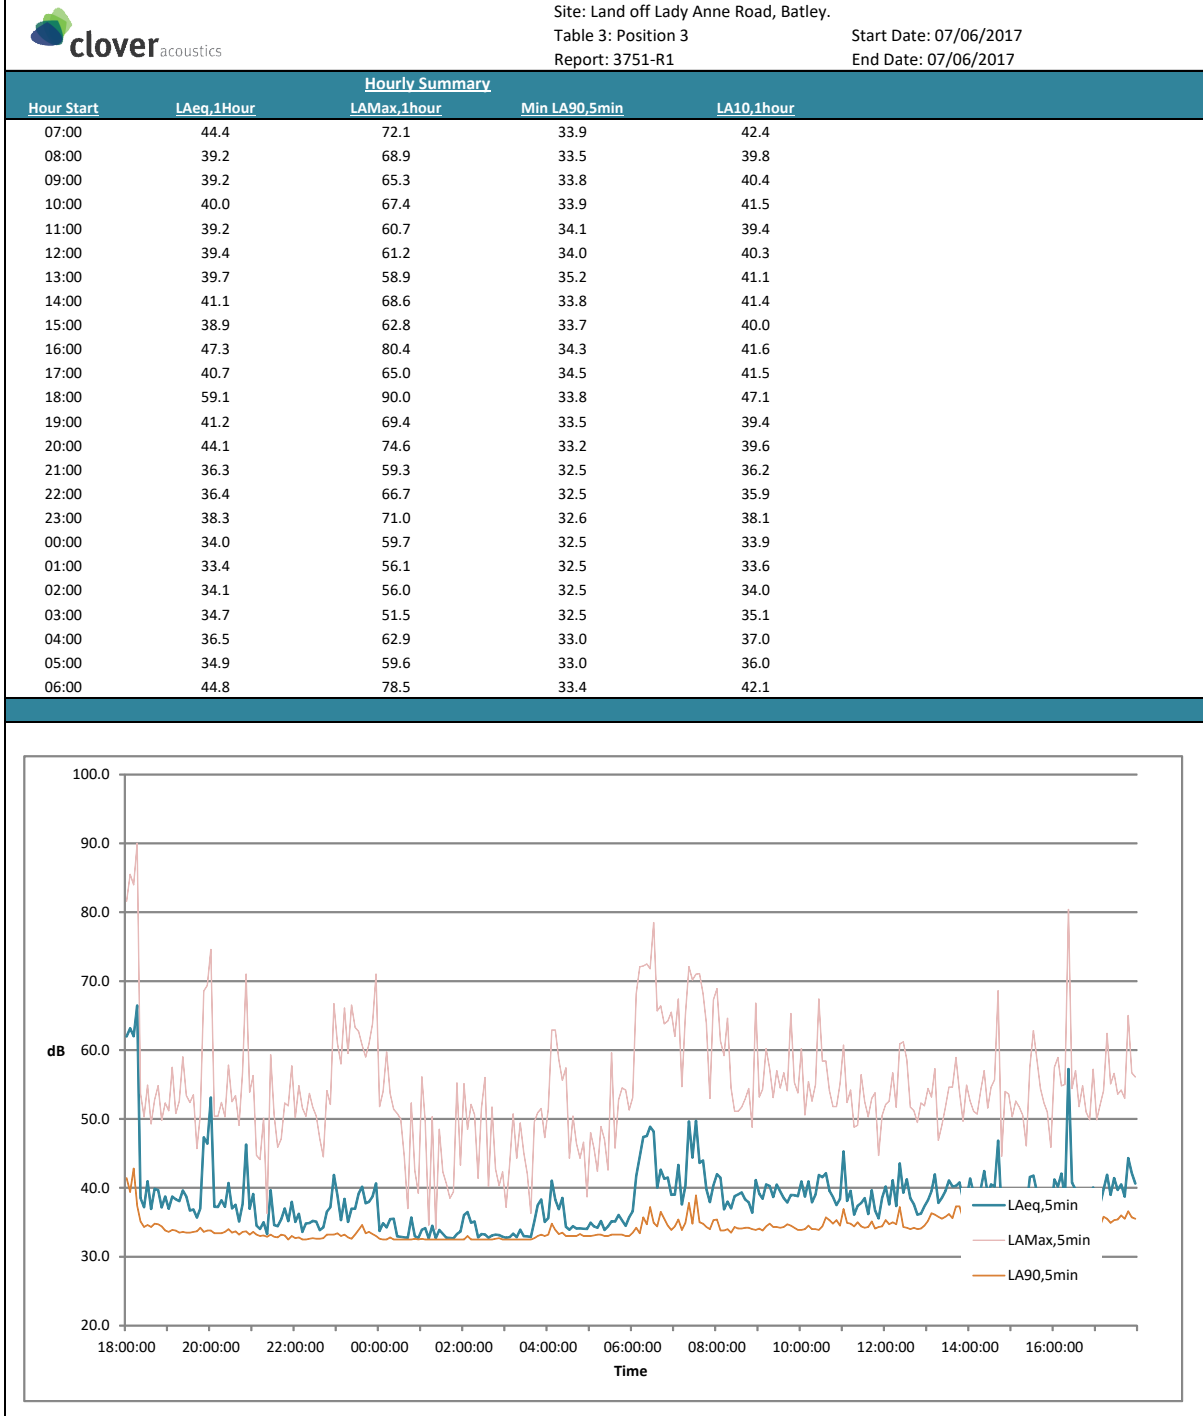

Data Summary Table - Position 3

Monitoring Position 3				
Measurement	Daytime	Hour Ending/ Period	Night-time	Hour Ending/ Period
Minimum dB $L_{Aeq,1hr}$	36	21:00	33	01:00
Maximum dB $L_{Aeq,1hr}$	59	18:00	45	06:00
Average dB $L_{Aeq,16hr}/L_{Aeq,8hr}$	48	07:00 – 23:00	38	23:00 – 07:00
Night dB L_{Amax} ³	–	–	64	06:45

The daytime hourly equivalent continuous sound pressure levels at the proposed façade ranged between 36dB $L_{Aeq,1hr}$ and 59dB $L_{Aeq,1hr}$ with an average level during the daytime period of 48dB $L_{Aeq,16hr}$.

The night-time hourly equivalent continuous sound pressure levels at the proposed façade ranged between 33dB $L_{Aeq,1hr}$ and 45dB $L_{Aeq,1hr}$ with an average level during the night-time period of 38dB $L_{Aeq,8hr}$. The 15th highest³ night-time individual noise event between the hours of 23:00 and 07:00 was 64dB L_{Amax} .

6. Design Criteria

Internal Design Criteria

The internal design criteria proposed is in line with the guidance from BS8233:2014 for indoor ambient noise levels within spaces when they are unoccupied.

Area	Internal Level, dB(A)
Living Rooms (07:00 – 23:00)	35
Dining Rooms (07:00 - 23:00)	40
Bedrooms (23:00 – 07:00)	30

As the nature of the dominant noise affecting site is road traffic and may during the night time be sporadic the previously referred to level of 45dB L_{Amax} should be considered in line with the discussion in section 2 of this report. The follow section gives recommendations for achieving the proposed internal design criteria.

7. Mitigation

Glazing Design – All Facades

The internal design criteria can be achieved through a glazing performance requirement. The following table summarises the recorded levels on site and show the glazing performance requirement to achieve the criteria. This uses the simple calculation method from the Appendix in BS8233:2014. Standard forms of construction are assumed therefore it is likely the glazing will be the lowest performing façade element.

Monitoring Position 1 – Upper North Street	Living Room Areas	Dining Room Areas	Bedroom Areas	
Average Case Levels	46 dB $L_{Aeq,16hr}$	46 dB $L_{Aeq,16hr}$	43 dB $L_{Aeq,8hr}$	65 dB L_{AMAX}
Internal Design Criteria	35 dB(A)	40 dB(A)	30 dB(A)	45 dB L_{AMAX}
Glazing Performance Requirement	11 dB R_{TRA}	6 dB R_{TRA}	13 dB R_{TRA}	20 dB R_{TRA}

Monitoring Position 2 – Regent Hill	Living Room Areas	Dining Room Areas	Bedroom Areas	
Average Case Levels	45 dB $L_{Aeq,16hr}$	45 dB $L_{Aeq,16hr}$	40 dB $L_{Aeq,8hr}$	59 dB L_{AMAX}
Internal Design Criteria	35 dB(A)	40 dB(A)	30 dB(A)	45 dB L_{AMAX}
Glazing Performance Requirement	10 dB R_{TRA}	5 dB R_{TRA}	10 dB R_{TRA}	14 dB R_{TRA}

Monitoring Position 3 – Rear	Living Room Areas	Dining Room Areas	Bedroom Areas	
Average Case Levels	48 dB $L_{Aeq,16hr}$	48 dB $L_{Aeq,16hr}$	38 dB $L_{Aeq,8hr}$	64 dB L_{AMAX}
Internal Design Criteria	35 dB(A)	40 dB(A)	30 dB(A)	45 dB L_{AMAX}
Glazing Performance Requirement	13 dB R_{TRA}	8 dB R_{TRA}	8 dB R_{TRA}	19 dB R_{TRA}

The glazing performance requirement is based on the traffic corrected sound reduction index R_{TRA} . Where the single event L_{Amax} criteria exceeds the night-time average $L_{Aeq,8hr}$ criteria it will be used in the specification of glazing to this façade.

Glazing Configurations

The table below is a summary of the typical performance of Pilkington glazed units as detailed in *Pilkington Design Guide "Glass & Noise Control" – Technical Bulletin May 1997*. Glazing from any other manufacturer can be used providing it can be shown that it will achieve the glazing performance requirements above.

Pilkington Configurations	dB R _{TRA}	Position 1		Position 2		Position 3	
		Living	Bed	Living	Bed	Living	Bed
4.12.4	25	✓	✓	✓	✓	✓	✓
6.12.6	26	✓	✓	✓	✓	✓	✓
6.12.6-4pvb ⁴	27	✓	✓	✓	✓	✓	✓
10.12.4	29	✓	✓	✓	✓	✓	✓
10.12.6	32	✓	✓	✓	✓	✓	✓
10.12.6-4pvb	34	✓	✓	✓	✓	✓	✓
6.100.4 Secondary	37	✓	✓	✓	✓	✓	✓
6.150.4 Secondary	39	✓	✓	✓	✓	✓	✓
10.200.6 Secondary	45	✓	✓	✓	✓	✓	✓

Monitoring Position 1 – In living areas to ensure the values identified in Table 4 of BS8233:2014 for suitable “Indoor ambient noise levels for dwellings” are achieved a minimum glazing performance of 11dB R_{TRA} is required. The minimum Pilkington glazing configuration to achieve this is 4.12.4 double glazing which has a performance of 25dB R_{TRA}. In bedroom areas to ensure the values identified in Table 4 of BS8233:2014 for suitable “Indoor ambient noise levels for dwellings” are achieved a minimum glazing performance of 20dB R_{TRA} is required. The minimum Pilkington glazing configuration to achieve this is 4.12.4 double glazing which has a performance of 25dB R_{TRA}

Monitoring Position 2 – In living areas to ensure the values identified in Table 4 of BS8233:2014 for suitable “Indoor ambient noise levels for dwellings” are achieved a minimum glazing performance of 10dB R_{TRA} is required. The minimum Pilkington glazing configuration to achieve this is 4.12.4 double glazing which has a performance of 25dB R_{TRA}. In bedroom areas to ensure the values identified in Table 4 of BS8233:2014 for suitable “Indoor ambient noise levels for dwellings” are achieved a minimum glazing performance of 14dB R_{TRA} is required. The minimum Pilkington glazing configuration to achieve this is 4.12.4 double glazing which has a performance of 25dB R_{TRA}

Monitoring Position 3 – In living areas to ensure the values identified in Table 4 of BS8233:2014 for suitable “Indoor ambient noise levels for dwellings” are achieved a minimum glazing performance of 13dB R_{TRA} is required. The minimum Pilkington glazing configuration to achieve this is 4.12.4 double glazing which has a performance of 25dB R_{TRA}. In bedroom areas to ensure the values identified in Table 4 of BS8233:2014 for suitable “Indoor ambient noise levels for dwellings” are achieved a minimum glazing performance of 19dB R_{TRA} is required. The minimum Pilkington glazing configuration to achieve this is 4.12.4 double glazing which has a performance of 25dB R_{TRA}

⁴ PVB laminated glass - polyvinyl butyrain.

Ventilation Specification

Care should be taken with regard to selection of ventilation so it shall not compromise the glazing specification. Ventilation requirements are out of the scope of this report. Assuming a trickle vent solution will be adopted, the specified acoustic trickle vents should have a performance equal or greater than $23\text{dB } D_{n,e,w} + C_{tr}$ which is based on a single ventilator per room being installed. Additional ventilators will degrade the overall performance therefore the acoustic performance of the selected ventilators should be increased based on the formula where n is the number of ventilators to be installed:

$$\text{Performance Requirement} = 23 + 10 \log(n)$$

Greenwood Airvac Contact: Gary Swift – M:07801 039584

World Health Organisation – Guidelines for Community Noise 1999.

The World Health Organisation gives guidance for maximum recommended noise levels outside residential properties as follows:

Specific Environment	Critical health effect	dB	Time	dB
		L_{Aeq}	(hr)	L_{Amax}
Outdoor living area	Serious annoyance, daytime and evening	55	16	-
	Moderate annoyance, daytime and evening	50	16	-
Outside bedrooms	Sleep disturbance, window open (outdoor values)	45	8	60

The levels are shown to be below the recommended guideline value for moderate. Whilst external L_{Amax} levels exceeded the guideline value internal criterion from BS8233:2014 can be achieved with the prescribed glazing solution.

8. Conclusion

The site has been surveyed in line with the recommendations in BS7445:1 – 2003 and BS7445:2 – 1991. This report has shown that the target internal noise levels for bedroom and living/dining areas in accordance with internal ambient levels from the guidance in BS8233:2014 can be achieved by using the correct glazing specification.

Position 1

In living areas to achieve the design target internal ambient levels from the guidance in BS8233:2014 a glazing specification with a performance of 11dB R_{TRA} is required. Based on the Pilkington Design Guide performance tables, the glazing configuration that will achieve this performance is 4.12.4 double glazing with a performance of 25dB R_{TRA} .

In bedroom areas to achieve the design target internal ambient levels from the guidance in BS8233:2014 a glazing specification with a performance of 20dB R_{TRA} is required. Based on the Pilkington Design Guide performance tables, the glazing configuration that will achieve this performance is 4.12.4 double glazing with a performance of 25dB R_{TRA} .

Position 2


In living areas to achieve the design target internal ambient levels from the guidance in BS8233:2014 a glazing specification with a performance of 10dB R_{TRA} is required. Based on the Pilkington Design Guide performance tables, the glazing configuration that will achieve this performance is 4.12.4 double glazing with a performance of 25dB R_{TRA} .

In bedroom areas to achieve the design target internal ambient levels from the guidance in BS8233:2014 a glazing specification with a performance of 14dB R_{TRA} is required. Based on the Pilkington Design Guide performance tables, the glazing configuration that will achieve this performance is 4.12.4 double glazing with a performance of 25dB R_{TRA} .

Position 3

In living areas to achieve the design target internal ambient levels from the guidance in BS8233:2014 a glazing specification with a performance of 13dB R_{TRA} is required. Based on the Pilkington Design Guide performance tables, the glazing configuration that will achieve this performance is 4.12.4 double glazing with a performance of 25dB R_{TRA} .

In bedroom areas to achieve the design target internal ambient levels from the guidance in BS8233:2014 a glazing specification with a performance 19dB R_{TRA} is required. Based on the Pilkington Design Guide performance tables, the glazing configuration that will achieve this performance is 4.12.4 double glazing with a performance of 25dB R_{TRA} .



Steve Clow MIOA

Acoustic Consultant

9. Appendix

Glossary of Terms

Specific Noise Source

The noise source under investigation for assessing the likelihood of complaints.

Specific Noise Level, $L_{Aeq,T}$

The equivalent continuous A-weighted sound pressure level at the assessment position produced by the specific noise source over a given reference time interval.

Rating Level, $L_{A,T}$

The specific noise level plus any adjustment for the characteristic features of the noise.

Background Noise Level, $L_{A90,T}$

The A-weighted sound pressure level of the residual noise at the assessment position that is exceeded for 90 % of a given time interval, T.

Residual Noise

The ambient noise remaining at a given position in a given situation when the specific noise source is suppressed to a degree such that it does not contribute to the ambient noise.

Ambient Noise

Totally encompassing sound in a given situation at a given time usually composed of sound from many sources near and far.

Reference Time Interval, T

The specified interval over which an equivalent continuous A-weighted sound pressure level is determined.

$L_{Aeq,T}$

The A-weighted equivalent continuous sound level – the sound level of a notionally steady sound having the same energy as the fluctuating sound over a specified measurement period, T.

$L_{A10,T}$

The A-weighted sound level exceeded for 10% of the specified measurement period, T.

L_{Amax}

The highest short duration A-weighted sound level recorded during a noise event.

A-Weighting

The 'A' weighting is a correction term applied to the frequency range in order to approximate to the sensitivity of the human ear to noise. It is generally used to obtain an overall noise level from octave or third octave band frequencies.

Octave Band

A frequency band in which the upper limit of the band is twice the frequency of the lower limit.

One-third-octave Band

A frequency band in which the upper limit of the band is 1/3 times the frequency of the lower limit.

Data Appendix


 Site: Land off Lady Anne Road, Batley. Table 1a: - Data - Position 1 Report: 3751-R1																Start Date: 07/06/2017 End Date: 07/06/2017			
Time	LAeq	LA90	LAMax	Time	LAeq	LA90	LAMax	Time	LAeq	LA90	LAMax	Time	LAeq	LA90	LAMax				
18:00	44.5	40.4	55.9	22:50	38.0	35.2	47.6	03:40	34.7	33.1	49.2	08:30	44.5	38.6	60.0				
18:05	43.2	39.0	57.1	22:55	35.9	34.7	54.0	03:45	41.3	34.1	56.8	08:35	44.9	38.8	58.6				
18:10	47.4	40.4	60.7	23:00	37.2	35.4	58.1	03:50	42.1	34.8	55.7	08:40	43.0	39.3	51.2				
18:15	44.0	40.2	56.2	23:05	38.7	35.3	58.3	03:55	47.0	37.4	59.6	08:45	43.5	39.7	56.7				
18:20	45.2	40.8	59.3	23:10	35.5	34.4	53.5	04:00	48.3	37.4	60.8	08:50	44.7	40.1	60.0				
18:25	47.1	41.2	60.1	23:15	36.7	35.1	56.4	04:05	46.7	37.7	59.9	08:55	45.0	39.8	62.2				
18:30	44.6	39.5	63.8	23:20	36.6	34.4	48.2	04:10	48.2	41.2	62.3	09:00	44.4	40.2	62.1				
18:35	42.7	39.4	58.6	23:25	36.8	34.0	59.6	04:15	46.6	39.7	57.5	09:05	43.3	39.2	61.4				
18:40	44.8	40.0	66.9	23:30	37.4	35.3	57.6	04:20	46.2	39.1	64.3	09:10	43.9	38.6	59.8				
18:45	46.0	40.4	57.9	23:35	39.8	37.1	66.2	04:25	51.2	42.3	64.0	09:15	47.3	40.5	58.4				
18:50	49.0	40.3	61.6	23:40	41.2	37.2	59.7	04:30	48.9	38.7	70.6	09:20	46.4	40.2	62.2				
18:55	42.5	37.2	59.1	23:45	41.3	35.4	70.3	04:35	46.6	38.9	56.6	09:25	43.0	39.8	57.3				
19:00	46.0	39.0	68.1	23:50	37.7	36.2	54.1	04:40	49.0	39.7	66.4	09:30	43.5	40.0	55.1				
19:05	44.0	36.5	66.1	23:55	40.6	35.3	68.3	04:45	46.5	41.9	63.0	09:35	42.1	39.0	58.0				
19:10	41.9	37.3	56.3	00:00	35.8	34.6	58.9	04:50	46.6	38.0	60.9	09:40	46.3	39.4	60.1				
19:15	41.3	35.5	64.2	00:05	37.7	33.6	66.8	04:55	49.1	38.8	60.7	09:45	48.3	40.8	62.7				
19:20	50.1	36.5	67.4	00:10	34.9	33.5	57.3	05:00	45.8	35.0	57.9	09:50	43.9	39.5	56.7				
19:25	44.7	35.8	61.0	00:15	33.9	33.5	48.0	05:05	44.4	35.1	56.2	09:55	48.8	38.0	68.0				
19:30	46.5	36.6	69.3	00:20	34.5	33.8	50.6	05:10	43.2	35.4	56.3	10:00	45.3	39.3	63.7				
19:35	42.3	35.5	61.4	00:25	36.9	33.1	67.4	05:15	44.8	36.6	58.0	10:05	49.0	37.8	67.0				
19:40	42.8	36.1	62.4	00:30	33.5	33.0	50.6	05:20	40.3	35.1	54.6	10:10	50.4	39.4	68.6				
19:45	44.1	37.3	57.0	00:35	33.2	32.7	50.0	05:25	42.2	34.5	59.0	10:15	47.9	40.1	59.6				
19:50	41.5	36.7	53.3	00:40	33.2	32.8	52.0	05:30	42.6	34.4	62.7	10:20	48.3	39.7	60.8				
19:55	39.1	36.2	53.4	00:45	33.6	33.0	54.4	05:35	39.4	34.5	64.7	10:25	48.8	39.9	61.2				
20:00	48.1	38.4	66.5	00:50	33.3	32.9	47.8	05:40	43.4	34.9	57.1	10:30	47.7	41.1	61.5				
20:05	45.2	36.4	65.5	00:55	34.7	33.3	55.0	05:45	43.1	35.8	59.0	10:35	47.2	40.9	61.2				
20:10	40.2	35.6	54.8	01:00	33.1	32.8	47.8	05:50	44.6	36.4	65.0	10:40	46.7	41.8	61.1				
20:15	40.9	35.6	52.8	01:05	36.8	33.8	48.9	05:55	41.6	34.7	65.3	10:45	46.4	40.8	64.8				
20:20	45.2	35.7	64.8	01:10	33.1	32.6	48.0	06:00	42.8	35.0	63.6	10:50	44.4	40.4	55.0				
20:25	43.3	35.9	57.4	01:15	32.8	32.5	49.2	06:05	39.8	36.5	59.6	10:55	44.4	42.0	52.6				
20:30	45.6	37.0	63.1	01:20	33.8	32.8	42.0	06:10	42.1	37.3	64.1	11:00	45.9	42.5	55.1				
20:35	41.3	35.7	57.8	01:25	32.9	32.6	38.7	06:15	41.2	35.7	60.4	11:05	48.0	41.8	63.5				
20:40	44.7	36.8	59.9	01:30	34.7	32.8	57.4	06:20	46.0	40.8	64.8	11:10	46.4	42.1	58.0				
20:45	45.9	35.4	64.8	01:35	36.6	33.0	51.1	06:25	47.7	39.9	63.3	11:15	45.6	41.0	59.8				
20:50	43.7	37.1	61.8	01:40	33.1	32.7	40.2	06:30	48.1	43.0	66.6	11:20	43.2	40.2	56.9				
20:55	40.4	35.4	59.6	01:45	33.2	32.8	45.1	06:35	44.2	38.5	62.6	11:25	47.8	42.2	66.2				
21:00	44.8	35.3	64.2	01:50	33.0	32.6	41.1	06:40	43.7	38.3	69.3	11:30	53.1	41.8	68.5				
21:05	48.6	36.6	65.0	01:55	33.1	32.7	48.5	06:45	46.2	41.5	70.9	11:35	49.5	41.3	67.0				
21:10	42.2	34.7	64.6	02:00	39.5	33.0	58.2	06:50	45.7	41.1	70.2	11:40	48.8	42.1	64.6				
21:15	40.2	34.9	56.1	02:05	36.0	33.5	47.6	06:55	45.9	38.1	70.5	11:45	46.4	41.3	58.7				
21:20	41.1	35.7	52.4	02:10	42.5	35.0	55.2	07:00	42.7	37.3	69.4	11:50	42.2	39.7	56.1				
21:25	38.9	36.0	50.0	02:15	33.4	32.9	51.9	07:05	43.7	38.8	69.9	11:55	44.3	41.2	56.1				
21:30	35.2	33.9	43.9	02:20	33.8	33.1	42.5	07:10	45.9	39.8	69.5	12:00	44.8	41.7	57.3				
21:35	37.7	35.1	45.8	02:25	33.7	33.0	57.2	07:15	42.9	37.6	56.9	12:05	48.5	42.3	62.0				
21:40	38.3	34.7	47.7	02:30	36.3	33.3	48.6	07:20	45.3	40.5	61.6	12:10	47.5	41.5	63.5				
21:45	40.8	36.2	53.9	02:35	33.5	32.9	42.7	07:25	48.1	42.1	71.1	12:15	48.1	41.5	66.3				
21:50	37.8	35.9	50.4	02:40	33.4	33.0	47.7	07:30	45.3	39.6	69.2	12:20	46.5	41.2	64.0				
21:55	34.9	34.1	41.2	02:45	33.4	32.8	46.4	07:35	47.4	42.9	63.2	12:25	50.1	42.8	66.9				
22:00	40.7	35.2	56.5	02:50	34.2	33.3	40.9	07:40	44.7	39.0	61.1	12:30	47.1	40.1	70.1				
22:05	35.3	34.5	40.2	02:55	34.1	33.1	56.3	07:45	43.5	39.3	69.9	12:35	45.0	40.1	64.3				
22:10	36.0	34.1	47.6	03:00	33.4	32.9	47.1	07:50	41.2	38.5	57.7	12:40	43.1	38.9	60.9				
22:15	33.9	33.4	37.1	03:05	33.3	32.5	45.2	07:55	41.8	38.5	58.0	12:45	41.6	38.6	55.9				
22:20	35.4	33.1	48.7	03:10	35.5	32.7	56.9	08:00	42.7	38.1	58.0	12:50	46.4	39.1	64.9				
22:25	33.8	33.3	39.7	03:15	33.2	32.8	45.2	08:05	41.6	38.0	57.9	12:55	43.4	39.5	60.1				
22:30	36.2	33.2	55.2	03:20	33.4	33.0	43.1	08:10	43.7	38.1	59.3	13:00	46.2	41.7	61.5				
22:35	33.9	33.4	40.5	03:25	33.1	32.7	36.1	08:15	43.6	37.4	67.0	13:05	45.4	42.5	53.8				
22:40	35.8	33.6	48.2	03:30	33.3	32.9	43.3	08:20	43.8	38.4	57.1	13:10	45.3	42.2	55.5				
22:45	37.2	33.5	53.0	03:35	33.5	33.1	45.2	08:25	42.2	37.1	58.3	13:15	45.8	41.7	57.9				

Table 1b: - LAMax Events Ranked		
#	Time	LAMax
1	06:45	70.9
2	04:30	70.6
3	06:55	70.5
4	23:45	70.3
5	06:50	70.2
6	06:40	69.3
7	23:55	68.3
8	00:25	67.4
9	00:05	66.8
10	06:30	66.6
11	04:40	66.4
12	23:35	66.2
13	05:55	65.3
14	05:50	65.0
15	06:20	64.8
16	05:35	64.7
17	04:20	64.3
18	06:10	64.1
19	04:25	64.0
20	06:00	63.6
21	06:25	63.3
22	04:45	63.0
23	05:30	62.7
24	06:35	62.6
25	04:10	62.3
26	04:50	60.9
27	04:00	60.8
28	04:55	60.7
29	06:15	60.4
30	04:05	59.9
31	23:40	59.7
32	23:25	59.6
33	03:55	59.6
34	06:05	59.6
35	05:25	59.0
36	05:45	59.0
37	23:05	58.3
38	02:00	58.2
39	23:00	58.1
40	05:15	58.0
41	05:00	57.9
42	23:30	57.6
43	04:15	57.5
44	01:30	57.4
45	00:10	57.3
46	02:25	57.2
47	05:40	57.1
48	03:10	56.9
49	03:45	56.8
50	04:35	56.6
51	23:15	56.4
52	02:55	56.3
53	05:10	56.3
54	05:05	56.2
55	03:50	55.7
56	02:10	55.2
57	00:55	55.0
58	05:20	54.6

Position 1 - Data



Site: Land off Lady Anne Road, Batley.
 Table 2a: - Data - Position 2
 Report: 3751-R1

Start Date: 07/06/2017
 End Date: 07/06/2017

Time	LAeq	LA90	LAMax	Time	LAeq	LA90	LAMax	Time	LAeq	LA90	LAMax	Time	LAeq	LA90	LAMax	Time	LAeq	LA90	LAMax
18:00	45.4	38.3	60.1	22:50	38.9	35.4	57.9	03:40	44.1	34.9	56.1	08:30	41.9	38.7	60.0	13:20	54.7	46.3	67.2
18:05	40.5	37.0	53.6	22:55	42.8	35.9	66.3	03:45	47.2	36.9	60.2	08:35	42.0	38.9	56.0	13:25	46.1	42.8	55.6
18:10	40.8	36.9	54.7	23:00	35.1	34.4	41.8	03:50	45.3	36.5	61.0	08:40	42.0	38.3	63.6	13:30	44.4	41.6	54.4
18:15	41.5	38.0	52.4	23:05	36.1	35.4	43.6	03:55	43.4	37.2	55.6	08:45	41.0	38.2	66.9	13:35	44.1	42.1	51.3
18:20	47.1	36.4	69.5	23:10	35.9	34.7	43.1	04:00	42.1	39.6	55.5	08:50	40.0	37.9	52.2	13:40	44.4	41.6	58.7
18:25	47.7	37.3	70.1	23:15	35.4	33.8	46.7	04:05	39.9	36.4	55.0	08:55	40.9	37.9	59.1	13:45	44.9	41.9	57.6
18:30	39.1	36.0	51.9	23:20	36.6	35.5	41.8	04:10	37.8	34.8	51.8	09:00	41.6	37.8	60.8	13:50	43.1	40.7	60.4
18:35	47.1	37.3	62.5	23:25	38.9	37.7	60.9	04:15	36.8	34.1	50.0	09:05	42.7	39.8	64.3	13:55	45.9	42.8	58.3
18:40	51.8	37.6	67.8	23:30	40.0	38.5	51.5	04:20	35.5	33.5	44.2	09:10	43.1	39.5	58.2	14:00	47.1	43.8	59.2
18:45	41.0	36.2	59.0	23:35	37.9	36.2	45.9	04:25	35.6	33.5	45.3	09:15	41.8	39.4	51.5	14:05	46.0	42.5	53.7
18:50	39.7	35.7	54.4	23:40	38.2	37.0	48.5	04:30	37.7	33.4	51.2	09:20	42.3	39.6	61.9	14:10	46.5	42.3	56.4
18:55	38.7	35.0	57.6	23:45	37.3	36.0	50.8	04:35	35.6	33.8	47.2	09:25	42.6	38.6	68.8	14:15	51.3	43.7	64.1
19:00	39.0	35.1	60.4	23:50	37.0	35.5	50.2	04:40	35.0	33.5	45.2	09:30	41.7	38.9	61.9	14:20	45.5	43.0	58.1
19:05	43.4	35.4	62.0	23:55	35.4	34.3	48.3	04:45	35.3	33.4	47.3	09:35	41.9	39.1	57.4	14:25	44.1	41.9	52.4
19:10	43.8	36.1	58.0	00:00	35.0	33.7	48.7	04:50	34.7	33.0	46.8	09:40	40.6	39.0	55.7	14:30	43.9	41.2	52.6
19:15	46.9	36.5	68.5	00:05	34.7	33.7	46.8	04:55	35.5	33.3	54.9	09:45	41.5	39.1	57.9	14:35	47.4	42.3	65.7
19:20	39.5	35.8	53.6	00:10	35.6	34.5	51.3	05:00	35.0	33.4	46.8	09:50	41.8	39.0	53.2	14:40	40.6	38.8	46.2
19:25	41.0	34.7	60.1	00:15	34.9	33.7	46.4	05:05	37.8	34.2	51.5	09:55	42.7	38.8	58.1	14:45	43.0	38.2	56.4
19:30	45.1	35.3	64.0	00:20	33.8	32.8	45.0	05:10	36.1	33.4	44.4	10:00	40.7	38.2	50.0	14:50	39.6	37.5	45.5
19:35	49.7	34.8	68.9	00:25	33.3	32.6	40.6	05:15	36.9	34.1	45.2	10:05	43.6	40.5	55.2	14:55	43.9	39.7	54.9
19:40	39.2	36.0	53.5	00:30	33.2	32.5	41.6	05:20	36.4	33.9	43.9	10:10	41.5	38.9	61.1	15:00	44.6	42.0	54.9
19:45	40.9	34.9	58.1	00:35	33.3	32.5	48.4	05:25	35.9	34.2	47.5	10:15	41.4	39.7	50.2	15:05	44.3	41.3	58.6
19:50	49.3	36.3	71.1	00:40	33.7	32.6	42.6	05:30	35.7	33.6	47.0	10:20	42.9	40.1	55.4	15:10	41.8	39.3	52.4
19:55	50.8	36.7	67.5	00:45	34.2	32.8	45.8	05:35	36.2	35.0	45.6	10:25	43.6	41.2	53.4	15:15	43.2	39.4	61.0
20:00	41.1	36.9	59.6	00:50	33.3	32.5	47.1	05:40	36.9	35.1	46.2	10:30	45.1	41.8	56.3	15:20	44.2	40.4	59.4
20:05	51.6	35.2	72.7	00:55	36.1	33.5	59.8	05:45	36.2	34.5	58.9	10:35	44.3	41.4	57.4	15:25	45.0	41.3	57.1
20:10	42.8	35.4	61.6	01:00	33.5	32.5	41.4	05:50	37.7	34.9	48.3	10:40	45.5	41.5	59.1	15:30	42.0	38.9	52.3
20:15	41.0	35.7	54.3	01:05	33.0	32.4	40.7	05:55	43.7	36.1	68.4	10:45	45.3	41.3	61.7	15:35	45.4	39.5	62.4
20:20	53.4	37.4	77.8	01:10	33.9	32.4	47.1	06:00	39.1	38.0	47.0	10:50	43.8	40.8	51.7	15:40	40.4	37.8	51.4
20:25	57.8	35.5	84.0	01:15	33.6	32.5	44.5	06:05	37.9	36.3	49.7	10:55	44.7	41.6	58.7	15:45	39.9	38.2	46.5
20:30	38.1	35.2	47.4	01:20	34.2	32.4	46.8	06:10	43.5	41.1	54.9	11:00	43.4	40.6	52.8	15:50	40.6	37.9	51.9
20:35	35.5	34.0	43.3	01:25	35.1	32.8	46.2	06:15	41.6	39.6	63.2	11:05	43.0	40.8	51.1	15:55	42.7	39.5	50.4
20:40	39.6	36.1	48.8	01:30	32.7	32.2	40.7	06:20	46.1	44.2	64.4	11:10	43.1	40.7	53.4	16:00	40.9	38.2	53.8
20:45	44.6	34.9	62.2	01:35	32.8	32.1	40.7	06:25	44.9	41.2	57.1	11:15	46.1	43.1	58.2	16:05	44.4	40.6	53.1
20:50	37.5	34.1	52.8	01:40	33.3	32.2	44.7	06:30	51.7	40.2	84.4	11:20	45.9	40.9	71.0	16:10	42.5	39.2	54.1
20:55	43.2	36.5	62.3	01:45	32.8	32.1	40.6	06:35	45.2	43.1	64.4	11:25	43.1	40.5	56.9	16:15	48.9	38.8	68.6
21:00	36.9	33.8	53.9	01:50	39.7	32.8	56.5	06:40	46.2	43.3	65.2	11:30	42.8	40.6	50.9	16:20	48.9	41.8	66.9
21:05	35.0	33.6	46.6	01:55	33.5	32.5	40.8	06:45	44.2	39.9	68.3	11:35	44.3	40.6	56.7	16:25	42.4	39.2	53.3
21:10	37.1	34.0	48.4	02:00	44.2	34.2	61.7	06:50	47.3	38.3	78.7	11:40	41.5	39.2	56.0	16:30	41.4	38.7	53.4
21:15	36.3	34.7	48.3	02:05	34.5	32.6	49.0	06:55	42.9	40.0	59.5	11:45	42.0	39.8	54.0	16:35	42.7	38.5	54.5
21:20	37.3	33.9	54.7	02:10	34.1	32.6	56.4	07:00	46.1	42.0	65.6	11:50	43.2	41.2	48.1	16:40	41.5	38.6	49.1
21:25	36.8	34.7	48.2	02:15	33.2	32.1	46.8	07:05	43.4	38.5	68.4	11:55	46.7	42.1	62.8	16:45	40.7	38.4	49.3
21:30	37.2	34.7	48.4	02:20	33.9	32.5	42.2	07:10	44.3	41.0	59.2	12:00	43.8	40.5	53.4	16:50	42.5	38.6	53.7
21:35	40.0	35.1	57.1	02:25	32.9	32.4	47.5	07:15	49.4	44.6	68.6	12:05	47.4	41.4	64.2	16:55	41.4	39.1	49.2
21:40	37.6	34.7	51.5	02:30	33.0	32.4	45.9	07:20	48.3	40.8	73.4	12:10	42.8	40.6	50.4	17:00	41.7	38.9	54.4
21:45	34.1	33.0	40.9	02:35	33.3	32.4	46.6	07:25	49.0	45.1	69.8	12:15	50.0	44.0	62.2	17:05	45.1	41.3	56.1
21:50	39.6	34.4	57.0	02:40	33.1	32.4	40.9	07:30	47.0	41.3	74.2	12:20	43.7	40.2	64.0	17:10	42.9	40.4	51.5
21:55	34.6	33.4	41.1	02:45	32.8	32.5	40.6	07:35	45.5	40.8	70.1	12:25	43.2	40.5	52.0	17:15	39.9	38.7	45.1
22:00	36.3	33.7	45.4	02:50	32.8	32.4	40.6	07:40	42.7	39.8	61.1	12:30	41.3	39.6	47.6	17:20	43.5	40.5	50.0
22:05	33.6	32.8	41.4	02:55	32.6	32.1	40.6	07:45	42.8	39.1	60.5	12:35	40.9	39.3	47.1	17:25	42.9	40.6	53.4
22:10	34.7	33.0	43.3	03:00	32.6	32.0	40.6	07:50	42.4	38.0	68.3	12:40	40.7	38.9	51.5	17:30	45.0	40.8	54.6
22:15	35.2	33.0	46.3	03:05	32.6	32.1	40.7	07:55	41.9	38.4	66.0	12:45	42.1	39.9	50.9	17:35	44.1	41.5	52.8
22:20	35.6	33.3	47.3	03:10	32.7	32.0	43.1	08:00	42.7	38.2	66.8	12:50	42.8	40.4	54.0	17:40	44.3	41.7	53.1
22:25	34.2	33.2	40.9	03:15	32.7	32.0	41.1	08:05	40.4	38.5	54.1	12:55	44.3	42.3	49.9	17:45	50.0	40.1	69.1
22:30	34.6	33.0	44.9	03:20	32.9	32.3	43.0	08:10	42.6	39.3	68.8	13:00	44.8	42.4	59.2	17:50	47.7	40.7	62.7
22:35	35.6	33.6	46.8	03:25	32.7	32.1	41.8	08:15	40.9	38.5	57.5	13:05	45.1	42.0	58.5	17:55	42.4	40.1	51.2
22:40	37.7	34.7	48.2	03:30	33.7	32.4	42.5	08:20	46.6	40.6	61.1	13:10	44.1	41.8	49.8				
22:45	36.1	34.8	45.0	03:35	36.0	33.1	43.2	08:25	42.1	39.0	54.6	13:15	45.6	42.6	55.2				

Table 2b: - LAMax Events Ranked

#	Time	LAMax
1	06:30	84.4
2	06:50	78.7
3	05:55	68.4
4	06:45	68.3
5	06:40	65.2
6	06:20	64.4
7	06:35	64.4
8	06:15	63.2
9	02:00	61.7
10	03:50	61.0
11	23:25	60.9
12	03:45	60.2
13	00:55	59.8
14	06:55	59.5
15	05:45	58.9
16	06:25	57.1
17	01:50	56.5
18	02:10	56.4
19	03:40	56.1
20	03:55	55.6
21	04:00	55.5
22	04:05	55.0
23	04:55	54.9
24	06:10	54.9
25	04:10	51.8
26	23:30	51.5
27	05:05	51.5
28	00:10	51.3
29	04:30	51.2
30		



Site: Land off Lady Anne Road, Batley.
 Table 3a: - Data - Position 3
 Report: 3751-R1

Start Date: 07/06/2017
 End Date: 07/06/2017

Time	LAeq	LA90	LAMax	Time	LAeq	LA90	LAMax	Time	LAeq	LA90	LAMax	Time	LAeq	LA90	LAMax	Time	LAeq	LA90	LAMax
18:00	62.0	41.4	81.6	22:50	37.2	33.2	52.1	03:40	35.2	32.7	49.6	08:30	39.0	34.1	51.1	13:20	38.6	35.5	49.1
18:05	63.1	39.4	85.5	22:55	41.9	33.2	66.7	03:45	37.5	33.0	50.9	08:35	39.3	34.1	51.7	13:25	39.5	35.8	51.7
18:10	62.0	42.8	84.0	23:00	38.9	33.4	61.0	03:50	38.3	33.2	51.5	08:40	38.3	34.2	52.9	13:30	41.1	36.2	54.6
18:15	66.5	37.4	90.0	23:05	35.3	33.0	58.0	03:55	35.0	33.0	47.3	08:45	37.9	34.2	54.4	13:35	40.2	35.6	54.6
18:20	38.5	35.1	53.7	23:10	38.4	33.2	66.1	04:00	35.6	33.2	51.4	08:50	36.4	34.0	48.8	13:40	40.3	37.3	58.9
18:25	37.2	34.3	50.3	23:15	35.1	32.8	59.5	04:05	41.0	34.8	62.9	08:55	41.1	33.9	66.8	13:45	40.8	37.3	53.9
18:30	41.0	34.6	54.9	23:20	36.9	32.6	66.5	04:10	38.3	33.9	62.9	09:00	39.1	34.1	53.2	13:50	38.3	35.5	49.7
18:35	36.9	34.3	49.3	23:25	37.0	33.2	63.3	04:15	36.9	33.3	58.6	09:05	38.4	33.8	54.3	13:55	38.5	35.3	54.9
18:40	39.9	34.8	52.8	23:30	39.1	33.9	62.7	04:20	38.5	33.5	55.6	09:10	40.5	34.4	60.2	14:00	41.3	36.6	52.6
18:45	39.7	34.7	54.8	23:35	40.2	34.6	60.7	04:25	34.4	33.0	57.4	09:15	40.3	34.8	57.3	14:05	39.2	36.6	51.1
18:50	37.2	34.4	49.8	23:40	37.8	33.4	59.0	04:30	33.9	33.0	44.3	09:20	38.7	34.3	53.1	14:10	38.9	36.2	50.7
18:55	38.7	33.8	52.3	23:45	37.9	33.6	60.9	04:35	34.4	33.0	50.4	09:25	40.5	34.3	57.0	14:15	39.8	35.8	54.1
19:00	37.0	33.6	51.2	23:50	38.7	33.3	63.8	04:40	34.1	33.0	46.4	09:30	39.5	34.2	54.5	14:20	42.4	36.5	57.0
19:05	38.7	33.9	57.5	23:55	40.6	33.0	71.0	04:45	34.1	33.3	44.3	09:35	38.5	34.3	56.7	14:25	39.0	35.9	51.6
19:10	38.3	33.8	50.8	00:00	33.7	32.6	51.8	04:50	34.1	33.0	46.6	09:40	37.9	34.7	54.1	14:30	40.5	36.2	54.6
19:15	38.1	33.5	52.6	00:05	34.9	32.5	54.0	04:55	34.0	33.0	38.7	09:45	39.0	34.5	65.3	14:35	40.2	35.7	55.7
19:20	39.6	33.6	59.0	00:10	34.3	32.5	59.7	05:00	35.0	33.0	48.0	09:50	38.9	34.2	55.3	14:40	46.8	36.1	68.6
19:25	38.7	33.5	53.4	00:15	35.4	32.8	53.7	05:05	34.4	33.1	45.8	09:55	38.8	33.9	53.8	14:45	36.5	34.7	44.6
19:30	36.7	33.5	52.4	00:20	35.5	32.5	51.4	05:10	34.2	33.2	42.4	10:00	40.9	33.9	60.2	14:50	39.7	35.0	54.0
19:35	36.9	33.6	53.5	00:25	33.0	32.5	50.8	05:15	35.2	33.2	48.9	10:05	38.7	34.0	50.6	14:55	36.6	33.8	53.6
19:40	35.7	33.7	45.7	00:30	32.9	32.5	50.0	05:20	33.9	33.0	47.0	10:10	40.9	34.5	55.4	15:00	37.2	34.7	50.3
19:45	37.0	34.2	50.5	00:35	32.8	32.5	44.6	05:25	34.4	33.0	42.6	10:15	37.9	34.0	52.6	15:05	39.6	35.2	52.6
19:50	47.3	33.6	68.6	00:40	32.7	32.5	37.0	05:30	35.1	33.2	59.6	10:20	39.0	34.0	55.0	15:10	38.2	34.9	51.7
19:55	46.4	33.8	69.4	00:45	35.7	32.5	52.3	05:35	35.1	33.2	45.8	10:25	41.9	33.9	67.4	15:15	36.7	34.2	50.5
20:00	53.1	33.8	74.6	00:50	33.0	32.6	42.5	05:40	36.0	33.2	52.8	10:30	41.6	34.4	58.4	15:20	36.9	34.5	46.1
20:05	37.3	33.4	50.4	00:55	32.7	32.5	39.2	05:45	35.3	33.2	54.5	10:35	42.1	35.7	58.4	15:25	41.6	35.1	57.5
20:10	37.2	33.4	50.4	01:00	33.9	32.6	56.1	05:50	34.5	33.0	54.2	10:40	39.6	35.3	54.1	15:30	41.8	35.7	62.8
20:15	38.2	33.4	52.4	01:05	34.1	32.5	49.7	05:55	35.7	33.0	51.3	10:45	38.7	34.8	51.8	15:35	39.4	34.7	58.6
20:20	37.2	33.6	50.3	01:10	32.7	32.5	34.6	06:00	36.6	33.5	53.1	10:50	37.5	35.3	51.8	15:40	39.4	34.5	54.4
20:25	40.7	34.0	57.8	01:15	34.5	32.5	50.3	06:05	41.7	34.2	68.2	10:55	38.4	34.5	55.1	15:45	37.8	33.7	52.3
20:30	37.0	33.5	52.5	01:20	32.7	32.5	34.0	06:10	44.5	33.4	72.1	11:00	45.3	36.9	60.7	15:50	36.7	33.8	51.0
20:35	37.5	33.7	53.4	01:25	33.9	32.5	48.5	06:15	47.4	35.7	72.2	11:05	38.1	34.9	52.4	15:55	36.2	33.8	45.9
20:40	35.1	33.2	49.1	01:30	33.3	32.5	42.3	06:20	47.5	34.7	72.5	11:10	39.5	34.8	54.2	16:00	41.2	35.5	57.5
20:45	37.6	33.6	56.8	01:35	32.7	32.5	40.6	06:25	48.9	37.2	71.8	11:15	36.1	34.4	48.8	16:05	40.2	34.3	58.9
20:50	46.3	33.7	71.0	01:40	32.7	32.5	38.5	06:30	48.2	34.9	78.5	11:20	37.4	35.0	49.1	16:10	42.1	36.2	54.8
20:55	37.0	33.2	53.9	01:45	32.7	32.5	39.4	06:35	40.0	34.4	65.7	11:25	37.8	34.4	56.4	16:15	38.3	34.5	55.0
21:00	39.1	33.6	56.3	01:50	33.3	32.5	55.2	06:40	42.6	36.5	66.4	11:30	38.5	34.2	52.5	16:20	57.2	34.3	80.4
21:05	34.5	33.2	44.7	01:55	33.7	32.5	43.3	06:45	41.3	35.5	63.8	11:35	36.2	34.3	50.3	16:25	40.8	35.3	54.4
21:10	34.0	33.0	44.1	02:00	36.1	32.5	55.1	06:50	41.5	34.5	64.2	11:40	39.6	35.1	53.0	16:30	39.7	34.9	57.0
21:15	35.0	33.1	50.1	02:05	36.5	33.0	48.5	06:55	39.0	33.9	65.5	11:45	36.7	34.1	53.8	16:35	37.7	34.6	51.8
21:20	33.3	32.9	36.3	02:10	34.9	32.5	52.1	07:00	39.0	34.4	62.0	11:50	35.6	34.3	44.7	16:40	38.5	34.5	54.8
21:25	39.7	33.2	59.3	02:15	35.1	32.5	50.6	07:05	43.3	35.4	67.4	11:55	38.6	34.4	50.5	16:45	39.3	34.8	51.0
21:30	34.6	32.9	50.5	02:20	32.8	32.5	41.4	07:10	37.6	33.9	54.7	12:00	40.2	35.3	52.1	16:50	39.0	34.7	49.9
21:35	34.4	32.8	45.9	02:25	33.3	32.5	51.5	07:15	40.3	34.9	65.1	12:05	37.6	34.7	52.6	16:55	40.0	34.7	57.2
21:40	35.4	33.2	47.1	02:30	33.2	32.5	56.0	07:20	49.6	37.8	72.1	12:10	41.1	35.0	56.7	17:00	36.7	34.5	49.9
21:45	37.0	33.1	52.3	02:35	32.8	32.5	40.2	07:25	44.4	34.8	70.2	12:15	37.3	34.7	51.7	17:05	37.7	34.5	52.1
21:50	35.2	32.5	51.9	02:40	33.1	32.5	51.7	07:30	49.7	38.9	71.0	12:20	43.5	37.2	60.9	17:10	39.8	35.8	54.1
21:55	38.0	33.0	57.7	02:45	33.2	32.6	42.7	07:35	43.6	35.0	71.1	12:25	39.3	34.3	61.2	17:15	41.9	35.5	62.4
22:00	35.0	32.7	50.2	02:50	33.1	32.7	40.3	07:40	44.0	34.8	68.2	12:30	41.2	34.2	58.6	17:20	39.0	34.9	55.1
22:05	36.2	32.8	54.8	02:55	32.9	32.5	42.3	07:45	39.8	34.3	63.9	12:35	38.5	34.0	51.7	17:25	41.4	35.3	56.6
22:10	33.6	32.5	51.6	03:00	32.8	32.5	37.2	07:50	37.9	34.0	53.0	12:40	37.6	34.2	51.2	17:30	39.7	35.4	53.6
22:15	34.8	32.5	50.4	03:05	32.8	32.5	43.4	07:55	40.4	35.3	67.3	12:45	36.1	34.0	49.5	17:35	40.5	36.0	54.2
22:20	34.9	32.6	53.7	03:10	33.3	32.5	50.7	08:00	42.0	35.4	68.9	12:50	36.3	34.1	52.3	17:40	38.7	35.5	53.0
22:25	35.2	32.7	51.7	03:15	32.8	32.5	44.3	08:05	41.5	33.8	61.3	12:55	37.3	34.5	51.9	17:45	44.3	36.6	65.0
22:30	35.1	32.6	50.4	03:20	33.9	32.5	49.4	08:10	36.9	33.8	59.2	13:00	38.2	35.2	54.4	17:50	42.1	35.7	56.7
22:35	33.9	32.6	47.1	03:25	33.0	32.5	45.1	08:15	38.0	34.0	64.6	13:05	39.5	36.3	53.2	17:55	40.6	35.5	56.1
22:40	34.3	32.7	44.5	03:30	32.9	32.5	42.0	08:20	37.0	33.5	54.5	13:10	42.0	36.1	57.3				
22:45	36.5	33.2	54.1	03:35	32.9	32.5	36.3	08:25	38.8	34.3	51.1	13:15	37.8	35.8	46.9				

Table 3b: - LAMax Events Ranked

#	Time	LAMax
1	06:30	78.5
2	06:20	72.5
3	06:15	72.2
4	06:10	72.1
5	06:25	71.8
6	23:55	71.0
7	06:05	68.2
8	23:20	66.5
9	06:40	66.4
10	23:10	66.1
11	06:35	65.7
12	06:55	65.5
13	06:50	64.2
14	23:50	63.8
15	06:45	63.8
16	23:25	63.3
17	04:05	62.9
18	04:10	62.9
19	23:30	62.7
20	23:00	61.0
21	23:45	60.9
22	23:35	60.7
23	00:10	59.7
24	05:30	59.6
25	23:15	59.5
26	23:40	59.0
27	04:15	58.6
28	23:05	58.0
29	04:25	57.4
30		

Development Layouts



Figure 2 – Revised Proposed Layout Plan