PUZ-ZM R32 Power Inverter Heat Pump
Outdoor Unit
Product Specifications







Product Dimensions PUZ-ZM35/50VKA

Upper View

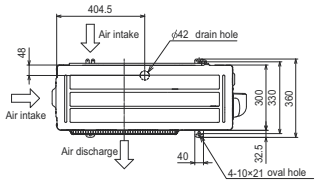

Front View



Side View



Product Dimensions PUZ-ZM60/71VHA

Upper View

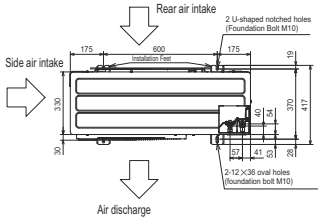

Front View

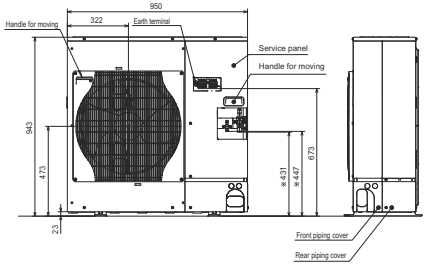

Product Dimensions PUZ-ZM100/125/140VKA, PUZ-ZM100/125/140YKA

Upper View

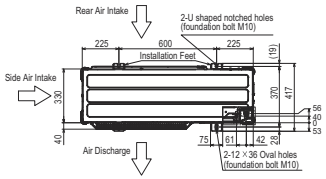

Front View

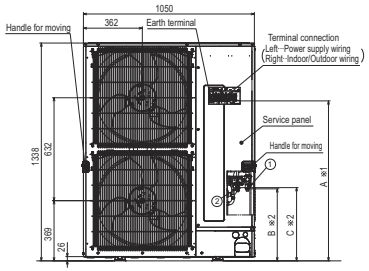

Side View



① Refrigerant GAS pipe connection	② Refrigerant LIQUID pipe connection
ø15.88 (5/8F)	ø9.52 (3/8F)

MODEL	A	B	C
PUZ-ZM100-140VKA	1067	442	450
PUZ-ZM100-140YKA	919	442	450

※1···Indication of Terminal connection location.
※2···Indication of STOP VALVE connection location.

MITSUBISHI ELECTRIC
Changes for the Better

Telephone: 01707 282880
email: air.conditioning@meuk.mee.com web: airconditioning.mitsubishielectric.co.uk microsite: timeforR32.co.uk

UNITED KINGDOM Mitsubishi Electric Europe Living Environment Systems Division, Travellers Lane, Hatfield, Hertfordshire, AL10 8XB, England. General Enquiries Telephone: 01707 282880 Fax: 01707 278881
IRELAND Mitsubishi Electric Europe, Westgate Business Park, Ballymount, Dublin 24, Ireland. Telephone: Dublin (01) 419 8800 Fax: Dublin (01) 419 8890 International code: (003531)

Country of origin: United Kingdom – Japan – Thailand – Malaysia. ©Mitsubishi Electric Europe 2017. Mitsubishi and Mitsubishi Electric are trademarks of Mitsubishi Electric Europe B.V. The company reserves the right to make any variation in technical specification to the equipment described, or to withdraw or replace products without prior notification or public announcement. Mitsubishi Electric is constantly developing and improving its products. All descriptions, illustrations, drawings and specifications in this publication present only general particulars and shall not form part of any contract. All goods are supplied subject to the Company's General Conditions of Sale, a copy of which is available on request. Third-party product and brand names may be trademarks or registered trademarks of their respective owners.

Note: The fuse rating is for guidance only. Please refer to the relevant databook for detailed specification. It is the responsibility of a qualified electrician/electrical engineer to select the correct cable size and fuse rating based on current regulation and site specific conditions. Mitsubishi Electric's air conditioning equipment and heat pump systems contain a fluorinated greenhouse gas, R410A (GWP:2088), R32 (GWP:675), R407C (GWP:1774) or R134a (GWP:1430). *These GWP values are based on Regulation (EU) No 517/2014 from IPCC 4th edition. In case of Regulation (EU) No.626/2011 from IPCC 3rd edition, these are as follows. R410A (GWP:1975), R32 (GWP: 550), R407C (GWP:1650) or R134a (GWP:1300).

Effective as of October 2017 SAP No. 317318

Green Gateway
www.greengateway.mitsubishielectric.co.uk
Mitsubishi Electric UK's commitment to the environment

Follow us @meuk_les
Follow us @green_gateway
Mitsubishi Electric Living Environmental Systems UK
mitsubishielectric2
thehub.mitsubishielectric.co.uk