



## TYPICAL SECTION


ADEQUATE BEARING STRATA TO BE CONFIRMED ON SITE BY A SUITABLE QUALIFIED ENGINEER FROM HHA AND CONFIRMED IN WRITING TO KIRKLEES. IF AN ALLOWABLE BEARING PRESSURE OF 100kN/m² CANNOT BE COMFIRMED, A FURTHER DEPTH OF MATERIAL SHALL BE EXCAVATED ALL AROUND THE CONCRETE BASE AND REPLACED WITH MASS CONCRETE.

ENSURE ALL CONCRETE IS THOROUGHLY VIBRATED/ COMPACTED.

20mm EXPANSION JOINT BETWEEN EACH WALL SECTION FILLED WITH HYDRO PAK AND SEALED WITH A 2 PART PLIASTIC SEALANT.

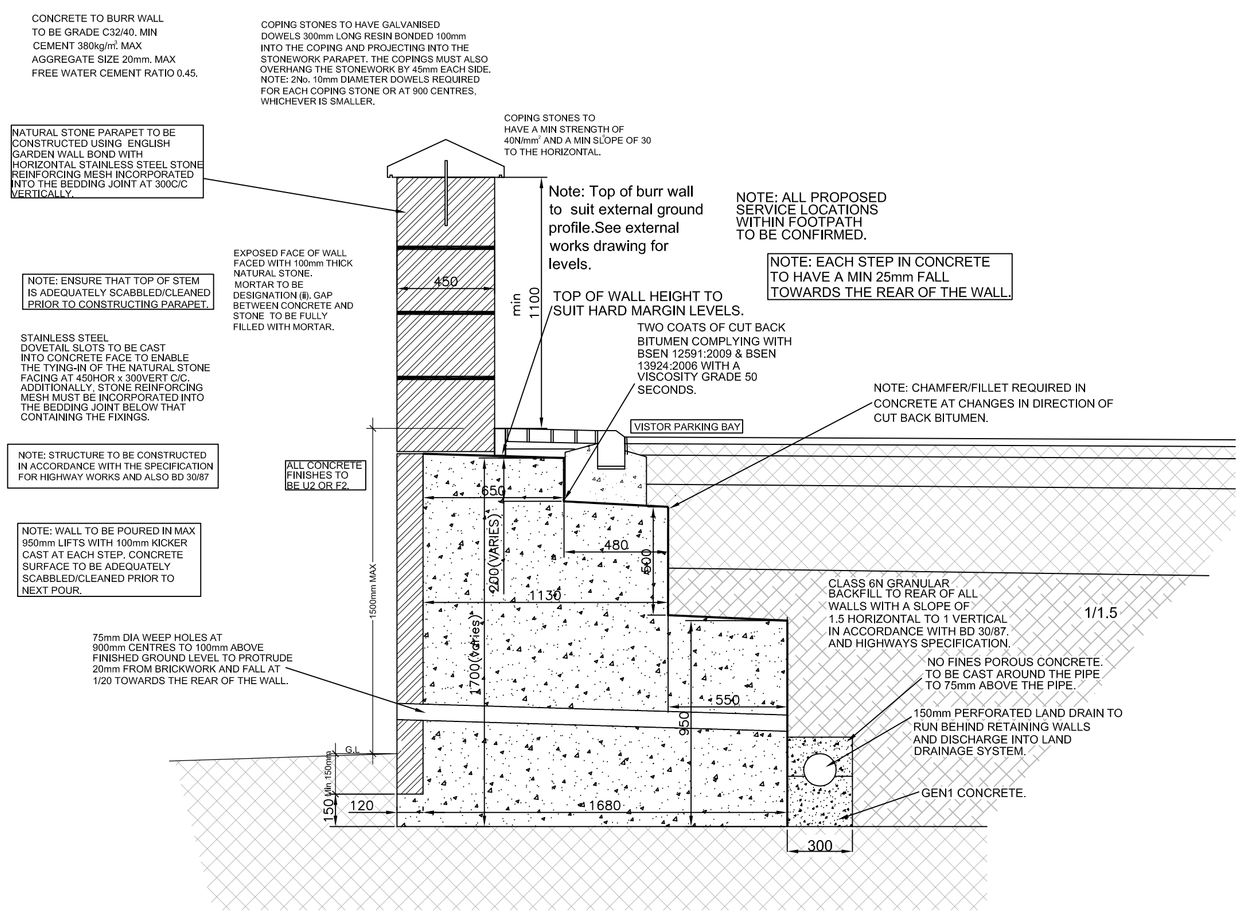


SITE PLAN - SCALE 1:200

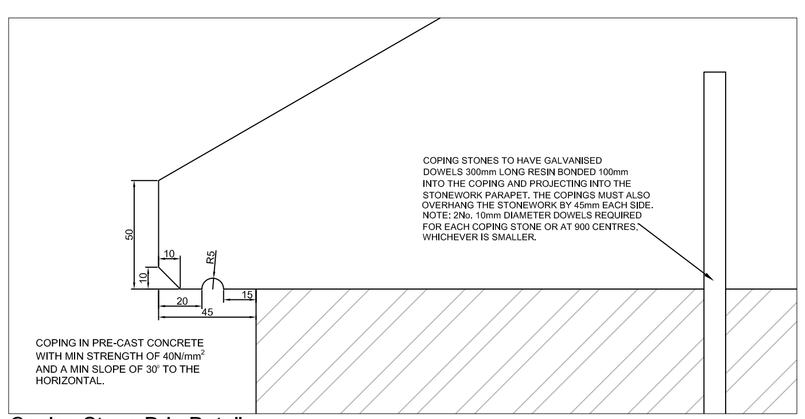


Coping Stone Drip Detail

NOTE.
SAFE TEMPORARY WORKING AREA TO BE PROVIDED FOR CONSTRUCTION OF WALL. SLOPE FACE TO REAR OF EXCAVATION TO HAVE A SAFE BATTER AND IF REQUIRED, SHEET PILED TEMPORARY WORKS TO BE DESIGNED TO SUPPORT EXCAVATED SLOPE FACE. DESIGN AND METHOD STATEMENT TO BE PROVIDED BY CONTRACTOR PRIOR TO CONSTRUCTION ON SITE.

NOTES
1. All concrete to be Grade C32/40.
2. Concrete sulphate class DS-1 ACEC class AC-1s to be used throughout.

**Haigh Huddleston & Associates**
Civil Structural Engineering Consultants
Firth Buildings, 99 - 101 Leeds Rd, Dewsbury, WF12 7BU t 01924 464342 f 01924 450662
e trevor.haigh@haighhuddleston.co.uk

Client
SB HOMES

Project
GILLROYD LANE, LINTHWAITE

Detail
ROAD 1/VISITOR PARKING HIGHWAY BURR WALL GENERAL ARRANGEMENT DETAILS

PRELIMINARY ISSUE

| Dwn | Chkd | Date | Scale | Dwg No. |
|---|---|---|---|---|
| PW | MH | May 22 | 1:50/20 @A2 | E16/6781/102 |