PROJECT I ORIGINATOR I ZONE I LEVEL I TYPE I ROLE I CLASS I NUMBER	REVISION
P1948-NOV-XX-EX-DR-E-9601	P01

LINKED FILES
2753_PROPOSED_BLOCK LAYOUT01

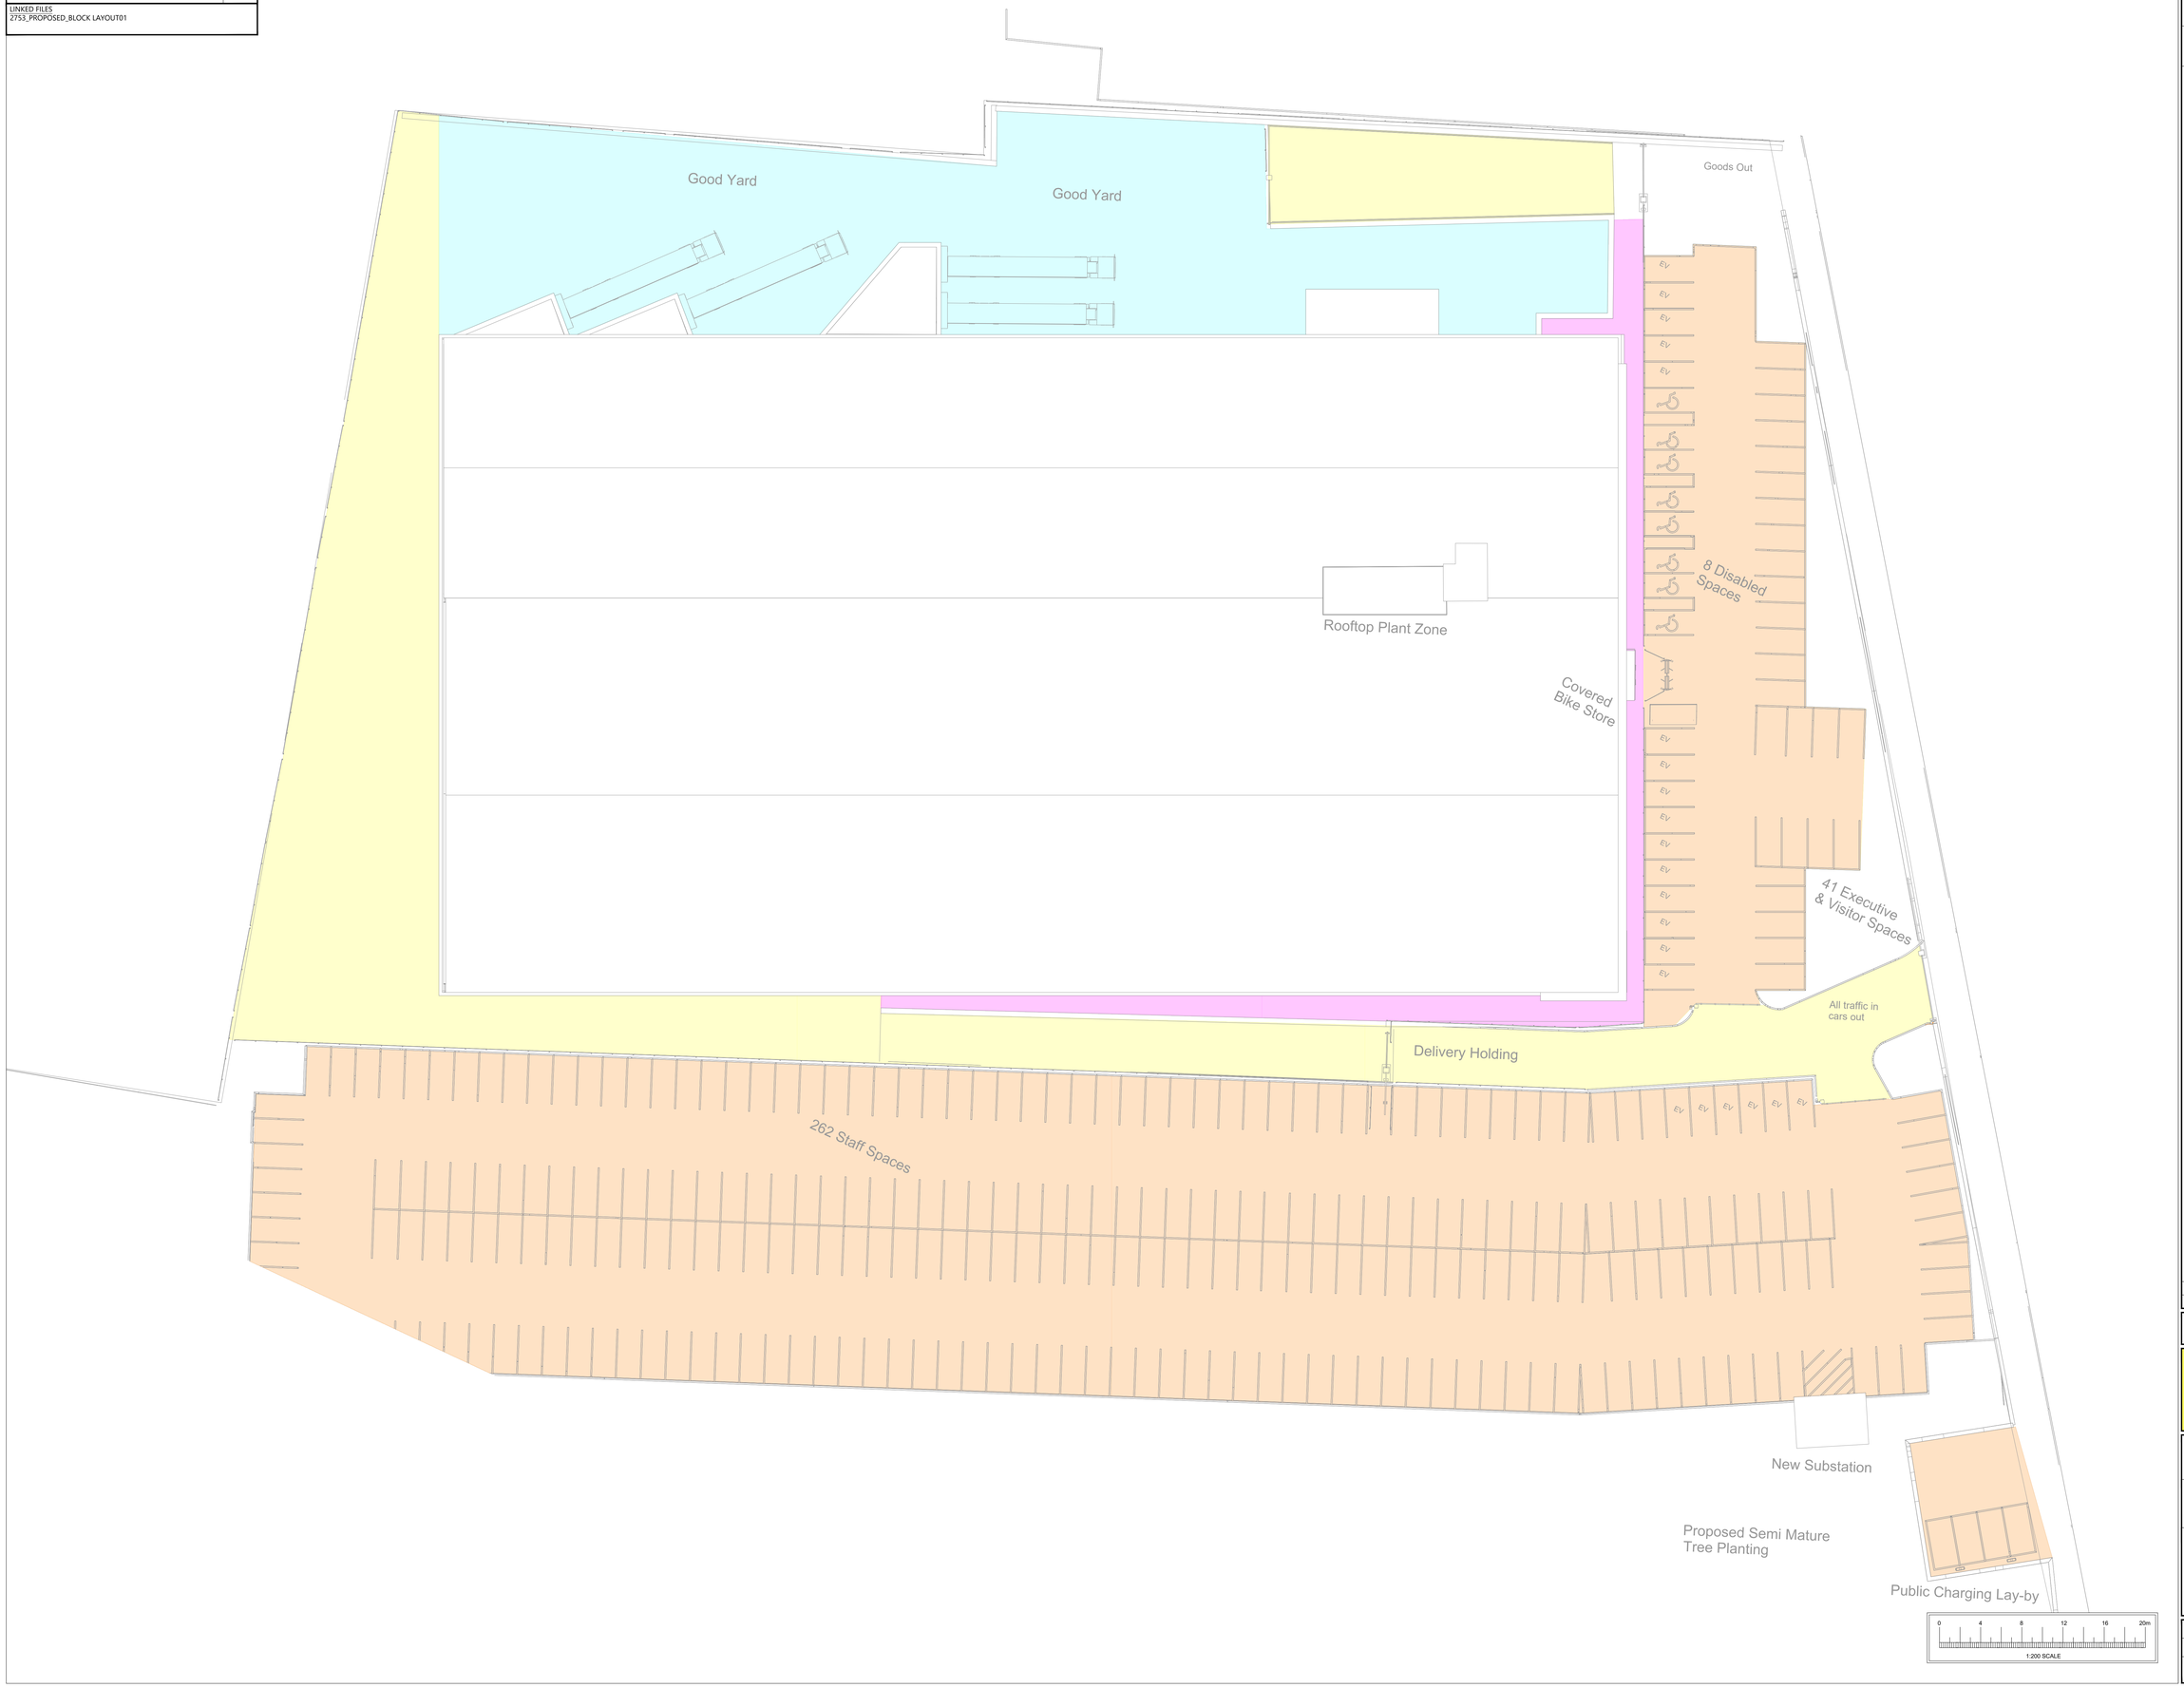

© PROTECTED BY UK COPYRIGHT LAW
DO NOT SCALE OFF THIS DRAWING

DESIGNERS RISK ASSESSMENT
Under section 11, 18 - Construction (Design and Management) Regulations 2015

SAFETY, HEALTH & ENVIRONMENTAL INFORMATION
There are no significant, unusual or location specific risks which are not obvious to a competent contractor or likely to be difficult to manage

EXTERNAL LIGHTING NOTES
1. LUMINAIRES SHALL BE AUTOMATICALLY CONTROLLED FOR PREVENTION OF OPERATION DURING DAYLIGHT HOURS VIA TIME CLOCK AND PHOTOCELL

LEGEND	
SYMBOL	REFERENCE
	5 LUX @0.25 UNIFORMITY
	10 LUX @0.4 UNIFORMITY
	20 LUX @0.4 UNIFORMITY
	50 LUX @0.4 UNIFORMITY

3
Spatial Coordination

STA	REV	DESCRIPTION	DES	CHD	DATE
-	P01	PRELIMINARY ISSUE	MH	GP	20.01.23

PURPOSE OF ISSUE
PRELIMINARY ISSUE

NOVO Integration Ltd
7 Feast Field, Horsforth, Leeds,
West Yorkshire, LS18 4TJ
t: +44(0)113 2577200 e: novocad@novo.eu.com

CLIENT
pcspecialist

PROJECT
GRANGE MOOR
WAKEFIELD

TITLE
ELECTRICAL SERVICES
SITE PLAN
EXTERNAL LIGHTING
STRATEGY LAYOUT

SCALE	ORIGINAL SIZE	DATE
1:200	A0	JAN '23
DRAWN: MNM	DESIGNED: MH	CHECKED: GP

PROJECT I ORIGINATOR I ZONE I LEVEL I TYPE I ROLE I CLASS I NUMBER: P1948-NOV-XX-EX-DR-E-9601
REVISION: P01

EXTERNAL LIGHTING STRATEGY LAYOUT