The use of this data by the recipient acts as an agreement of the following statements. Do not use this data if you do not agree with any of the following statements:-

Ryder Architecture has co-ordinated relevant information received from third parties, but are not responsible for the content of the information received from others.


The controlled version of this drawing should be viewed in DWF or PDF format not DWG or other formats. All prints of this drawing must be made in full colour.

Where this drawing has been based upon Ordnance Survey data, it has been reproduced under the terms of Ryder Licence No. 100000144. Reproduction of this drawing in whole or in part is prohibited without the prior permission of Ordnance Survey.

Do not scale the drawing. Use figured dimensions in all cases. Check all dimensions on site. Report any discrepancies in writing to Ryder before proceeding.

Scale Bar (m)


0 1 2 4 8






1 Elevation A

1 : 200

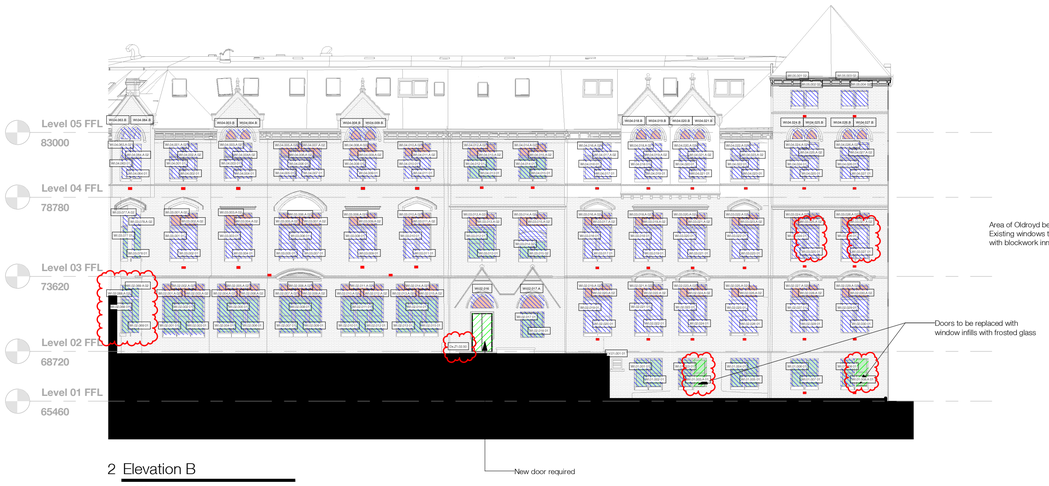

2 Elevation B

1 : 200

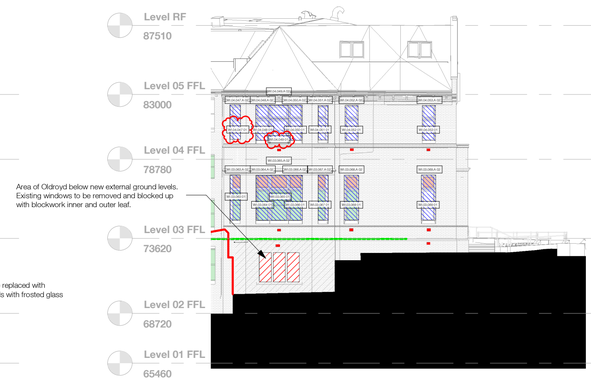

3 Elevation C

1 : 200

KEY

- Existing external window to be replaced with new specification window
- Existing window to be removed and filled
- Demo works to existing facade
- Existing door to be removed and replaced
- Proposed glazed spandrel panel
- Stonework repairs required
- Existing air bricks
- Existing rain water pipes to be adapted where intersecting new building (blue line)
- Proposed frosted glass
- Proposed privacy frosted film to retained existing windows. Specifciation as per ER's window film type 5, Solarshade Opalux privacy and decoration film - Type PV900 Frost

Window Schedule Key

1 : 20

EXISTING WINDOWS TO BE FULLY SURVEYED PRIOR TO MANUFACTURE OF NEW PROPOSED WINDOWS.

NEW WINDOWS TO REFLECT EXISTING SIZES TRANSOMS, FRAME / STILE DEPTHS TO ACHIEVE REQUIRED U-VALUES

01 - GLAZED PANEL - FIXED

02 - GLAZED PANEL - OPENING LIGHT


Glazing Specification Note:

All glazing to achieve the following specification:

Build Up
– Outer - 6mm toughened Suncool 70/40
– Cavity – 16mm argon filled
– Inner – 9.5mm clear toughened Optilam with Low E coating (Manual attack resistance BS EN356 - P4A)


Frame Bites
12.7mm

Uniclass Code: Ss_25_30_95_96

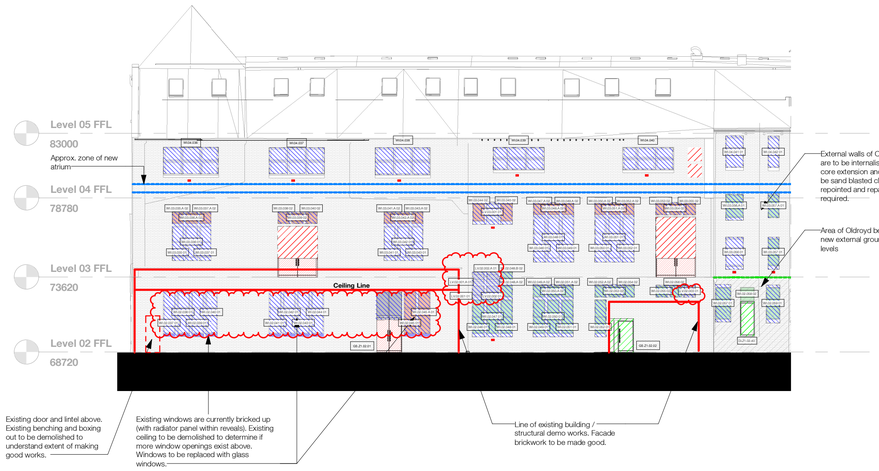


4 Elevation D

1 : 200

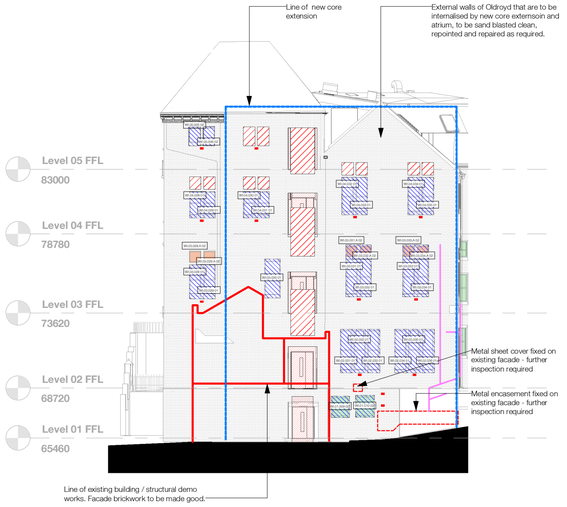

5 Elevation E

1 : 200

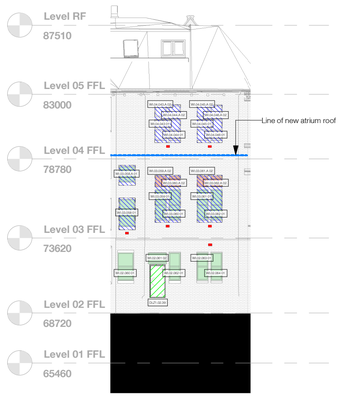


6 Elevation F


1 : 200



Elevation D

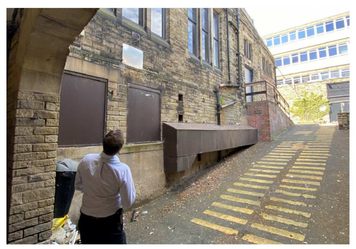

Elevation E - Metal Enclosures

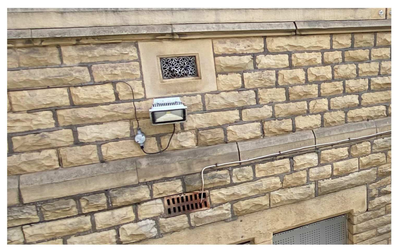

Typical Air Bricks



Elevation D - Stoneworks To Be Repaired

C02	Window references updated and references added where not indicated. Doors replaced with windows where required. Numbering sequnece updated to Elevation D.	SAY	SAY	11/07/22
C01	Issued for Construction	SAY	SAY	05/01/22
P3	Drawing updated following WD comments email 22/06/2021	JGO	AYO	01/07/21
P2	Stage 4 issue	JGO	AYO	21/06/21
P1	First Issue. Stage 3 Information.	JGO	AYO	26/02/21
Rev	**Description**	**Drawn**	**Checked**	**Date**

Suitability
Issued for Construction

Project
6BKD1
Willmott Dixon

Drawing
Existing Oldroyd Elevations

Drawing Number

Project ID	Originator	Zone	Level	Type	Role	Number
6BKD1	- RYD	- Z1	- ZZ	- DR	- A	- 00302

Project Number	Scale at A1	Status	Revision
3273-01	As indicated	A1	C02

info@ryderarchitecture.com
www.ryderarchitecture.com

Ryder