

PEAK acoustics



Noise Impact Assessment

Client:	Marcus Stapley
Site:	Land at 1 & 1a Sparks Road, Huddersfield, HD3 4BX
Reference No.	2804231NR
Revision:	0.0
Date of Issue:	23/05/2023

Project Consultant

T. Brown BSc (Hons) MIOA
Acoustic Consultant
tom@acousticsurveys.co.uk

Proofing Consultant

Molly-Sue Bisset
Office Manager
molly@acousticsurveys.co.uk

Email: sales@acousticsurveys.co.uk | **Office** 0330 043 1764

Web: www.acousticsurveys.co.uk

Peak Acoustics Ltd, Silk Point, Queen's Avenue, Macclesfield, Cheshire, SK10 2BB

Executive Summary

An Environmental Noise Assessment has been undertaken at 1 & 1a Sparks Road, Huddersfield, HD3 4BX in relation to the proposed construction of 3 terrace dwellings and a pair of semi-detached dwellings.

Environmental noise monitoring was undertaken at the site from 10th – 11th May 2023. Noise affecting the development was determined to be primarily from road traffic on New Hey Road.

A glazing and ventilation scheme has been given to ensure conditions in habitable rooms remain within the desired design criteria of BS8233:2014. The derived scheme is summarised below.

Glazing & Ventilation Scheme

Internal Space	Glazing		Ventilation	
	Minimum Performance $R_w (+C_{tr})^{[1]}$	Example Specification ^[2]	Minimum Performance $D_{ne,W,+C_{tr} (Open)}$	Example Specification ^[3]
Living Areas – Terrace	30 (26)	Double Glazing: 4/16/4	32	Hit & Miss Trickle Vent (Open): Titon Trimvent XS13 4400EA
Bedrooms – Terrace	30 (26)	Double Glazing: 4/16/4	32	Hit & Miss Trickle Vent (Open): Titon Trimvent XS13 4400EA
Dining Rooms - Terrace	30 (26)	Double Glazing: 4/16/4	32	Hit & Miss Trickle Vent (Open): Titon Trimvent XS13 4400EA
Living Areas – Semi	30 (26)	Double Glazing: 4/16/4	32	Hit & Miss Trickle Vent (Open): Titon Trimvent XS13 4400EA
Bedrooms – Semi	30 (26)	Double Glazing: 4/16/4	32	Hit & Miss Trickle Vent (Open): Titon Trimvent XS13 4400EA
Bedrooms – Roof - Semi	30 (26)	Double Glazing: 4/16/4	32	Hit & Miss Trickle Vent (Open): Titon Trimvent XS13 4400EA
Dining Rooms - Semi	30 (26)	Double Glazing: 4/16/4	32	Hit & Miss Trickle Vent (Open): Titon Trimvent XS13 4400EA

An assessment of the external amenity spaces has also been undertaken and levels are within the 'desirable' criteria of BS8233. Site plans are provided within **Appendix G**.

Contents

Executive Summary.....	2
1. Introduction	4
1.1. Proposal	4
1.2. Reason for Assessment	4
1.3. Planning Conditions	4
1.4. Assessment Guidance Documentation	4
2. Environmental Noise Survey	4
2.1. Survey Measurement	4
2.2. Measurement Location	5
2.3. Site Descriptions	5
2.4. Noise Affecting the Development	6
2.5. Environmental Noise Survey Results	6
2.6. Weather Conditions	6
2.7. Measurement Equipment	6
3. Internal Noise Level Assessment.....	7
3.1. Design Criteria.....	7
3.2. Assessment Noise Levels.....	7
3.3. Internal Noise Calculations.....	8
4. Sound Insulation Scheme	8
4.1. External Building Envelope.....	8
4.2. Glazing and Ventilation	8
5. Internal Noise Levels	9
6. External Amenity Areas.....	10
7. Conclusions	10
APPENDIX A – Measurement Details	11
APPENDIX B - Equipment Details	11
APPENDIX C - Meteorology Details	11
APPENDIX D - Calibration Details	11
APPENDIX E – Noise Survey Time History	12
APPENDIX F – BS8233 Rigorous Design Calculations.....	13
APPENDIX G – Site Plans	20
APPENDIX H – Legislation, Policy and Guidance	22
APPENDIX I – Acoustic Terminology.....	24

1. Introduction

1.1. Proposal

It is proposed to construct 3 terraced houses and a pair of semi-detached houses on land at 1 & 1a Sparks Road, Huddersfield; hereafter referred to as 'the site'. The site currently consists of existing dwellings with the new buildings to be constructed on vacant land at the same site.

1.2. Reason for Assessment

A noise assessment is to be submitted as part of the planning application to ensure desirable noise levels are met within the habitable rooms of the proposed development and external amenity areas. The assessment aims to provide a sound insulation scheme for the development.

1.3. Planning Conditions

No planning conditions have so far been set for the site, however the local authority have requested a noise impact assessment due to the proximity of the site to an unrestricted haulage yard.

1.4. Assessment Guidance Documentation

Guidance on the assessment and design criteria will be drawn from BS8233:2014 - *Guidance on sound insulation and noise reduction for buildings*. Table 4 in Section 7.7.2 of this standard suggests indoor ambient noise levels for dwellings.

Additional guidance will be drawn from 'ProPG: Planning & Noise' which was published "*to provide practitioners with guidance on a recommended approach to the management of noise within the planning system in England.*"

Where necessary, mitigation recommendations will be given to comply with the requirements of the National Planning Policy Framework (2021) and the Noise Policy Statement for England (2010). Further information on all guidance documentation can be found in **Appendix H**.

2. Environmental Noise Survey

2.1. Survey Measurement

To assess the environmental noise levels affecting the proposed development, an unattended noise survey was undertaken at the site from 10th – 11th May 2023. This period was selected to capture events and noise levels on a typical weekday from all nearby commercial and industrial sources as well as noise from Sparks Road, New Hey Road and other nearby residential sources.

Measurements of $L_{Aeq,T}$ and L_{AFmax} were logged in 5-minute intervals in accordance with the provisions of BS7445 - *Description and Measurement of Environmental Noise*.

2.2. Measurement Location

Monitoring position M1 is located at the Southeast boundary of the site. The microphone was positioned approximately 1.7 metres above ground level and away from any reflective surfaces.

The site and monitoring locations are shown below in **Figure 1**.



Figure 1: Site & Measurement Locations – google.com/maps

 Monitoring Location (M1)

 Site Boundary (Approx.)

2.3. Site Descriptions

The site sits between the A640 (New Hey Road) to the North, and Sparks Road to the Southwest. There is an existing residential building at the site fronted onto New Hey Road. The new buildings will be positioned behind this.

To the East of the site is the yard of 'Heathcote Transport' which is a Haulage firm. The yard itself is only big enough for 2 or 3 HGV's and non were observed in the yard during site visits. Adjacent to this there is also an architectural salvage / demolition yard.

To the South of the site is what appears to be a caravan storage yard and West of the site is Sparks Road and a mixture of detached and semi-detached housing and gardens.

2.4. Noise Affecting the Development

The primary noise source affecting the development was identified as traffic on New Hey Road. Secondary sources were noted as noise from the nearby architectural salvage yard and some intermittent and distant construction noise.

2.5. Environmental Noise Survey Results

The results from the noise monitoring location M1 are summarised below.

The full-time history of the noise monitoring data is given in **Appendix E**.

Table 1. – Environmental Measurement Summary

Measurement	Date(s)	Period	L _{Aeq} (dB)	Typical* L _{AFmax} (dB)
M1	10 th & 11 th May 2023	Day (16hr Aggregate Periods)	49	-
	10 th – 11 th May 2023	Night (8hr)	50	72

* The given 'Typical' L_{AFmax} levels are an average of the spectra of the noisiest 10 events of the night-time period.

2.6. Weather Conditions

Daytime temperatures of 13°C were noted during the survey with winds of 3 – 5m/s. Detailed weather conditions are given in **Appendix C**.

2.7. Measurement Equipment

Measurement equipment complies with accuracy requirements for common environmental noise measurement standards. Equipment was calibrated before and after use and no significant drift occurred during measurements. Up-to-date calibration certification can be provided upon request. A detailed equipment list is given in **Appendix B** with calibration information in **Appendix D**.

3. Internal Noise Level Assessment

3.1. Design Criteria

BS8233:2014 - *Guidance on sound insulation and noise reduction for buildings* suggests indoor ambient noise levels for dwellings in Table 4, Section 7.7.2. These are summarised below.

Table 2. – Indoor Ambient Noise Levels for Dwellings

Activity	Location	07:00 to 23:00	23:00 to 07:00
Resting	Living Room	35 dB $L_{Aeq,16hour}$	-
Dining	Dining room/area	40 dB $L_{Aeq,16hour}$	-
Sleeping	Bedroom	35 dB $L_{Aeq,16hour}$	30 dB $L_{Aeq,8hour}$

BS8233 states that the guideline values given above are for ‘noise without character’, further stating:

“Noise has a specific character if it contains features such as a distinguishable, discrete and continuous tone, is irregular enough to attract attention, or has strong low-frequency content, in which case lower noise limits might be appropriate.”

Table 4 of BS8233 also has accompanying notes that were subject to additions in ProPG. The relevant notes with the additions of ProPG are given below.

“In most circumstances in noise sensitive rooms at night (e.g. bedrooms) good acoustic design can be used so that individual noise events do not normally exceed 45dB $L_{Amax,F}$ more than 10 times a night.”

In considering the noise climate affecting the proposed development, as discussed in Section 2.4, it is deemed appropriate to use guidelines set out in BS8233 and ProPG to ensure the internal criteria set out by the WHO for internal noise maxima L_{Amax} and internal L_{Aeq} .

3.2. Assessment Noise Levels

In the interest of a robust assessment, the loudest of the measurement intervals, subject to irregular events, are to be considered in the assessment of internal noise levels and determining the sound insulation scheme.

The resultant external noise levels for the assessment of internal ambient noise levels are summarised in the table below.

Table 3. – Assessment Noise Levels

Period	$L_{Aeq,T}$ (dB)	L_{Amax} (dB)
Daytime (1hr)	52	-
Night (1hr)	58	72

3.3. Internal Noise Calculations

Internal noise levels have been calculated to demonstrate that the proposed dwellings can achieve the desired design criteria when appropriate glazing and ventilation systems are utilised.

Internal arrangements of the dwellings have been submitted by the client, proposed drawings by 'drawmyextension.co.uk' have been used to scale room and glazing dimensions and can be found in **Appendix G**.

Assessment is not required for each individual room therefore a worst-case situation will be used in which the worst affected rooms/floors will be used.

Calculations of internal ambient noise levels have been undertaken using the 'rigorous calculation' method given in Annex G2 of BS8233:2014. Full details of the calculations are provided in **Appendix F**.

4. Sound Insulation Scheme

4.1. External Building Envelope

Material build-up of the façade will significantly dictate the noise levels within the proposed dwelling. For the purposes of this report, the heavyweight construction of the façade is assumed to provide a minimum sound reduction of 49 dB R_w .

Where the roof is to be utilised as a voided loft space with thermal insulation, no further details are required. If the proposed dwelling has rooms within the roof space, the additional material build-up will be assumed at a minimum sound reduction of 39 dB R_w .

4.2. Glazing and Ventilation

The following glazing and ventilation scheme for the development has been derived with a view of achieving the internal noise level criteria given in Table 2.

Table 4. – Glazing & Ventilation Scheme

Internal Space	Glazing		Ventilation	
	Minimum Performance $R_w (+C_{tr})^{[1]}$	Example Specification ^[2]	Minimum Performance $D_{ne,W,+C_{tr} (Open)}$	Example Specification ^[3]
Living Areas – Terrace	30 (26)	Double Glazing: 4/16/4	32	Hit & Miss Trickle Vent (Open): Titon Trimvent XS13 4400EA
Bedrooms – Terrace	30 (26)	Double Glazing: 4/16/4	32	Hit & Miss Trickle Vent (Open): Titon Trimvent XS13 4400EA
Dining Rooms - Terrace	30 (26)	Double Glazing: 4/16/4	32	Hit & Miss Trickle Vent (Open): Titon Trimvent XS13 4400EA
Living Areas – Semi	30 (26)	Double Glazing: 4/16/4	32	Hit & Miss Trickle Vent (Open): Titon Trimvent XS13 4400EA
Bedrooms – Semi	30 (26)	Double Glazing: 4/16/4	32	Hit & Miss Trickle Vent (Open): Titon Trimvent XS13 4400EA
Bedrooms – Roof - Semi	30 (26)	Double Glazing: 4/16/4	32	Hit & Miss Trickle Vent (Open): Titon Trimvent XS13 4400EA
Dining Rooms - Semi	30 (26)	Double Glazing: 4/16/4	32	Hit & Miss Trickle Vent (Open): Titon Trimvent XS13 4400EA

N.B. Note that other glazing configurations and ventilators can achieve the given minimum performance requirements.

[1] The sound insulation value of the glazing should take into account the glass as well as the frame and perimeter seal.

[2] Example glazing specification format given as ‘XXmm Float / 16mm Air gap / XXmm Float’

[3] It is noted that BS8233 section 7.2.2 states ‘If relying on closed windows to meet the guide values, there needs to be an appropriate alternative ventilation that does not compromise the façade insulation or the resulting noise level’. This statement implies that the use of closed windows and an alternative means of ventilation is acceptable.

5. Internal Noise Levels

It is determined that by using mitigation as specified in **Table 4** for the building façades, the outcome summarised in the following table is achieved.

Table 5. – Internal Noise Levels

Internal Space	Noise Parameter	Internal Noise Level (dB)	Within Design Criteria?
Living Room – Terrace	Daytime $L_{Aeq, 16hr}$	23	Yes
Kitchen Diner – Terrace	Daytime $L_{Aeq, 16hr}$	24	Yes
Bedroom - Terrace	Daytime $L_{Aeq, 16hr}$	24	Yes
	Night-time $L_{Aeq, 8hr}$	23	Yes
	Night-time $L_{Amax F}$	39	Yes
	Living Room – Semi	Daytime $L_{Aeq, 16hr}$	24
Kitchen Diner – Semi	Daytime $L_{Aeq, 16hr}$	23	Yes
Bedroom - Semi	Daytime $L_{Aeq, 16hr}$	23	Yes
	Night-time $L_{Aeq, 8hr}$	22	Yes
	Night-time $L_{Amax F}$	38	Yes
Master Bedroom – Roof - Semi	Daytime $L_{Aeq, 16hr}$	23	Yes
	Night-time $L_{Aeq, 8hr}$	22	Yes
	Night-time $L_{Amax F}$	39	Yes

For the daytime assessment for living areas, the desirable limit of BS8233:2014 suggests a guideline of 35 dB $L_{Aeq, 16hr}$ for resting conditions, and up to 40 dB is considered acceptable for necessary developments.

All results, with the implementation of the derived sound insulation scheme given in **Table 4**, would place the internal daytime noise levels below 35 dB, therefore within the desired limit.

For the night-time assessment for bedrooms, BS8233:2014 suggests a desirable guideline of 30 dB $L_{Aeq, 8hr}$ for sleeping conditions, with an acceptable limit of 35 dB $L_{Aeq, 8hr}$.

Implementation of the derived sound insulation scheme given in **Table 4** would place the internal continuous night-time noise levels below 30 dB, therefore within the desirable category.

For the night-time assessment for bedrooms, ProPG suggests that individual noise events do not normally exceed 45dB $L_{Amax,F}$ more than 10 times a night.

Implementation of the derived sound insulation scheme given in **Table 4** would place the internal $L_{Amax,F}$ night-time events below 45 dB, therefore within the criteria.

6. External Amenity Areas

BS8233:2014 provides a desirable guideline of 50 dB $L_{Aeq,16hr}$ for external amenity spaces and an acceptable guideline of 55 dB $L_{Aeq,16hr}$ for noisier environments.

External daytime noise levels were measured on-site at position M1 (Figure 1)

Table 6. – External Amenity Area Assessment

Measurement Position	Noise Parameter	Garden Noise Level (dB)	BS8233 Criteria	Attenuation Required (dB)
M1	Daytime $L_{Aeq, 16hr}$	49	50 – 55 dB $L_{Aeq, 16hr}$	0

As this is within the limits of the BS8233 criteria, this value is deemed acceptable. It is also noted that once the building has been completed, levels in the external amenity areas are deemed to be lower due to shielding from noise from the building facades.

7. Conclusions

A noise assessment has been undertaken at 1 & 1a Sparks Road, Huddersfield, HD3 4BX in relation to the proposed construction of 3 terrace dwellings and a pair of semidetached dwellings.

Environmental noise monitoring was undertaken at the site from 10th – 11th May 2023. Noise affecting the development was determined to be primarily from traffic on New Hey Road.

A glazing and ventilation scheme has been given to ensure conditions in habitable rooms remain within the design criteria.

Internal noise levels are anticipated to be within the guidelines of BS8233 with comments from ProPG.

APPENDIX A – Measurement Details

Measurement(s)	Kit	Start Date	Start Time	End Date	End Time
M1	A5	10/05/2023	09:50	11/05/2023	09:25

APPENDIX B - Equipment Details

Kit	Equipment	Make	Model	Class	Serial Number
A5	Sound Meter	RION	NL-52	1	00219828
A5	Pre-Amp	RION	NH-25	1	00344
A5	Microphone	RION	UC-59	1	18806
A5	Calibrator	RION	NL-75	1	34212936

APPENDIX C - Meteorology Details


Date	Temp C°	Wind Speed m/s	Wind Direction	Humidity %	Precipitation mm	Cloud Cover (Oktas)
10/05/2023	13	5	W	76	0.0	7/8
11/05/2023	13	3	W	76	0.0	7/8

APPENDIX D - Calibration Details

Kit	Calibrator Ref Level (dB)	Deviation Before (dB)	Deviation After (dB)
A5	94.00	0.00	0.00

APPENDIX E – Noise Survey Time History

Environmental Noise Measurement M1 Time History: 10th – 11th May 2023

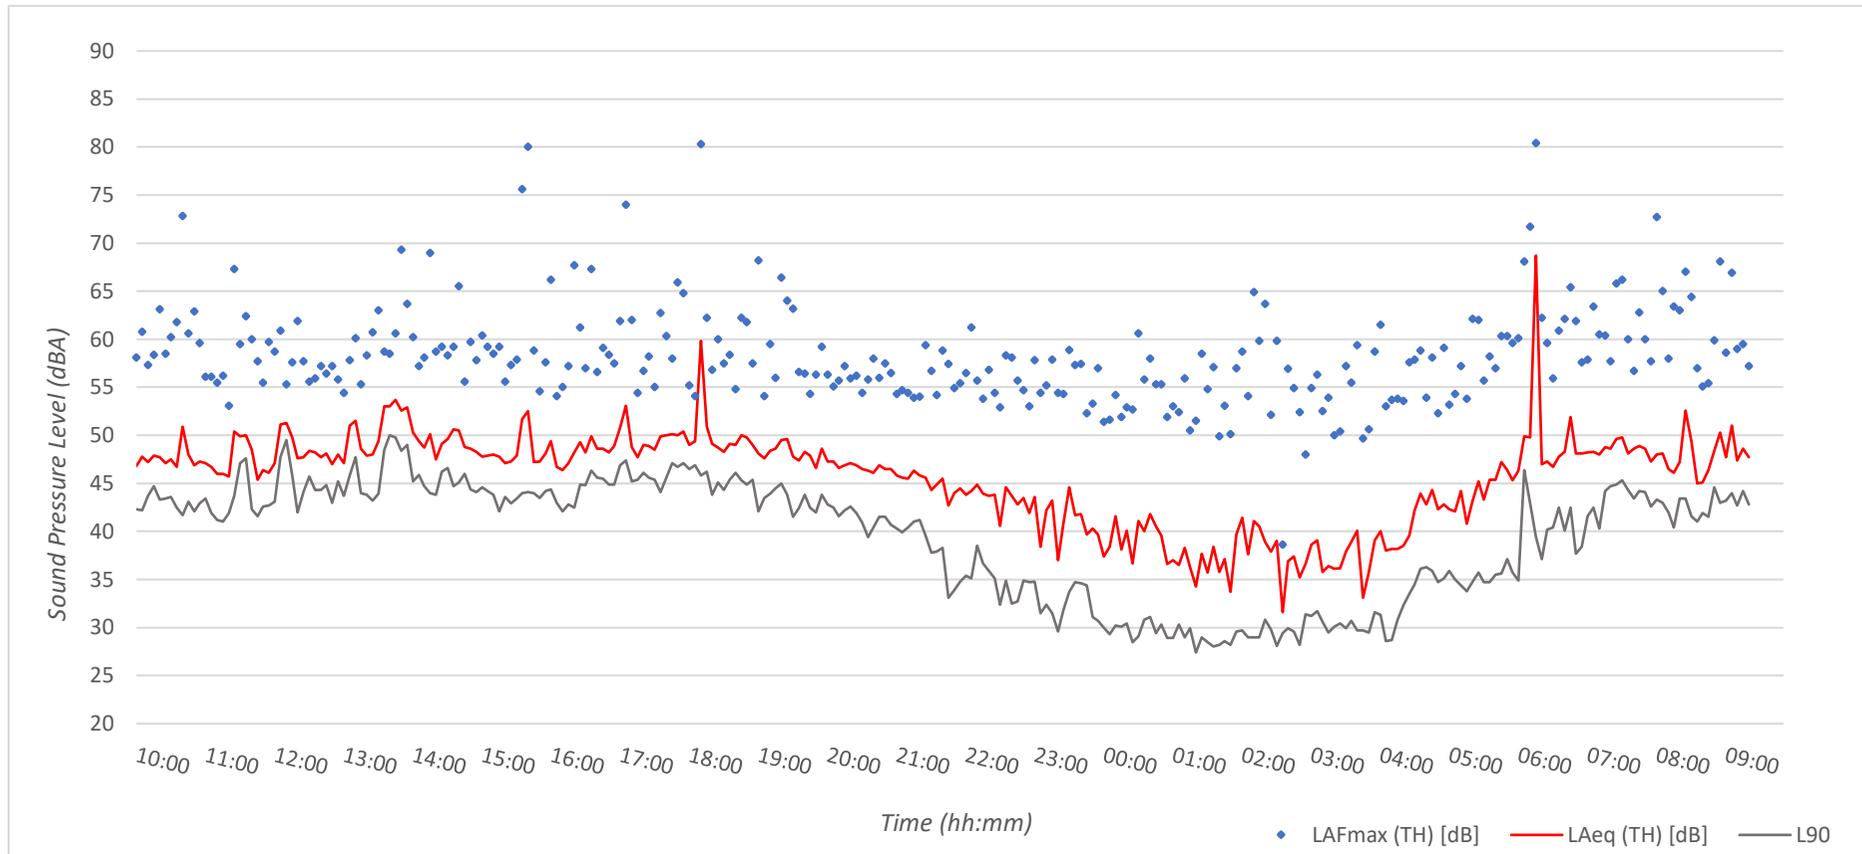

APPENDIX F – BS8233 Rigorous Design Calculations

1. Terrace - Kitchen-Diner - GF																																				
BS8233:2014 Façade Noise Break In Calculator																																				
Daytime External Noise Level - Leq - 1 hour																																				
Night-time External Noise Level - Leq - 1 hour																																				
Night-time Lmax Noise Levels																																				
Room Properties																																				
Width (m)	Height (m)	Depth (m)	Glazing	Reverb Time																																
4.5	2.4	3.3	3.81	0.6																																
Façade Construction																																				
Wall Construction	Brick and block, 75mm cavity, 60mm Fibreglass																																			
Roof Construction	Not Within Roof Space																																			
Glazing Spec	4 / 16 / 4																																			
Ventilation Spec	Hit & Miss Trickle Vent (Open)																																			
Room Coefficient																																				
8	9	9	10	10	A																															
0.7	0.7	0.6	0.6	0.6	RT																															
SRI (Sound Reduction Index)																																				
31	46	43	49	56	49(44)																															
0	0	0	0	0	N/A																															
24	18	26	40	45	30(26)																															
38.4	36.8	33.8	29.7	33.8	32																															
Calculation Results																																				
Daytime Internal Noise Level - LAeq	Target Value <	35																																		
Night-time Internal Noise Level - LAeq	Target Value <																																			
Internal Lmax Noise Levels	Target Value <																																			
<table border="1"> <thead> <tr> <th>125</th> <th>250</th> <th>500</th> <th>1k</th> <th>2k</th> <th>dBA</th> </tr> </thead> <tbody> <tr> <td>125</td> <td>250</td> <td>500</td> <td>1k</td> <td>2k</td> <td>dBA</td> </tr> <tr> <td>48.6</td> <td>45.5</td> <td>45.5</td> <td>46.8</td> <td>40.7</td> <td>49</td> </tr> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>							125	250	500	1k	2k	dBA	125	250	500	1k	2k	dBA	48.6	45.5	45.5	46.8	40.7	49												
125	250	500	1k	2k	dBA																															
125	250	500	1k	2k	dBA																															
48.6	45.5	45.5	46.8	40.7	49																															
<table border="1"> <thead> <tr> <th>125</th> <th>250</th> <th>500</th> <th>1k</th> <th>2k</th> <th>dBA</th> </tr> </thead> <tbody> <tr> <td>125</td> <td>250</td> <td>500</td> <td>1k</td> <td>2k</td> <td>dBA</td> </tr> <tr> <td>9.2</td> <td>18.5</td> <td>16.9</td> <td>19.4</td> <td>10.5</td> <td>23.5</td> </tr> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>							125	250	500	1k	2k	dBA	125	250	500	1k	2k	dBA	9.2	18.5	16.9	19.4	10.5	23.5												
125	250	500	1k	2k	dBA																															
125	250	500	1k	2k	dBA																															
9.2	18.5	16.9	19.4	10.5	23.5																															
Sound Insulation Requirement																																				
Minimum Sound Insulation Requirement																																				
Glazing	30(26)	dB R _{W(+Ctr)}	Suitable Systems Double Glazing 4 / 16 / 4																																	
Ventilation	32	D _{n,e,w+Ctr}	Hit & Miss Trickle Vent (Open) Titon Trimvent XS13 4400EA																																	
Suitable systems given as reference only. Other products that achieve the required sound insulation values are available.																																				
Calculations conducted in accordance with BS8233:2014 rigorous calculation method																																				
$L_{eq,2} = L_{eq,ff} + 10 \log_{10} \left(\frac{A_0}{S} 10^{\frac{-D_{01}}{10}} + \frac{S_{wl}}{S} 10^{\frac{-R_{01}}{10}} + \frac{S_{cw}}{S} 10^{\frac{-R_{01}}{10}} + \frac{S_{fl}}{S} 10^{\frac{-R_{01}}{10}} \right) + 10 \log_{10} \left(\frac{S}{A} \right) + 3$																																				

2. Terrace - Living Room

BS8233:2014 Façade Noise Break In Calculator					
Daytime External Noise Level - Leq - 1 hour					
Night-time External Noise Level - Leq - 1 hour					
Night-time Lmax Noise Levels					
Room Properties					
Width (m)	Height (m)	Depth (m)	Glazing	Reverb Time	
4.5	2.4	4	2.42	0.7	
Façade Construction					
Wall Construction	Brick and block, 75mm cavity, 60mm Fibreglass				
Roof Construction	Not Within Roof Space				
Glazing Spec	4 / 16 / 4				
Ventilation Spec	Hit & Miss Trickle Vent (Open)				
Room Coefficient					
10	10	11	11	11	A
0.7	0.7	0.7	0.6	0.6	RT
SRI (Sound Reduction Index)					
31	46	43	49	56	49(44)
0	0	0	0	0	N/A
24	18	26	40	45	30(26)
38.4	36.8	33.8	29.7	33.8	32
Calculation Results					
Daytime Internal Noise Level - LAeq		Target Value <	35		
Night-time Internal Noise Level - LAeq		Target Value <			
Internal Lmax Noise Levels		Target Value <			
125 250 500 1k 2k dBA					
48.6	45.5	45.5	46.8	40.7	49
125 250 500 1k 2k dBA					
7.9	16.0	15.2	19.5	10.6	22.5

Sound Insulation Requirement

Minimum Sound Insulation Requirement			Suitable Systems
Glazing	30(26)	dB R _{W(+Ctr)}	Double Glazing 4 / 16 / 4
Ventilation	32	D _{n,e,w+Ctr}	Hit & Miss Trickle Vent (Open)
<i>Suitable systems given as reference only. Other products that achieve the required sound insulation values are available.</i>			

$$L_{eq,2} = L_{eq,ff} + 10 \log_{10} \left(\frac{A_0}{S} 10^{\frac{-D_{01}}{10}} + \frac{S_{wl}}{S} 10^{\frac{-R_{w1}}{10}} + \frac{S_{cw}}{S} 10^{\frac{-R_{cw}}{10}} + \frac{S_{fl}}{S} 10^{\frac{-R_{fl}}{10}} \right) + 10 \log_{10} \left(\frac{S}{A} \right) + 3$$

3. Terrace - Bedroom 1																																			
BS8233:2014 Façade Noise Break In Calculator																																			
Daytime External Noise Level - Leq - 1 hour																																			
Night-time External Noise Level - Leq - 1 hour																																			
Night-time Lmax Noise Levels																																			
Room Properties																																			
Width (m)	Height (m)	Depth (m)	Glazing	Reverb Time																															
4.5	2.4	3.5	4.21	0.6																															
Façade Construction																																			
Wall Construction	Brick and block, 75mm cavity, 60mm Fibreglass																																		
Roof Construction	Not Within Roof Space																																		
Glazing Spec	4 / 16 / 4																																		
Ventilation Spec	Hit & Miss Trickle Vent (Open)																																		
Calculation Results																																			
Daytime Internal Noise Level - LAeq	Target Value <	35																																	
Night-time Internal Noise Level - LAeq	Target Value <	30																																	
Internal Lmax Noise Levels	Target Value <	45																																	
<table border="1" style="width: 100%; border-collapse: collapse; margin-top: 10px;"> <thead> <tr> <th>125</th> <th>250</th> <th>500</th> <th>1k</th> <th>2k</th> <th>dB(A)</th> </tr> </thead> <tbody> <tr> <td>48.6</td> <td>45.5</td> <td>45.5</td> <td>46.8</td> <td>40.7</td> <td>49</td> </tr> <tr> <td>48.0</td> <td>45.6</td> <td>45.7</td> <td>45.0</td> <td>38.7</td> <td>48</td> </tr> <tr> <td>68.8</td> <td>61.6</td> <td>62.6</td> <td>59.3</td> <td>58.2</td> <td>65</td> </tr> </tbody> </table>						125	250	500	1k	2k	dB(A)	48.6	45.5	45.5	46.8	40.7	49	48.0	45.6	45.7	45.0	38.7	48	68.8	61.6	62.6	59.3	58.2	65						
125	250	500	1k	2k	dB(A)																														
48.6	45.5	45.5	46.8	40.7	49																														
48.0	45.6	45.7	45.0	38.7	48																														
68.8	61.6	62.6	59.3	58.2	65																														
<table border="1" style="width: 100%; border-collapse: collapse; margin-top: 10px;"> <thead> <tr> <th colspan="5" style="text-align: center;">Room Coefficient</th> <th></th> </tr> </thead> <tbody> <tr> <td style="text-align: center;">9</td> <td style="text-align: center;">9</td> <td style="text-align: center;">10</td> <td style="text-align: center;">10</td> <td style="text-align: center;">10</td> <td style="text-align: center;">A</td> </tr> <tr> <td style="text-align: center;">0.7</td> <td style="text-align: center;">0.7</td> <td style="text-align: center;">0.6</td> <td style="text-align: center;">0.6</td> <td style="text-align: center;">0.6</td> <td style="text-align: center;">RT</td> </tr> </tbody> </table>						Room Coefficient						9	9	10	10	10	A	0.7	0.7	0.6	0.6	0.6	RT												
Room Coefficient																																			
9	9	10	10	10	A																														
0.7	0.7	0.6	0.6	0.6	RT																														
<table border="1" style="width: 100%; border-collapse: collapse; margin-top: 10px;"> <thead> <tr> <th colspan="5" style="text-align: center;">SRI (Sound Reduction Index)</th> <th>Rw</th> </tr> </thead> <tbody> <tr> <td style="text-align: center;">31</td> <td style="text-align: center;">46</td> <td style="text-align: center;">43</td> <td style="text-align: center;">49</td> <td style="text-align: center;">56</td> <td style="text-align: center;">49(44)</td> </tr> <tr> <td style="text-align: center;">0</td> <td style="text-align: center;">N/A</td> </tr> <tr> <td style="text-align: center;">24</td> <td style="text-align: center;">18</td> <td style="text-align: center;">26</td> <td style="text-align: center;">40</td> <td style="text-align: center;">45</td> <td style="text-align: center;">30(26)</td> </tr> <tr> <td style="text-align: center;">38.4</td> <td style="text-align: center;">36.8</td> <td style="text-align: center;">33.8</td> <td style="text-align: center;">29.7</td> <td style="text-align: center;">33.8</td> <td style="text-align: center;">32</td> </tr> </tbody> </table>						SRI (Sound Reduction Index)					Rw	31	46	43	49	56	49(44)	0	0	0	0	0	N/A	24	18	26	40	45	30(26)	38.4	36.8	33.8	29.7	33.8	32
SRI (Sound Reduction Index)					Rw																														
31	46	43	49	56	49(44)																														
0	0	0	0	0	N/A																														
24	18	26	40	45	30(26)																														
38.4	36.8	33.8	29.7	33.8	32																														
<table border="1" style="width: 100%; border-collapse: collapse; margin-top: 10px;"> <thead> <tr> <th>125</th> <th>250</th> <th>500</th> <th>1k</th> <th>2k</th> <th>dB(A)</th> </tr> </thead> <tbody> <tr> <td style="text-align: center;">9.3</td> <td style="text-align: center;">18.7</td> <td style="text-align: center;">17.0</td> <td style="text-align: center;">19.4</td> <td style="text-align: center;">10.5</td> <td style="text-align: center;">23.7</td> </tr> <tr> <td style="text-align: center;">8.7</td> <td style="text-align: center;">18.8</td> <td style="text-align: center;">17.2</td> <td style="text-align: center;">17.6</td> <td style="text-align: center;">8.5</td> <td style="text-align: center;">23.0</td> </tr> <tr> <td style="text-align: center;">29.5</td> <td style="text-align: center;">34.8</td> <td style="text-align: center;">34.1</td> <td style="text-align: center;">31.9</td> <td style="text-align: center;">28.0</td> <td style="text-align: center;">39.4</td> </tr> </tbody> </table>						125	250	500	1k	2k	dB(A)	9.3	18.7	17.0	19.4	10.5	23.7	8.7	18.8	17.2	17.6	8.5	23.0	29.5	34.8	34.1	31.9	28.0	39.4						
125	250	500	1k	2k	dB(A)																														
9.3	18.7	17.0	19.4	10.5	23.7																														
8.7	18.8	17.2	17.6	8.5	23.0																														
29.5	34.8	34.1	31.9	28.0	39.4																														
Sound Insulation Requirement																																			
Minimum Sound Insulation Requirement																																			
Glazing	30(26)	dB R _{W(+Ctr)}	Suitable Systems <i>Double Glazing</i> <i>4 / 16 / 4</i>																																
Ventilation	32	D _{n,e,w+Ctr}	<i>Hit & Miss Trickle Vent (Open)</i> <i>Titon Trimvent XS13 4400EA</i>																																
<i>Suitable systems given as reference only. Other products that achieve the required sound insulation values are available.</i>																																			
<i>Calculations conducted in accordance with BS8233:2014 rigorous calculation method</i>																																			
$L_{eq,2} = L_{eq,ff} + 10 \log_{10} \left(\frac{A_0}{S} 10^{-\frac{D_{0,2}}{10}} + \frac{S_{wi}}{S} 10^{-\frac{R_{wi}}{10}} + \frac{S_{ew}}{S} 10^{-\frac{R_{ew}}{10}} + \frac{S_{tr}}{S} 10^{-\frac{R_{tr}}{10}} \right) + 10 \log_{10} \left(\frac{S}{A} \right) + 3$																																			

4. Semi - Kitchen Diner																																			
BS8233:2014 Façade Noise Break In Calculator																																			
Daytime External Noise Level - Leq - 1 hour																																			
Night-time External Noise Level - Leq - 1 hour																																			
Night-time Lmax Noise Levels																																			
Room Properties																																			
Width (m)	Height (m)	Depth (m)	Glazing	Reverb Time																															
3.2	2.4	5	1.21	0.6																															
Façade Construction																																			
Wall Construction	Brick and block, 75mm cavity, 60mm Fibreglass																																		
Roof Construction	Not Within Roof Space																																		
Glazing Spec	4 / 16 / 4																																		
Ventilation Spec	Hit & Miss Trickle Vent (Open)																																		
Calculation Results																																			
Daytime Internal Noise Level - LAeq		Target Value <	35																																
Night-time Internal Noise Level - LAeq		Target Value <																																	
Internal Lmax Noise Levels		Target Value <																																	
<table border="1" style="width: 100%; border-collapse: collapse; margin-top: 10px;"> <thead> <tr> <th>125</th> <th>250</th> <th>500</th> <th>1k</th> <th>2k</th> <th>dBA</th> </tr> </thead> <tbody> <tr> <td>48.6</td> <td>45.5</td> <td>45.5</td> <td>46.8</td> <td>40.7</td> <td>49</td> </tr> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>						125	250	500	1k	2k	dBA	48.6	45.5	45.5	46.8	40.7	49																		
125	250	500	1k	2k	dBA																														
48.6	45.5	45.5	46.8	40.7	49																														
<table border="1" style="width: 100%; border-collapse: collapse; margin-top: 10px;"> <thead> <tr> <th colspan="5" style="text-align: center;">Room Coefficient</th> <th></th> </tr> </thead> <tbody> <tr> <td>9</td> <td>9</td> <td>10</td> <td>10</td> <td>10</td> <td>A</td> </tr> <tr> <td>0.7</td> <td>0.7</td> <td>0.6</td> <td>0.6</td> <td>0.6</td> <td>RT</td> </tr> </tbody> </table>						Room Coefficient						9	9	10	10	10	A	0.7	0.7	0.6	0.6	0.6	RT												
Room Coefficient																																			
9	9	10	10	10	A																														
0.7	0.7	0.6	0.6	0.6	RT																														
<table border="1" style="width: 100%; border-collapse: collapse; margin-top: 10px;"> <thead> <tr> <th colspan="5" style="text-align: center;">SRI (Sound Reduction Index)</th> <th>Rw</th> </tr> </thead> <tbody> <tr> <td>31</td> <td>46</td> <td>43</td> <td>49</td> <td>56</td> <td>49(44)</td> </tr> <tr> <td>0</td> <td>0</td> <td>0</td> <td>0</td> <td>0</td> <td>N/A</td> </tr> <tr> <td>24</td> <td>18</td> <td>26</td> <td>40</td> <td>45</td> <td>30(26)</td> </tr> <tr> <td>38.4</td> <td>36.8</td> <td>33.8</td> <td>29.7</td> <td>33.8</td> <td>32</td> </tr> </tbody> </table>						SRI (Sound Reduction Index)					Rw	31	46	43	49	56	49(44)	0	0	0	0	0	N/A	24	18	26	40	45	30(26)	38.4	36.8	33.8	29.7	33.8	32
SRI (Sound Reduction Index)					Rw																														
31	46	43	49	56	49(44)																														
0	0	0	0	0	N/A																														
24	18	26	40	45	30(26)																														
38.4	36.8	33.8	29.7	33.8	32																														
<table border="1" style="width: 100%; border-collapse: collapse; margin-top: 10px;"> <thead> <tr> <th>125</th> <th>250</th> <th>500</th> <th>1k</th> <th>2k</th> <th>dBA</th> </tr> </thead> <tbody> <tr> <td>8.0</td> <td>13.8</td> <td>14.8</td> <td>20.8</td> <td>11.9</td> <td style="background-color: #e0ffe0;">22.9</td> </tr> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table>						125	250	500	1k	2k	dBA	8.0	13.8	14.8	20.8	11.9	22.9																		
125	250	500	1k	2k	dBA																														
8.0	13.8	14.8	20.8	11.9	22.9																														
Sound Insulation Requirement																																			
Minimum Sound Insulation Requirement																																			
Glazing	30(26)	dB $R_{W(+Ctr)}$	Suitable Systems <i>Double Glazing</i> 4 / 16 / 4																																
Ventilation	32	$D_{n,e,w+Ctr}$	<i>Hit & Miss Trickle Vent (Open)</i> <i>Titon Trimvent XS13 4400EA</i>																																
<i>Suitable systems given as reference only. Other products that achieve the required sound insulation values are available.</i>																																			
<p><i>Calculations conducted in accordance with BS8233:2014 rigorous calculation method</i></p> $L_{eq,2} = L_{eq,ff} + 10 \log_{10} \left(\frac{A_0}{S} 10^{-\frac{D_{0,2}}{10}} + \frac{S_{wi}}{S} 10^{-\frac{R_{wi}}{10}} + \frac{S_{ew}}{S} 10^{-\frac{R_{ew}}{10}} + \frac{S_{\alpha}}{S} 10^{-\frac{R_{\alpha}}{10}} \right) + 10 \log_{10} \left(\frac{S}{A} \right) + 3$																																			

5. Semi - Living Room					
BS8233:2014 Façade Noise Break In Calculator					
Daytime External Noise Level - Leq - 1 hour					
Night-time External Noise Level - Leq - 1 hour					
Night-time Lmax Noise Levels					
Room Properties					
Width (m)	Height (m)	Depth (m)	Glazing	Reverb Time	
4.3	2.4	4	5.06	0.6	
Façade Construction					
Wall Construction	Brick and block, 75mm cavity, 60mm Fibreglass				
Roof Construction	Not Within Roof Space				
Glazing Spec	4 / 16 / 4				
Ventilation Spec	Hit & Miss Trickle Vent (Open)				
Calculation Results					
Daytime Internal Noise Level - LAeq		Target Value <	35		
Night-time Internal Noise Level - LAeq		Target Value <			
Internal Lmax Noise Levels		Target Value <			
Sound Insulation Requirement					
Minimum Sound Insulation Requirement					
Glazing	30(26)	dB $R_{W(+Ctr)}$	Suitable Systems <i>Double Glazing</i> 4 / 16 / 4		
Ventilation	32	$D_{n,e,w+Ctr}$	Hit & Miss Trickle Vent (Open)		
<i>Suitable systems given as reference only. Other products that achieve the required sound insulation values are available.</i>					
$L_{eq,2} = L_{eq,ff} + 10 \log_{10} \left(\frac{A_0}{S} 10^{-\frac{D_{ext}}{10}} + \frac{S_{wi}}{S} 10^{-\frac{R_{wi}}{10}} + \frac{S_{ew}}{S} 10^{-\frac{R_{ew}}{10}} + \frac{S_{ar}}{S} 10^{-\frac{R_{ar}}{10}} \right) + 10 \log_{10} \left(\frac{S}{A} \right) + 3$					

125	250	500	1k	2k	dBA
48.6	45.5	45.5	46.8	40.7	49

Room Coefficient					
10	10	10	11	11	A
0.7	0.7	0.6	0.6	0.6	RT

SRI (Sound Reduction Index)					Rw
31	46	43	49	56	49(44)
0	0	0	0	0	N/A
24	18	26	40	45	30(26)
38.4	36.8	33.8	29.7	33.8	32

125	250	500	1k	2k	dBA
9.6	19.2	17.5	19.7	10.8	24.0


6. Semi - Bedroom 1

BS8233:2014 Façade Noise Break In Calculator					
Daytime External Noise Level - Leq - 1 hour					
Night-time External Noise Level - Leq - 1 hour					
Night-time Lmax Noise Levels					
Room Properties					
Width (m)	Height (m)	Depth (m)	Glazing	Reverb Time	
4.2	2.4	3.2	2.21	0.6	
Façade Construction					
Wall Construction	Brick and block, 75mm cavity, 60mm Fibreglass				
Roof Construction	Not Within Roof Space				
Glazing Spec	4 / 16 / 4				
Ventilation Spec	Hit & Miss Trickle Vent (Open)				
Calculation Results					
Daytime Internal Noise Level - LAeq	Target Value <	35			
Night-time Internal Noise Level - LAeq	Target Value <	30			
Internal Lmax Noise Levels	Target Value <	45			
Room Coefficient					
8	8	8	9	9	A
0.7	0.7	0.6	0.6	0.6	RT
SRI (Sound Reduction Index)					
31	46	43	49	56	49(44)
0	0	0	0	0	N/A
24	18	26	40	45	30(26)
38.4	36.8	33.8	29.7	33.8	32
SRI (Sound Reduction Index)					
125	250	500	1k	2k	dBA
8.3	16.6	15.6	19.5	10.6	22.8
7.7	16.7	15.8	17.7	8.6	22.0
28.5	32.7	32.7	32.0	28.1	38.3
Sound Insulation Requirement					
Minimum Sound Insulation Requirement					
Glazing	30(26)	dB R _{W(+Ctr)}	Suitable Systems <i>Double Glazing</i> <i>4 / 16 / 4</i>		
Ventilation	32	D _{n,e,w+Ctr}	Hit & Miss Trickle Vent (Open) <i>Titon Trimvent XS13 4400EA</i>		
<i>Suitable systems given as reference only. Other products that achieve the required sound insulation values are available.</i>					
$L_{eq,2} = L_{eq,ff} + 10 \log_{10} \left(\frac{A_0}{S} 10^{-\frac{D_{ext}}{10}} + \frac{S_{wi}}{S} 10^{-\frac{R_{wi}}{10}} + \frac{S_{ew}}{S} 10^{-\frac{R_{ew}}{10}} + \frac{S_{ar}}{S} 10^{-\frac{R_{ar}}{10}} \right) + 10 \log_{10} \left(\frac{S}{A} \right) + 3$					


7. Semi - Master Bedroom - Roof

BS8233:2014 Façade Noise Break In Calculator					
Daytime External Noise Level - Leq - 1 hour					
Night-time External Noise Level - Leq - 1 hour					
Night-time Lmax Noise Levels					
Room Properties					
Width (m)	Height (m)	Depth (m)	Glazing	Reverb Time	
4.3	2.4	6	2.44	0.7	
Façade Construction					
Wall Construction	Brick and block, 75mm cavity, 60mm Fibreglass				
Roof Construction	Tiled, pitched roof				
Glazing Spec	4 / 16 / 4				
Ventilation Spec	Hit & Miss Trickle Vent (Open)				
Calculation Results					
Daytime Internal Noise Level - LAeq	Target Value <	35			
Night-time Internal Noise Level - LAeq	Target Value <	30			
Internal Lmax Noise Levels	Target Value <	45			
Room Coefficient					
13	14	14	15	15	A
0.8	0.7	0.7	0.6	0.7	RT
SRI (Sound Reduction Index)					
31	46	43	49	56	49(44)
27	37	43	48	52	0
24	18	26	40	45	30(26)
38.4	36.8	33.8	29.7	33.8	32
Calculation Results					
125	250	500	1k	2k	dBA
12.9	15.3	15.2	20.0	11.3	23.0
12.3	15.4	15.4	18.2	9.3	22.1
33.1	31.4	32.3	32.5	28.8	38.8
Sound Insulation Requirement					
Minimum Sound Insulation Requirement					
Glazing	30(26)	dB R _{W(+Ctr)}	Suitable Systems <i>Double Glazing</i> <i>4 / 16 / 4</i>		
Ventilation	32	D _{n,e,w+Ctr}	Hit & Miss Trickle Vent (Open) <i>Titon Trimvent XS13 4400EA</i>		
<i>Suitable systems given as reference only. Other products that achieve the required sound insulation values are available.</i>					
$L_{eq,2} = L_{eq,ff} + 10 \log_{10} \left(\frac{A_0}{S} 10^{-\frac{D_{ext}}{10}} + \frac{S_{wi}}{S} 10^{-\frac{R_{wi}}{10}} + \frac{S_{ew}}{S} 10^{-\frac{R_{ew}}{10}} + \frac{S_{ar}}{S} 10^{-\frac{R_{ar}}{10}} \right) + 10 \log_{10} \left(\frac{S}{A} \right) + 3$					


APPENDIX G – Site Plans

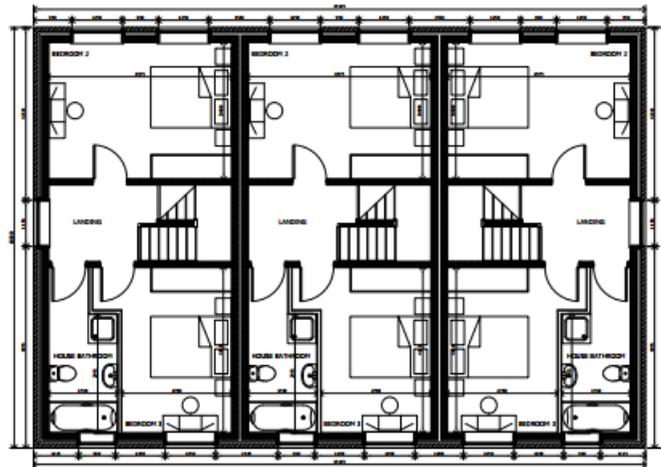

1. Proposed Second Floor Layout

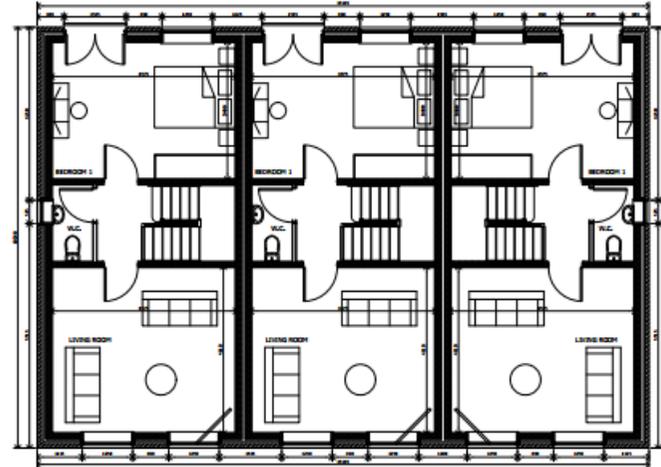

2. Proposed First Floor Layout

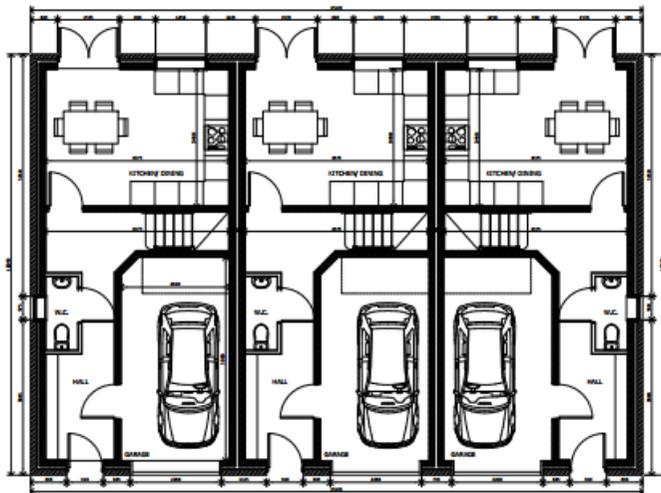


3. Proposed Ground Floor Layout



Draw My Extension Ltd
21A, Pavilion Lane, Huddersfield, HD3 3JZ
T: +44 (0)1484 303 3548
E: info@drawmyextension.co.uk
W: www.drawmyextension.co.uk


All work is to be carried out in accordance with the requirements of the Building Regulations and the current Building Regulations in force.
Do not scale from this drawing. Do it by reference to any dimensions.
Do not refer to dimensions on this drawing as they are not necessarily correct or representing their drawings.
The drawing is copyright.

REV	DATE	AUTHOR/CHKD




PROJECT
Proposed Development
Land at 1 & 1a Sparks Road
Huddersfield, HD3 4BX
DRAWING TITLE
Proposed Floor Plans
Townhouse Types - Plots 1, 2 & 3


PROJECT NO.	SCALE NO.	REVISION
22216	02	
STATUS	PLANNING SUBMISSION	
SCALE 0.4V 1:50	DATE Nov 22	DRAWN 08

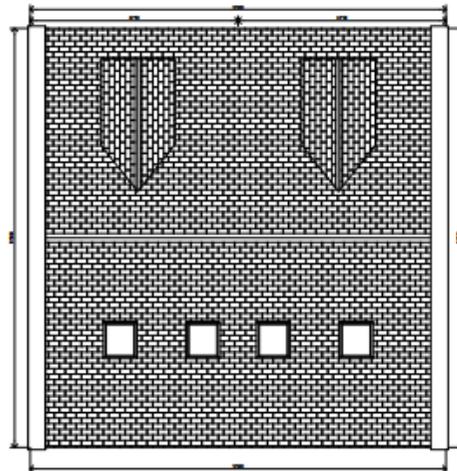


1. Proposed Roof Layout

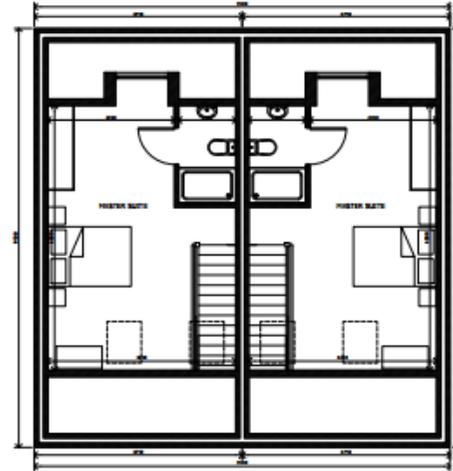

2. Proposed Second Floor Layout

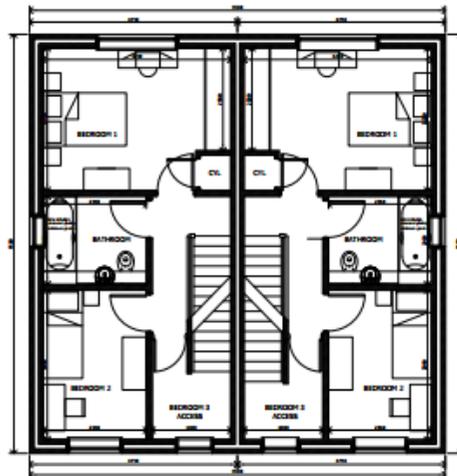

3. Proposed First Floor Layout

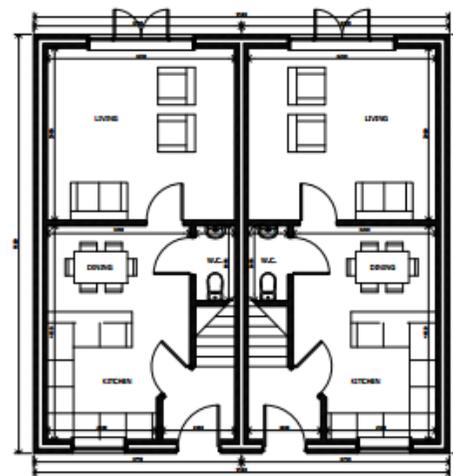

4. Proposed Ground Floor Layout



Draw Change Ltd
23.6 Premier Lane Industrial Estate,
Preston Lane, Huddersfield, HD3 7SL

T: +44 (0)1482 320 33 66
E: info@drawmyextension.co.uk
W: www.drawmyextension.co.uk

All work to be carried out in accordance with the requirements of the Building Regulations and the relevant Authority Regulations currently in force.
Do not scale from this drawing. Dotted to be indicated any dimensions.
Check relevant dimensions on site before commencing work or preparing shop drawings.
This drawing is copyright.

REV	DATE	AUTHOR/CHKD



PROJECT
Proposed Development
Land at 1 & 1a Sparks Road
Huddersfield, HD3 4BX
DRAWING TITLE
Proposed Dormer Type Plot 4 & 5
Floor Plans

PROJECT NO.	SHEET NO.	TOTAL SHEETS
22216	04	04
STATUS: PLANNING SUBMISSION		
SCALE: AS SHOWN	DWG NO: 04	DATE: 04/01/2023

APPENDIX H – Legislation, Policy and Guidance

Guidance for the assessment of noise affecting new residential development is given in the National Planning Policy Framework (NPPF). Section 15 of the NPPF states:

“174. Planning policies and decisions should contribute to and enhance the natural and local environment by:

e) preventing new and existing development from contributing to, being put at unacceptable risk from, or being adversely affected by, unacceptable levels of...noise pollution.”

Section 185 further states:

“Planning policies and decisions should also ensure that new development is appropriate for its location taking into account the likely effects (including cumulative effects) of pollution on health, living conditions and the natural environment, as well as the potential sensitivity of the site or the wider area to impacts that could arise from the development. In doing so they should:

A. Mitigate and reduce to a minimum potential adverse impact resulting from noise from new development – and avoid noise giving rise to significant adverse impacts on health and the quality of life;

B. Identify and protect tranquil areas which have remained relatively undisturbed by noise and are prized for their recreational and amenity value for this reason.”

Section 187 states:

“Planning policies and decisions should ensure that new development can be integrated effectively with existing businesses and community facilities (such as places of worship, pubs, music venues and sports clubs). Existing businesses and facilities should not have unreasonable restrictions placed on them as a result of development permitted after they were established. Where the operation of an existing business or community facility could have a significant adverse effect on new development (including changes of use) in its vicinity, the applicant (or ‘agent of change’) should be required to provide suitable mitigation before the development has been completed.”

To avoid and mitigate adverse noise effects on health arising from and impacting on new development, the NPPF makes reference to NPSE. The Noise Policy Statement for England (NPSE) was published in March 2010 and covers all forms of noise other than occupational noise.

The Noise Policy Statement for England (NPSE) states the following aims in paragraph 2.2.

NOEL – No Observed Effect Level.

This is the level below which no effect can be detected. In simple terms, below this level, there is no detectable effect on health and quality of life due to the noise.

LOAEL – Lowest Observed Adverse Effect Level.

This is the level above which adverse effects on health and quality of life can be detected.

SOAEL – Significant Observed Adverse Effect Level.

This is the level above which significant adverse effects on health and quality of life occur.

The NPSE does not define the SOAEL numerically, stating in paragraph 2.22:

“It is not possible to have a single objective noise-based measure that defines SOAEL that is applicable to all sources of noise in all situations. Consequently, the SOAEL is likely to be different for different noise sources, for different receptors and at different times. It is acknowledged that further research is required to increase our understanding of what may constitute a significant adverse impact on health and quality of life from noise. However, not having specific SOAEL values in the “NPSE provides the necessary policy flexibility until further evidence and suitable guidance is available.”

There is no local or national guidance on how the three terms should be defined numerically, it is for the assessor to collate and interpret appropriate guidance on noise, such as may be found in British Standards, and correlate the guidance with the concepts of NOEL, LOAEL and SOAEL.

BS8233:2014 - *Guidance on sound insulation and noise reduction for buildings* suggests indoor ambient noise levels for dwellings in Table 4, Section 7.7.2. These are summarised below.

Activity	Location	07:00 to 23:00	23:00 to 07:00
Resting	Living Room	35 dB L _{Aeq,16hour}	-
Dining	Dining room/area	40 dB L _{Aeq,16hour}	-
Sleeping	Bedroom	35 dB L _{Aeq,16hour}	30 dB L _{Aeq,8hour}

BS8233 states that the guideline values given above are for ‘noise without character’, further stating:

“Noise has a specific character if it contains features such as a distinguishable, discrete and continuous tone, is irregular enough to attract attention, or has strong low-frequency content, in which case lower noise limits might be appropriate.”

Table 4 of BS8233 also has accompanying notes that were subject to additions in ProPG. The relevant notes with the additions of ProPG are given below.

“NOTE 4 Regular individual noise events (for example, scheduled aircraft or passing trains) can cause sleep disturbance. A guideline value may be set in terms of SEL or L_{Amax,F}, depending on the character and number of events per night. Sporadic noise events could require separate values. In most circumstances in noise sensitive rooms at night (e.g. bedrooms) good acoustic design can be used so that individual noise events do not normally exceed 45dB L_{Amax,F} more than 10 times a night. However, where it is not reasonably practicable to achieve this guideline then the judgement of acceptability will depend not only on the maximum noise levels but also on factors such as the source, number, distribution, predictability and regularity of noise events.”

“NOTE 7 Where development is considered necessary or desirable, despite external noise levels above WHO guidelines, the internal LAeq target levels may be relaxed by up to 5 dB and reasonable internal conditions still achieved.”

APPENDIX I – Acoustic Terminology

To aid the understanding of acoustic terminology and the relative difference between noise levels the following background information is provided.

We perceive sound when the ear detects fluctuations in air pressure (sound waves), which are then processed by the brain and perceived as sound. Humans can hear an incredibly wide range of sound intensities ranging from jet engines to fingertips lightly brushing against each other. This range is quantified using a logarithmic scale called the decibel scale (dB). The comfortable range of the decibel scale typically ranges from 0dB (the threshold of hearing) to around 140dB. Here are some examples of common environments and their typical noise levels.

Noise Level	Environment
0 dB(A)	Threshold of hearing
20 to 30 dB(A)	Quiet bedroom at night
30 to 40 dB(A)	Living room during the day
40 to 50 dB(A)	Typical office
50 to 60 dB(A)	Inside a moving car
60 to 70 dB(A)	Typical high street
100 to 110 dB(A)	Fire alarm at 1 meter away
140 dB(A)	Threshold of pain

Terminology

dB (decibel) – A unit used to quantify the pressure level of sound. Defined as 20 times the logarithm of the ratio between the root-mean-square pressure of a given sound field and a reference pressure level (2×10^{-5} Pa – threshold of hearing).

$L_{Aeq, T}$ – The equivalent continuous sound pressure level over a stated period. It quantifies a fluctuating sound level over a given period as the equivalent continuous sound level over which the same amount of acoustic energy is contained over. This is A-weighted in order to assess human perception.

L_{Amax} – the maximum RMS A-weighted sound pressure level occurring within a specified time period; the time weighting is typically either Fast or Slow.

A-Weighting – A standard weighting of the audible frequencies designed to reflect the response of the human ear to noise.

R_w – The Weighted Sound Reduction Index (R_w) is a number used to rate the effectiveness of a soundproofing system or material.

$D_{n,e,w}$ – The Weighted Sound Reduction Index specifically for ventilators.

C_{tr} – C_{tr} is a spectrum adaptation term which method is defined in BS EN ISO 717. The standard uses a reference curve to determine the weighted value of airborne sound insulation. The spectrum adaptation terms C and C_{tr} may be used to take into account different source spectra. ' C_{tr} ' is the A-weighted urban traffic noise spectrum.