






**1 Substation - North Elevation**  
1 : 25

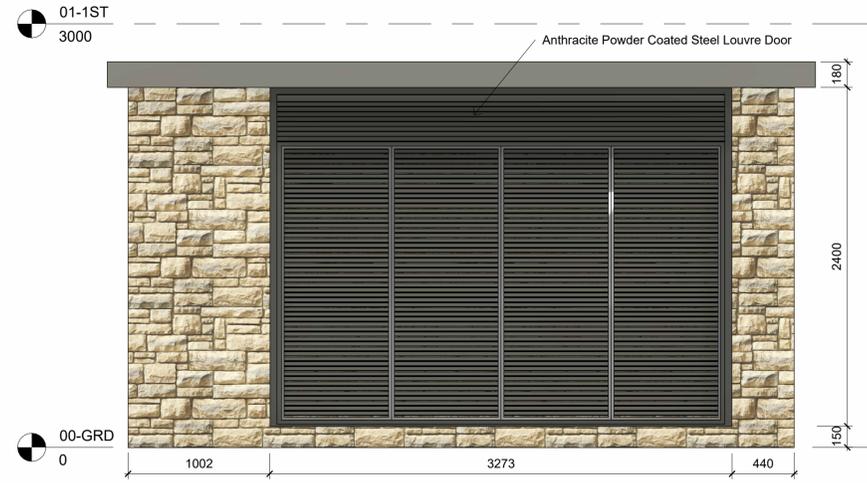


**2 Substation - East Elevation**  
1 : 25

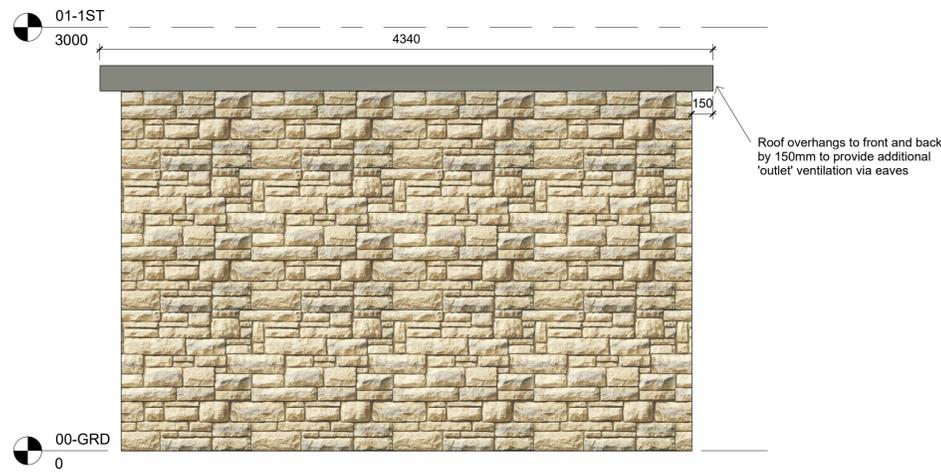

**3 Substation - South Elevation**  
1 : 25

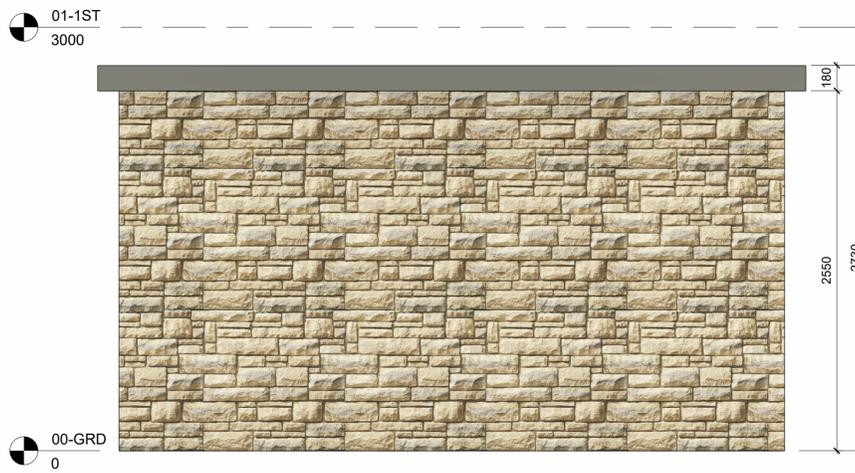

**4 Substation - West Elevation**  
1 : 25

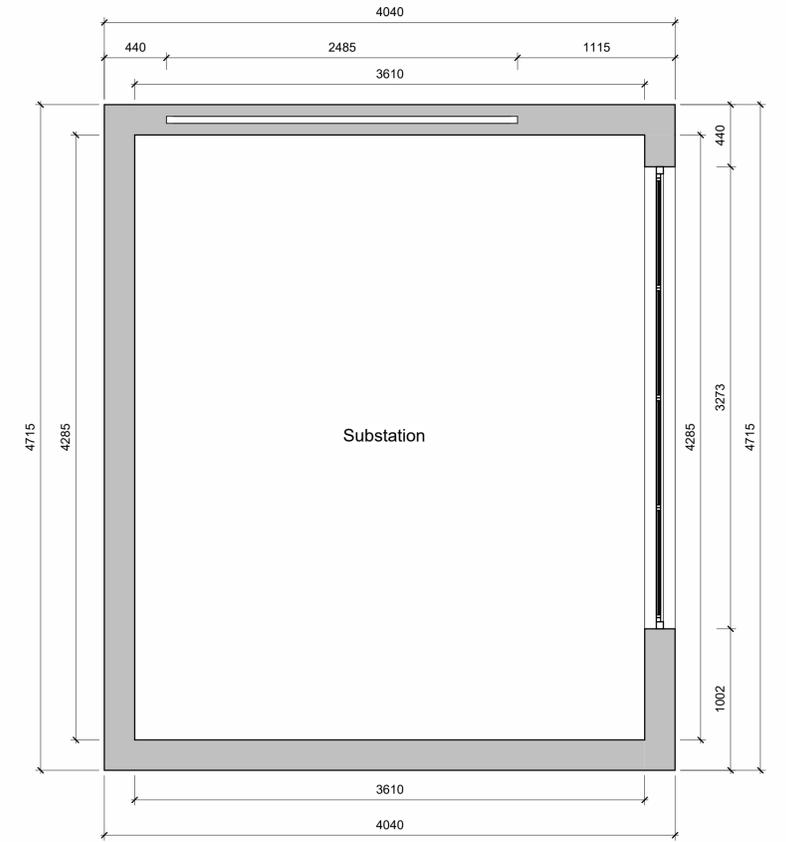

**5 Substation**  
1 : 25

**NOTE:**  
Min. of 500mm clear hardstanding required around whole of enclosure in order to maintain ventilation  
Sufficient clearance required to allow both doors to open through 90 ° without being impeded. Doors in open position must not encroach over public footpath

**COPYRIGHT**  
All rights in this work are reserved. No part of this work may be reproduced, stored or transmitted in any form or by any means including without limitation by photocopying or placing on a website without the prior permission in writing of ADG except in accordance with the provisions of the Copyright, Designs and Patents Act 1988.  
Applications for permission to reproduce any part of this work should be addressed to ADG Architects at info@adgarchitects.co.uk

**AREA CALCULATIONS**  
The areas shown are approximate only and have been measured off preliminary drawings as the likely areas at the current state of design using the stated option from the Code of Measuring Practice, 6th edition. These may be affected by future design development and construction tolerances, or the result of surveys for existing buildings. Take account of these factors before planning any financial or property development purpose or strategy and seek confirmation of latest areas before decision making.

Rev	Date	Revision Description	Issued by

Client  
Muller Property Group

Project  
Proposed Care Home  
Development, 21 Thomas Street,  
Lindley, Huddersfield, HD3 3JJ

Job Number  
H.21.81



Drawing Title  
Proposed Substation Details

Drawing Issue  
PLANNING

Drawing Number A1 Scale  
(02) 01 1 : 25