
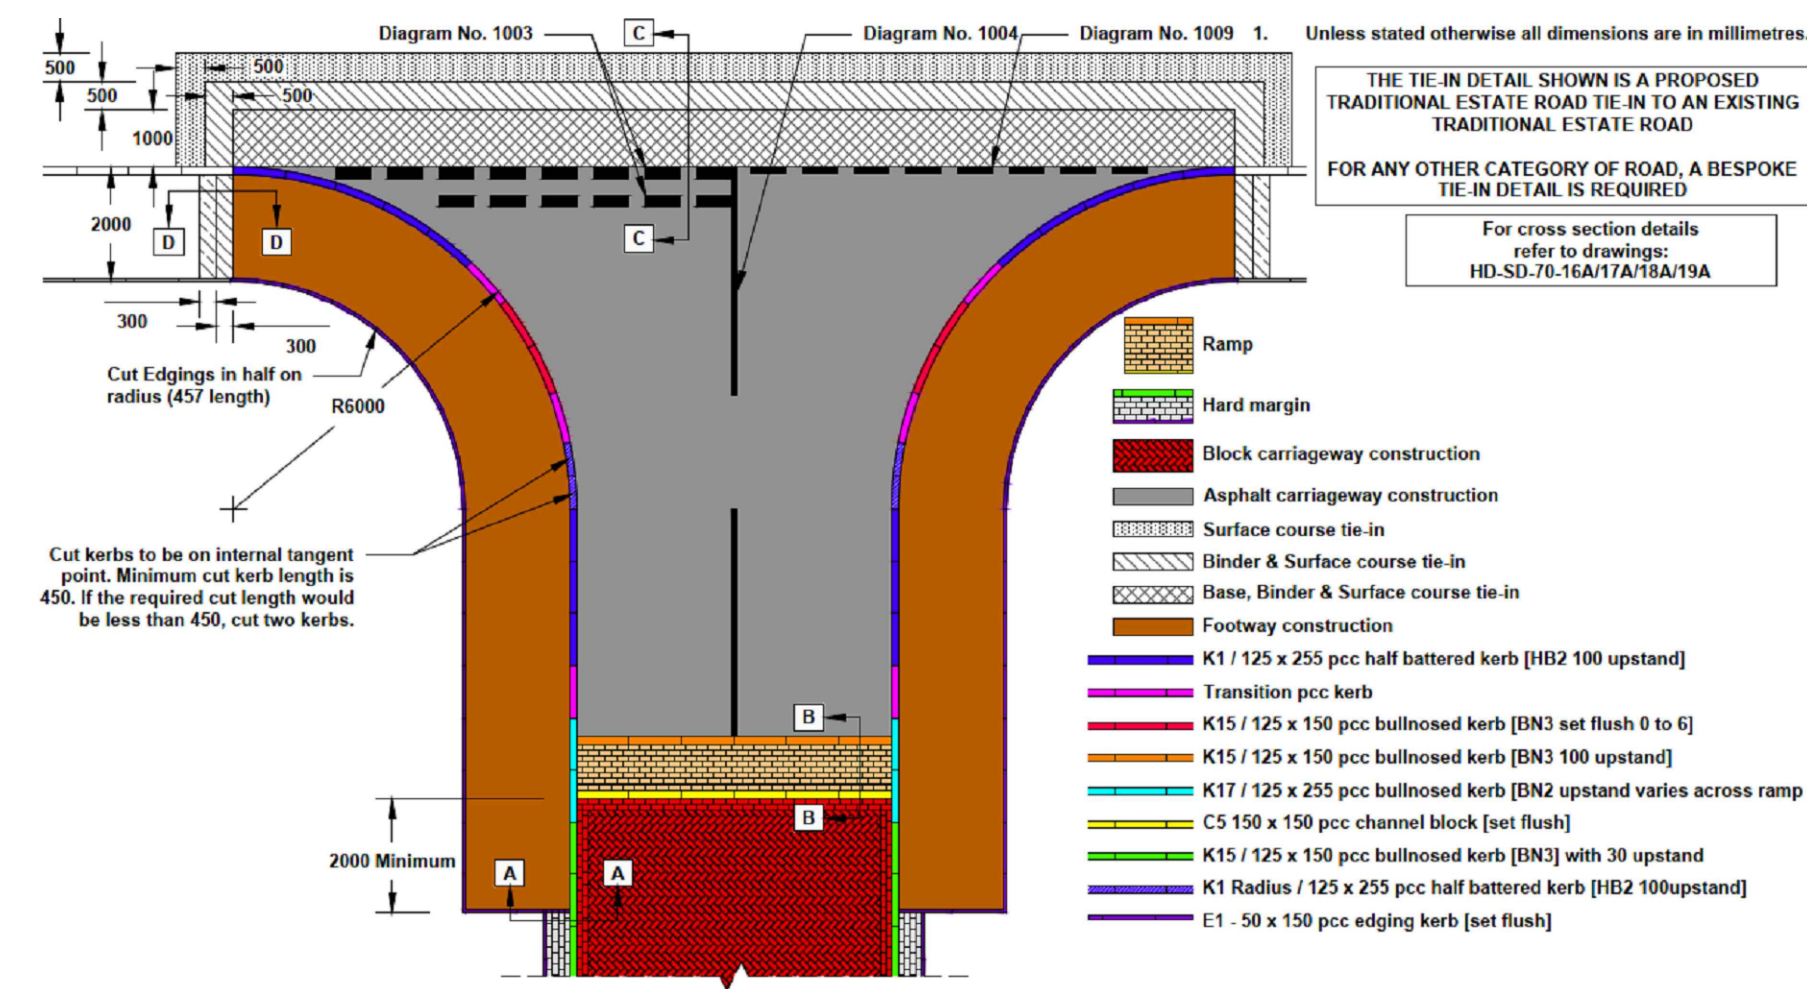

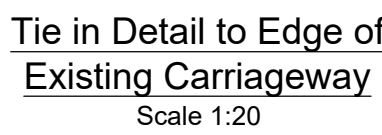



PIPE NOMINAL BORE (DN)	MAX. PARTICLE SIZE (mm)	CLASS OF BEDDING	SUITABLE IMPORTED GRANULAR MATERIALS
100 dia	10	S	10mm NOMINAL SINGLE-SIZED OR 10mm TO 5mm GRADED.
OVER 100 TO 150 dia	15	S	max 14mm NOMINAL SINGLE-SIZED OR 14mm TO 5mm GRADED.
OVER 150 TO 600dia	20	S	max 20mm NOMINAL SINGLE -SIZED OR 20mm TO 5mm GRADED.
OVER 600	40	S	max 40mm NOMINAL SINGLE-SIZED OR 40mm TO 5mm GRADED.

TABLE B.
CLASS 'S' PIPE BEDDING DETAIL

NOMINAL DIA OF PIPE (mm)	THICKNESS OF COMPRESSIBLE FILLER (mm)
LESS THAN 450	18
450-1200	36
EXCEEDING 1200	54



CONCRETE PIPE SURROUND DETAIL CLASS 'Z' BEDDING



MOVEMENT JOINT TO CONCRETE PIPE SURROUND

Health, Safety & Environmental Notes

NOTES

07.09.23	Updated according to Kirklees council comments	LM	AL	P4
03.08.23	Junction Detail Added to drawing	OCB	AL	P3
29.03.23	Details updated to suit Kirklees Council standard details	OCB	JS	P2
27.07.22	Initial Issue	RLP	JS	P1
Date	Description	By	Chk	Rev

ADEPT
CIVIL AND STRUCTURAL CONSULTING ENGINEERS

Web: www.adeptcsce.com Originating Office
Email: inbox@adeptcsce.com 1912 Mills, Sunny Bank Mills,
Tel: 0113 239 4518 (Leeds) Farsley, Leeds, LS28 5UJ
Tel: 0161 974 3620 (Manchester)

Project
Blue Hills Farm,
Birkenshaw

Title
S38
Highway Details - Sheet 2

Client **Vistry**
Partnerships

Scale @ A1	Initial author	Initial checker	Approver	Initial Date
N/A	RLP	JS	RP	May 22
Status	Purpose	Adept Ref		
S2	Preliminary	09.21011		
Project Number	Originator	Volume	Level	Type
09.21011-ACE-00-ZZ-DR-C-2081				
Role	Drg. No.	Rev.		
		P4		