



F54 - F55

GROUND LEVEL	170.089	169.249	169.922	168.828	170.295	170.822	170.850
FOULWATER COVER LEVEL	170.082						170.800
FOULWATER INVERT	168.480						167.878
FOULWATER DETAILS	Pipe 1.004 Dia 150 Circular PLASTIC 1 in 120						
FOULWATER LENGTHS	60.251						

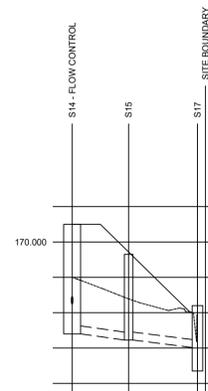

S14 - S17

GROUND LEVEL	169.800	168.259	
STORMWATER COVER LEVEL	170.500	169.650	168.200
STORMWATER INVERT	167.400	167.226	167.015
STORMWATER DETAILS	Pipe 1.012 Dia 225 Circular PLASTIC 1 in 46	Pipe 1.013 Dia 225 Circular PLASTIC 1 in 46	
STORMWATER LENGTHS	8.000	9.756	

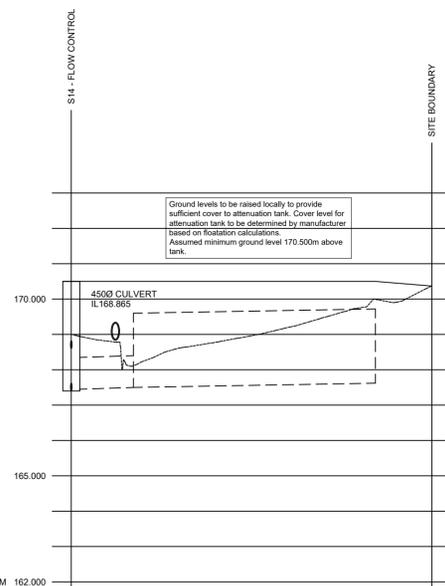

Attenuation Tank

GROUND LEVEL	169.800	168.226	168.762	169.103	169.723	170.267
STORMWATER COVER LEVEL	170.500	170.500				170.500
STORMWATER INVERT	167.500 167.450	167.500				167.500
STORMWATER DETAILS	Dia 900 Circular CONC 1 in 178	Attenuation Tank Dimensions: 34.0 x 11.5 x 2.1m Base Area: 391m² Volume: 780m³				
STORMWATER LENGTHS	8.800	34.000				

1. ALL ADAPTABLE SEWER WORKS AND MATERIAL TO BE IN ACCORDANCE WITH "CODES FOR ADOPTION", THE RELEVANT BRITISH/EUROPEAN AND YORKSHIRE WATER'S STANDARDS/REQUIREMENTS/ADDENDUM TO THE MECHANICAL AND ELECTRICAL SPECIFICATION AND KITEMARKED.
2. MANHOLE COVERS SHALL HAVE A CLEAR OPENING OF 600mm AND SHALL BE CLASS D400 TO BS EN 124 WITH 150mm DEEP FRAMES IN HIGHWAYS.
3. FILLED GROUND MUST BE FILLED AND CONSOLIDATED UNDER THE SUPERVISION AND TO THE SATISFACTION OF YORKSHIRE WATER BEFORE ANY SEWER WORKS ARE CARRIED OUT.
4. YORKSHIRE WATER IS NOT OBLIGED TO ACCEPT FILTER DRAIN/LAND DRAINAGE RUNOFF INTO THE PUBLIC SEWER NETWORK OR ADAPTABLE DRAINAGE SYSTEM (DIRECTLY OR INDIRECTLY). AN ALTERNATIVE METHOD OF DISPOSAL OF THE LAND DRAINAGE RUNOFF WILL THEREFORE BE REQUIRED AND YOU WILL HAVE TO LIAISE WITH THE LOCAL AUTHORITY. LAND DRAINAGE SECTION WITH REGARD TO THE DISPOSAL OF THE FILTER DRAIN/LAND DRAINAGE RUNOFF.
5. COVER SLABS MUST CARRY THE BS1 KITEMARK OR WILL BE REJECTED BY YORKSHIRE WATER INSPECTOR. WHERE THE CLEAR OPENING OF THE KITEMARKED PRODUCT IS DIFFERENT TO THAT OF THE COVER AND FRAME, A LOADING BEARING SLAB SHOULD BE FITTED ABOVE THE COVER SLAB TO BRING THE SIZE DOWN TO 600x600mm FOR THE YORKSHIRE WATER SPECIFIED COVER SIZE. PLEASE REFER TO CONCRETE PIPE SYSTEMS ASSOCIATION (CPSA), 'TECHNICAL BULLETIN' ISSUED AUTUMN 2004 FOR KITEMARKED COVER SLAB OPENING SIZES.
6. SULPHATE RESISTANT CEMENT (C20-DC2) AND PRECAST CONCRETE PRODUCTS MUST BE USED OR A LABORATORY REPORT PROVIDED PROVING THAT SUCH PRECAUTIONS ARE NOT NECESSARY.
7. THE ADAPTABLE SEWERS SHOULD BE A MINIMUM OF 1m AND MANHOLES 0.5m FROM KERB FACES AND MARGINS.
8. SEWERS MUST HAVE 5m CLEARANCE FROM TREES AND HEDGES (PLEASE ALSO REFER TO FIGURE 2.3 ON PAGE 33 IN "CODES FOR ADOPTION" FOR RESTRICTION ON TREE PLANTING ADJACENT TO SEWERS).
9. SEWERS TO BE LAID IN CLASS 'S' BEDDING (150mm GRANULAR BED AND SURROUND), WHERE DEPTH OF COVER TO TOP OF THE SEWER IS LESS THAN 1.2m IN HIGHWAYS AND VERGES (OR LESS THAN 900mm IN NONE VEHICULAR ACCESS AREAS) THEN A CONCRETE SLAB OVER SEWER SHALL BE PROVIDED ABOVE GRANULAR BED AND SURROUND.
10. BEDDING AND BACKFILL MATERIAL TO CONFORM TO THE REQUIREMENT OF WATER INDUSTRY SPECIFICATION 4-08-02 (TABLE A2).
11. THE CHAMBER SIZE OF MANHOLES WITH MORE THAN ONE CONNECTION IN THEM MAY NEED TO BE INCREASED AN INCREMENT TO ACCOMMODATE THE CONNECTIONS AND BENDS.
12. YORKSHIRE WATER POLICY IS NOT TO ACCEPT TYPE 'C' BRICK MANHOLES AND 1050mm DIAM. MANHOLE RINGS. INSTEAD IT IS PREFERRED THAT YOU USE A TYPE 'B' MANHOLE WITH 1200mm DIAM. OR 1500mm DIAM. RINGS, WITH THE OPENING SIGHTED OVER THE CHANNEL WHERE DEPTH OF COVER TO PIPE SOFFIT IS 1-1.5m.
13. ADAPTABLE PLASTIC SEWER PIPES TO BE BS1 KITEMARKED (CERTIFIED TO WIS 4-35-01 AND BS EN 13476). ADAPTABLE PLASTIC SEWER PIPES TO BE LAID IN MAXIMUM 3 METRE LENGTHS UNLESS THERE IS A SPECIFIC OPERATIONAL NEED TO LAY LONGER LENGTHS. PLASTIC CHANNEL SECTIONS IN MANHOLES ARE NOT ACCEPTABLE AND YORKSHIRE WATER WOULD PREFER CLAYWARE CHANNELS IN MANHOLES. WE HAVE FOUND THAT PLASTIC CHANNELS ARE DIFFICULT TO SET IN CONCRETE BECAUSE THEY FLOAT AND A SATISFACTORY FINISHED CANNOT BE OBTAINED ON THE BENCHING.
14. THE MINIMUM CRUSHING STRENGTH FOR CLAY PIPES SHOULD BE AS FOLLOWS: 100mm DIA. 40KN/m, 150mm DIA. 48KN/m, 225mm DIA. 45KN/m AND 300mm DIA. 72KN/m. THE MINIMUM CRUSHING STRENGTH FOR CONCRETE PIPES SHOULD BE CLASS 120 (54KN/m) TO EN 1916/BS5911-1:2002. PLASTIC PIPES SHOULD CONFORM TO WIS 4-35-01 AND BS EN 13476.
15. WHERE A B125 COVER AND FRAME HAS BEEN APPROVED, THIS MUST NOT BE COATED IN PLASTIC AND MUST HAVE LIFTING EYES SUIABLY SIZED TO ACCOMMODATE STANDARD LIFTING KEYS. SCREW DOWN COVERS ARE NOT ACCEPTABLE.
16. ALL HIGHWAY WORKS AND MATERIAL TO CONFORM WITH KIRKLEES MDC SPECIFICATION.
17. GULLY COVER AND FRAMES SHALL BE D400 DUCTILE IRON AND COMPLY WITH EUROPEAN STANDARD BS EN 124. THOSE SIGHTED IN ACCESSWAYS AND MEWS COURTS MUST BE SUITABLE FOR USE IN PEDESTRIAN AREAS.

RISK ASSESSMENT	LEVEL OF RISK	SUGGESTED ACTION
DEEP EXCAVATIONS ASSOCIATED WITH NEW DRAINAGE WORKS	HIGH	ENSURE ALL EXCAVATIONS HAVE ADEQUATE TRENCH SUPPORTS
HANDLING LARGE DIAMETER MANHOLE RINGS AND CIRCULAR PIPES	HIGH	USE CORRECT LIFTING EQUIPMENT AND ENSURE OPERATIVES WEAR APPROPRIATE PROTECTIVE CLOTHING/HARD HATS/SOCCER PPE
CONTACT WITH SEWAGE	MED	OPERATIVES TO USE CORRECT BREATHING EQUIPMENT/CORRECT PPE
NOISE	MED	OPERATIVES TO USE CORRECT EAR PROTECTION/CORRECT PPE
DRAINAGE EXCAVATIONS ADJACENT EXISTING BOUNDARY STRUCTURES	HIGH	ENSURE CORRECT SUPPORTS ARE PROVIDED TO TRENCHES AND BUILDINGS WHERE REQUIRED
DRAINAGE EXCAVATION IN PUBLIC HIGHWAY	HIGH	ENSURE CORRECT USE OF TRENCH SUPPORTS IN EXCAVATION AND SCREEN BARRIERS TO PROTECT MEMBERS OF THE PUBLIC
MAINTAIN ACCESS TO ADJACENT PROPERTIES AND OCCUPIERS	HIGH	ENSURE WORKS ARE PROTECTED WITH BARRIERS AND SIGNS TO GUIDE THE PUBLIC AWAY FROM THE WORKS
DRAINAGE EXCAVATIONS NEAR TO EXISTING SERVICES	HIGH	ENSURE WORKS ARE PROTECTED WITH BARRIERS AND SIGNS TO GUIDE MEMBERS OF THE PUBLIC AWAY FROM THE AREA
WORKING IN CONFINED SPACES, WORKING IN DRAINS AND MANHOLES	HIGH	CONFINED SPACES WORKING TRAINED PERSONNEL ONLY TO CARRY OUT WORKS UNDER A PERMIT TO WORK SCHEME. AIR MONITORED BY CONTRACTOR. GAS TESTING TO TAKE PLACE BEFORE ALL ENTRIES TO CONFINED SPACES.
WORKING IN HIGHWAYS / RISKS FROM VEHICLE AND PLANT	HIGH	ALL WORKS TO BE SIGNED AND FENCED FROM NORMAL VEHICULAR TRAFFIC. ALL WORKERS TO WEAR HIGH VISIBILITY CLOTHING. ALL PLANT TO HAVE VISUAL AND AUDIBLE WARNING SYSTEMS.
ROAD AND DRAINAGE CONSTRUCTION	HIGH	ALL EXCAVATIONS TO BE ADEQUATELY FENCED OFF AND SUPPORTED DURING CONSTRUCTION. ALL OPERATIVES TO BE TRAINED IN CORRECT METHODS OF LIFTING AND WORK IN ACCORDANCE WITH LOWER RISKS.
IT IS ASSUMED THAT WORKS ASSOCIATED WITH THIS DESIGN WILL BE UNDERTAKEN BY A PERSON OR PERSONS WHO ARE COMPETENT AND HAVE THE REQUIRED LEVEL OF EXPERIENCE AND EXPERTISE		

A	Culvert size amended to 450 Dia. Sewer design amended to suit amended culvert size.	16.01.23	JF
Rev	Description	Date	Initials

Haigh Huddleston & Associates  
Civil Structural Engineering Consultants

Firth Buildings, 99 - 101 Leeds Rd, Dewsbury, WF12 7BU t 01924 464342 f 01924 450662  
e martin@haighhuddleston.co.uk

Client	YORKSHIRE COUNTRY PROPERTIES		
Project	ABBEY ROAD, SHERLEY		
Detail	ROAD AND SEWER LONG-SECTIONS OPEN SPACE & OFFSITE		
Dwg No.	Client	Date	Scale
JM	MH	MAR'2022	1/500 @A1
Dwg No.	E17/7465/505_04A		