

DO NOT SCALE

SHORT PIPES AT CHAMBERS/ROCKER PIPES

NOT WITHSTANDING SPECIFIC REQUIREMENTS FOR INDIVIDUAL CHAMBER TYPES ALL PIPES LEADING TO AND FROM CHAMBERS MUST MEET THE REQUIREMENTS OF CLAUSE 5.19 OF CESWI.

MANHOLE CHAMBERS

ALL PIPES SHALL BE LAID SOFFIT TO SOFFIT UNLESS STATED OTHERWISE ON THE MANHOLE SCHEDULE. MANHOLES, SOAKWAYS & COVER SLABS TO BE BS EN 1917 AND BS 5911-3.

ALL OVERSIZED PRECAST CONCRETE MANHOLE CIRCULAR VERTICAL UNITS AND COVER SLABS INCLUDING ALL ANCYLLARY CONCRETE PRODUCTS ARE IN FULL COMPLIANCE WITH BS EN 1917 & BS 5911-3:41

DESIGN CHEMICAL CLASS (DC-CLASS) OF CONCRETE IN PRECAST CONCRETE MANHOLES, CIRCULAR VERTICAL UNITS AND COVER SLABS, INCLUDING ALL ANCYLLARY CONCRETE PRODUCTS SHOULD BE CONSTRUCTED FOR AN INTENDED WORKING LIFE OF 100 YEARS (MIN).

MANHOLE COVERS

ALL MANHOLE COVERS SHOULD BE BUILT IN ACCORDANCE WITH THE RELEVANT PROVISIONS OF BS EN 124 (KITEMARKED) AND BE BEDDED AND HAUNCHED IN MORTAR. ALL COVERS TO ADAPTABLE MANHOLES SHALL BE MARKED FW OR SW IF ON A FOUL OR SURFACE WATER SEWER RESPECTIVELY. THEY SHALL BE COATED WITH BLACK BITUMINOUS COMPOSITION IN ACCORDANCE WITH BS EN 124.

GROUP	COVER CLASS	USAGE (FIGURE 9a)	MIN. THICKNESS OF STEEL PROTECTION* (mm) (TABLE 3)
2	B125*	PEDESTRIANS AND CAR PARKING ZONES	3
4	D400*	AREAS FOR ALL TYPES OF ROAD VEHICLES	6

* ONLY B125 AND D400 MANHOLE COVER AND FRAMES ARE TO BE USED ON THE ADAPTABLE DRAINAGE NETWORK

* WITHOUT THE THICKNESS OF THE ADDITIONAL CORROSION PROTECTION.

TABLE AND FIGURE REFERENCE ARE TO BS EN 124.

WHERE THERE IS DOUBT AS TO WHICH COVER SHOULD BE USED, A STRONGER CLASS SHOULD BE SELECTED.

INFILL COVERS SHALL NOT BE USED. WHERE A COVER IS LOCATED IN BLOCK PAVING, THE FRAME SHALL BE 150 DEEP.

FRAMES FOR MANHOLES SHALL BE BEDDED IN POLYESTER RESIN BEDDING MORTAR IN NRSWA CATEGORIES I, II OR III.

JOINTS TO MANHOLE RINGS AND SLABS.

ALL MANHOLE RINGS AND SLABS SHALL BE JOINED WITH MORTAR, PROPRIETARY BITUMEN OR RESIN MASTIC SEALANT.

ALL MANHOLE FRAMES TO BE SET PARALLEL TO ADJACENT KERBS OR NEAREST BUILDINGS. MANHOLE COVERS AND FRAMES TO BE FLUSH WITH SURFACE ±5mm MAX.

CONCRETE PROTECTION TO PIPES

TO BE IN ACCORDANCE WITH CLAUSE 5.3 OF CESWI. AT THE DISCRETION OF THE ENGINEER, AWAY FROM CHAMBERS AND WHERE GROUND CONDITIONS PERMIT THE LENGTH OF UNINTERRUPTED CONCRETE PROTECTION MAY BE INCREASED TO 8m.

COMPRESSIBLE FILLER FOR PIPELINES.

TO BE USED TO INTERRUPT CONCRETE PROTECTION TO PIPELINES AND SHALL COMPLY WITH CLAUSE 2.19 OF CESWI.

TRENCH WIDTH

NOTE THE MAXIMUM TRENCH WIDTH MUST NOT BE EXCEEDED. IF THE WIDTH IS EXCEEDED THE CONTRACTOR MUST SUBMIT REVISED BEDDING PROPOSALS TO THE ENGINEER.

SOFT SPOTS AND OVERDIG

SOFT SPOTS SHALL BE REMOVED FROM THE BOTTOM OF THE TRENCH AND OTHER EXCAVATIONS AND THEN BE REFILLED TO FORMATION LEVEL WITH THE SAME MATERIAL AS THE PERMANENT WORK WHICH IS TO REST ON THAT FORMATION. OVERDIG SHALL BE TREATED IN THE SAME MANNER AT CONTRACTORS EXPENSE.

SUBJECT TO THE APPROVAL OF INDEPENDENT WATER NETWORKS LIMITED

NOTES

ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

ALL DRAINAGE WORKS SHALL BE CARRIED OUT IN ACCORDANCE WITH THE WATER SERVICES ASSOCIATION 'CODES FOR ADOPTION' AND INDEPENDENT WATER NETWORKS LTD'S 'SPECIFICATION' / SPECIAL REQUIREMENTS.

INSITU AND PRECAST CONCRETE UNITS SHALL HAVE SULPHATE RESISTING PORTLAND CEMENT TO BS 4027, UNLESS AGREED WITH THE ADOPTING AUTHORITY.

WHERE A B125 COVER AND FRAME HAS BEEN APPROVED, THIS MUST NOT BE COATED IN PLASTIC AND MUST HAVE LIFTING EYES SUITABLY SIZED TO ACCOMMODATE STANDARD LIFTING KEYS. SCREW DOWN COVERS ARE NOT ACCEPTABLE.

CONCRETE

FOR DESIGNED, DESIGNATED OR STANDARDISED PRESCRIBED CONCRETE REFER TO BS EN 206-1 AND BS 8500.

PIPES

CONCRETE PIPES TO BE TO BS EN 1916 & BS 5911-1, CLAYWARE PIPES TO BE TO BS EN 295.

THERMOPLASTICS STRUCTURED WALL PIPE SHALL COMPLY WITH THE RELEVANT PROVISIONS OF 'WIS 4-35-01'. PIPES SHALL BE BSI KITEMARKED OR HAVE EQUIVALENT THIRD PARTY CERTIFICATION. PIPES SHALL BE CLASS 8kN/m2 NOMINAL SHORT TERM RING STIFFNESS

BACKFILL TO TRENCHES - WITHIN HIGHWAYS

ALL TRENCHES SITUATED WITHIN HIGHWAYS OR PROSPECTIVE HIGHWAYS TO BE BACKFILLED IN ACCORDANCE WITH THE LOCAL HIGHWAY AUTHORITY REQUIREMENTS OR IF NONE AVAILABLE IN ACCORDANCE WITH WITH CLAUSE 3.6.4 OF CESWI, i.e. HAUC SPECIFICATION FOR THE REINSTATEMENT OF OPENINGS IN HIGHWAYS APPENDIX A1 CLASSES A,B,C,D.

BACKFILL TO TRENCHES - OUTSIDE HIGHWAYS BELOW HARD PAVED AREAS

BACKFILL TO BE SAME AS WITHIN HIGHWAYS

BACKFILL TO TRENCHES - SOFT AREAS

SIDEFILL TO COMPLY WITH SPECIFICATION FOR HIGHWAY WORKS CLASS 8.

BACKFILL TO COMPLY WITH SPECIFICATION FOR HIGHWAY WORKS CLASS 1, 2 OR 3

SEE BACKFILL TO TRENCHES BELOW HARD PAVED AREA


PIPE BEDDING AND FILL MATERIAL

UNLESS OTHERWISE STATED BEDDING TO ALL PIPES TO BE CLASS 'B'.

NOMINAL BORE OF PIPE (mm)	ALTERNATIVE AGGREGATE SIZES (mm)	
	SINGLE-SIZED	GRADED
150	10 or 14	14 to 5
200-300	10, 14 or 20	14 to 5 or 20 to 5
375-525	14 or 20	14 to 5 or 20 to 5
EXCEEDING 525	14, 20 or 40	14 to 5, 20 to 5 or 40 to 5

REFERENCE SHOULD BE MADE TO BS 882 TABLE 4.

SELECTED FILL TYPE 'B' SHALL COMPLY WITH CLAUSE 2.49 OF CESWI.

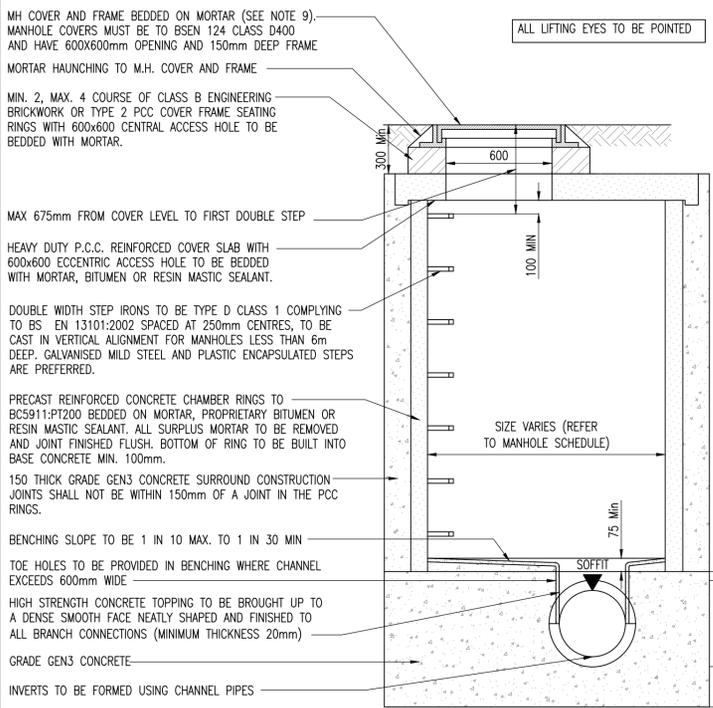


DIA. OF LARGEST PIPE IN M.H.	CHAMBER SECTION INT. DIA. (mm)
UP TO 300mm	1200
375 TO 450	1350
500 TO 700	1500
750 TO 900	1800
1000	2100

TABLE 1.1 APPLICABLE TO MANHOLE TYPES A AND B. CHAMBER SIZES ARE MINIMUM REQUIRED. SEE LAYOUT FOR ANY VARIATIONS.


TYPICAL MANHOLE DETAIL - TYPE B. MAX DEPTH TO SOFFIT OF PIPE 3.0m

TYPE B MANHOLE DETAILS MAY BE APPLIED TO TYPE A MANHOLES FOR CHAMBER DIAMETERS LESS THAN 1500mm UP TO 6.0m DEPTH TO SOFFIT.

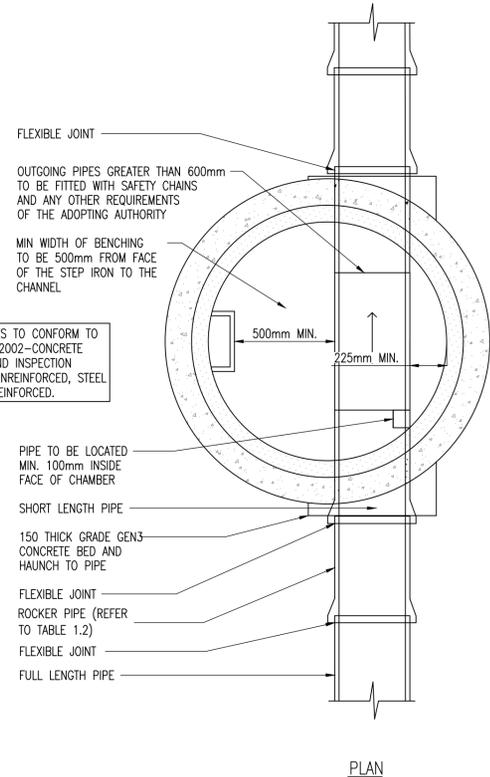


NOMINAL SIZE	EFFECTIVE LENGTH (mm)
150 TO 600	600
675 TO 675	1000
825 AND ABOVE	1250

SHORT AND ROCKER PIPE LENGTHS TABLE 1.2 APPLICABLE TO ALL MANHOLE TYPES

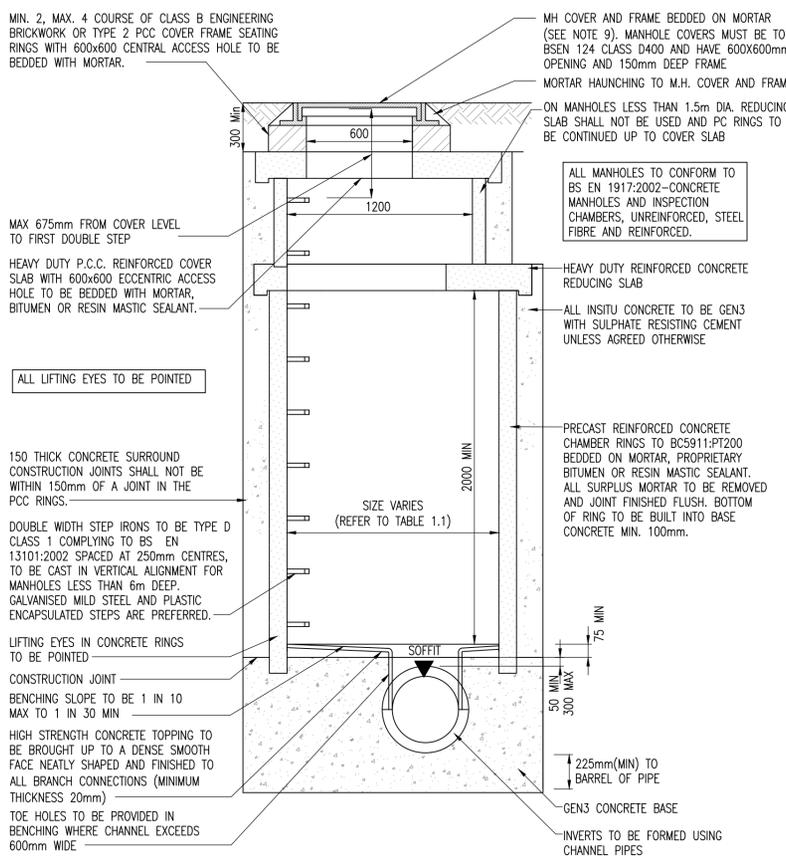


TYPICAL MANHOLE DETAIL - TYPE A. DEPTH TO SOFFIT OF PIPE 3000 TO 6000

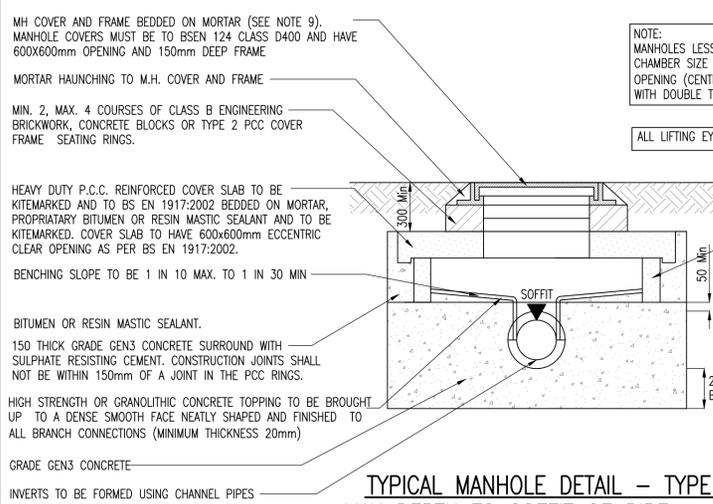


TYPICAL MANHOLE DETAIL - TYPE C. MAX DEPTH TO SOFFIT OF PIPE < 1.5m

NOTE: MANHOLES LESS THAN 1.5m TO SOFFIT WITH 1500mm Ø CHAMBER SIZE OR LARGER SHOULD HAVE A 1220x600mm OPENING (CENTRAL OR ECCENTRIC) SITED OVER CHANNEL WITH DOUBLE TWIN 600x600mm COVERS. ALL LIFTING EYES TO BE POINTED.

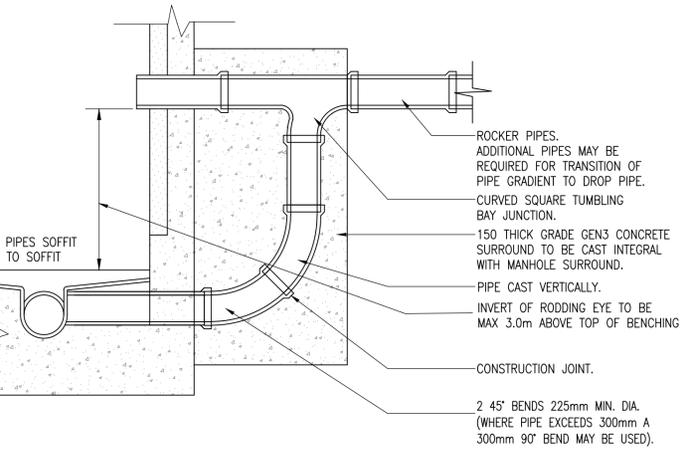


TYPICAL VERTICAL BACKDROP MANHOLE DETAIL (TO BE USED WHERE RAMPED BACKDROPS ARE NOT POSSIBLE)

(NOTE: CONSTRUCTION DETAILS AS STANDARD PPC MANHOLE.)

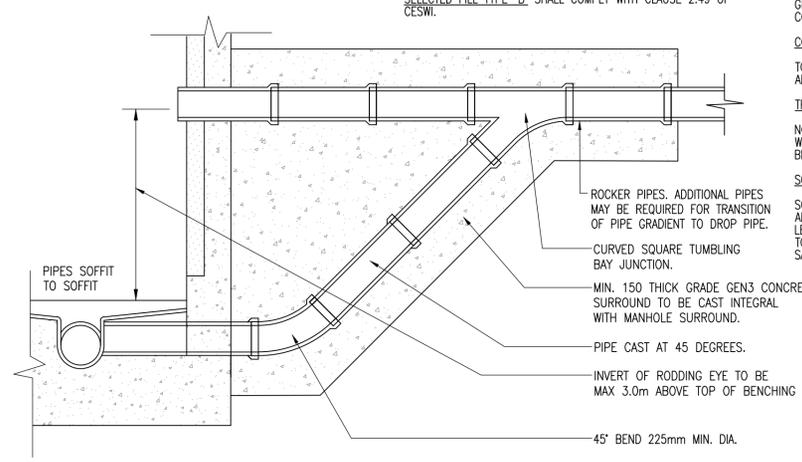


TYPICAL 45° BACKDROP DETAIL (TO BE USED WHERE POSSIBLE)

(NOTE: CONSTRUCTION DETAILS AS STANDARD PPC MANHOLE.)

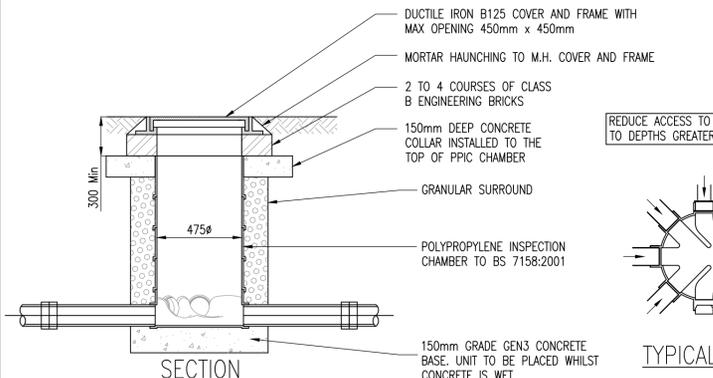

ADOPTABLE POLYPROPYLENE INSPECTION CHAMBER (PPIC) DEMARCATION CHAMBERS - MAX DEPTH 2.00m

(SCALE 1:20)

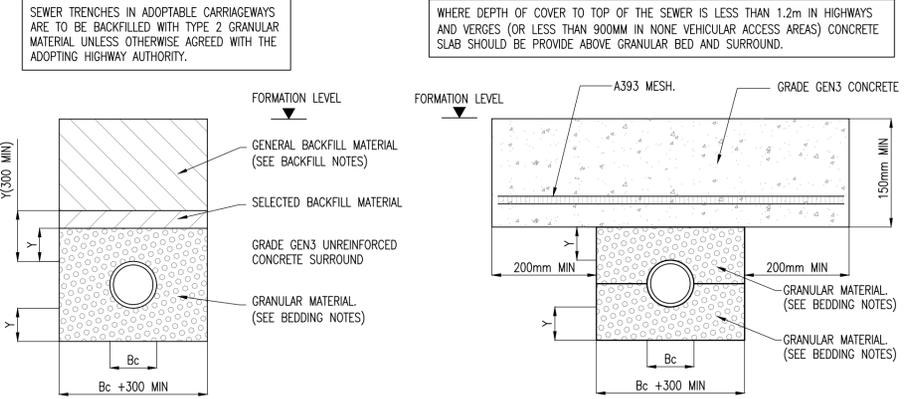

CLASS S DETAIL

RC SLAB OVER DETAIL

PIPE TRENCH BEDDING DETAILS

PIPE TRENCH BEDDING NOTES

A) Bc = OUTSIDE DIAMETER OF PIPE BARREL. B) Y = FOR UNIFORM SOILS: SLEEVE JOINTED PIPES, MIN. 50mm OR 1/6Bc, WHICHEVER IS THE GREATER. SOCKETED PIPE, MIN. 100mm OR 1/6Bc, WHICHEVER IS THE GREATER UNDER BARRELS AND NOT LESS THAN 50mm UNDER SOCKETS. FOR ROCK OR MIXED SOILS CONTAINING ROCK BANDS, BOULDERS, STONES OR OTHER IRREGULAR HARD SPOTS: SLEEVE JOINTED PIPES, MIN. 150mm OR 1/4Bc, WHICHEVER IS THE GREATER. SOCKETED PIPE, MIN. 200mm OR 1/4Bc, WHICHEVER IS THE GREATER UNDER BARRELS AND NOT LESS THAN 150mm UNDER SOCKETS.

NOMINAL PIPE DIA (mm)	THICKNESS OF COMPRESSIBLE FILLER (mm)	SUITABLE BACKFILL MATERIAL (REFER TO NOTES)
LESS THAN 450	18	SELECTED SIDEFILL AND SURROUND (REFER TO NOTES)
450 TO 1200	36	GRANULAR BEDDING MATERIAL. (REFER TO NOTES)
GREATER THAN 1200	54	GEN3 CONCRETE BED AND SURROUND (REFER TO NOTES)

COMPRESSIBLE FILLER TABLE (BITUMEN IMPREGNATED INSULATING BOARD TO BS 1142: PART 3)

C	JUL 23	ADNS	DRAWING REVISED FOLLOWING S38 COMMENTS RECEIVED 13 JUNE 2023.	MA
B	MAY 23	MA	CONNECTIONS GREYED FOR CLARITY.	MA
A	NOV 22	MA	PIPE BEDDING AMENDED FROM B TO S.	MA

Redrow House, Brunel Road, Wakefield 41 Industrial Estate, WF2 0XG
Tel: +44 (0)1924 822 566
www.redrow.co.uk

PROJECT:	BRADLEY VILLA FARM HUDDERSFIELD
TITLE:	STANDARD DRAINAGE DETAILS
SCALE @:	AS SHOWN
DESIGNED BY:	MA
APPROVED BY:	MA
DATE:	FEBRUARY 2022
PROJECT NO.:	4607
DRAWING NO.:	4607-16-06-109
REV.:	C

© Redrow plc or its group companies. All rights reserved.