


NOTES

1. DO NOT SCALE THIS DRAWING. ALL DIMENSIONS MUST BE CHECKED/ VERIFIED ON SITE. IF IN DOUBT ASK.
2. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTS, ENGINEERS AND SPECIALISTS DRAWINGS AND SPECIFICATIONS.
3. ANY DISCREPANCIES NOTED ON SITE ARE TO BE REPORTED TO THE ENGINEER IMMEDIATELY.
4. REFER TO DRAWING A3-UTL-DDG-XX-DR-D-501 and 502 FOR DRAINAGE LAYOUT.
5. REFER TO MANUFACTURER'S INSTALLATION GUIDANCE FOR ALL SPECIFIED PRODUCTS.
6. ALL WORKS TO COMPLY WITH BUILDING REGULATIONS GUIDANCE AND LABC TECHNICAL MANUAL
7. INSPECTION AND MAINTENANCE FREQUENCY: ALL PIPEWORK, SILT TRAPS, CATCHPITS, GULLIES, ATTENUATION TANKS AND PUMP CHAMBERS TO BE INSPECTED AND CLEARED OUT EVERY THREE MONTHS FOR THE FIRST NINE MONTHS. AFTER NINE MONTHS FREQUENCY TO BE EVERY SIX MONTHS. PUMP SETS TO BE INSPECTED AND MAINTAINED IN ACCORDANCE WITH THE MANUFACTURER/PUMP PROVIDER'S RECOMMENDATIONS.

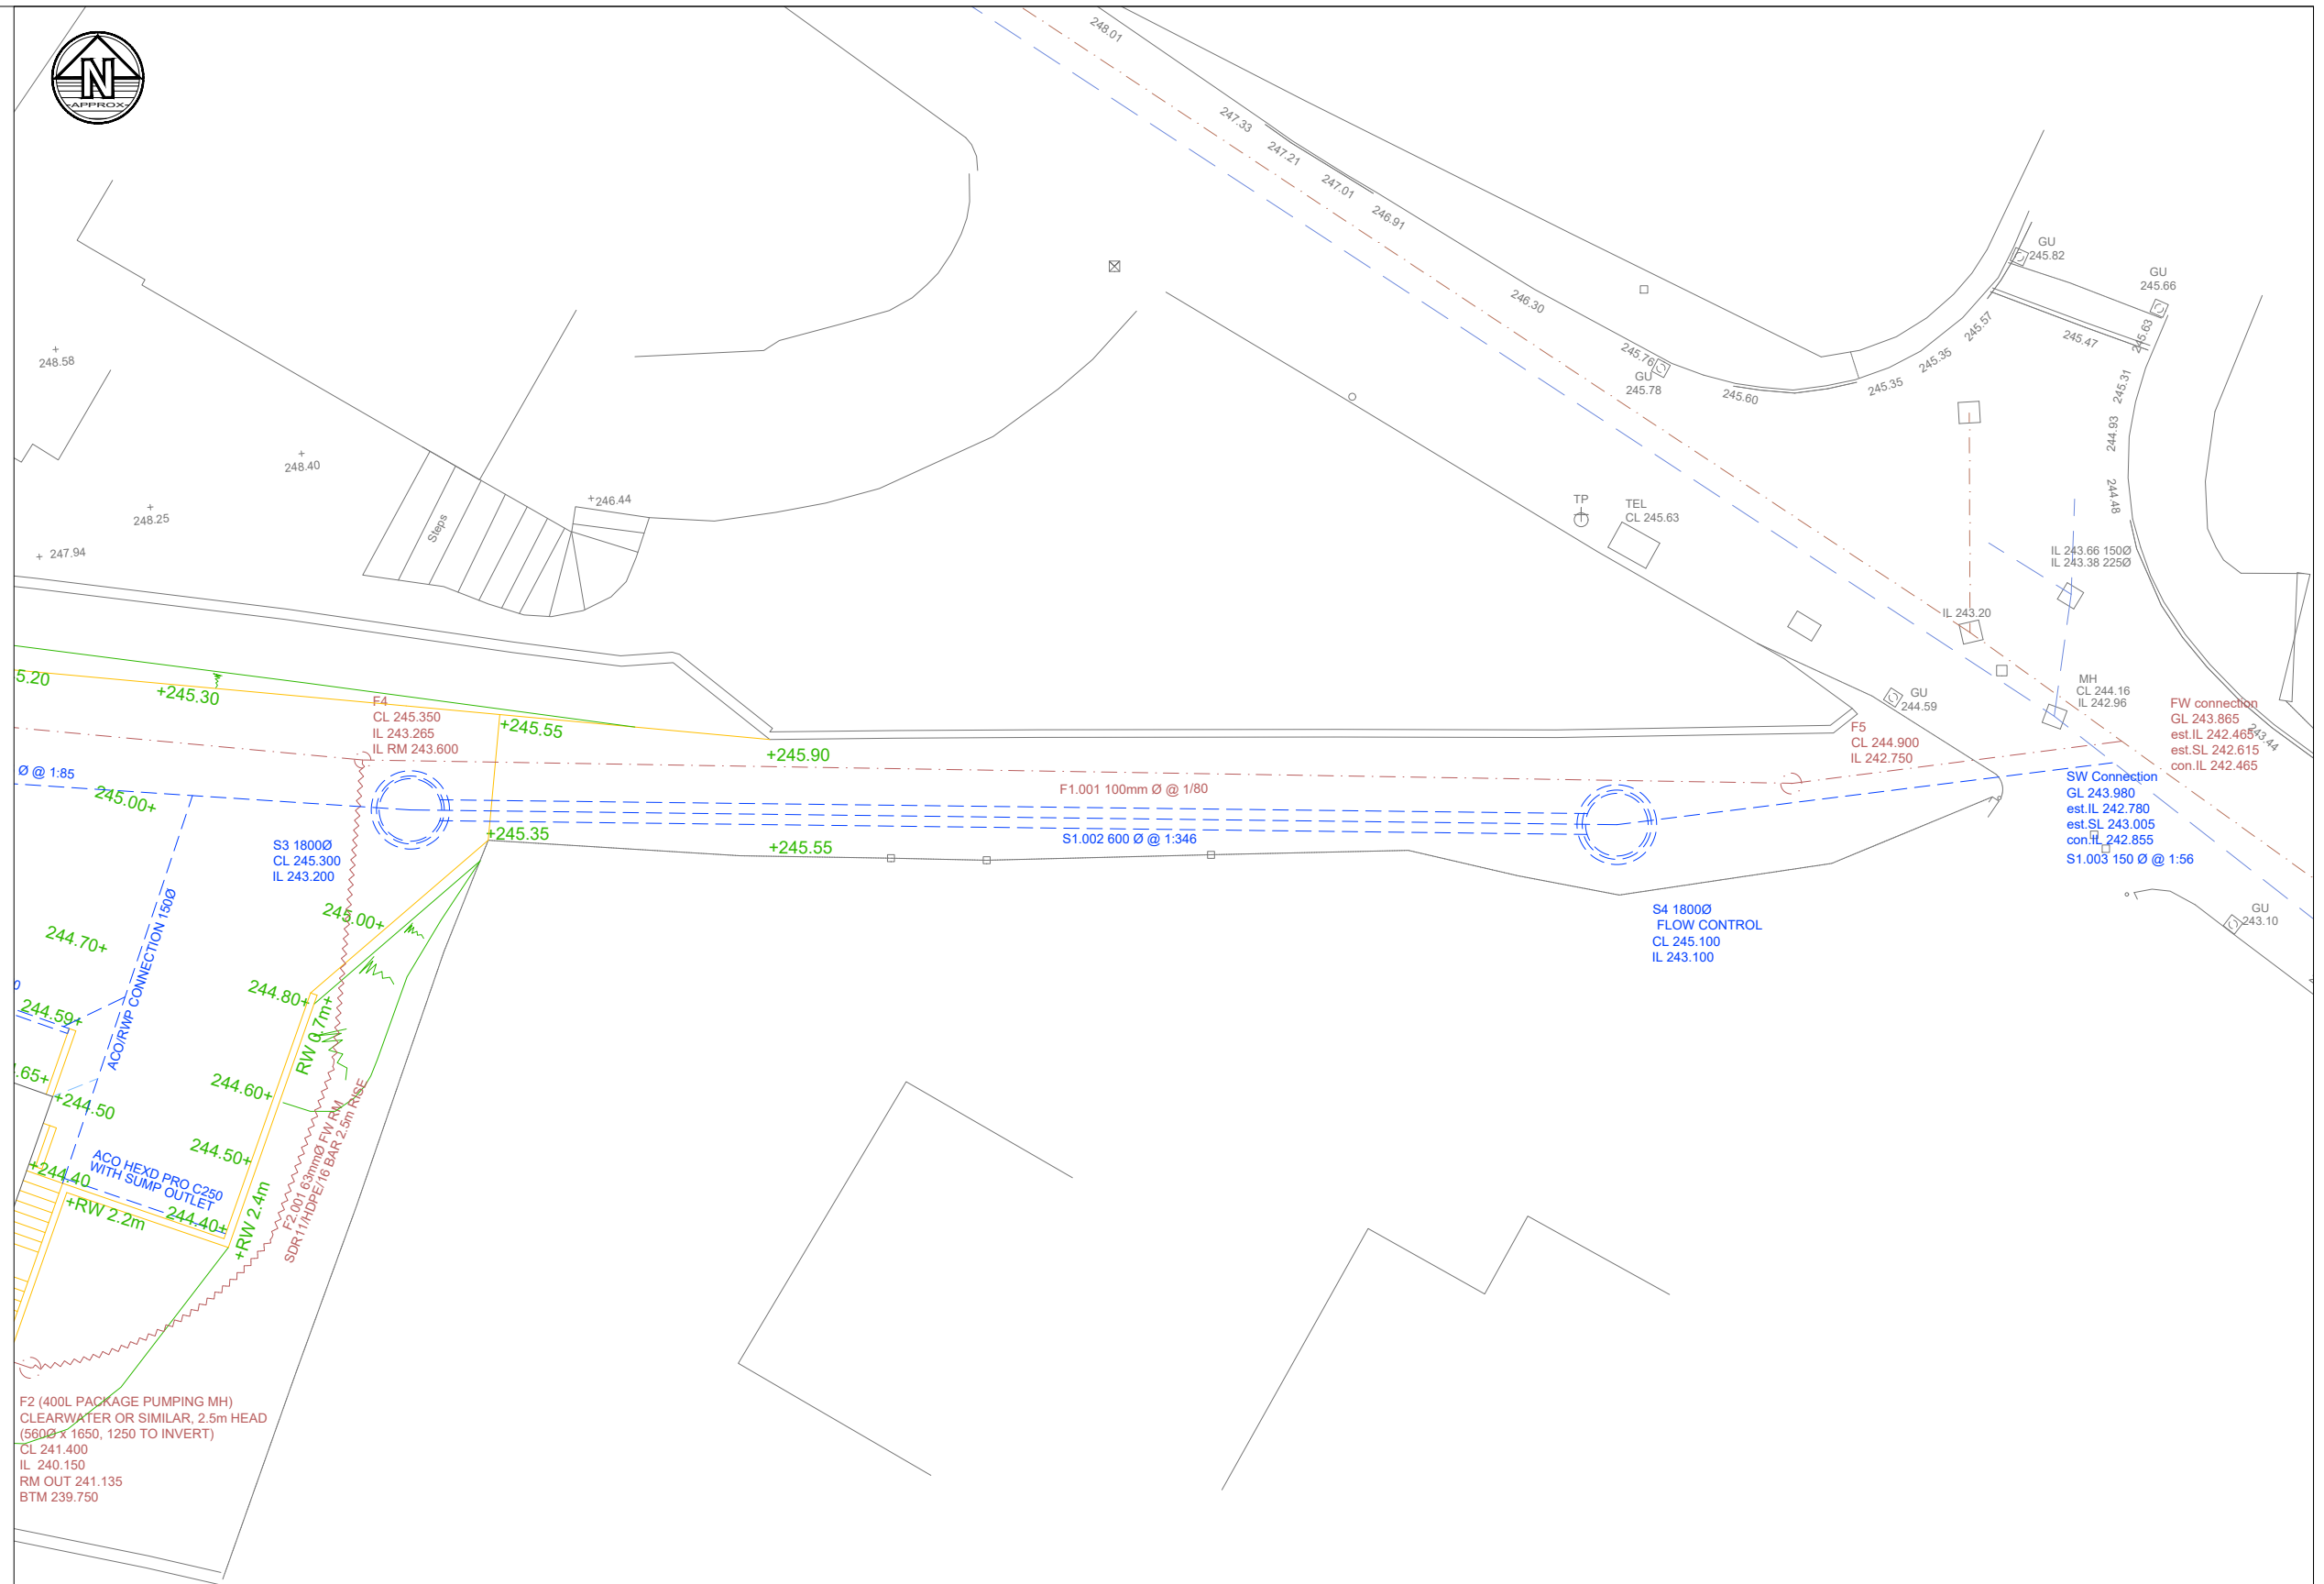

Issues & Revisions				
Rev	Date	Details of issue / revision		Dwn
P1	18.08.23	Preliminary Issue		SZ
P2	03.09.23	Minor drive level and S3 CL amendments		SZ

[illegible]