


NOTES :

1. IF THIS DRAWING HAS BEEN RECEIVED ELECTRONICALLY IT IS THE RECIPIENT'S RESPONSIBILITY TO PRINT THE DOCUMENT TO THE CORRECT SCALE.
2. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS STATED OTHERWISE. IT IS RECOMMENDED THAT INFORMATION IS NOT SCALED OFF THIS DRAWING.
3. THIS DRAWING SHOULD BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DRAWINGS AND SPECIFICATIONS.
4. ANY DISCREPANCIES NOTED ON SITE ARE TO BE REPORTED TO THE ENGINEER IMMEDIATELY.

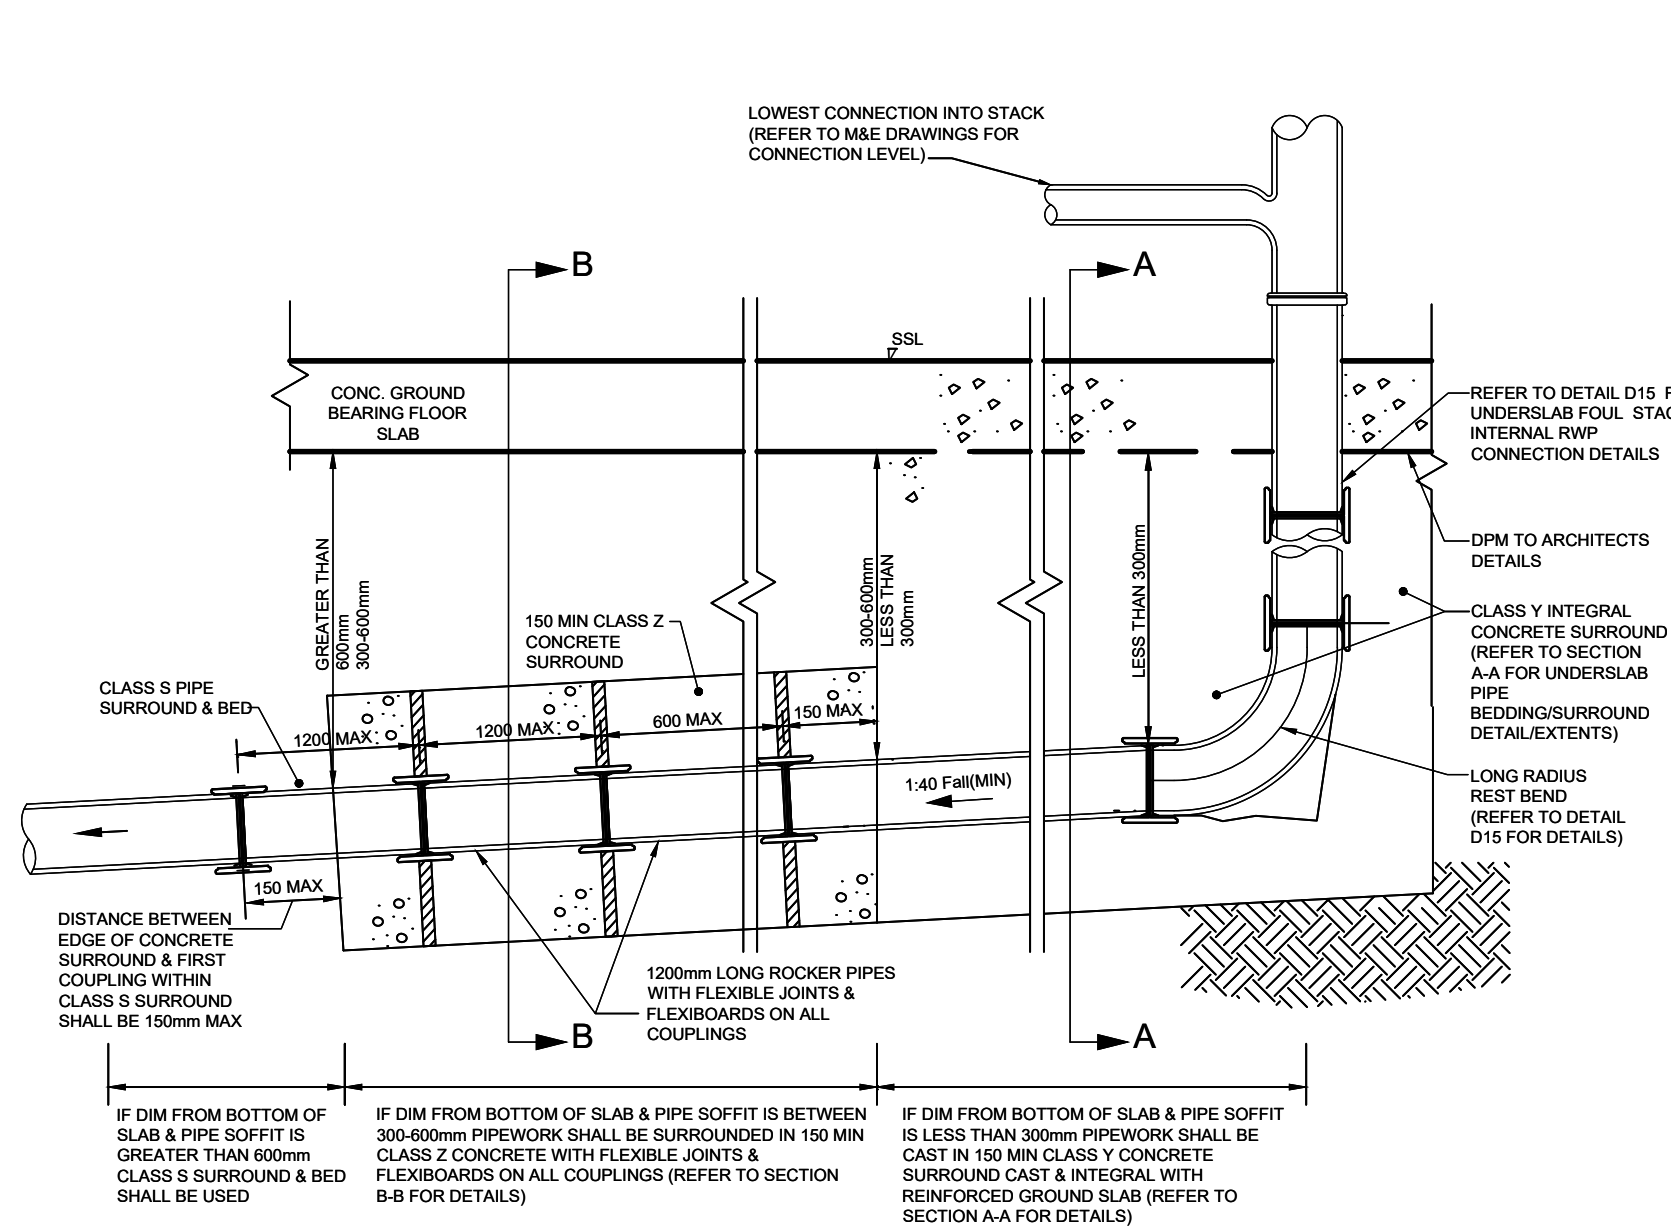


NOTES

1. THIS DETAIL SHALL ONLY BE USED UNDER AREAS OF GROUND BEARING SLAB WHERE UNDER SLAB PIPEWORK CAN BE SUPPORTED BY UNDER SLAB FILL MATERIAL.
2. CONNECTION INTO INTERNAL MANHOLE OR MAIN UNDER SLAB RUN OR EXIT THROUGH FOUNDATION EDGE DETAIL AS PER DETAIL D (REFER TO DRAINAGE PLAN)



SECTION C-C

FOUL AND RAINWATER PIPE
TYPICAL UNDERSLAB PIPE BEDDING DETAILS
FOR PIPEWORK UNDER STRUCTURAL SLAB
(FOR ALL UNDER SLAB PIPE DEPTHS)

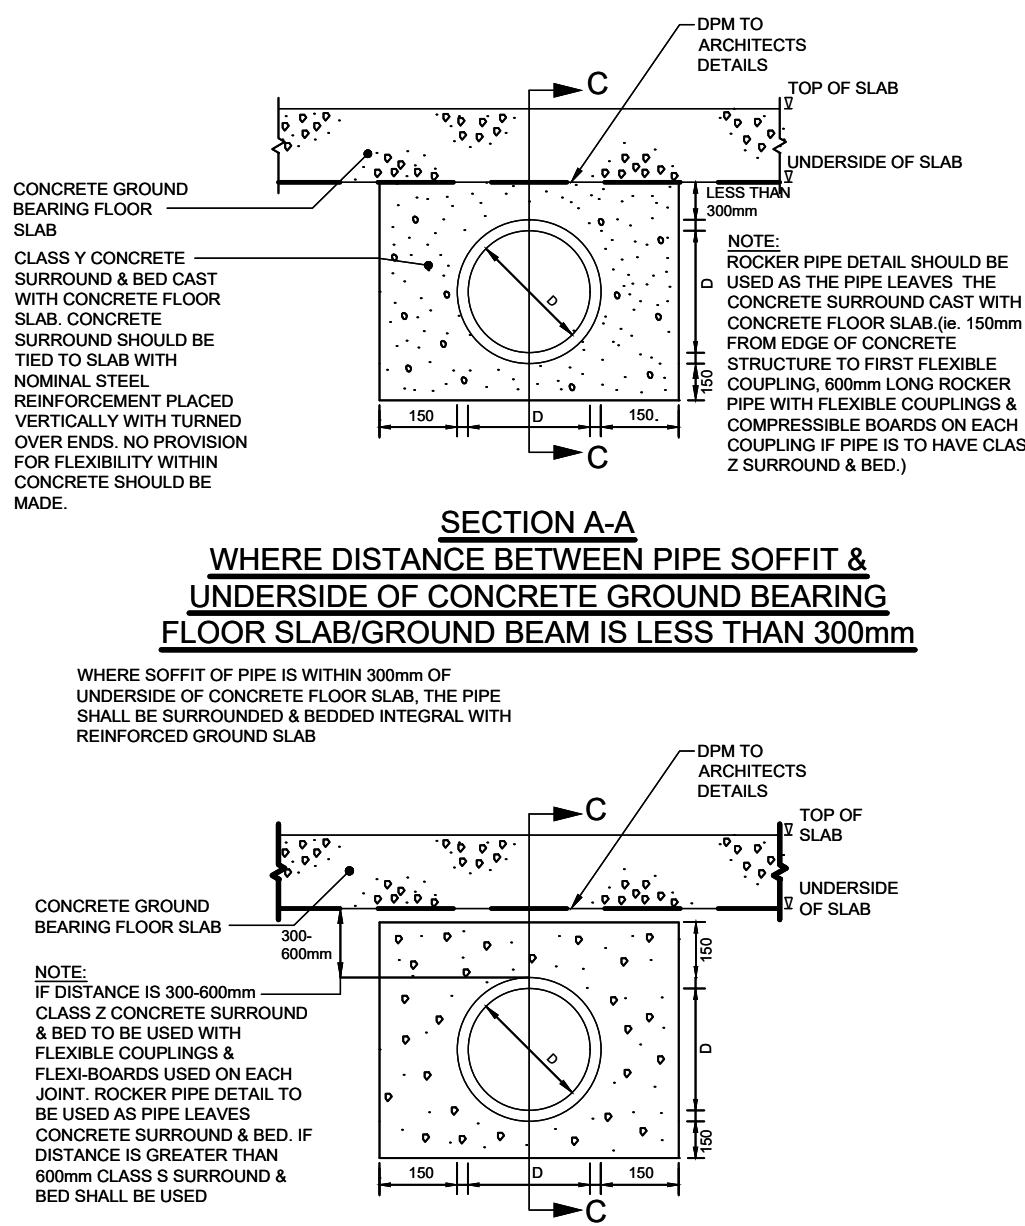

SECTION B-B
WHERE DISTANCE BETWEEN PIPE SOFFIT & UNDERSIDE
OF CONCRETE GROUND BEARING FLOOR SLAB/GROUND
BEAM IS GREATER THAN 300mm

WHERE SOFFIT OF PIPE IS BETWEEN 300 & 600mm FROM UNDERSIDE OF CONCRETE FLOOR SLAB, THE PIPE SHALL BE SURROUNDED & BEDDED IN ST4 CONCRETE. WHERE THIS DISTANCE EXCEEDS 600mm THE PIPE SHALL BE SURROUNDED & BEDDED IN GRANULAR MATERIAL.

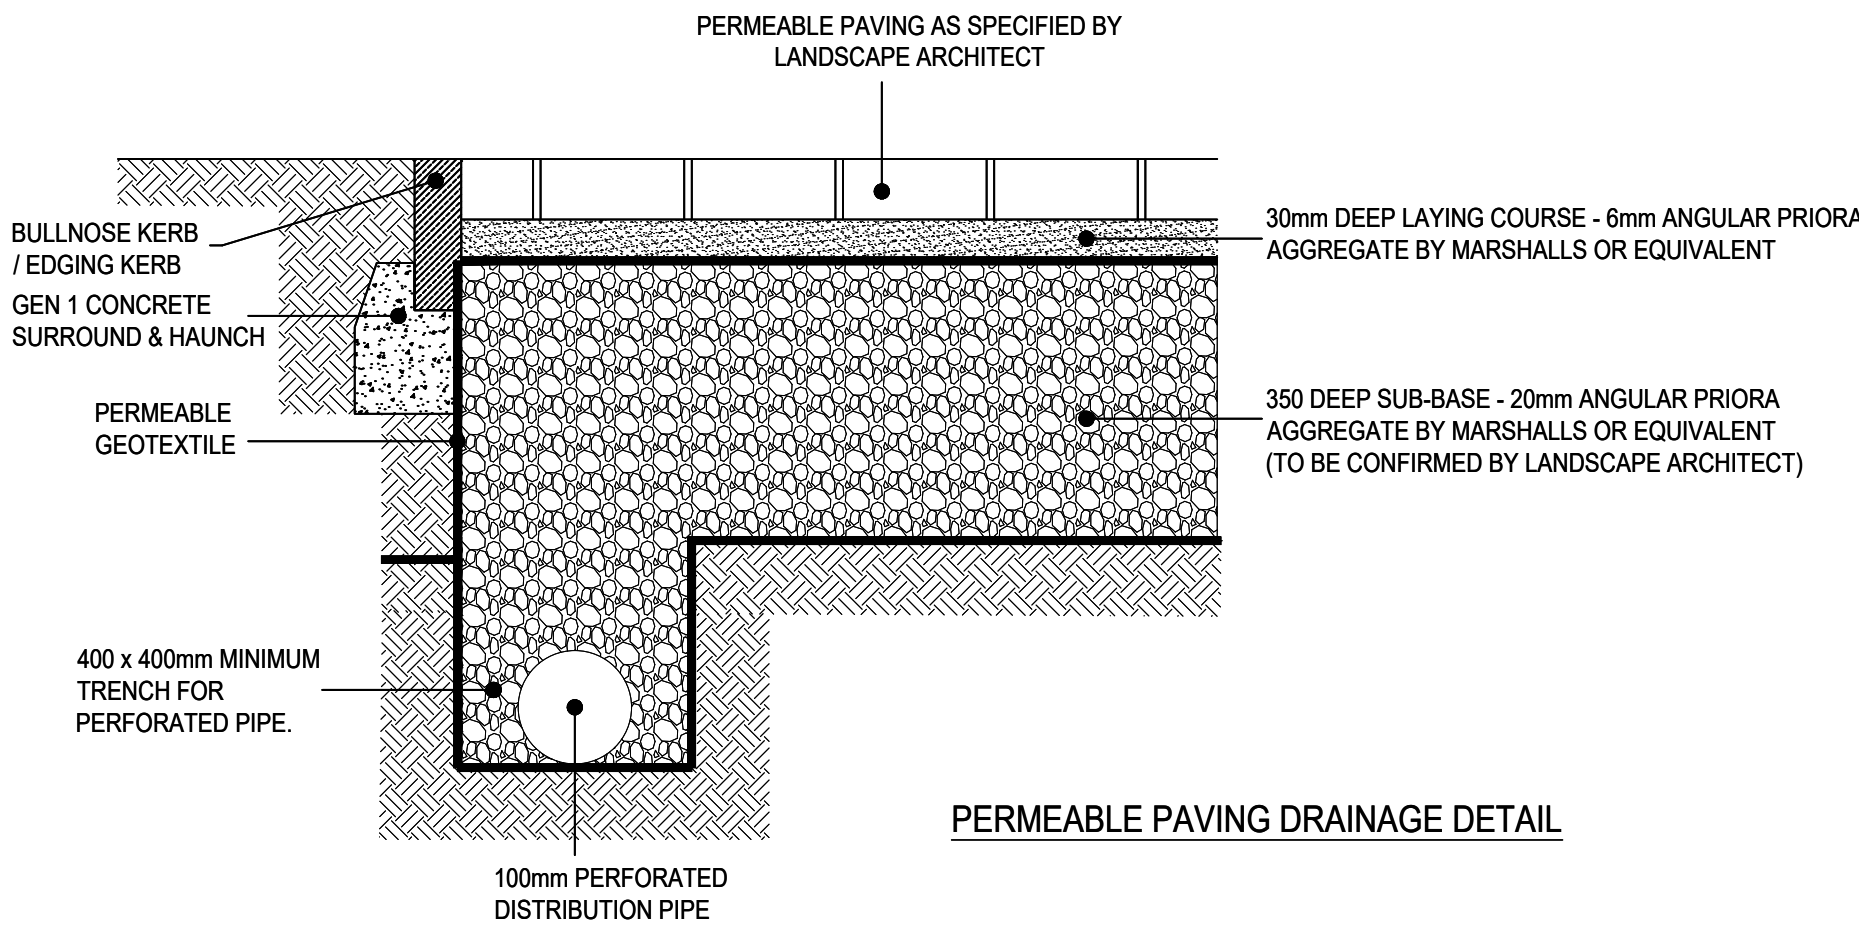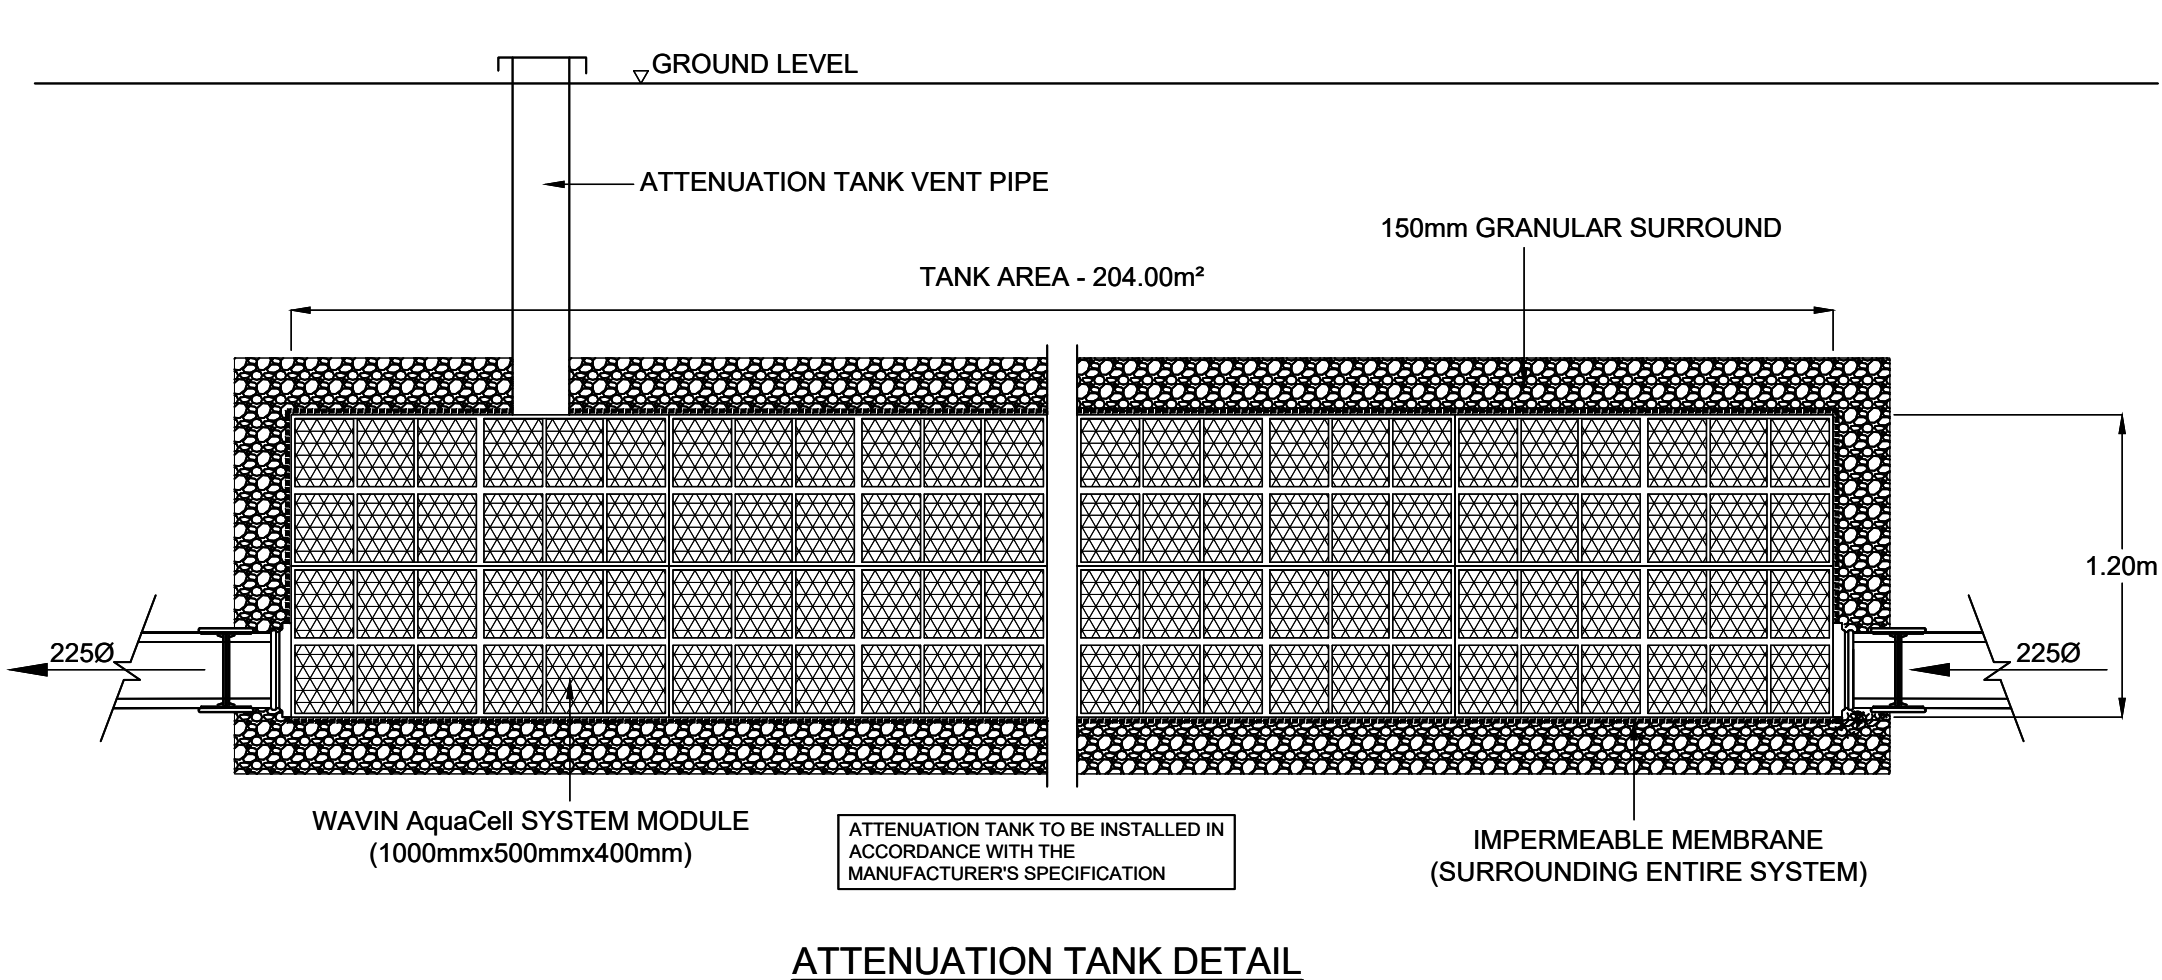

THIS DRAWING IS TO BE USED FOR
PRELIMINARY INFORMATION ONLY
AND **MUST NOT** BE READ AS A
CONSTRUCTION ISSUE. IT INDICATES
DESIGN INTENT ONLY AND IS
SUBJECT TO AMENDMENT DURING
FINAL DESIGN DEVELOPMENT

PRELIMINARY DRAWING ISSUE

P01	PRELIMINARY DRAWING ISSUE	MDS	12.01.23
rev	amendments	by	date

Client :

ASH MARTIN CONSTRUCTION

Project :

**FREDRICK FINLAY CARE HOME,
OXFORD ROAD, DEWSBURY**

Title

**PROPOSED BELOW GROUND
DRAINAGE DETAILS
SHEET 3 of 3**

Drawing Status : PRELIMINARY		Date Created : DEC '23		Drawing Scale : N.T.S.	
Project Number Originator Vol. Level Type Role Number LE-161-CCS- 01 - 00 - DR - S -0203					Rev : P01
Project Leader : JB		Drawn By : MDS		Initial Review : JB	