


AS EXISTING

All windows to have double-glazed units to achieve U value of 1,6 W/m²K.
5000mm² trickle vents to frame to all habitable rooms, 2500mm² to rest.
windows crossed to open and to be min 5% of total floor area.
All windows to have double-glazed units and trickle vents to frame.

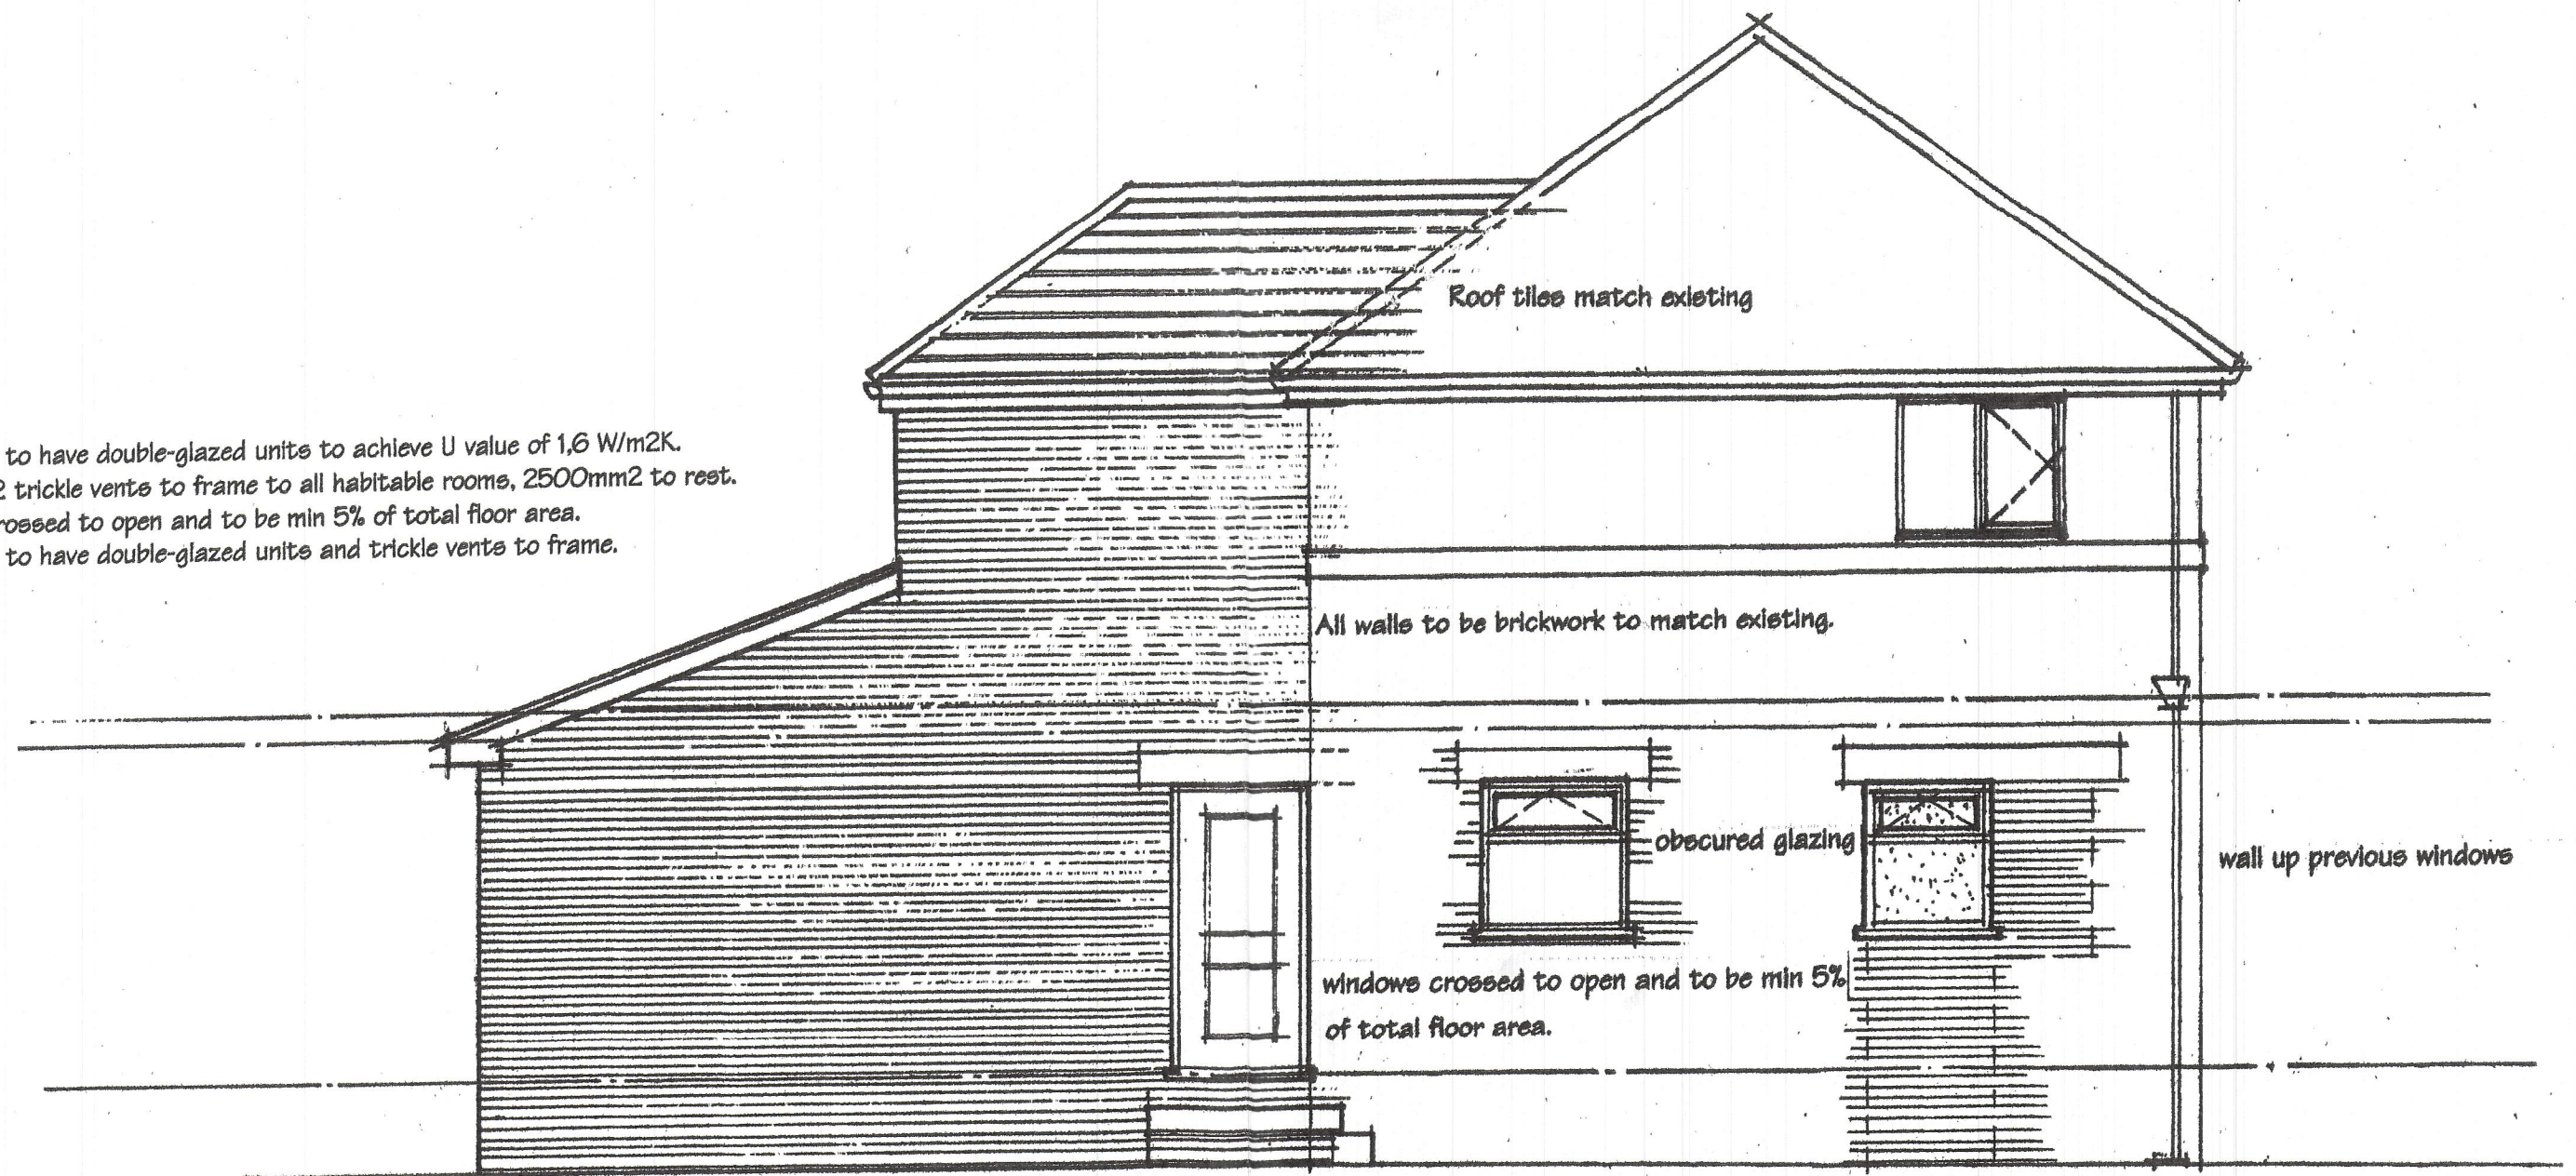

PROPOSED SIDE ELEVATION