
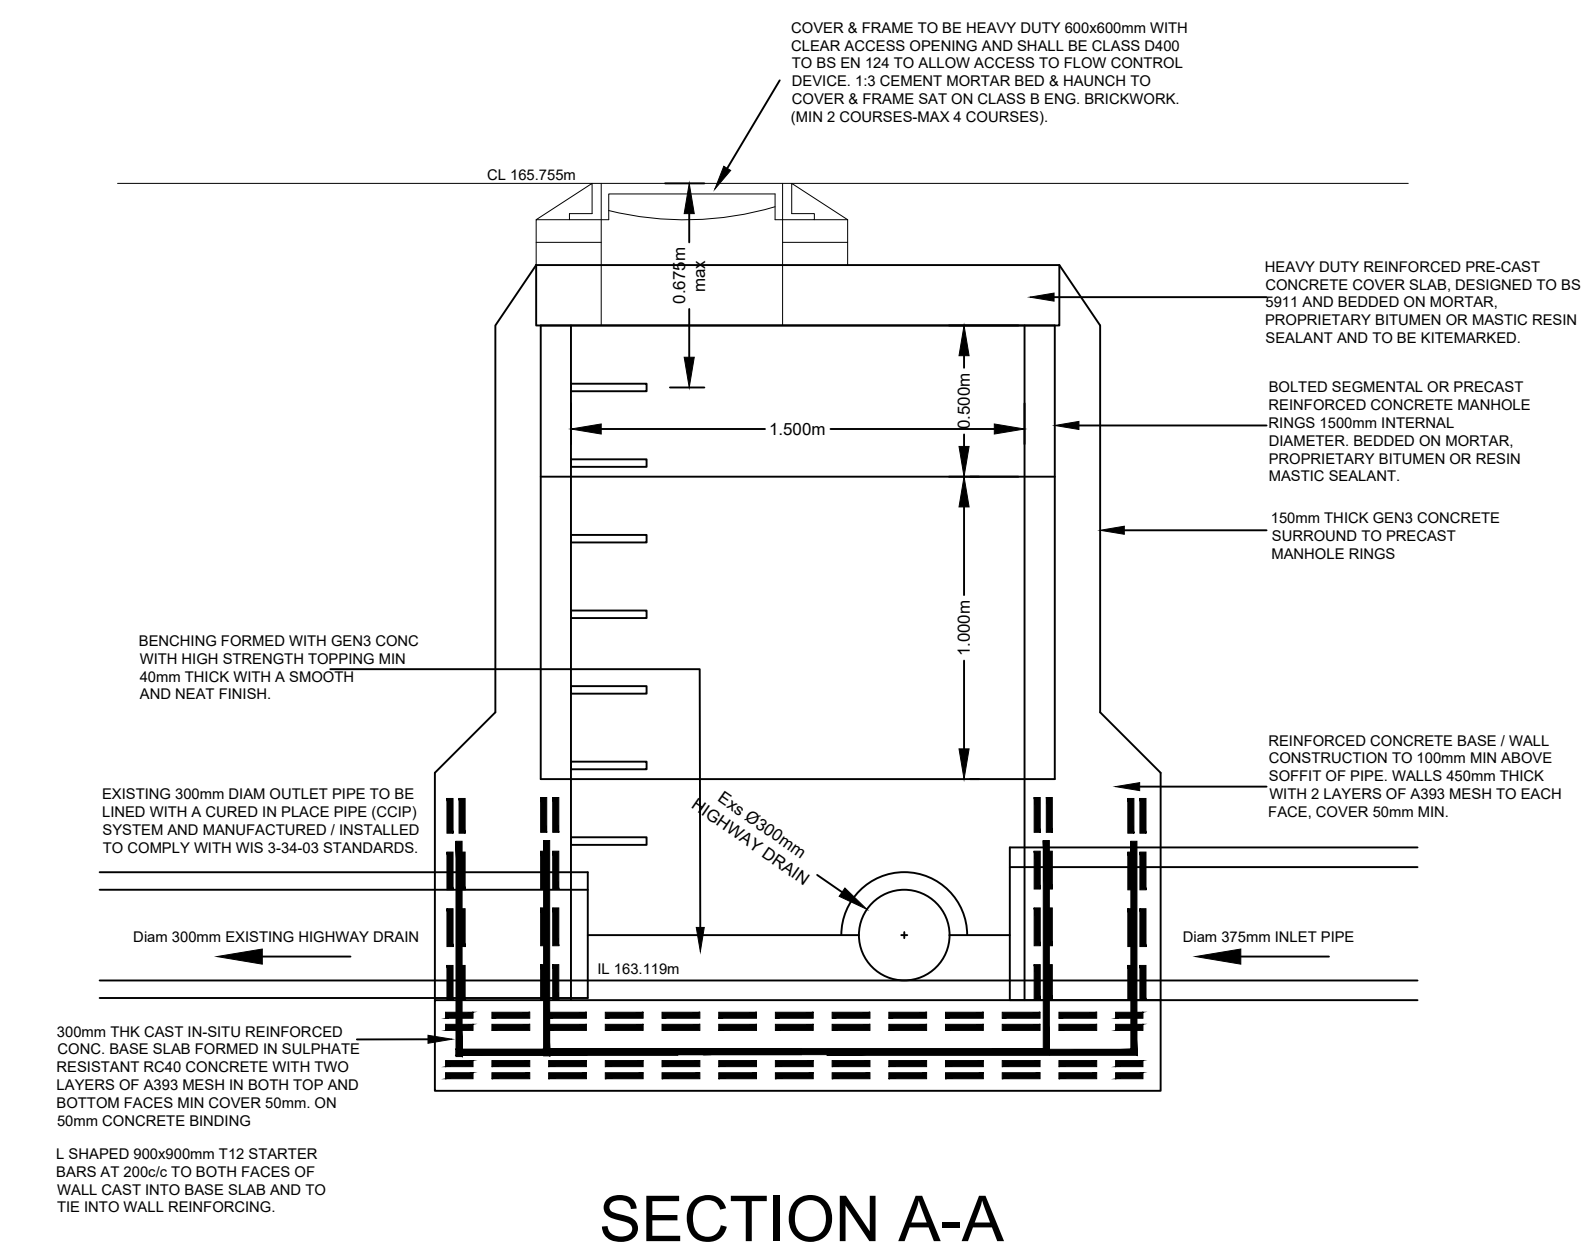


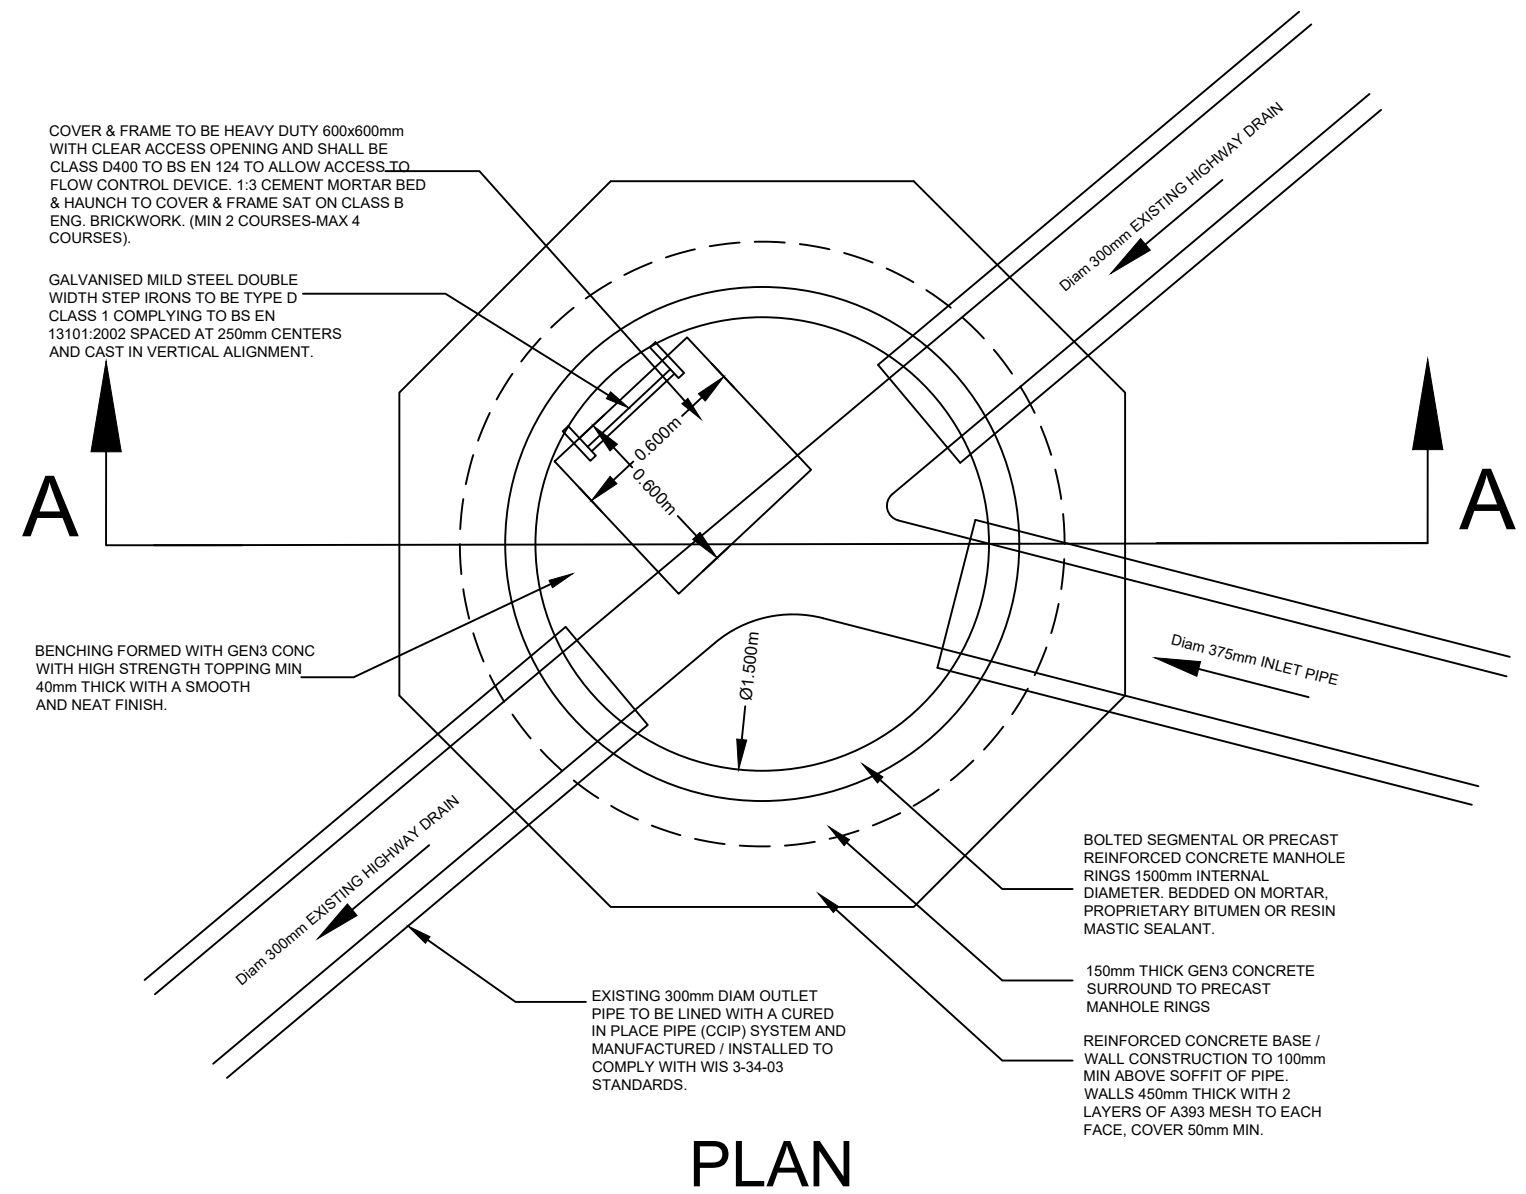

The benching to Manholes shall be Boxed-out and benched in accordance with Standard Manhole details and the following conditions:-

1. Where access into Manholes is restricted and the required headroom can not be achieved.
2. Where the pipe internal diameters are 1050mm or greater.
3. The width of Boxed-out benching shall be 750mm.
4. All access ladders or step irons must continue in accordance with standard Manhole Details and terminate at half channel level.

All Boxing-out of the benching within Manholes shall be approved by Kirklees before work commences.

**NOTE:**

All drainage work and materials to conform to 'Codes for Adoption' & Kirklees amendments.

NOTE: ALL CUSTOM BUILT IRONWORK TO BE HOT-DIPPED GALVANIZED PRIOR TO FINAL FIXING.

Rev A Fall arrest grille removed. Liner specification added. 04.07.24 HH

**Haigh Huddleston & Associates**

Civil Structural Engineering Consultants

Firth Buildings, 99 - 101 Leeds Rd, Dewsbury, WF12 7BU t 01924 464342 f 01924 450662  
e trevor.haigh@haighhuddleston.co.uk

|                                       |      |        |         |                  |
|---------------------------------------|------|--------|---------|------------------|
| Client                                |      |        |         |                  |
| SB HOMES                              |      |        |         |                  |
| Project                               |      |        |         |                  |
| LINGARDS ROAD, SLAITHWAITE            |      |        |         |                  |
| Detail                                |      |        |         |                  |
| MANHOLE DETAILS - SWS CULVERT OUTFALL |      |        |         |                  |
| Dwn                                   | Chkd | Date   | Scale   | Dwg No.          |
| HH                                    |      | JUL-24 | 1:25 A0 | E19/7567/012-04A |