

RBS Huddersfield
HDI

Internal Daylight Assessment

March 2024

CONTENTS

1	Executive Summary	3
2	Introduction	4
2.1	Background	4
2.2	The Nature and Effect of Daylight and Sunlight	4
3	Daylight and Sunlight Assessment Guidance	5
3.1	Internal Daylight Assessment	5
4	Methodology Applied	7
4.1	Data	7
4.2	Proposed Floor Plans	7
4.3	3D Model	9
4.4	Internal Surface Reflectance and Glazing Transmission	9
4.5	Design Data	9
5	Results	10
5.1	Target Illuminance Factor – Proposed Development	10
6	Conclusion	11

Document Control Sheet		Disclaimer
Report Reference	PP2324/HU/DL/202403-AV	<p>The contents of this report are based on drawings, specifications, and information provided, supplemented by assumptions made by NRG to achieve compliance.</p> <p>NRG bears no responsibility to third parties for any use or interpretation of this report. Third parties act on the report's contents at their own risk.</p> <p>The use of this report is exclusively reserved for the named client only, unless accompanied by a signed letter of reliance.</p> <p>This report has been produced by NRG Consulting (NRG) to support a Planning Application. It should not be relied upon at construction stage, for Building Control compliance, or to be used in the discharge of Planning Conditions.</p>
Report Revision	-	
Issue Purpose	For Planning	
Report Prepared For	Kelstone Ltd	
Report Author	Alex Visintini	
Approved By	Ryan Thrower	
Date of Issue	19 th March 2024	

1 Executive Summary

NRG Consulting have been commissioned to undertake an Internal Daylight Assessment on a proposed development at **RBS Huddersfield, 27 Market Place, Huddersfield, HD1 2AD.**

The proposed description of development is: *Change of use of an existing building to create eight residential units.*

Our assessment of the proposed development is in adherence to the following best-practice guidance and industry standards:

- *BRE's Site Layout Planning for Daylight and Sunlight, A guide to good practice (BR 209), 3rd Ed. (2022)*
- *Daylight in Buildings – (BS EN 17037:2018)*

The findings of this report illustrate that all the rooms achieve compliance with the internal daylight requirements as set out in the above guidances.

Based on these findings, it is considered that internal daylight levels should not be a constraint to the granting of planning permission.

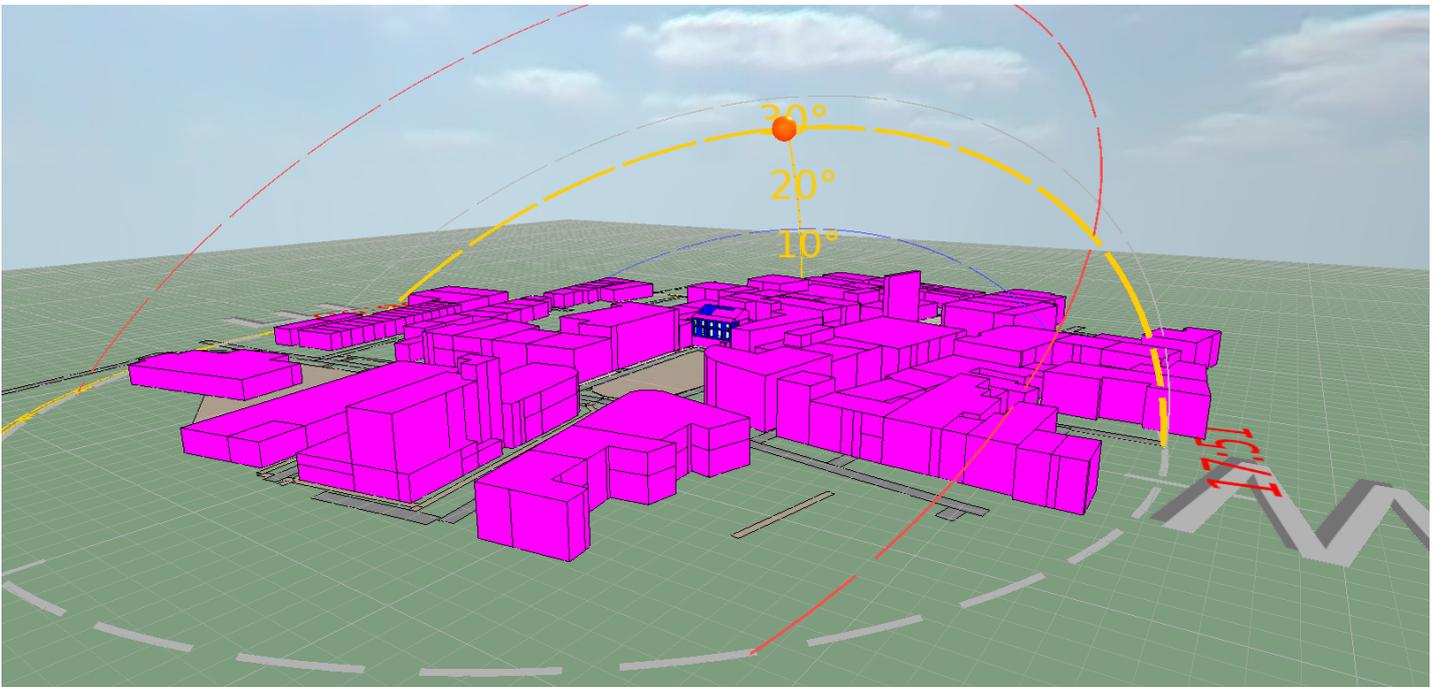


Figure 1: 3D model of proposed building

2 Introduction

2.1 Background

British Standard *Daylight in Buildings* (BS EN 17037) provides advice and guidelines on interior daylighting. It offers two methodologies for daylight provision in buildings: one based on achieving target illuminances from daylight, and an alternative method based on calculating daylight factors.

Within this report NRG Consulting proposes the following approach to assess the scheme:

- We will create a 3d model and use industry recognised software to evaluate internal daylight levels using the illuminance method for the living rooms, kitchens, and bedrooms of the proposed development.

2.2 The Nature and Effect of Daylight and Sunlight

The 3rd edition of the “Site Layout Planning for Daylight and Sunlight” guide by Paul J. Littlefair, released in June 2022, replaces the second edition. The key update is the methods for assessing daylight in a proposed building, as per Section 2.1 and Appendix C of the handbook. *Daylight in buildings* (BS EN 17037) supersedes BS 8206 Part 2 “Code of practice for daylighting”, which contained a method of assessment based on Average Daylight Factor, which is now no longer recommended.

BS EN 17037 offers two methodologies for evaluating daylight across a room’s working plane: the Illuminance Method and the Daylight Factor Method. BS EN 17037 further gives three levels of recommendation for daylight provision in interior spaces: minimum, medium and high. For compliance with the standard, a daylit space should achieve the minimum level of recommendation.

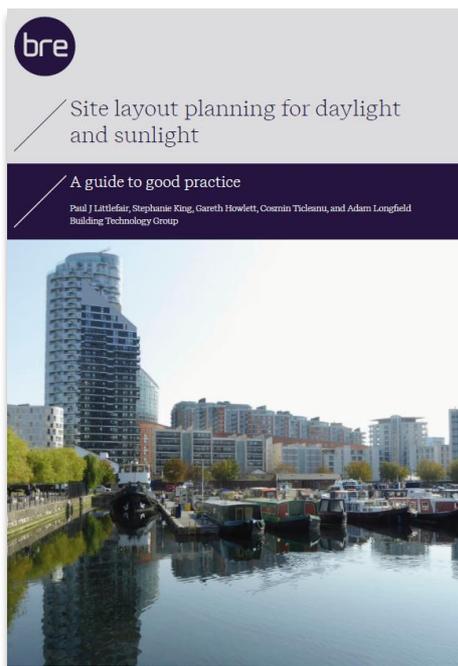


Figure 2: BRE guidelines



Figure 3: BS EN 17037

3 Daylight and Sunlight Assessment Guidance

3.1 Internal Daylight Assessment

In evaluating the internal daylight levels of proposed building projects, it is crucial to differentiate between daylight and sunlight. Daylight encompasses all direct and indirect sunlight during daytime hours, while sunlight refers solely to direct sunlight. Even on cloudy or overcast days, diffuse daylight can illuminate rooms through windows, despite the absence of sunlight.

The BS EN 17037 outlines criteria for two methodologies: the Illuminance Method and the Daylight Factor Method.

Illuminance Method

This method uses climatic data specific to the site location to calculate daylight illuminance at each point on a reference plane's assessment grid, at least hourly, for a typical year. A target illuminance (E_T) should be achieved across at least half of the reference plane in a daylit space for at least half of the daylight hours. Additionally, a minimum target illuminance (E_{TM}) should be achieved across 95% of the reference plane for at least half of the daylight hours; this is the minimum target illuminance to be achieved towards the back of the room. The E_{TM} target does not need to be achieved in UK dwellings.

Target illuminances from daylight over at least half of the daylight hours		
Level of recommendation	Target illuminance E_T (lx) for half of assessment grid	Target illuminance E_{TM} (lx) for 95% of assessment grid
Minimum* (See Table 3 for UK min)	300	100
Medium	500	300
High	750	500

Table 1: Target illuminance for side lit rooms

Daylight Factor Method

This method involves calculating the daylight factor at each point on an assessment grid. The CIE standard overcast sky is used for this calculation, and the result is expressed as a percentage. The table below provides the daylight factor targets for side-lit rooms in Finningley. The recommendations are considered met if the target daylight factor D for half of the floor area is achieved.

Target daylight factors (D) for Finningley		
Level of recommendation	Target daylight factor D for half of assessment grid	Target daylight factor D for 95% of assessment grid
Minimum	2.0%	0.7%
Medium	3.4%	2.0%
High	5.0%	3.4%

Table 2: Target illuminance for side lit rooms

Specific Recommendations for Daylight Provision in UK Dwellings

It is opinion of the UK committee that the recommendations for daylight provision set out in the BS EN 17037 may not be achievable for some buildings, particularly dwellings. It also highlights the relation between high internal daylight levels and risk of summer-time overheating recommending that any room in a dwelling where a daylight illuminance of 500lx is exceeded on 50% of the grid point for more than half of the daylight hours is checked for overheating.

The UK National Annex (Appendix C of the BRE Guidance) gives specific recommendations for habitable rooms in dwellings built in the United Kingdom. These recommendations are particularly relevant for 'hard to light' dwellings, such as those located in basements, those with significant external obstructions, or existing buildings being refurbished or converted into dwellings.

The National Annex therefore provides the UK guidance on minimum daylight provision in all UK dwellings, superseding the figure shown in Table 1.

Furthermore, the recommended levels of illuminance achieved over 95% of a reference plane need not apply to dwellings in the UK and thus are not included in this report.

Target illuminances from daylight over at least half of the daylight hours	
Room	Target illuminance E_r (lx) for half of assessment grid
Kitchen	200
Living Room	150
Bedroom	100
Table 3: Specific recommendations for daylight provision in UK dwellings	

Target daylight factors (DT) to achieve over at least 50% of the assessment grid			
Location	DT for 100 lx (Bedroom)	DT for 150 lx (Living room)	DT for 200 lx (Kitchen)
Finningley	0.7%	1.0%	1.3%
Table 4: Daylight factor target for UK dwellings			

4 Methodology Applied


4.1 Data

All data utilised in this report has been sourced directly from digital files supplied by the Design Team. The height of any potential obstructions has been determined using survey data or derived from publicly accessible aerial photographs.




Figure 4: Aerial view of the site as existing

4.2 Proposed Floor Plans

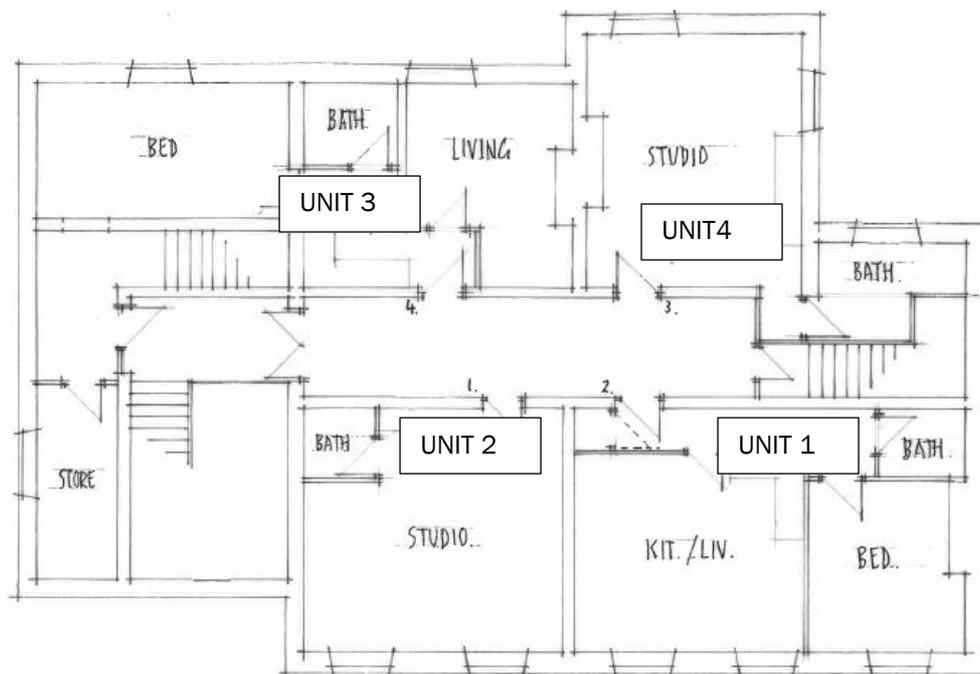


PROPOSED FIRST FLOOR PLAN.

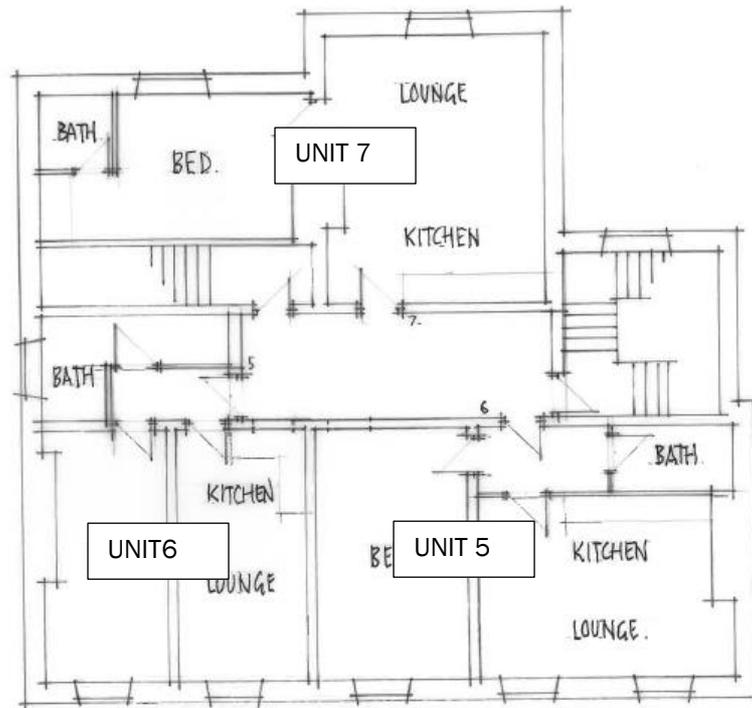

PROPOSED SECOND FLOOR

Figure 5: Proposed floor plan

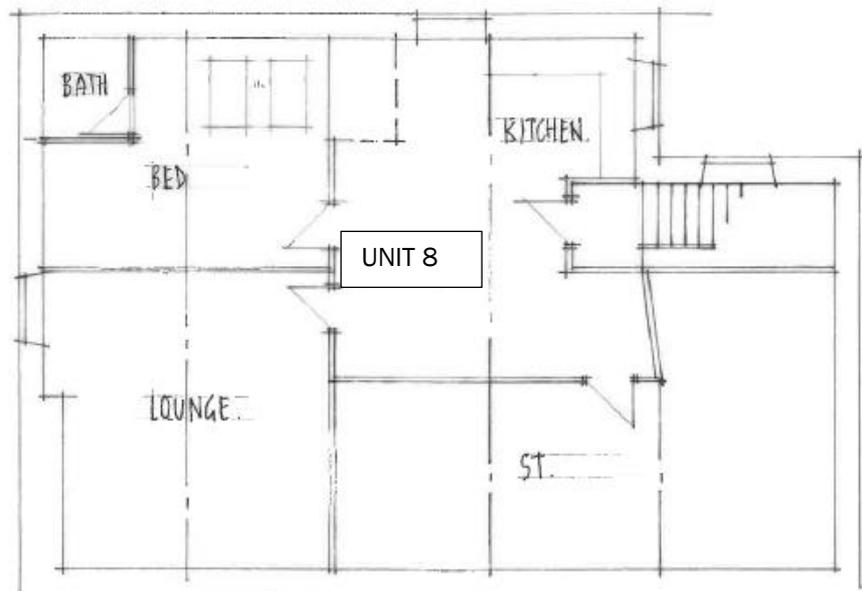

PROPOSED LOFT

4.3 3D Model

To carry out the internal daylight assessment, a full-scale 3D model of the proposed development was created using IES ModellIT. The internal daylight was then evaluated using IES Radiance, a program designed for thermal and environmental analysis.

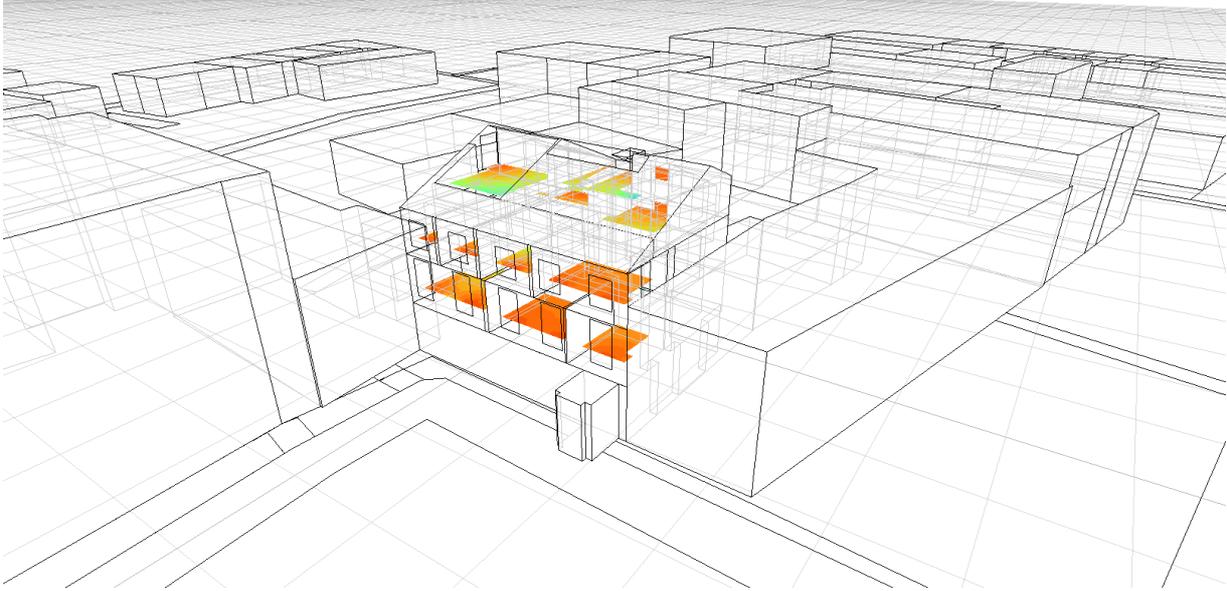


Figure 6: 3D model of the proposed development

4.4 Internal Surface Reflectance and Glazing Transmission

The reflectance of a room's internal surfaces significantly influences the internal daylight result. Lighter colours result in higher reflectance (white: 1.0; black: 0.0). The glazing transmission factors including the appropriate maintenance factor have also been included in the simulation along with window framing factor. The internal surface and windows properties used in this assessment are detailed in the table below:

Surface	Reflectance	
Floor	0.4 (e.g. light wood or grey tiles)	
Walls	0.7 (e.g. light pastel or white paint)	
Ceiling	0.7 (e.g. light pastel or white paint)	
Window	Light Transmittance	0.68

Table 5: Surface Properties

4.5 Design Data

The architectural design for this project was provided by **Philip Fletcher Architects**. The drawing pack used for this assessment was issued in March 2024.

PHOTO-2024-02-28-12-37-21	JPG File	440 KB
PHOTO-2024-02-28-12-37-21 (3)	JPG File	387 KB
PHOTO-2024-02-28-12-37-21 (2)	JPG File	272 KB
SKM_C75923110311431	Adobe Acrobat D...	110 KB
SKM_C75923110311430	Adobe Acrobat D...	113 KB
HPSCAN_2023122010070339_2023-12-20_...	Adobe Acrobat D...	429 KB

5 Results

5.1 Target Illuminance Factor – Proposed Development

We have evaluated the proposed new accommodation to ascertain if the internal spaces will receive adequate daylight, referencing Target Illuminance (ET) Factor. This method calculates the illuminance level at each point on an assessment grid.

Our analysis of the internal space of the proposed development reveals that the assessed rooms comfortably exceed both the BRE Guide and BS EN 17037:2018 acceptable criteria in terms of Illuminance Factor.

Unit	Room	Floor area that achieves the target (%)	Target to be achieved over 50% of the floor area (D_T/E_T)	BRE Compliant
1	Kitchen/living room	100	200	YES
	Bedroom	100	100	YES
2	Studio unit	100	200	YES
3	Living room	100	150	YES
	Bedroom	100	100	YES
4	Studio unit	99	200	YES
5	Kitchen/living room	100	200	YES
	Bedroom	100	100	YES
6	Kitchen/living room	100	200	YES
	Bedroom	100	100	YES
7	Kitchen/living room	100	200	YES
	Bedroom	100	100	YES
8	Kitchen/dining room	96	200	YES
	Living room	95	150	YES
	Bedroom	100	100	YES

Table 6: Internal daylight results

6 Conclusion

NRG Consulting have conducted an Illuminance Factor (E) assessment for the internal spaces of the proposed development. Our analysis concludes that daylight levels within the proposed habitable rooms are adequate and surpass the target criteria outlined in BS EN 17037:2018 and the BRE publication "Site Layout Planning for Daylight & Sunlight – A Guide to Good Practice" [Section 5.1].

As per the findings of this report, it is considered that the proposed internal daylight levels should not be a constraint to the granting of planning permission.

