

Siting and Sizing Options




Observe the following in connection with the condensate discharge hose

- Horizontal installation
- **No connection to the sewer**
- Discharge directly from the tundish into a soakaway pipe DN 100
- Accessory(2) heating for the condensate tray heating to be led to the outside
- When the flexible discharge hose is used, it must not be longer than the accessory heating element(1).



A = $\geq 900\text{mm}$ in regions with ground frost or $\geq 600\text{mm}$ in areas without.

B = 100mm


C = 100mm

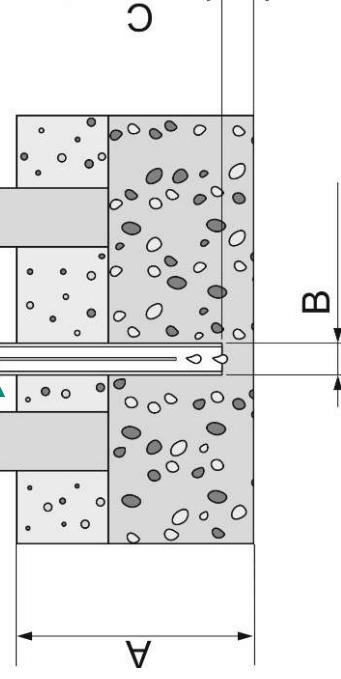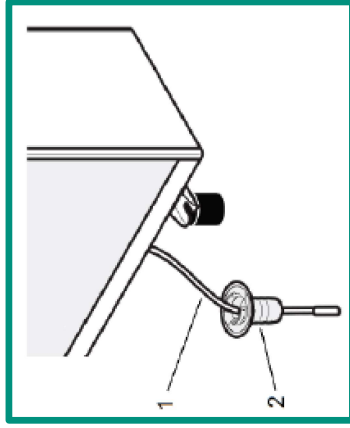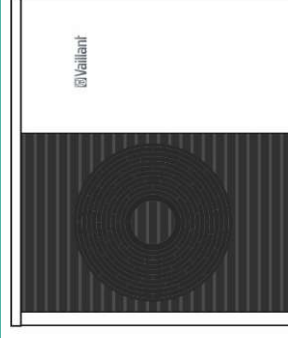


Installation arøTHERM plus

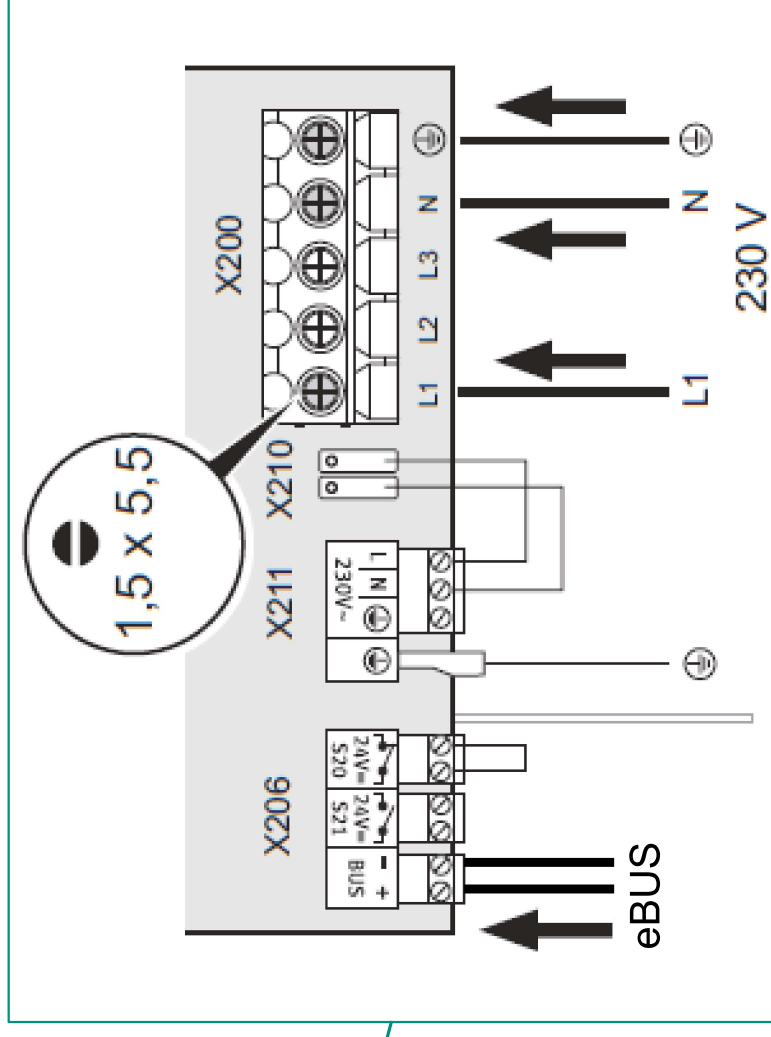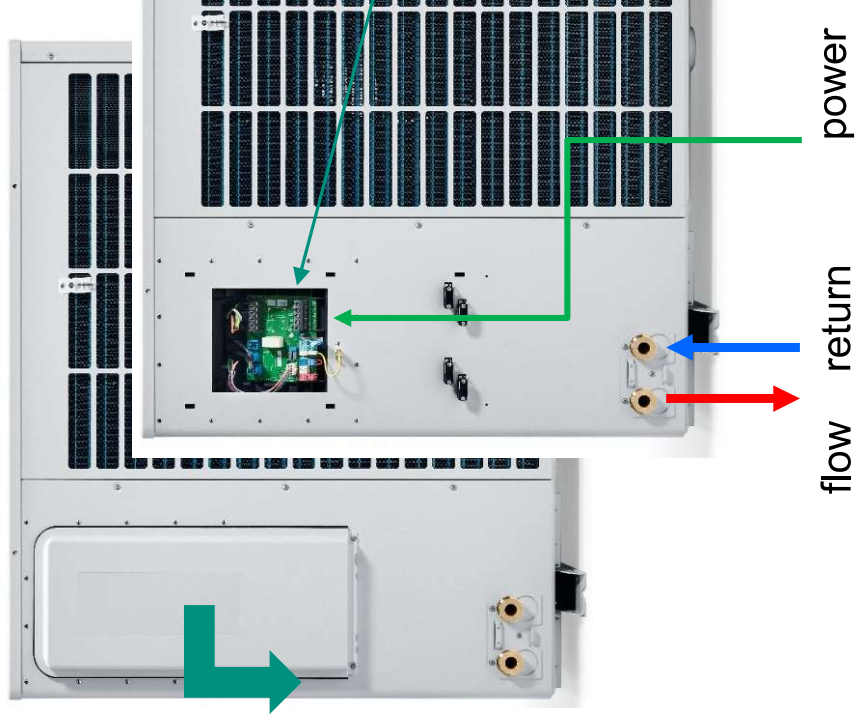


Siting and Sizing Options

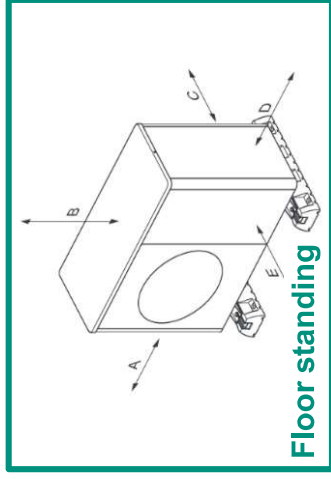


Floor standing

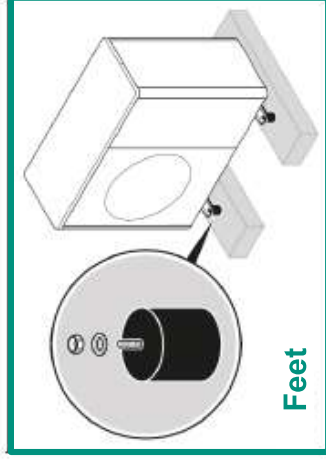



Feet

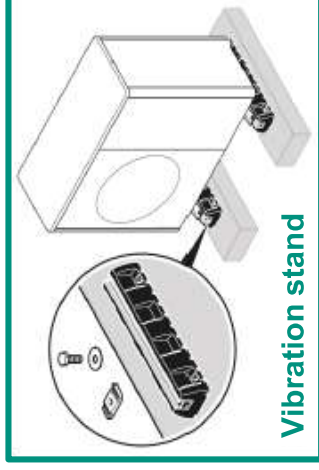

Vibration stand

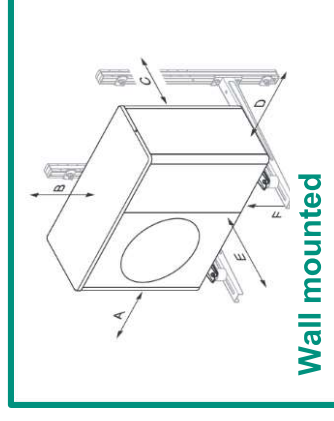

Wall mounted

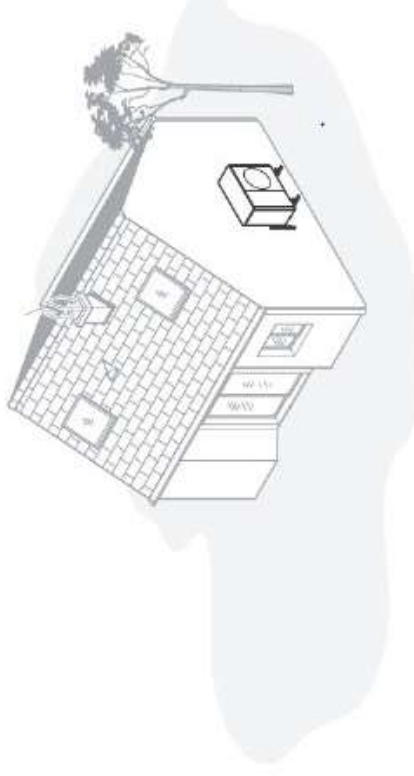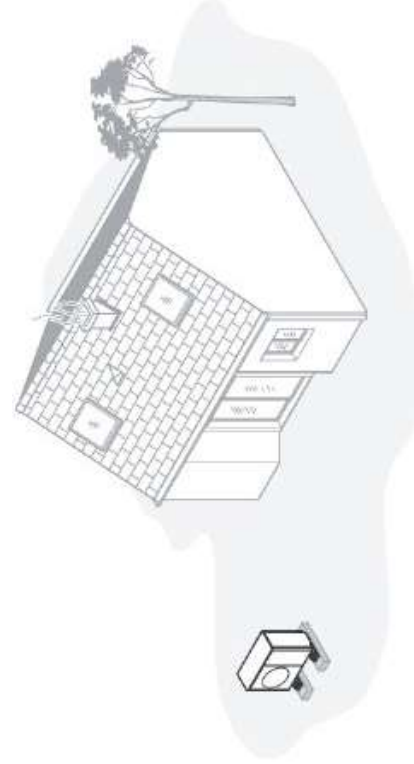



- Accessories outdoor unit:
 - standard-compliant insulation for fast installation
 - compensators to provide additional decoupling of the appliance from the house installation



- The automatic air vent is open when delivered
 - closing of the valve during first maintenance
 - during commissioning the sound safe area is not to be opened*

* If a cooling resistor has to be installed, refer to our service or join a training

