


## PART GROUND FLOOR PLAN SHOWING PROPOSED STRUCTURE OVER

1:50

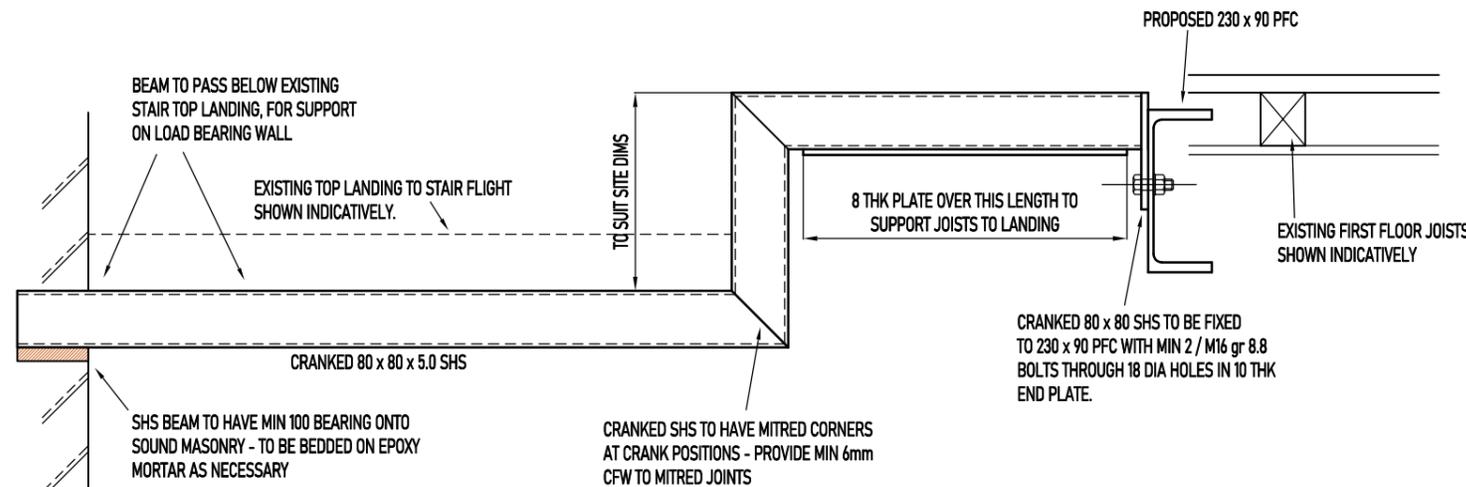

## SECTION B-B

1:10

1. All steelwork to be in accordance with the latest issue of the National Steelwork Specification for Building Construction.
2. All steelwork to be grade S355 JR to BS EN 10025 unless otherwise noted. Structural hollow sections to be hot finished, grade S355 J2H to BS EN 10210 unless otherwise noted.
3. Unless otherwise noted, steelwork to be blast cleaned to SA2.5 and painted with zinc phosphate primer to a minimum thickness of 75 microns. Top coats, where necessary to be to Architects specification. All primers to be compatible with top coats and intumescent coatings.
4. Where noted as galvanised, steelwork to be blast cleaned to SA2.5 and hot dip galvanised to a thickness of 140 microns. Galvanised steelwork to receive paint finishes to be T washed. Bolt and nut fixings to be hot spun galvanised, with threads re-cut after galvanising.
5. Fire protection to steelwork to be to Architects specification.
6. Connection designs and details not shown on these drawings to be designed by steelwork contractor. Connection details to be submitted for comment at least 10 days before fabrication.
7. Fabrication drawings to be submitted for comment at least 10 days before fabrication.
8. All dimensions relating to existing construction are to be obtained by the steelwork contractor.
9. A written method statement to describe proposed demolition and erection of steelwork is to be submitted at least 5 days before these works starting on site.
10. Temporary propping and support remains the responsibility of the contractor. Temporary propping loads shown on this drawing are minimum working loads for which temporary works should be designed. Temporary props to be taken to suitable foundation and to be fully braced and tied.
11. All reveals to be made good in engineering brickwork as necessary. New masonry to be fully bonded/tied to existing.

### GENERAL NOTES

Do not scale from this drawing, use figured dimensions only - where in doubt consult Engineer

This drawing to be read in conjunction with all relevant Architects and Building Services Engineers drawings

P1 Initial Issue 12.02.22

Revision Description Date

Client

Mr & Mrs Piscitelli

Project

14 PARKWOOD ROAD  
LONGWOOD

Upperbridge House  
24 Huddersfield Rd  
Holmfirth  
HD9 2JS  
dan@sawyerconeng.com  
07703 495485  
01484 767780

# SAWYER

Drawing Title

PART GROUND FLOOR PLAN  
SHOWING STRUCTURE OVER

Status

PRELIMINARY

Drawn

DS

Scales

AS NOTED - PLOTTED AT A3

Checked

DS


Project and Drg No.

21\_014\_003

Rev


P1

EXISTING TIMBER JOISTS (SHOWN INDICATIVELY)  
TO HAVE FULL BEARING ON SEATING PLATE.

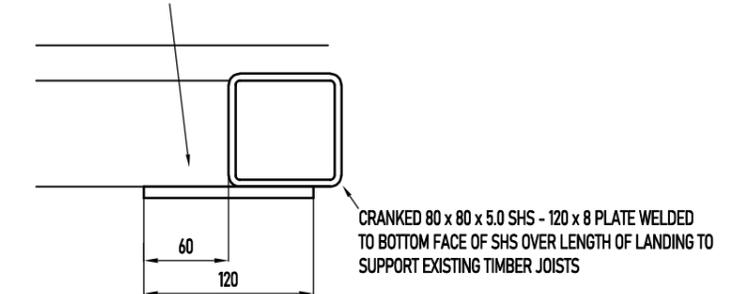

## SECTION A-A

1:5

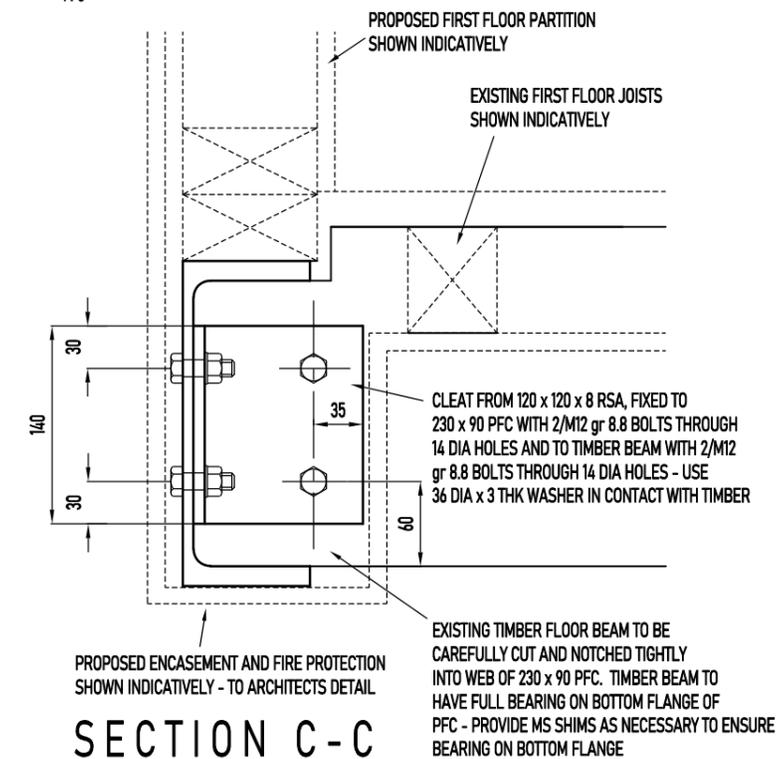

## SECTION C-C

1:5