



SECTION 1-1
S38 Zone of Influence Relative Tank
 (1:50)

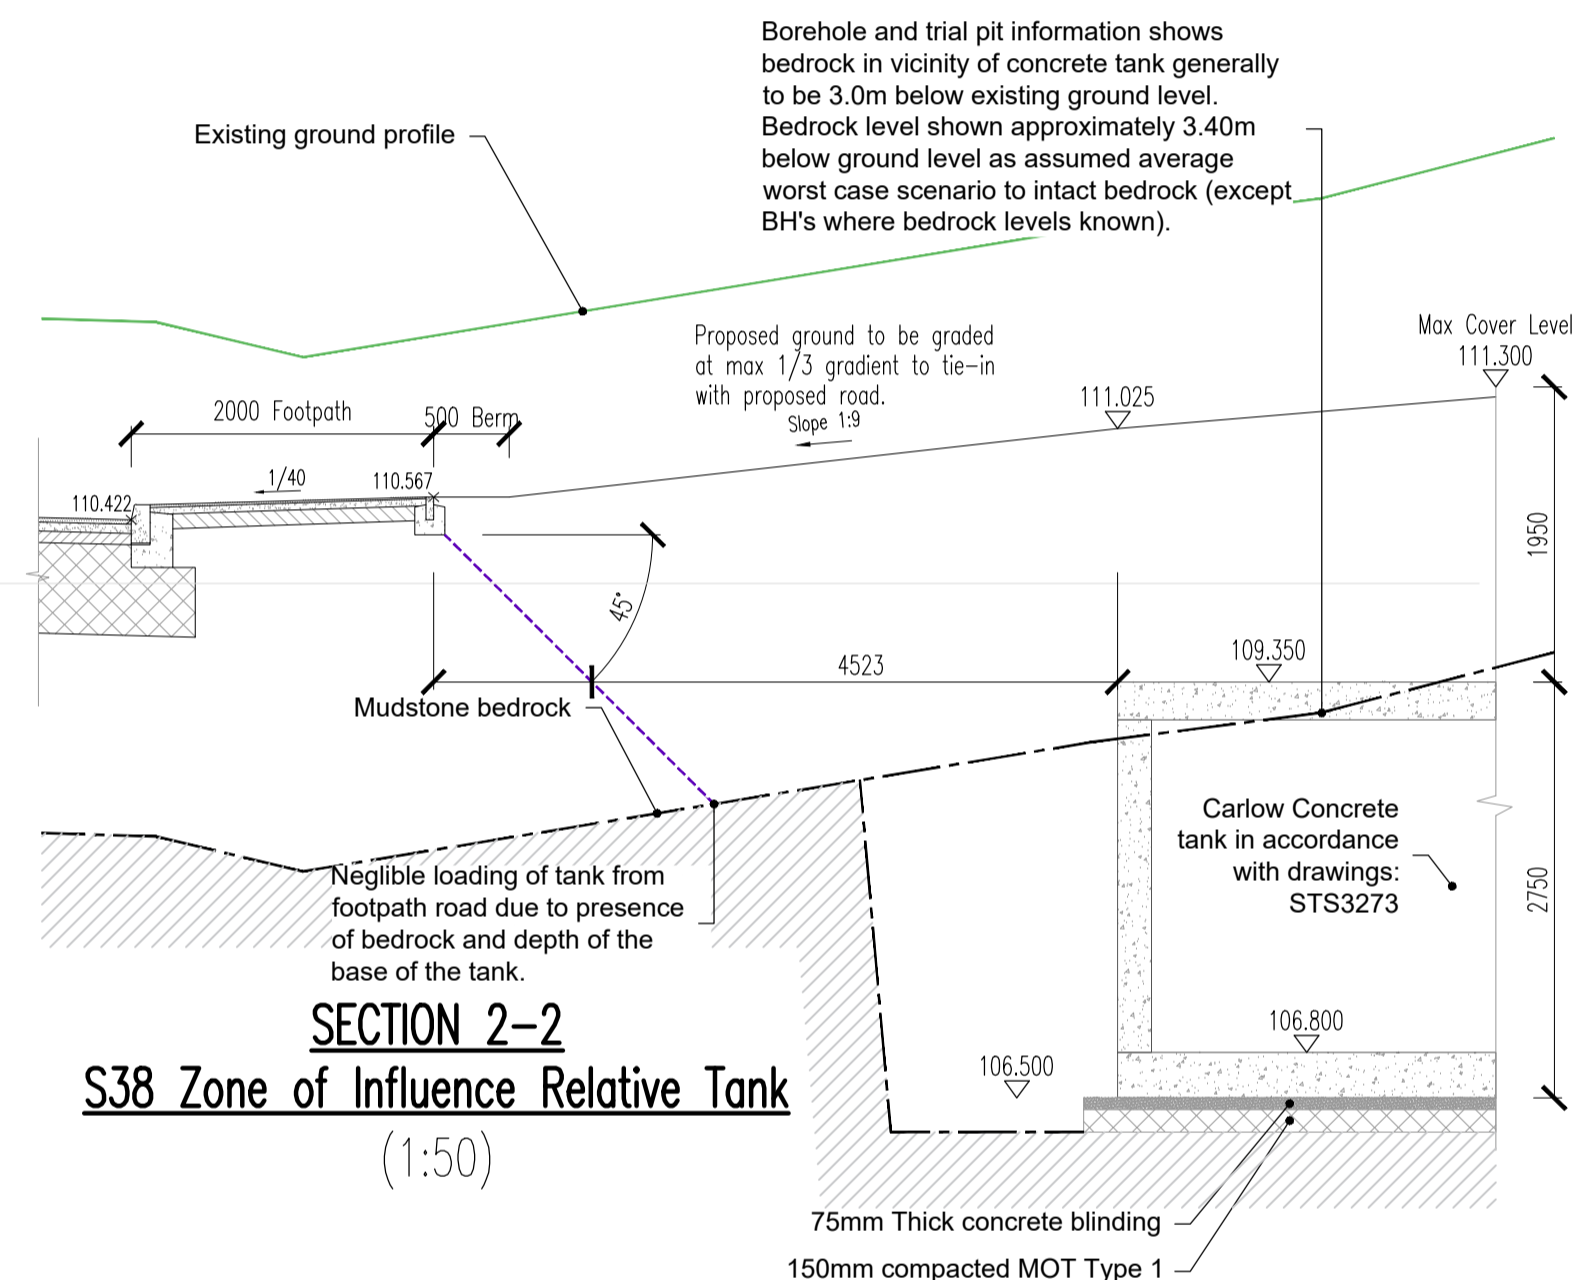

SECTION 2-2
S38 Zone of Influence Relative Tank
 (1:50)

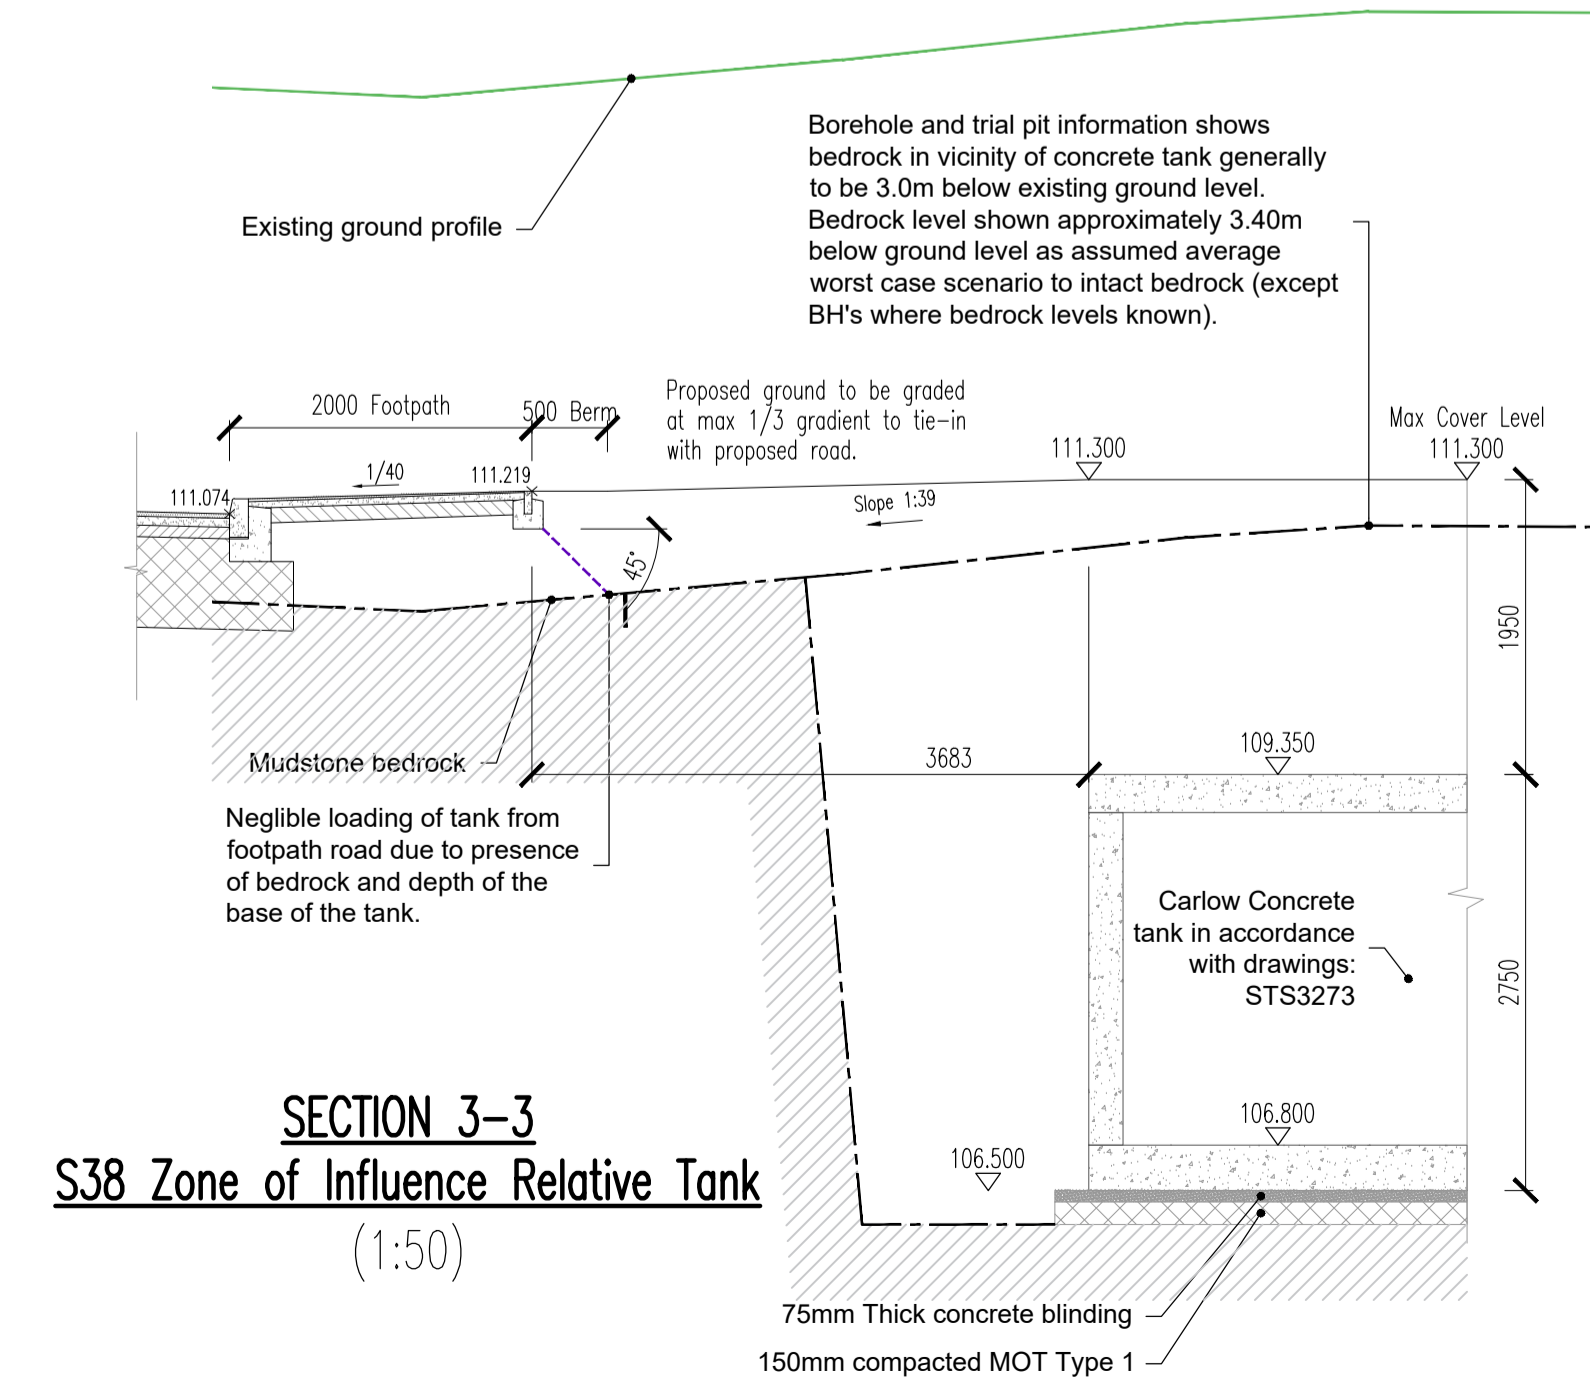

SECTION 3-3
S38 Zone of Influence Relative Tank
 (1:50)

N O T E S

ATTENTION IS DRAWN TO THE REQUIREMENTS OF THE CONSTRUCTION DESIGN AND MANAGEMENT REGULATIONS 2015 AND THE DUTIES AND RESPONSIBILITIES CONTAINED THEREIN

KEY

	Site Boundary
	S38 Boundary
	S38 Road - 45° Zone of Influence Extent to S104 Tank Base

- NOTES**
- Refer to typical section Drawing No 0257/05/04 for typical highway details.
 - Dropped kerbs and tactile pavings are required at the junctions to facilitate the movement of wheelchairs etc. The dropped kerbs to be laid with a 0-6mm upstand.
 - Adoptable sewers are not to be constructed under or within 1.0 metres of any footpath/ kerb line / service strip.
 - Off-site drainage already built must have invert levels checked prior to connection of the site drainage.
 - Gully positions shown are subject to adjustment on site to ensure full drainage and the absence of ponding.
 - No walls are to be constructed 1m of the highway drains located in gardens or verge.
 - No water should be allowed to discharge from any private drives onto the adoptable highway.
 - All highway works are to be the subject of a Section 38 Agreement of the highways Act 1980.
 - All public sewers to comply with the requirements of the Water UK publication "Design and Construction Guidance (DCG)", otherwise known as "the code" together with any additional specific requirements of the drainage authority.
 - All public sewers are to be the subject of a Section 104 Agreement of the Water Industry Act 1991.
 - Any coated base material in carriageway left exposed for more than seven days to be sealed using bituminous sealing grit.
 - Highway boundary to be indicated by back edgings laid flush or change of material on Private drives.
 - All vertical faces of joints involving flexible materials shall be treated with "Oxy-bit" or other approved joint sealant. This includes ironwork and precast products. Overbanding will not be accepted with Kirkless Council.
 - Do not scale from this drawing.

B	JMG	31.10.24	Dims From BOF to Tank added	MI	MI
A	MD	31.10.24	Amended to Kirkless Council comments	DB	DB
/	MD	08.08.24	Issued for approval	MD	MI
Rev	By	Date	Revision	Chk	Appd

ARP ASSOCIATES
 Chartered Consulting Engineers

Northwest House • 5 & 6 Northwest Business Park • Servia Hill, Leeds • LS6 2QH
 0113 245 8498 • 0113 244 3864 • Leeds@arpassociates.co.uk • www.arpassociates.co.uk

ARP Associates is a trading division of ARP Geotechnical Ltd, a company registered in England and Wales with company number 377831, whose registered office is at 5/6 Northwest Business Park, Servia Hill, Leeds LS6 2QH

TITLE	
SECTION 38 ZONE OF INFLUENCE PLAN	
PROJECT	
PLANE STREET HUDDERSFIELD	
CLIENT	
UNITY HOUSING ASSOCIATION	
DRAWING STATUS	
FOR APPROVAL	
Scale	Date
1:100 @ A1	JUL 24
Drawn	MD
Chk.	MI
Org. No.	Rev
257/05/02.06	B