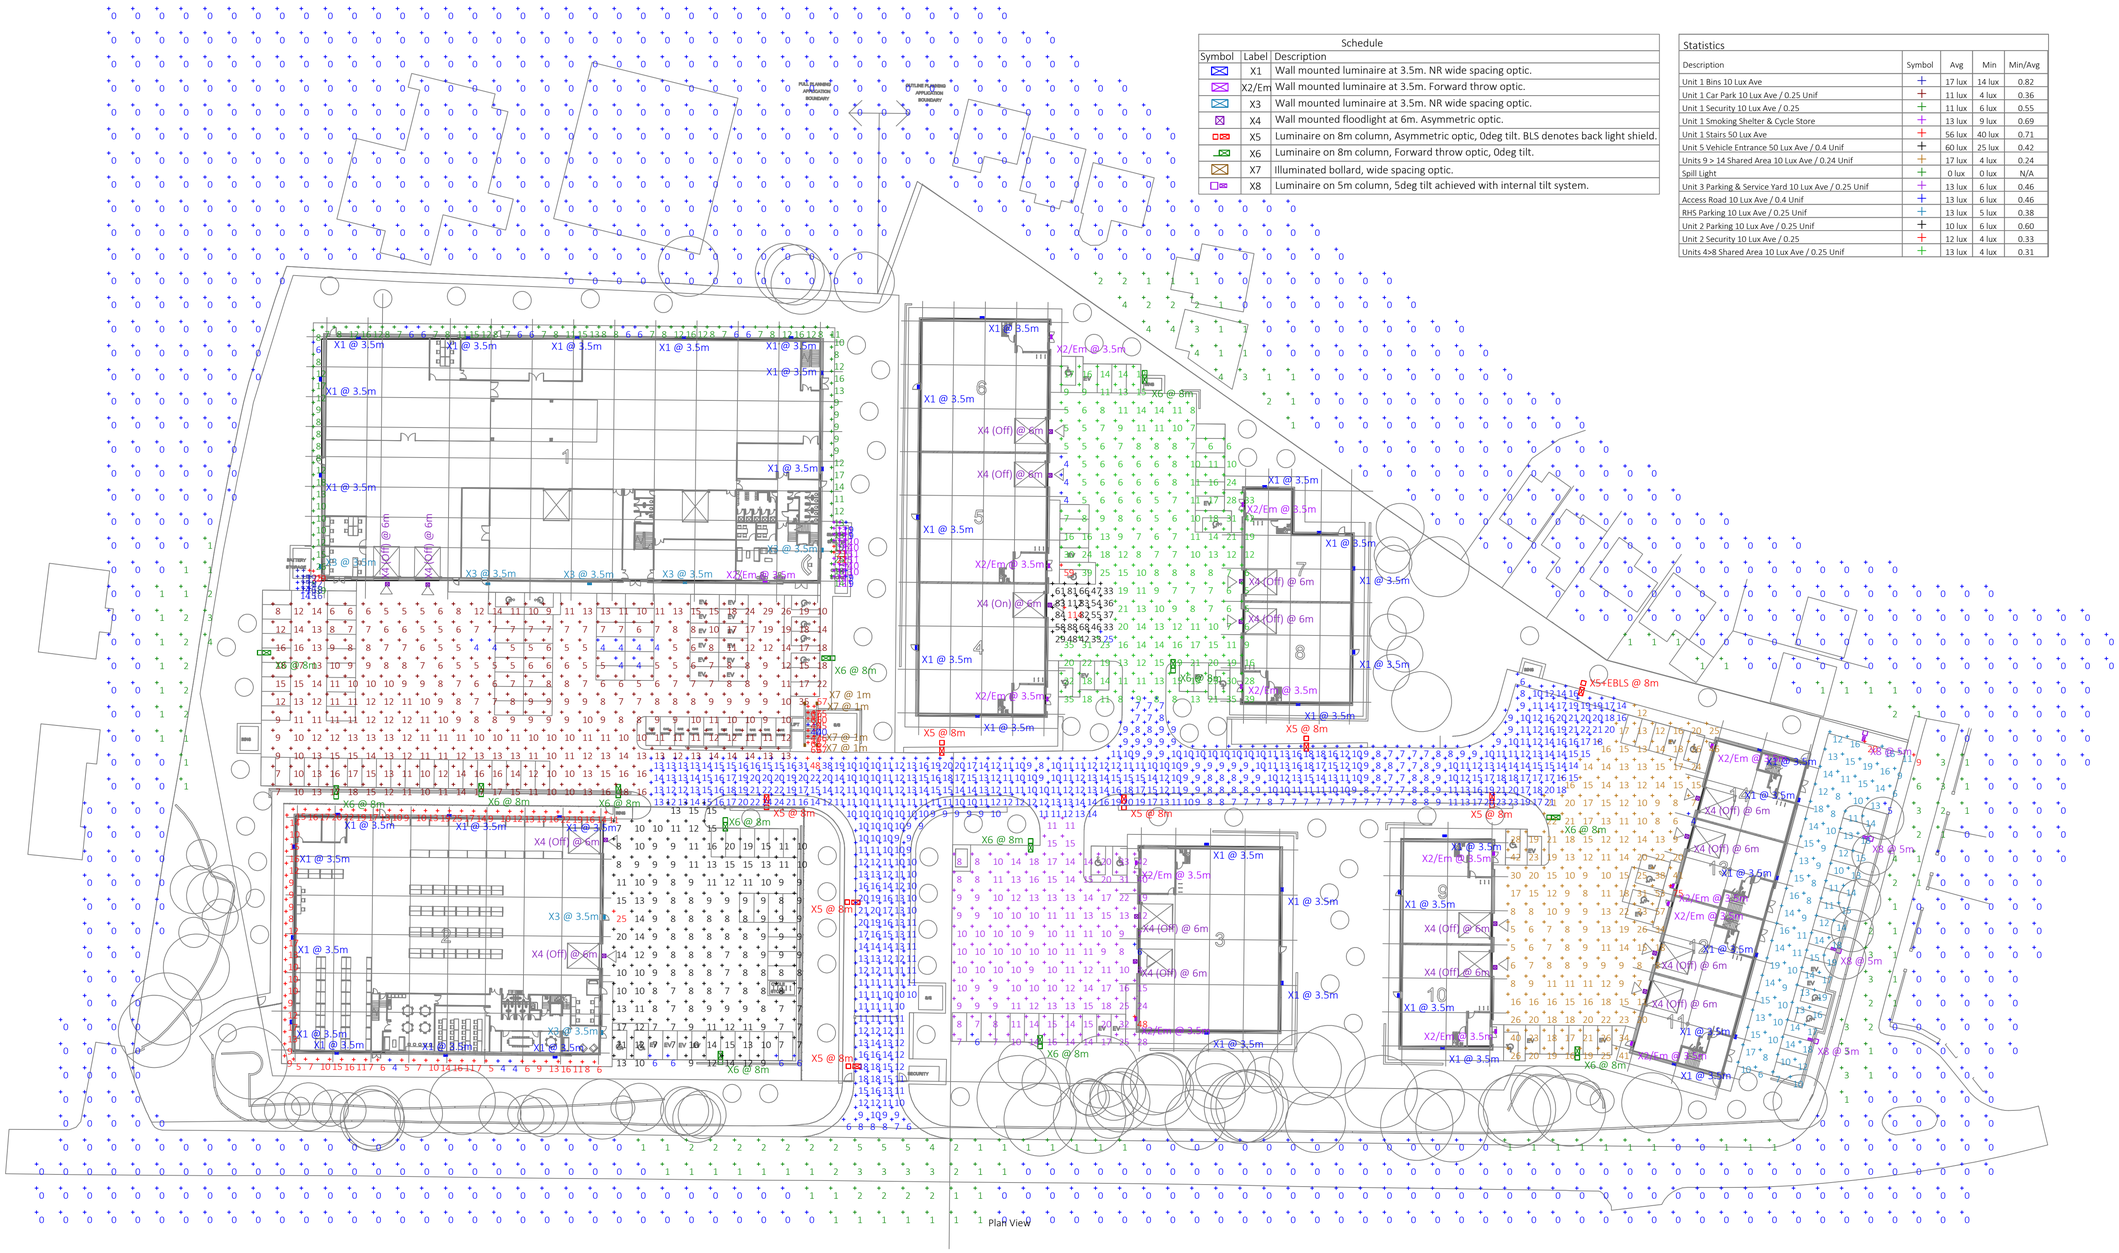

Schedule		
Symbol	Label	Description
	X1	Wall mounted luminaire at 3.5m. NR wide spacing optic.
	X2/Em	Wall mounted luminaire at 3.5m. Forward throw optic.
	X3	Wall mounted luminaire at 3.5m. NR wide spacing optic.
	X4	Wall mounted floodlight at 6m. Asymmetric optic.
	X5	Luminaire on 8m column, Asymmetric optic, 0deg tilt. BLS denotes back light shield.
	X6	Luminaire on 8m column, Forward throw optic, 0deg tilt.
	X7	Illuminated bollard, wide spacing optic.
	X8	Luminaire on 5m column, 5deg tilt achieved with internal tilt system.

Statistics				
Description	Symbol	Avg	Min	Min/Avg
Unit 1 Bins 10 Lux Ave		17 lux	14 lux	0.82
Unit 1 Car Park 10 Lux Ave / 0.25 Unif		11 lux	4 lux	0.36
Unit 1 Security 10 Lux Ave / 0.25		11 lux	6 lux	0.55
Unit 1 Smoking Shelter & Cycle Store		13 lux	9 lux	0.69
Unit 1 Stairs 50 Lux Ave		56 lux	40 lux	0.71
Unit 5 Vehicle Entrance 50 Lux Ave / 0.4 Unif		60 lux	25 lux	0.42
Units 9 > 14 Shared Area 10 Lux Ave / 0.24 Unif		17 lux	4 lux	0.24
Spill Light		0 lux	0 lux	N/A
Unit 3 Parking & Service Yard 10 Lux Ave / 0.25 Unif		13 lux	6 lux	0.46
Access Road 10 Lux Ave / 0.4 Unif		13 lux	6 lux	0.46
RHS Parking 10 Lux Ave / 0.25 Unif		13 lux	5 lux	0.38
Unit 2 Parking 10 Lux Ave / 0.25 Unif		10 lux	6 lux	0.60
Unit 2 Security 10 Lux Ave / 0.25		12 lux	4 lux	0.33
Units 4>8 Shared Area 10 Lux Ave / 0.25 Unif		13 lux	4 lux	0.31

NOTES

1. READ THIS DRAWING IN CONJUNCTION WITH ALL OTHER ARCHITECTS, STRUCTURAL ENGINEERS AND BUILDING SERVICES ENGINEERS DRAWINGS, SPECIFICATIONS AND SCHEDULES.
2. THE CONTRACTOR SHALL NOTE THAT THIS DRAWING IS INDICATIVE AND ILLUSTRATES DESIGN INTENT ONLY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE DETAILED DESIGN AND COORDINATION WITH THE STRUCTURE AND OTHER SERVICES.
3. THE SERVICES CONTRACTOR SHALL BE RESPONSIBLE FOR THE COORDINATION OF HIS WORK WITH ALL OTHER TRADES.

Revision	Description	Author	Checked	Date
P03	FOR PLANNING	DOC	JB	03-09-24

Orbis

TEL: 0113 730 3430
EMAIL: ENQUIRIES@ORBIS.UK.NET

CLIENT
PARK VALLEY
HUDDERSFIELD

PROJECT
BLACKMOORFOOT ROAD,
HUDDERSFIELD

TITLE
EXTERNAL LIGHTING STRATEGY
EXISTING SERVICES

SUITABILITY	SUITABILITY CODE
FOR INFORMATION	S2
ISSUE STATUS	SCALE @ A1
PRELIMINARY	1:500
DRAWING No.	REVISION
W0037-ORB-XX-XX-DR- E -63-00-00	P 03