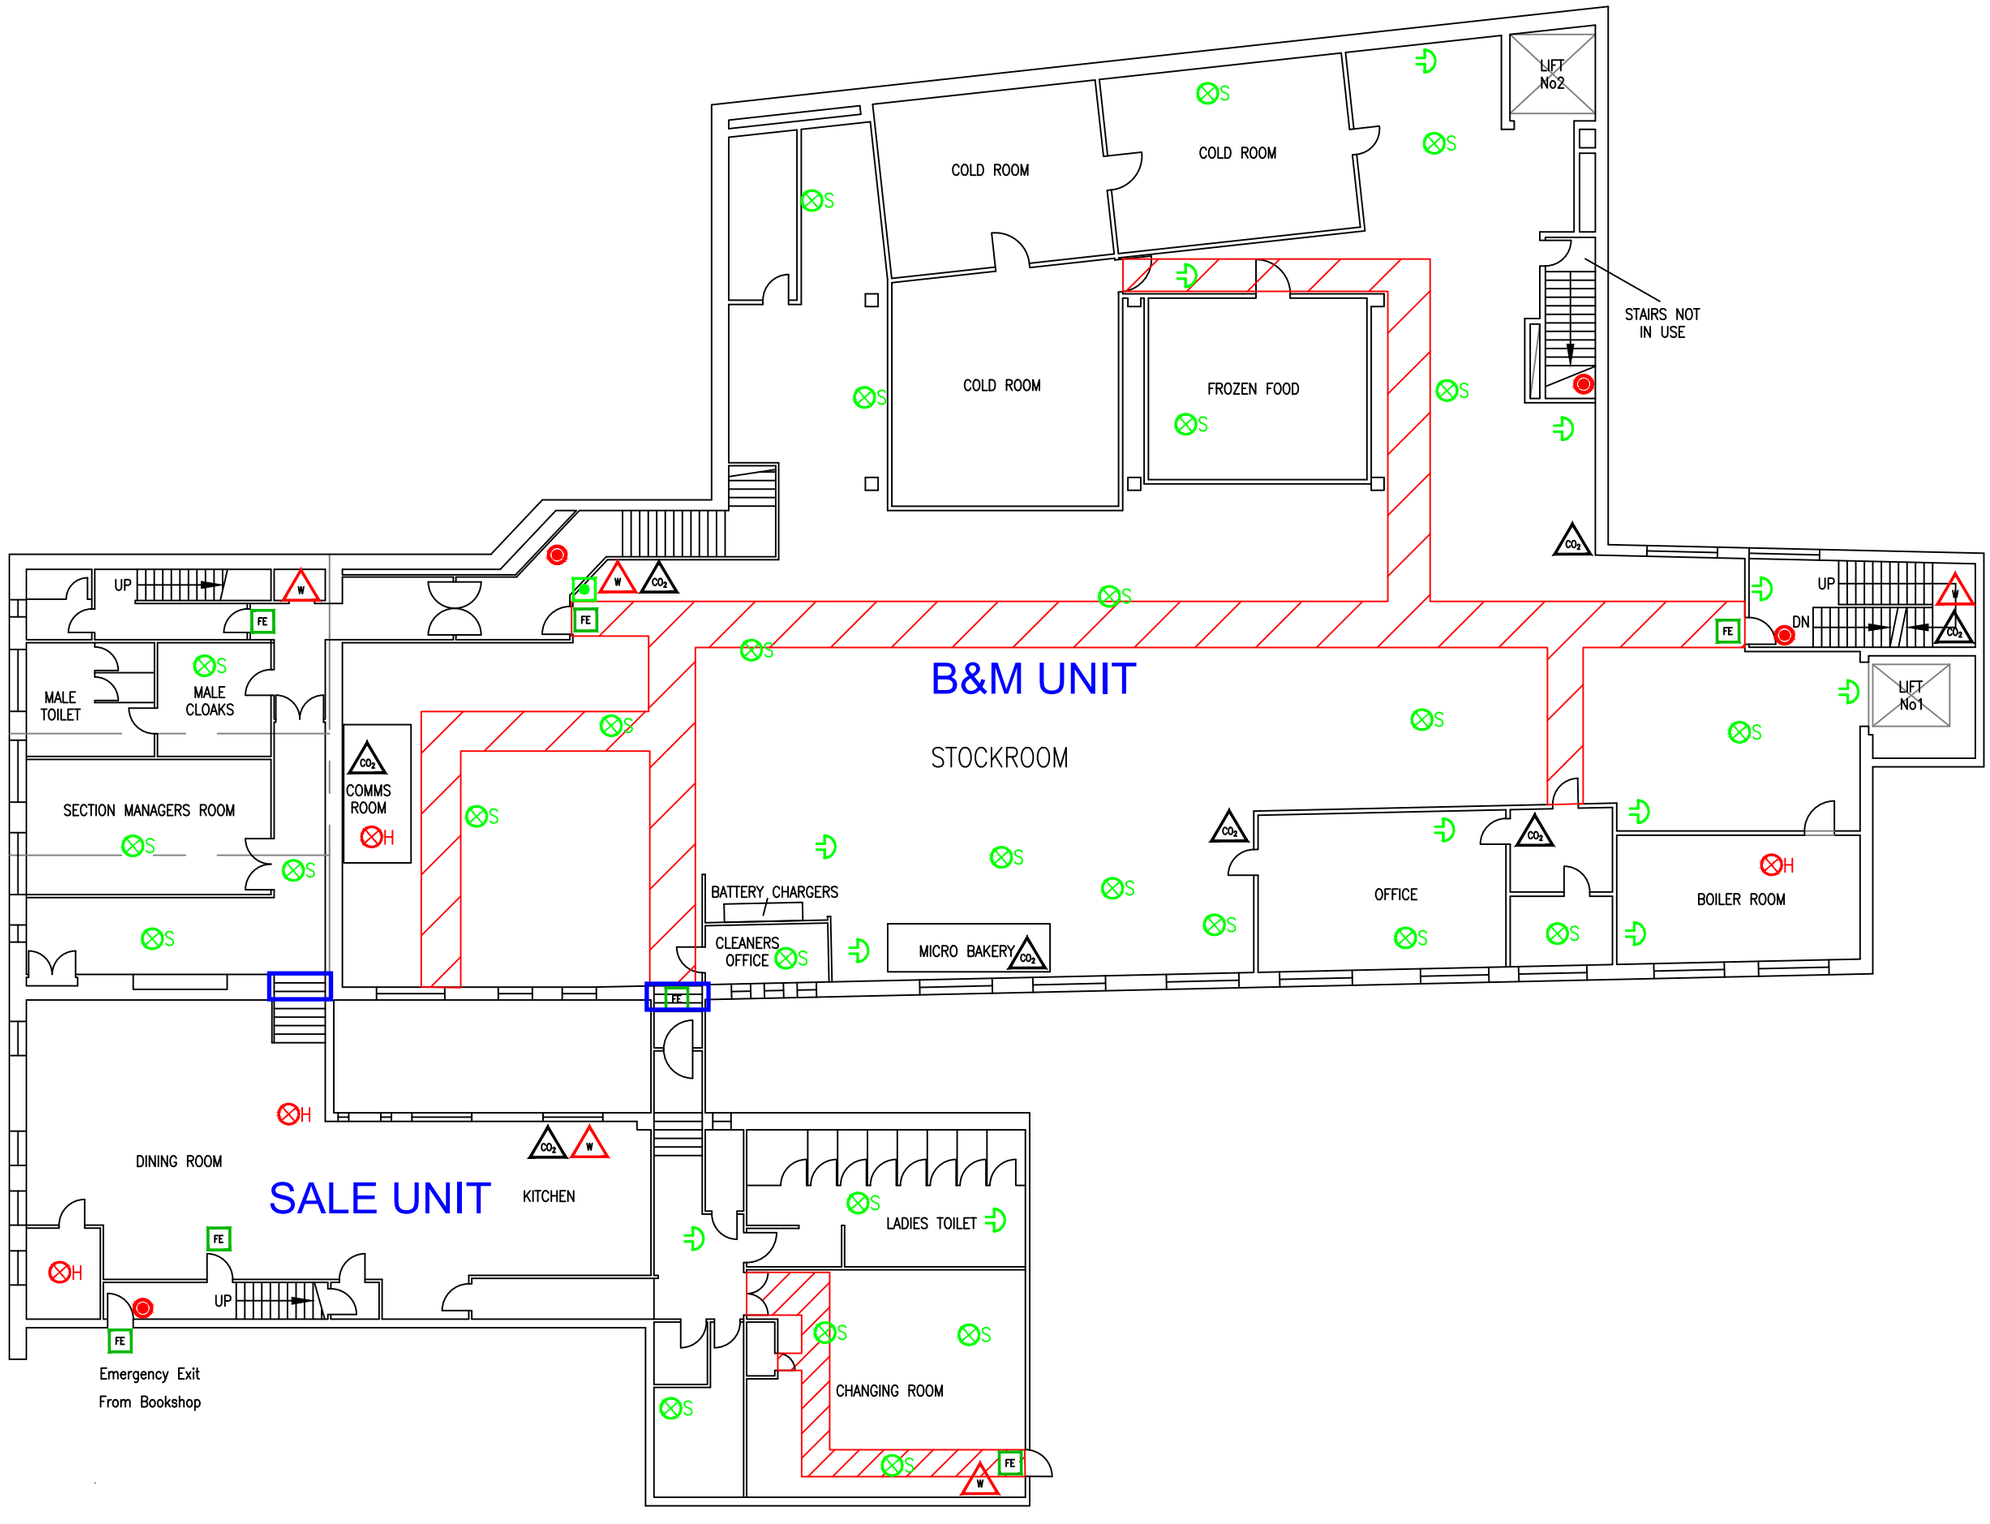


NOTES

ORIGINAL A1

DO NOT SCALE FROM THIS DRAWING.
ALL DIMENSIONS TO BE CHECKED ON SITE.
COPYRIGHT PROTECTED.

Fire Risk Assesment Key Chart

1) All maintenance is completed by a competent contractor and records are held centrally.
2) All store testing routines are held in the opening and closing book
3) All doors and walls to emergency staircases, corridors and partitions are built to minimum of 30 minutes fire resistance.

Equipment		Contractor Maintenance
W	Water Fire Extinguisher	Annual
CO_2	Carbon Dioxide Fire Extinguisher	Annual
DP	Dry Powder Fire Extinguisher	Annual
F	Foam Fire Extinguisher	Annual
FB	Fire Blanket	Annual
FP	Fire Panel	6 Monthly (Eire 4 monthly)
FS	Fire Shutter	Annual or 6 Monthly
FC	Fire Curtain	Annual or 6 Monthly
HR	Hose Reels	Annual or 6 Monthly
DR	Dry Riser	
EL	Emergency Lighting Internal & External	Annual or 5 Monthly
FE	Fire Exit Sign	
	Directional Signage	
	Fire Alarm Call Point	with Fire Panel Maintenance
	Yellow Break Glass Smoke Extract	
	Green Break Glass	
S	Smoke Detectors	6 Monthly (Eire 4 monthly)
H	Heat Detectors	6 Monthly (Eire 4 monthly)
	Sounder	with Fire Panel Maintenance
	Sounder with Beacon	with Fire Panel Maintenance
	Evacuation Chair	

REV	DATE	DESCRIPTION	DRAWN	CHECKED
03	K 07/17	UPDATED AS PER RECEIVED PLANS	IMD	VIC
02	J 08/16	UPDATED AS PER RECEIVED PLANS	IMD	BELH
01	I 08/15	UPDATED AS PER RECEIVED PLANS	IMD	CAH

CLIENT

M&S
FireHealthandSafety@marks-and-spencer.com

PROJECT

Fire Risk Assessment

DRAWING

M&S Huddersfield
First Floor Plan

CONSULTANT

CALLIDUS
CALLIDUS HEALTH & SAFETY
3 LANDMARK COURT
REVIE ROAD
LEEDS, LS11 8JT
TEL: 0113 385 2740

CONSULTANT No	SCALE	DATE	DRAWN	CHECKED
1672	NTS	12/07/2017	VIC	

PROJECT No	DISCIPLINE	DRAWING No	STATUS	REV
1672		1672-1		K

NB
DRAWINGS BASED ON SCANNED ORIGINAL DRAWINGS ONLY. NOT A DIGITAL SURVEY
ALL DIMENSIONS TO BE SITE CHECKED