Planning condition 14 - Electric car charging

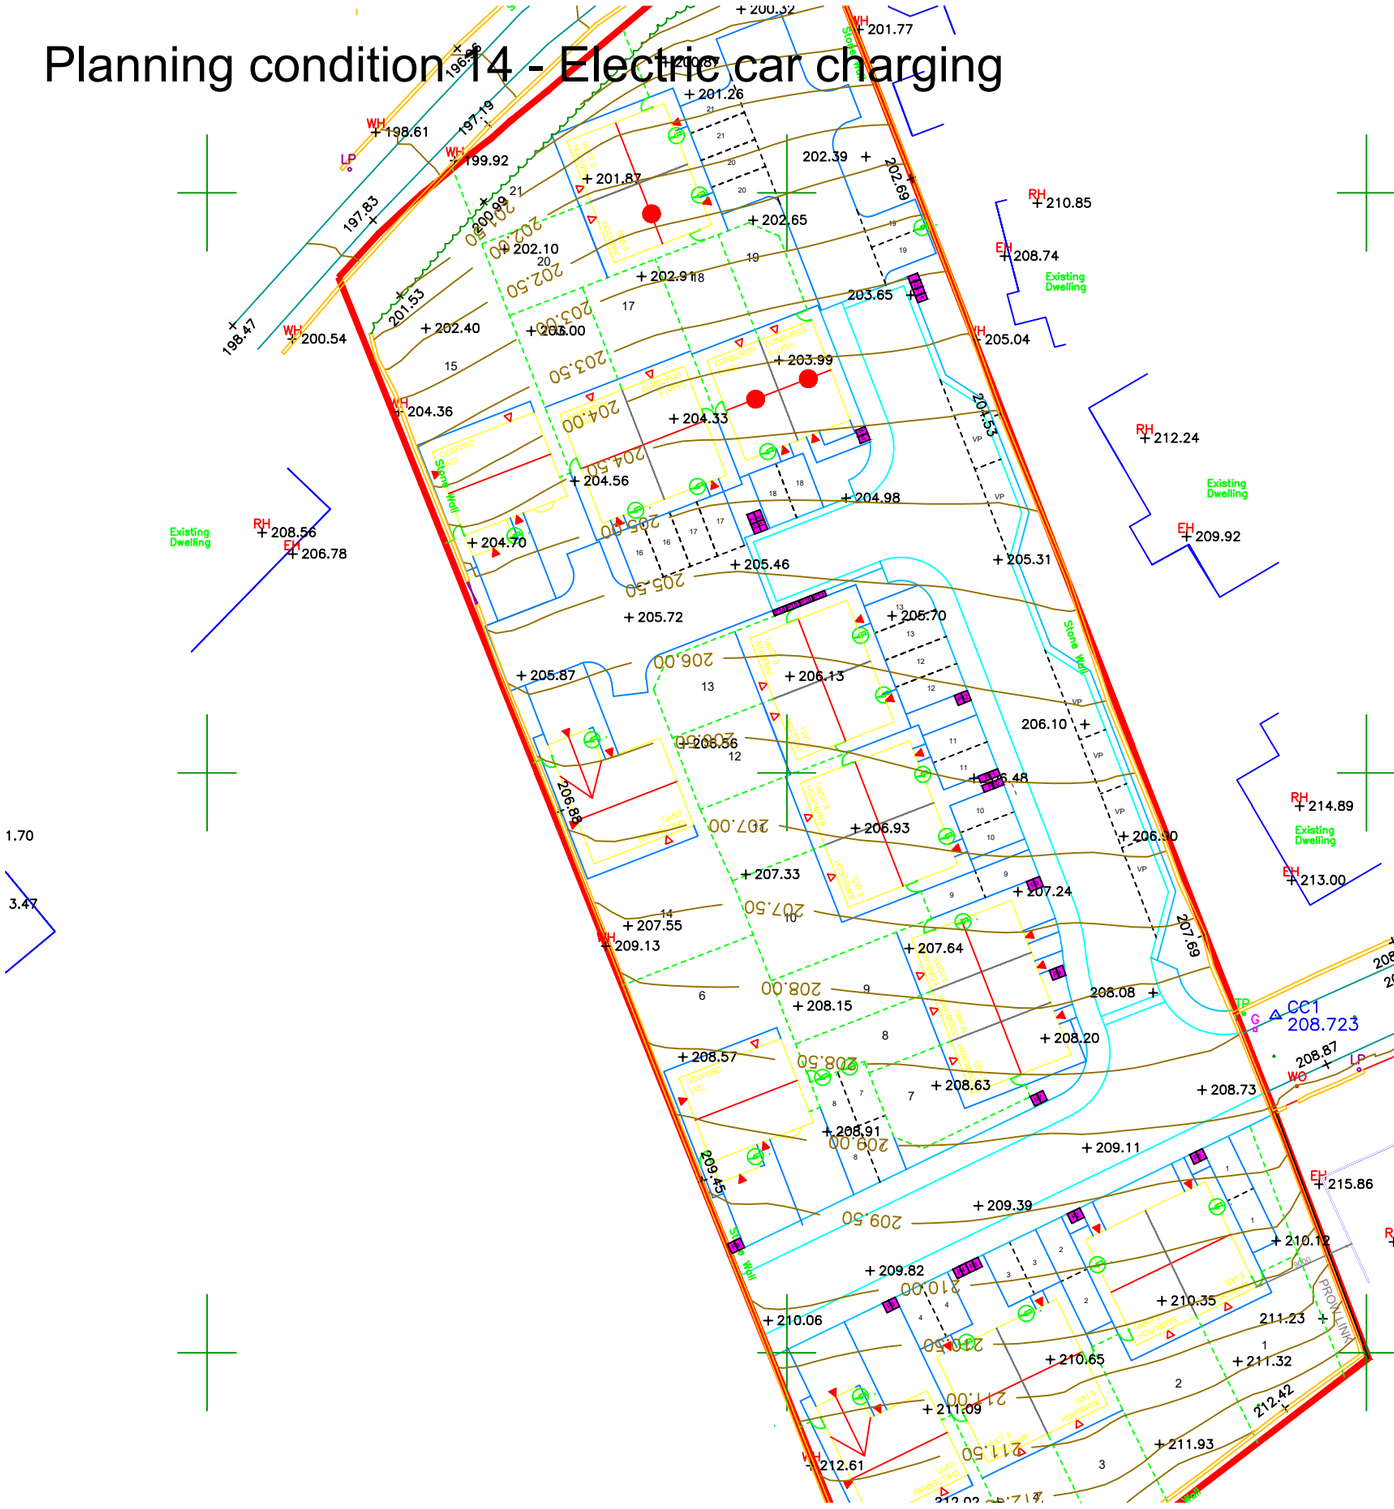

Provision and location of "Mode 3" electric car chargers fixed to dwelling
Specification to be Project EV EVA-07S-S

NOTE: The cable and circuitry ratings for the EVCP shall be of adequate size to ensure a minimum continuous current demand of 16Amps and a maximum demand of 32Amps.

N

Revision notes:		
Rev:	Date:	Notes:
A	02.04.25	Note regarding cabling and circuitry added - CD

Revision notes:		
Rev:	Date:	Notes:
..	..	..

Revision notes:		
Rev:	Date:	Notes:
..	..	..

Date: 28.01.25	Project: Bankfield Drive, Holmebridge
Scale @ A3: NTS	Drawing Number: 2405-03-006 Electric car charging plan
Drawn By: CD	Revision: A

OrionHomes
SO GOOD TO COME HOME TO
Unit 5, Benton Office Park, Bennett Avenue, Horbury, Wakefield, WF4 5RA, Tel: 01924 831030