



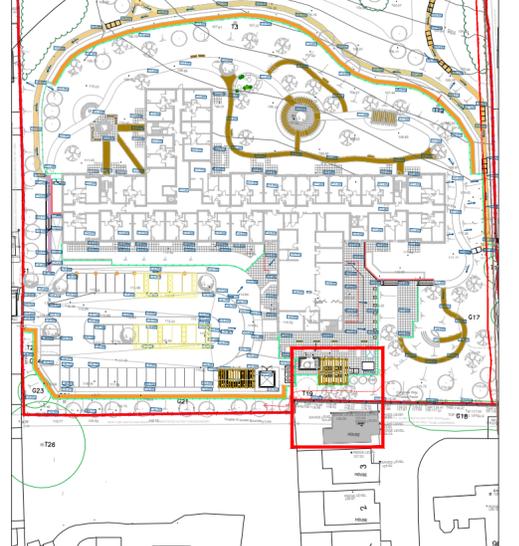


Suitability Code: S3
For COMMENT

4NO ASHP UNITS
REFER TO OPTION 2 OF THE ACOUSTIC REPORT
ASHP UNITS TO BE FITTED WITH AMBIENT
ACOUSTICS "CAHV-R450YA-HPB BOLT-ON
ACOUSTIC KIT"
HEIGHT OF THE COMPOUND WALL TO BE 2.8M

PROPOSED HEAVY STANDARD TREES
(12-14 GIRTH, 4.25-6.00M HEIGHT)

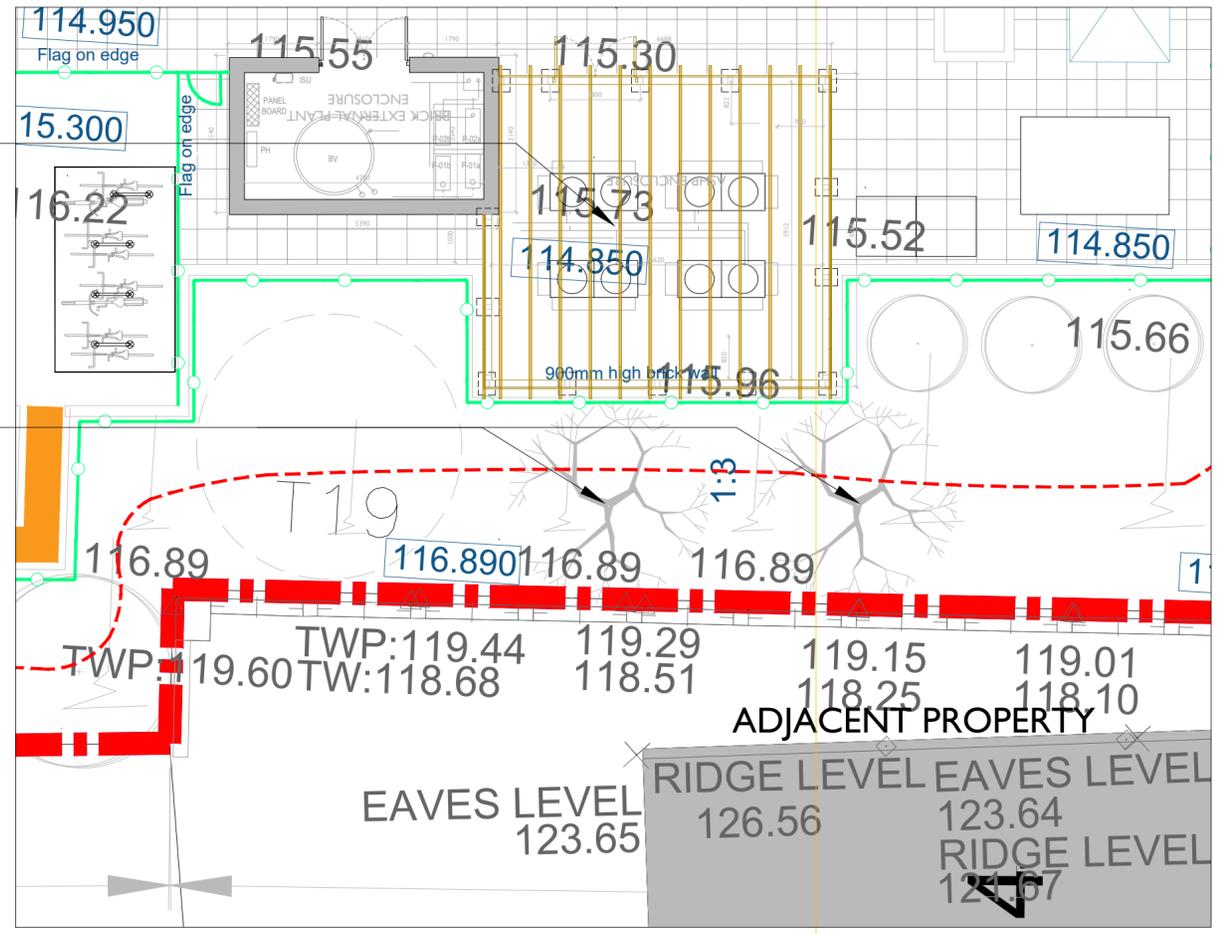

Site Plan Showing Location - NTS

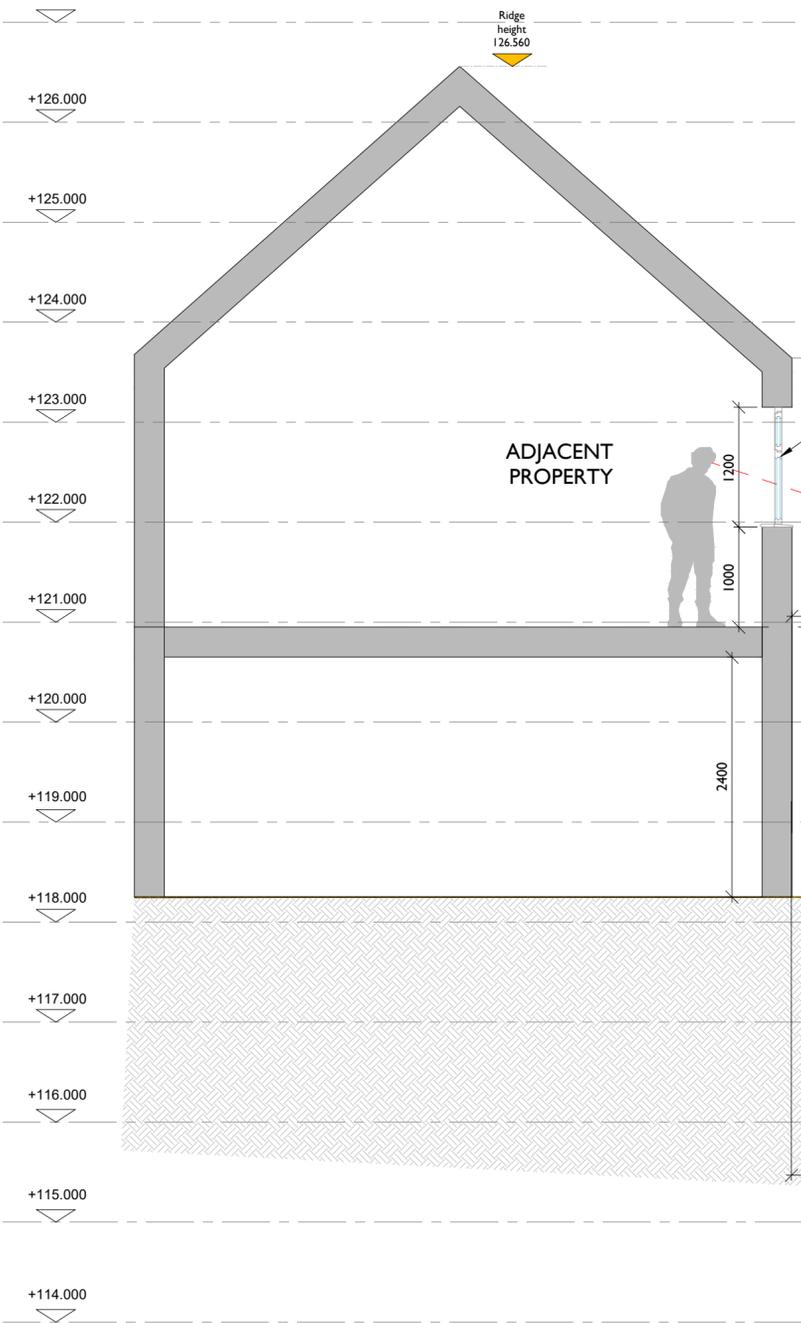

P04	SECTION LINE LOCATION ALTERED, DIMENSIONS ADDED AND ASHP'S INDICATED WITHIN ENCLOSURE	13.06.25	RB
P03	DRAWING UPDATED TO SHOW ASSUMED WINDOW POSITION OF HOUSE	11.03.25	SA
P02	PLANT UPDATED TO ACOUSTIC REPORT	11.03.25	SA
P01	FIRST ISSUE	06.03.25	SA
REV	COMMENT	DATE	DR CH

THIS DESIGN IS COPYRIGHT ©



5 NORTH HILL ROAD, LEEDS, HEADINGLEY, LS6 2EN
T: 0113 2754000
info@brewsterbye.co.uk www.brewsterbye.co.uk



JOB TITLE
PROPOSED EXTRA CARE
KENMORE DRIVE, CLECKHEATON

PLANT & ASHP ENCLOSURE
SITE SECTION

Drawn: SA Scale: 1:20 @ A2
Date: MAR 2025 Checked:

DWG NO	REV
CLK-BBA-XX-ZZ-DR-A-90-SK016	P04

SECTION THROUGH ASHP ENCLOSURE AND ADJACENT PROPERTY - Scale 1:50