

DESIGNERS HAZARD IDENTIFICATION
 IT IS ASSUMED THAT ALL WORKS WILL BE UNDERTAKEN BY A COMPETENT CONTRACTOR WORKING WHERE APPROPRIATE TO AN APPROVED METHOD STATEMENT. IN ADDITION TO THE HAZARDS TYPICALLY ASSOCIATED WITH THE TYPE OF CONSTRUCTION DETAILED ON THIS DRAWING, ANY KNOWN ABNORMAL HAZARDS SPECIFIC TO THIS SCHEME HAVE BEEN IDENTIFIED.



NOTES

- DO NOT SCALE FROM THIS DRAWING.
- IF ANY DISCREPANCIES ARE FOUND IN THIS DRAWING, PLEASE REPORT TO DUDLEYS CONSULTING ENGINEERS.
- ALL WORK TO BE UNDERTAKEN IN ACCORDANCE WITH THE CURRENT EDITION OF THE BUILDING REGULATIONS, SEWERAGE SECTOR CODES OF PRACTICE, AND THE RELEVANT LOCAL HIGHWAY AUTHORITY STANDARDS.

YORKSHIRE WATER NOTES:


- ALL ADAPTABLE SEWER WORKS AND MATERIAL TO BE IN ACCORDANCE WITH CODE FOR ADOPTION. THE RELEVANT BRITISH/EUROPEAN AND YORKSHIRE WATERS STANDARDS/REQUIREMENTS/ADDENDUM TO THE MECHANICAL AND ELECTRICAL SPECIFICATION AND KITEMARKED.
- MANHOLE COVERS SHALL/MUST HAVE A CLEAR OPENING OF 600mm AND SHALL BE CLASS D400 TO BS EN 124 WITH 150mm DEEP FRAMES IN HIGHWAYS.
- FILLED GROUND MUST BE FILLED AND CONSOLIDATED UNDER THE SUPERVISION AND TO THE SATISFACTION OF YORKSHIRE WATER BEFORE ANY SEWER WORKS ARE CARRIED OUT.
- YORKSHIRE WATER IS NOT OBLIGED TO ACCEPT FILTER DRAIN/LAND DRAINAGE RUN-OFF INTO THE PUBLIC SEWER NETWORK OR ADAPTABLE DRAINAGE SYSTEM (DIRECTLY OR INDIRECTLY). AN ALTERNATIVE METHOD OF DISPOSAL OF THE LAND DRAINAGE RUN-OFF WILL THEREFORE BE REQUIRED AND YOU WILL HAVE TO LIAISE WITH THE LOCAL AUTHORITY. LAND DRAINAGE SECTION REGARDING THE DISPOSAL OF THE FILTER DRAIN/LAND DRAINAGE RUN-OFF. THE ADAPTABLE SEWERS SHOULD BE A MINIMUM OF 1m AND MANHOLES 0.5m FROM KERB FACES AND SERVICE MARKINGS.
- SEWERS MUST HAVE 5m CLEARANCE FROM TREES AND HEDGES OR THE WIDTH OF THE CANOPY AT MATURE HEIGHT.
- SEWERS TO BE LAID IN CLASS "S" BEDDING (150mm GRANULAR BED AND SURROUND), WHERE DEPTH OF COVER TO TOP OF THE SEWER IS LESS THAN 1.2m IN HIGHWAYS AND VERGES (OR LESS THAN 900mm IN NONVEHICULAR ACCESS AREAS) THEN A CONCRETE SLAB SHOULD BE PROVIDED ABOVE GRANULAR BED AND SURROUND.
- BEDDING AND BACKFILL MATERIAL TO CONFORM TO THE REQUIREMENT OF WATER INDUSTRY SPECIFICATION 4-08-02 (TABLE A2).
- YORKSHIRE WATER POLICY IS THAT TYPE "C" BRICK MANHOLES AND 1050mm DIA. MANHOLE RINGS ARE NOT PREFERRED. INSTEAD IT IS PREFERRED THAT YOU USE A TYPE "B" MANHOLE WITH 1200mm DIA OR 1500mm DIA RINGS, WITH THE OPENING SITED OVER THE CHANNEL WHERE DEPTH OF COVER TO PIPE SOFFIT IS 1 - 1.5m.
- ADAPTABLE PLASTIC SEWER PIPES TO BE BS1 KITEMARKED (CERTIFIED TO WIS 4-35-01 AND BS EN 13476). ADAPTABLE PLASTIC SEWER PIPES TO BE LAID IN MAXIMUM 5m LENGTHS UNLESS THERE IS A SPECIFIC OPERATIONAL NEED TO LAY LONGER LENGTHS. PLASTIC CHANNEL SECTIONS IN MANHOLES ARE NOT ACCEPTABLE AND YORKSHIRE WATER WOULD REQUIRE CLAY WARE CHANNEL IN MANHOLES.
- THE MINIMUM CRUSHING STRENGTH FOR CLAY PIPES SHOULD BE AS FOLLOWS: 100mm DIA. 40kN/m, 150mm DIA. 40kN/m, 225mm DIA. 45kN/m AND 300mm DIA. 72kN/m. THE MINIMUM CRUSHING STRENGTH FOR CONCRETE PIPES SHOULD BE - (CLASS 120 TO EN 1916/BS5911-1:2002). PLASTIC PIPES SHOULD CONFORM TO WIS 4-35-01 AND BS EN 13476.
- WHERE A B125 COVER AND FRAME HAS BEEN APPROVED, THIS MUST NOT BE COATED IN PLASTIC AND MUST HAVE LIFTING EYES SUITABLY SIZED TO ACCOMMODATE STANDARD LIFTING KEYS. SCREW DOWN COVERS ARE NOT ACCEPTABLE.
- THERE MUST BE ENOUGH CLEARANCE AT CROSSOVERS TO ACCOMMODATE BEDDING TO BOTH PIPES, APPROX. 300mm. IF CROSSOVER IS NEAR THE ROCKER THEN THE CLEARANCE NEEDED MAY NEED TO BE INCREASED.

KIRKLEES COUNCIL NOTES

- ALL PRECAST CONCRETE ELEMENTS, INCLUDING COVER SLABS, TO BE IN ACCORDANCE WITH THE SEWERAGE SECTOR GUIDANCE APPENDIX C CLAUSES E2.29 AND E2.30 AND TO HAVE A CONCRETE DESIGN CHEMICAL CLASS OF DC-4.
- PCC COVER SLABS TO HAVE A MINIMUM OF 300mm COVER.


Typical Widewall Manhole Construction
 Type A Alternative Wide Wall Manhole Type C (Design and Construction Guidance)

For use on manholes of depth from cover level to soffit level between 3000mm and 6000mm. Wide wall manhole ring construction

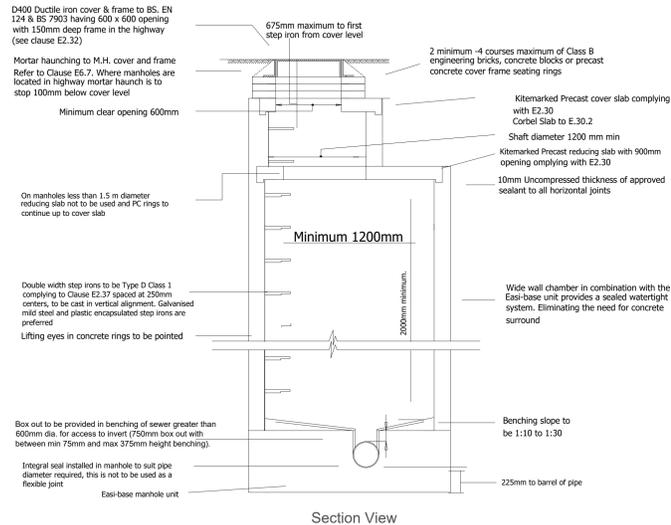


Typical Widewall Manhole Construction
 Alternative Wide Wall Manhole Type C (Design and Construction Guidance)

Maximum depth from cover level to soffit of pipe 3000mm Wide wall manhole ring construction

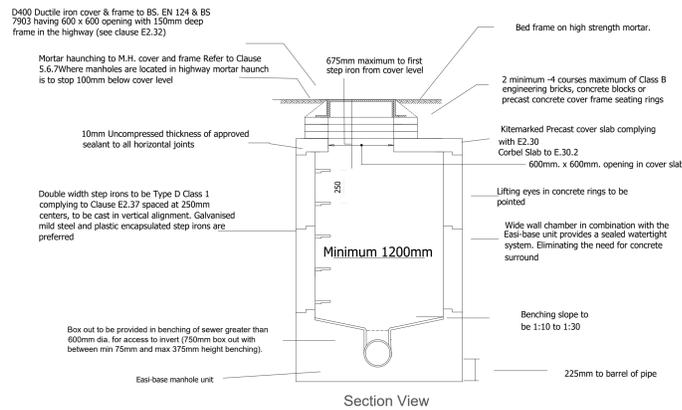


Shallow Manhole Construction
 Type C (Design and Construction Guidance)


Construction of manhole where depth from soffit to cover level less than 1500mm

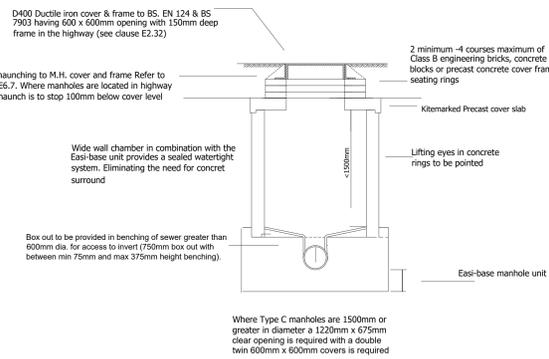

Typical Widewall Manhole Plan View
 Type C (Design and Construction Guidance)

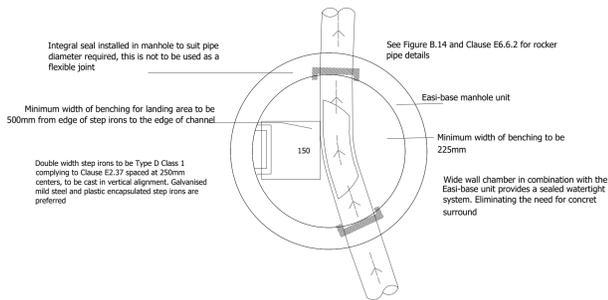

Shallow Widewall Manhole Plan View
 Type C (Design and Construction Guidance)

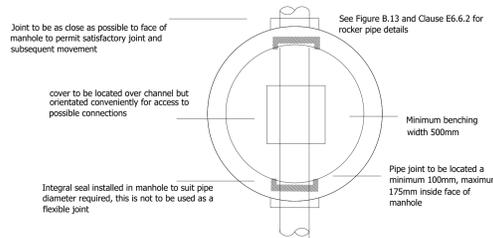

Manhole Diameters	
Nominal internal diameter of largest pipe in manhole (mm)	Minimum nominal internal dimension of manhole (mm)
Up to 300	1200
375-450	1350
500-700	1500
750-900	1800
Greater than 900	Specific detailed drawing required

PLEASE NOTE WHERE MANHOLES HAVE BACKDROP CONNECTIONS A FULL 150MM CONCRETE SURROUND TO THE MANHOLE IS REQUIRED

DATE	REVISION DESCRIPTION	BY	CHK.	REV.
10.01.25	PRELIMINARY ISSUE		OB	JA P01



PROJECT
**HEALEY LANE
 BATLEY, WF17 8BN**

TITLE
**DRAINAGE CONSTRUCTION
 DETAILS SHEET 2**

SCALE	PAPER	STAGE	STATUS
1:10	A0	PRELIMINARY	

DRAWING NO.	REV.
24106-DCE-XX-XX-D-C-126	P01