


RETAINING WALL 1 (4.2m)

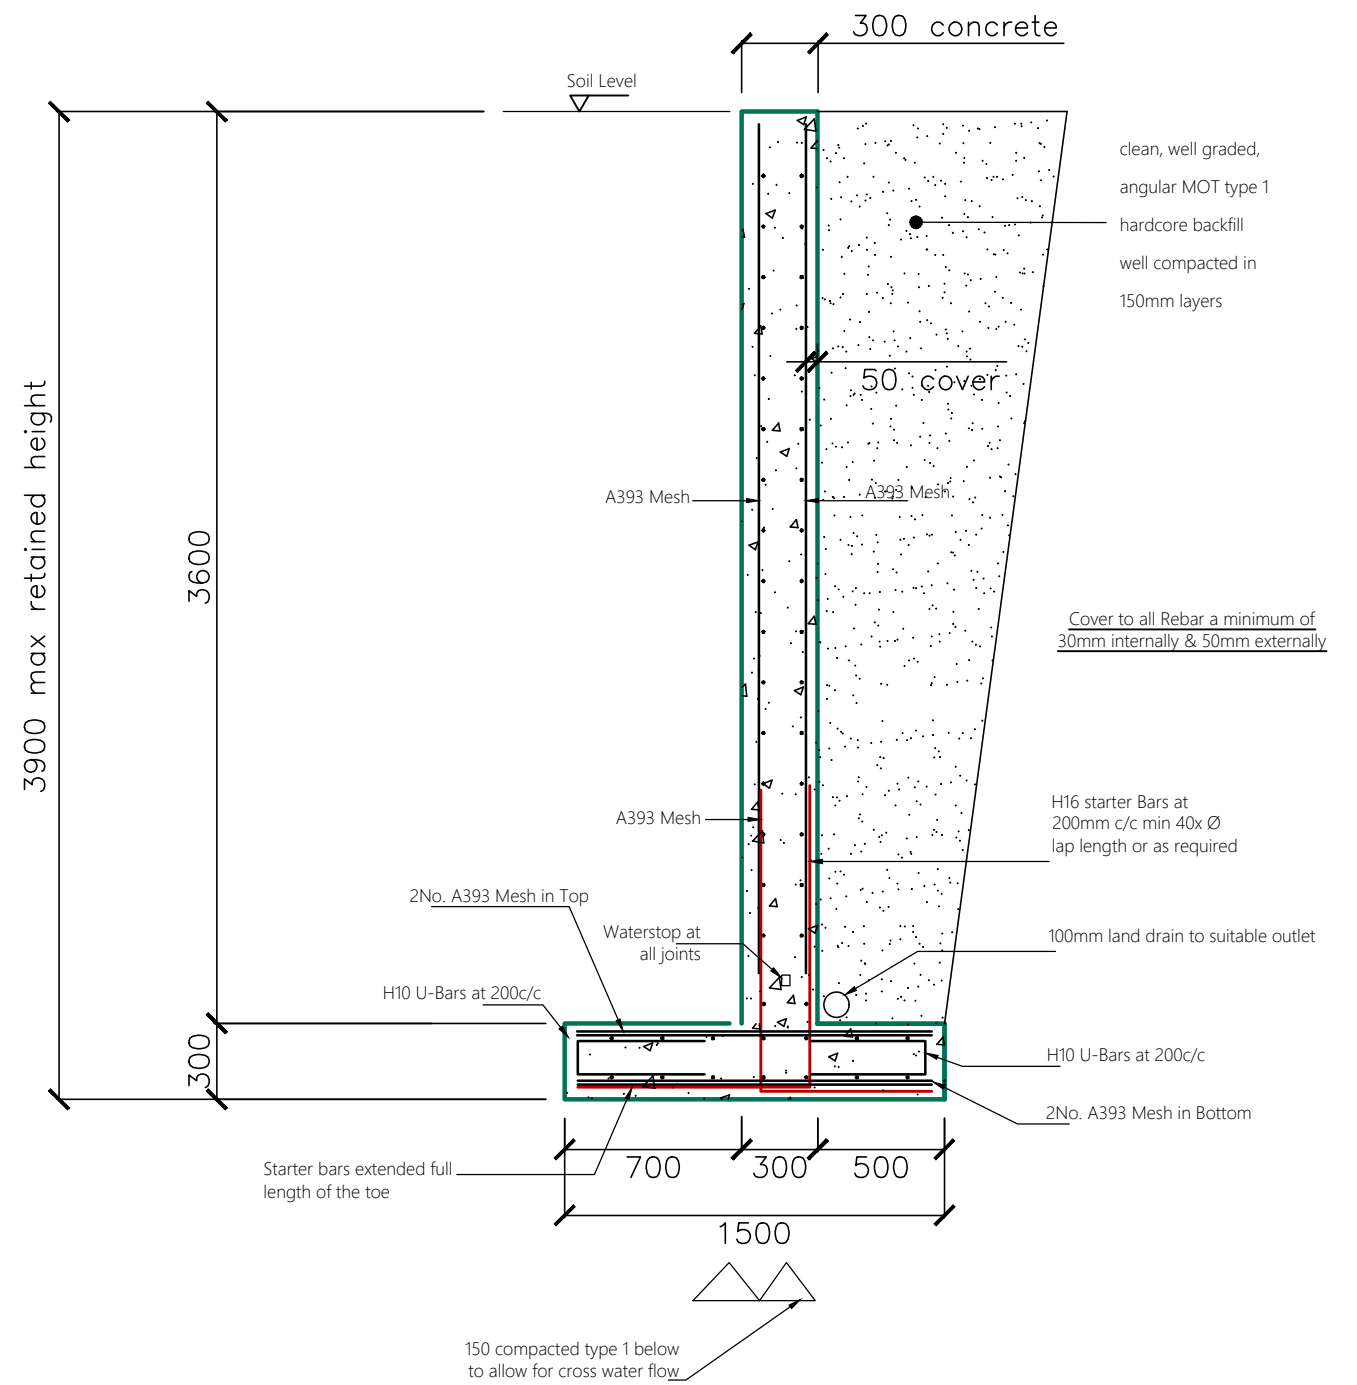

RETAINING WALL 2 (3.6m)

Notes:

1. All concrete grade C35 minimum.
2. All re-bar cover 35mm unless noted otherwise.
3. 100mm perforated drain behind wall encased in free draining material taken to suitable outlet.
4. All temporary shoring works are the responsibility of the main contractor.
5. Bituthene, or similar, protective DPM required behind retaining wall to prevent blockwork perishing.
6. All tanking, DPM and insulation to architects details.
7. All block work minimum 7.3 n/mm² compressive strength.

Rev	Date	by	Amendments
02	28/05/25	BRR	Second Issue
01	07/05/25	BRR	First Issue

Job Number 11302	Dwg Number SK-01
Scale 1:30 @A3	Rev 01
By BRR	Approved by DSH

Richard & Lisa Murgatroyd
 38 Longwood Gate
 RETAINING WALL
 Issued for **INFORMATION ONLY**

MarshDesignLtd
 STRUCTURAL ENGINEERS
 01484 341426
 www.marshdesign.co.uk