MITSUBISHI HEAVY INDUSTRIES AIR CONDITIONING EUROPE





FDTC25VH1 / SRC25ZS-W2

2.5 (0.9~ 3.2)

Indoor Unit : FDTC25VH1

Outdoor Unit : SRC25ZS-W2

R32

Specifications


Indoor unit				FDTC25VH1
Outdoor unit				SRC25ZS-W2
Power source				1Phase, 220 - 240, 50Hz
Nominal cooling capacity (Min~Max)			kW	2.5 (0.9~ 3.2)
Nominal heating capacity (Min~Max)			kW	2.9 (0.9 ~ 4.0)
Power consumption		Cooling/Heating	kW	0.61 / 0.71
EER/COP		Cooling/Heating		4.10 / 4.08
Max. running current			A	9
Sound power level	Indoor	Cooling/Heating	dB(A)	51 / 52
	Outdoor	Cooling/Heating		58 / 59
Sound pressure level	Indoor	Cooling (Hi/Me/Lo/Ulo)		38 / 34 / 30 / 27
		Heating (Hi/Me/Lo/Ulo)		39 / 36 / 32 / 28
	Outdoor	Cooling/Heating		47 / 47
Air flow	Indoor	Cooling (Hi/Me/Lo/Ulo)	m3/min	8.5 / 7.5 / 7.0 / 6.0
		Heating (Hi/Me/Lo/Ulo)		9.5 / 8.5 / 7.5 / 6.5
	Outdoor	Cooling/Heating		27.4 / 27.4
Exterior Dimensions	Indoor	Height x Width x Depth	mm	Unit : 248 x 570 x 570 Panel : 10 x 620 x 620
	Outdoor			540 x 780(+62) x 290
Net weight	Indoor / Outdoor		kg	16.0 (Unit : 13.5 Panel : 2.5) / 31.0
Refrigerant		Type/GWP		R32/675
Refrigerant		Charge	kg/TCO2Eq	0.62 / 0.419
Refrigerant piping size		Liquid/Gas	ø mm	6.35(1/4") / 9.52(3/8")
Refrigerant line (one way) length			m	Max. 20
Vertical height differences		Outdoor is higher/lower	m	Max. 10 / Max.10
Outdoor operating temperature range		Cooling	°C	-15~46
		Heating		-15~24
Panel				TC-PSA-5AW-E, TC-PSAE-5AW-E (Honeycomb) / TC-PSAG-5AW-E, TC-PSAGE-5AW-E (Grid)
Energy Class (Cooling/Heating)				A++/A+
SEER				6.80
SCOP (Average climate)				4.00
Pdesign (cooling/heating(@-10°C))			kW	2.50/2.40
Annual Electricity Consumption (cooling/heating)			kWh/a	129/840
Designated Heating Season				Average

• The data is measured under the following conditions(ISO-T1, H1). Cooling: Indoor temp. of 27°CDB, 19°CWB, and outdoor temp. of 35°CDB. Heating: Indoor temp. of 20°CDB, and outdoor temp. of 7°CDB, 6°CWB.
• Sound level indicates the value in an anechoic chamber. During operation these values are somewhat higher due to ambient conditions.
• 'tonne(s) of CO2 equivalent' means a quantity of greenhouse gases- expressed as the product of the weight of the greenhouse gases in metric tonnes and of their global warming potential.
*SEER/SCOP are based on EN14825:2016 and Commission regulation (EU) No.2016/2281

Because of our policy of continuous improvement, we reserve the right to make changes in all specifications without notice.


Schematics

4-way ceiling cassette type (FDTC)
FDTC25VH1, 35VH1

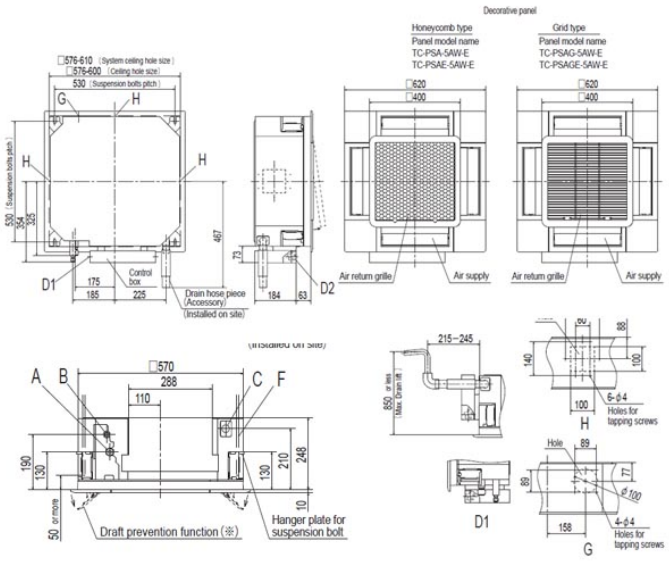

Notes (1) The model name label is attached to the control box lid.
(2) This unit is designed for 2×2 grid ceiling.
If it is installed on a ceiling other than 2×2 grid ceiling, provide an inspection opening on the control box side.
(3) Draft prevention function (※) is provided on the panel TC-PSA(G)E-5AW-E only.


Symbol	Content	
A	Gas piping	ϕ9.52 (3/8") (Flare)
B	Liquid piping	ϕ6.35 (1/4") (Flare)
C	Drain piping	VP25 (O.D.32)
D1	Power supply connection	
D2	Remote control code and signal wiring connection	
F	Suspension bolts	(M10 or M8)
G	Outside air opening for ducting	(Knock out)
H	Air outlet opening for ducting	ϕ125 (Knock out)
J	Inspection opening	450×450

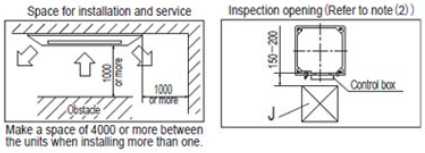


Outdoor units
SRC25ZS-W1, W2
SRC35ZS-W1, W2


	Installation space
L1	280 or more
L2	100 or more
L3	80 or more
L4	250 or more

Symbol	Content	
A	Service valve connection (gas side)	ϕ9.52 (3/8") (Flare)
B	Service valve connection (liquid side)	ϕ6.35 (1/4") (Flare)
C	Pipe/cable draw-out hole	
D	Drain discharge hole	ϕ20×2 places
E	Anchor bolt hole	M10-12×4 places

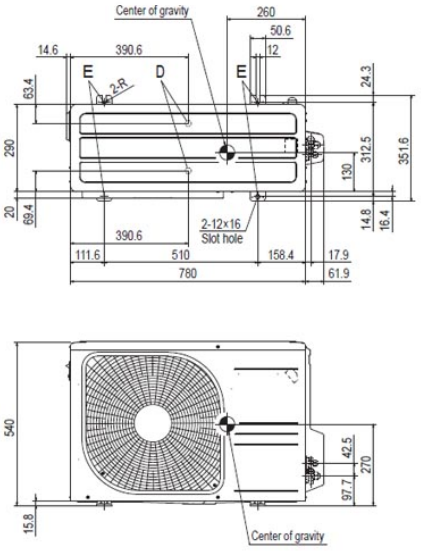



Notes (1) The unit must not be surrounded by walls on the four sides.
(2) The unit must be fixed with anchor bolts. An anchor bolt must not protrude more than 15mm.
(3) If the unit is installed in the location where there is a possibility of strong winds, place the unit such that the direction of air from the outlet gets perpendicular to the wind direction.
(4) Leave 200mm or more space above the unit.
(5) The wall height on the outlet side should be 1200mm or less.
(6) The model name label is attached on the right side of the unit.

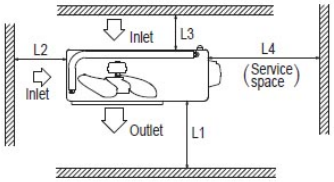

Because of our policy of continuous improvement, we reserve the right to make changes in all specifications without notice.