


This plan is for Quotation purposes only and shall not be used to set anyone to work
 Please note this cable route is not guaranteed and is subject to 3rd Party Consent from Network Rail

Northern Powergrid to excavate and reinstate within 3rd party land

The customer will be required to excavate and reinstate within their own boundary **A to B** and provide suitable cable access within the building

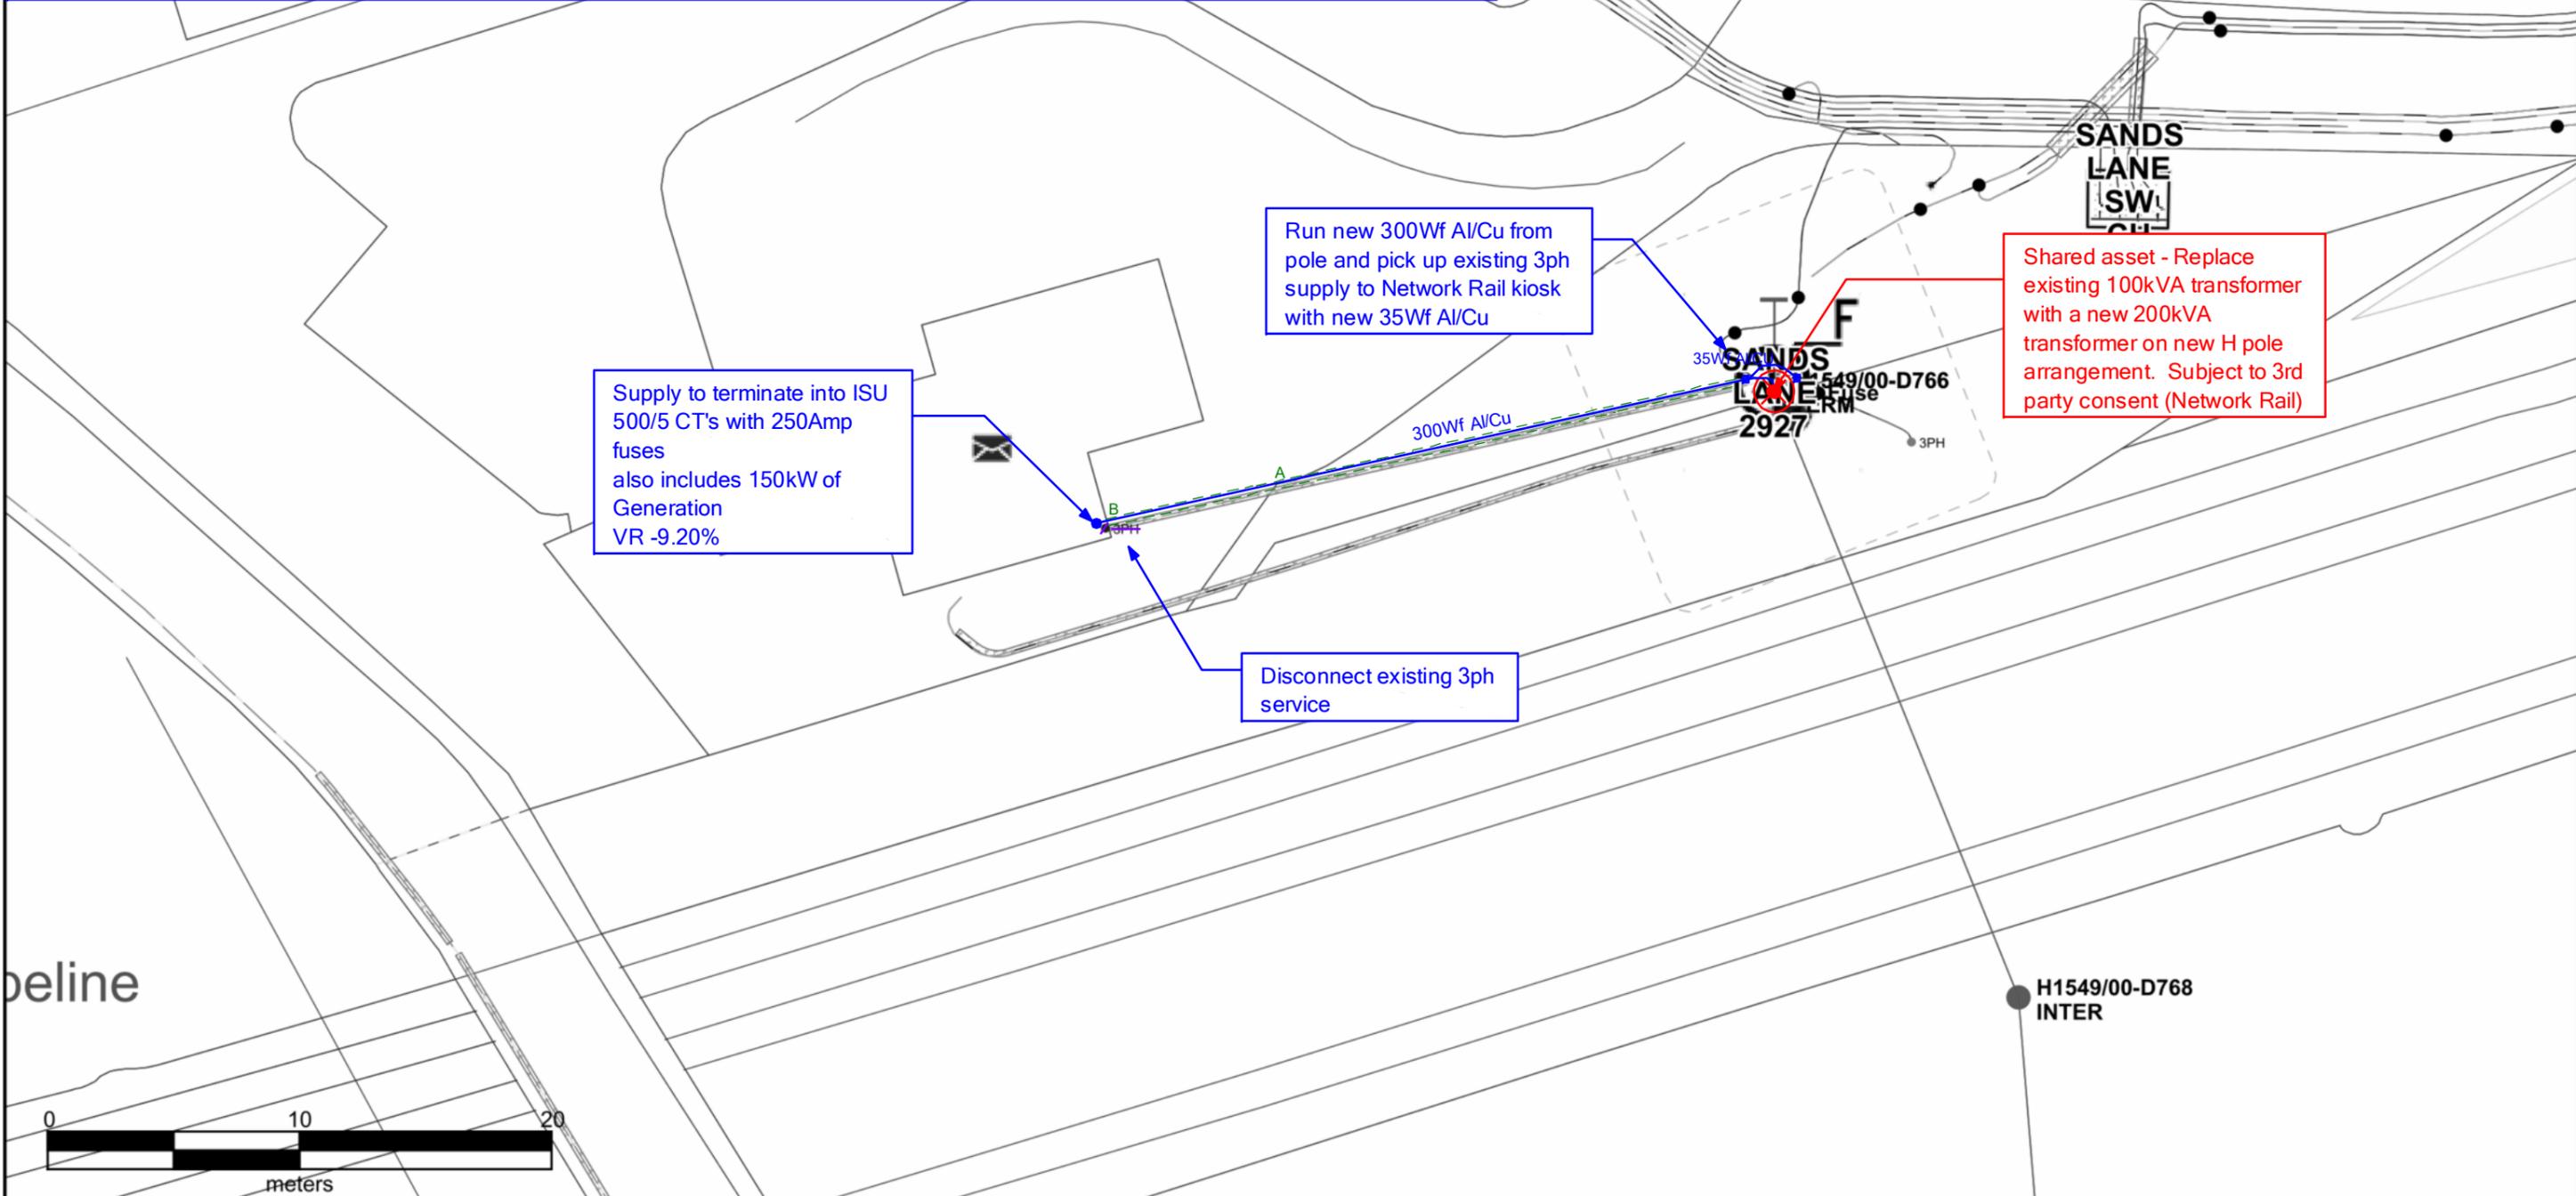


Supply to terminate into ISU
 500/5 CT's with 250Amp fuses
 also includes 150kW of Generation
 VR -9.20%

Run new 300Wf Al/Cu from pole and pick up existing 3ph supply to Network Rail kiosk with new 35Wf Al/Cu

Shared asset - Replace existing 100kVA transformer with a new 200kVA transformer on new H pole arrangement. Subject to 3rd party consent (Network Rail)

Disconnect existing 3ph service

baseline



This proposal plan must not be used for record purposes or for the location of existing cables. SafeDig Maps are available by calling 0191 22942295 Mon- Fri 8:30am - 4:45pm

Call Centre Phone Numbers:
 If the area is located in: North East call 0800 668877, Yorkshire or North Lincs call 0800 375675.

Northern Powergrid Holdings Company
 The position of our equipment is shown on the plan as accurately as possible. It may have changed since the plan was produced. Therefore the position of our equipment and those services which may not be shown should be established on site. Electricity cables not owned by Northern Powergrid Holdings Company may be laid in this area and may not be shown on this plan. Where private cables are shown, the information should not be regarded as accurate and should be used for guidance purposes only. In all cases, accurate information should be obtained from the owner of such cables prior to the commencement of work on site.

Reference should be made to HSE Guidance, HS(G)47 'Avoiding Danger from Underground Services' and GS6 'Avoidance of Danger from Overhead Power Lines'.

Reproduced from or based upon the Ordnance Survey map by Northern Powergrid Holdings Company by permission of Ordnance Survey on behalf of the Controller of Her Majesty's Stationary Office. Crown (c) Copyright (Northern Powergrid Holdings Company, EL100017931 and EL100036857).

Northern Powergrid Holdings Company, Lloyds Court, 78 Grey Street, Newcastle-Upon-Tyne, NE1 6AF
 Version 1.11 1st Jan 2024 **Call Centre Phone Numbers:** If the area is located in: North East call 0800 668877, Yorkshire or North Lincs call 0800 375675.

	20kV		Unfit For Service / Scrapped
	11kV		Existing underground cable
	LV Mains		Existing overhead line
	LV Service		Service Position
	Aux		Duct (125mm ID unless stated)
	Abandoned/Recovered		
	25kV		3kV

Original Print Size A3

OS Grid Reference: SE2178319498
 Printed By: donna.rhodes

Title:
 ENQ23214066
 Arthurs Cafe, Ladywood Lake
 Sands Lane, Mirfield
 WF14 8HJ



Date Printed: 10 Feb 2025 Scale: 1: 250