

Do not remove this panel from this drawing. Do not scale from this drawing. All dimensions and levels are to be checked on site. All discrepancies, errors and omissions must be reported immediately to Greig and Stephenson Ltd. The contractor is responsible for setting out, checking and confirming all site conditions prior to fabrication and construction. All building and fabrication works are to be carried out in accordance with the Local and National Building Codes, practices and standards. This drawing is copyright and must not be reproduced without the written consent of Greig and Stephenson Ltd. Greig and Stephenson Ltd. accept no responsibility for any loss or expenses arising from use of this drawing for any purpose other than those agreed in writing by Greig and Stephenson Ltd. This drawing is not to be used by any third party without the written consent of Greig and Stephenson Ltd.

KEY

- Automatic Fire Suppression
- Fire Alarm Control Panel
- FR60 - 60mins Fire Resistant
- FR60 Fire Resistance to Floor Above
- Exits Discounted in Fire
- Aspirating Smoke Detection + Beacon + Manual Call Point + Sounder
- Aspirating Smoke Detection + Beacon + Sounder
- Heat Detection + Beacon + Sounder
- Smoke Detection
- Smoke Detection + Beacon + Manual Call Point + Sounder
- Smoke Detection + Beacon + Sounder
- Smoke Detection + Sounder
- FR60 Insulated Ductwork
- Emergency Lighting - Anti Panic
- Emergency Lighting - Escape Route
- Emergency Lighting - Open Area
- Emergency Lighting - High Risk Task Area
- Final Fire Exit
- Max Escape Distance
- FR 120 - 120mins Fire Resistant
- FR120 Fire Resistance to Roof Above
- Fire Alarm Repeater Panel

NOTE: The maximum horizontal travel distance is 18 metres in a single direction and 45 metres where travel in more than one direction is available.

REV	DATE	COMMENT	CS/SS	NM
P01	28/08/25	Issued for Planning	CS/SS	NM


Greig & Stephenson Architects
 Studio SW.201, Screenworks
 22 Highbury Grove
 London, N5 2ER
 tel. 020 7403 5511
 fax. 020 7403 5544
 email. info@gands.co.uk

CLIENT: KIRKLEES COUNCIL
 PROJECT: HUDDERSFIELD MARKET
 STATUS: S3 - FOR REVIEW AND COMMENTS

DRAWING: Fire Strategy Market Hall and Annexe Level 00

SCALE	DRW CHKD	RWV APRV	DATE
As indicated @ A1	CS	CS	24/03/25
	NM	NM	

DRAWING NUMBER	REVISION
HMH-GSA-ZZ-00-D-A-0811	P01

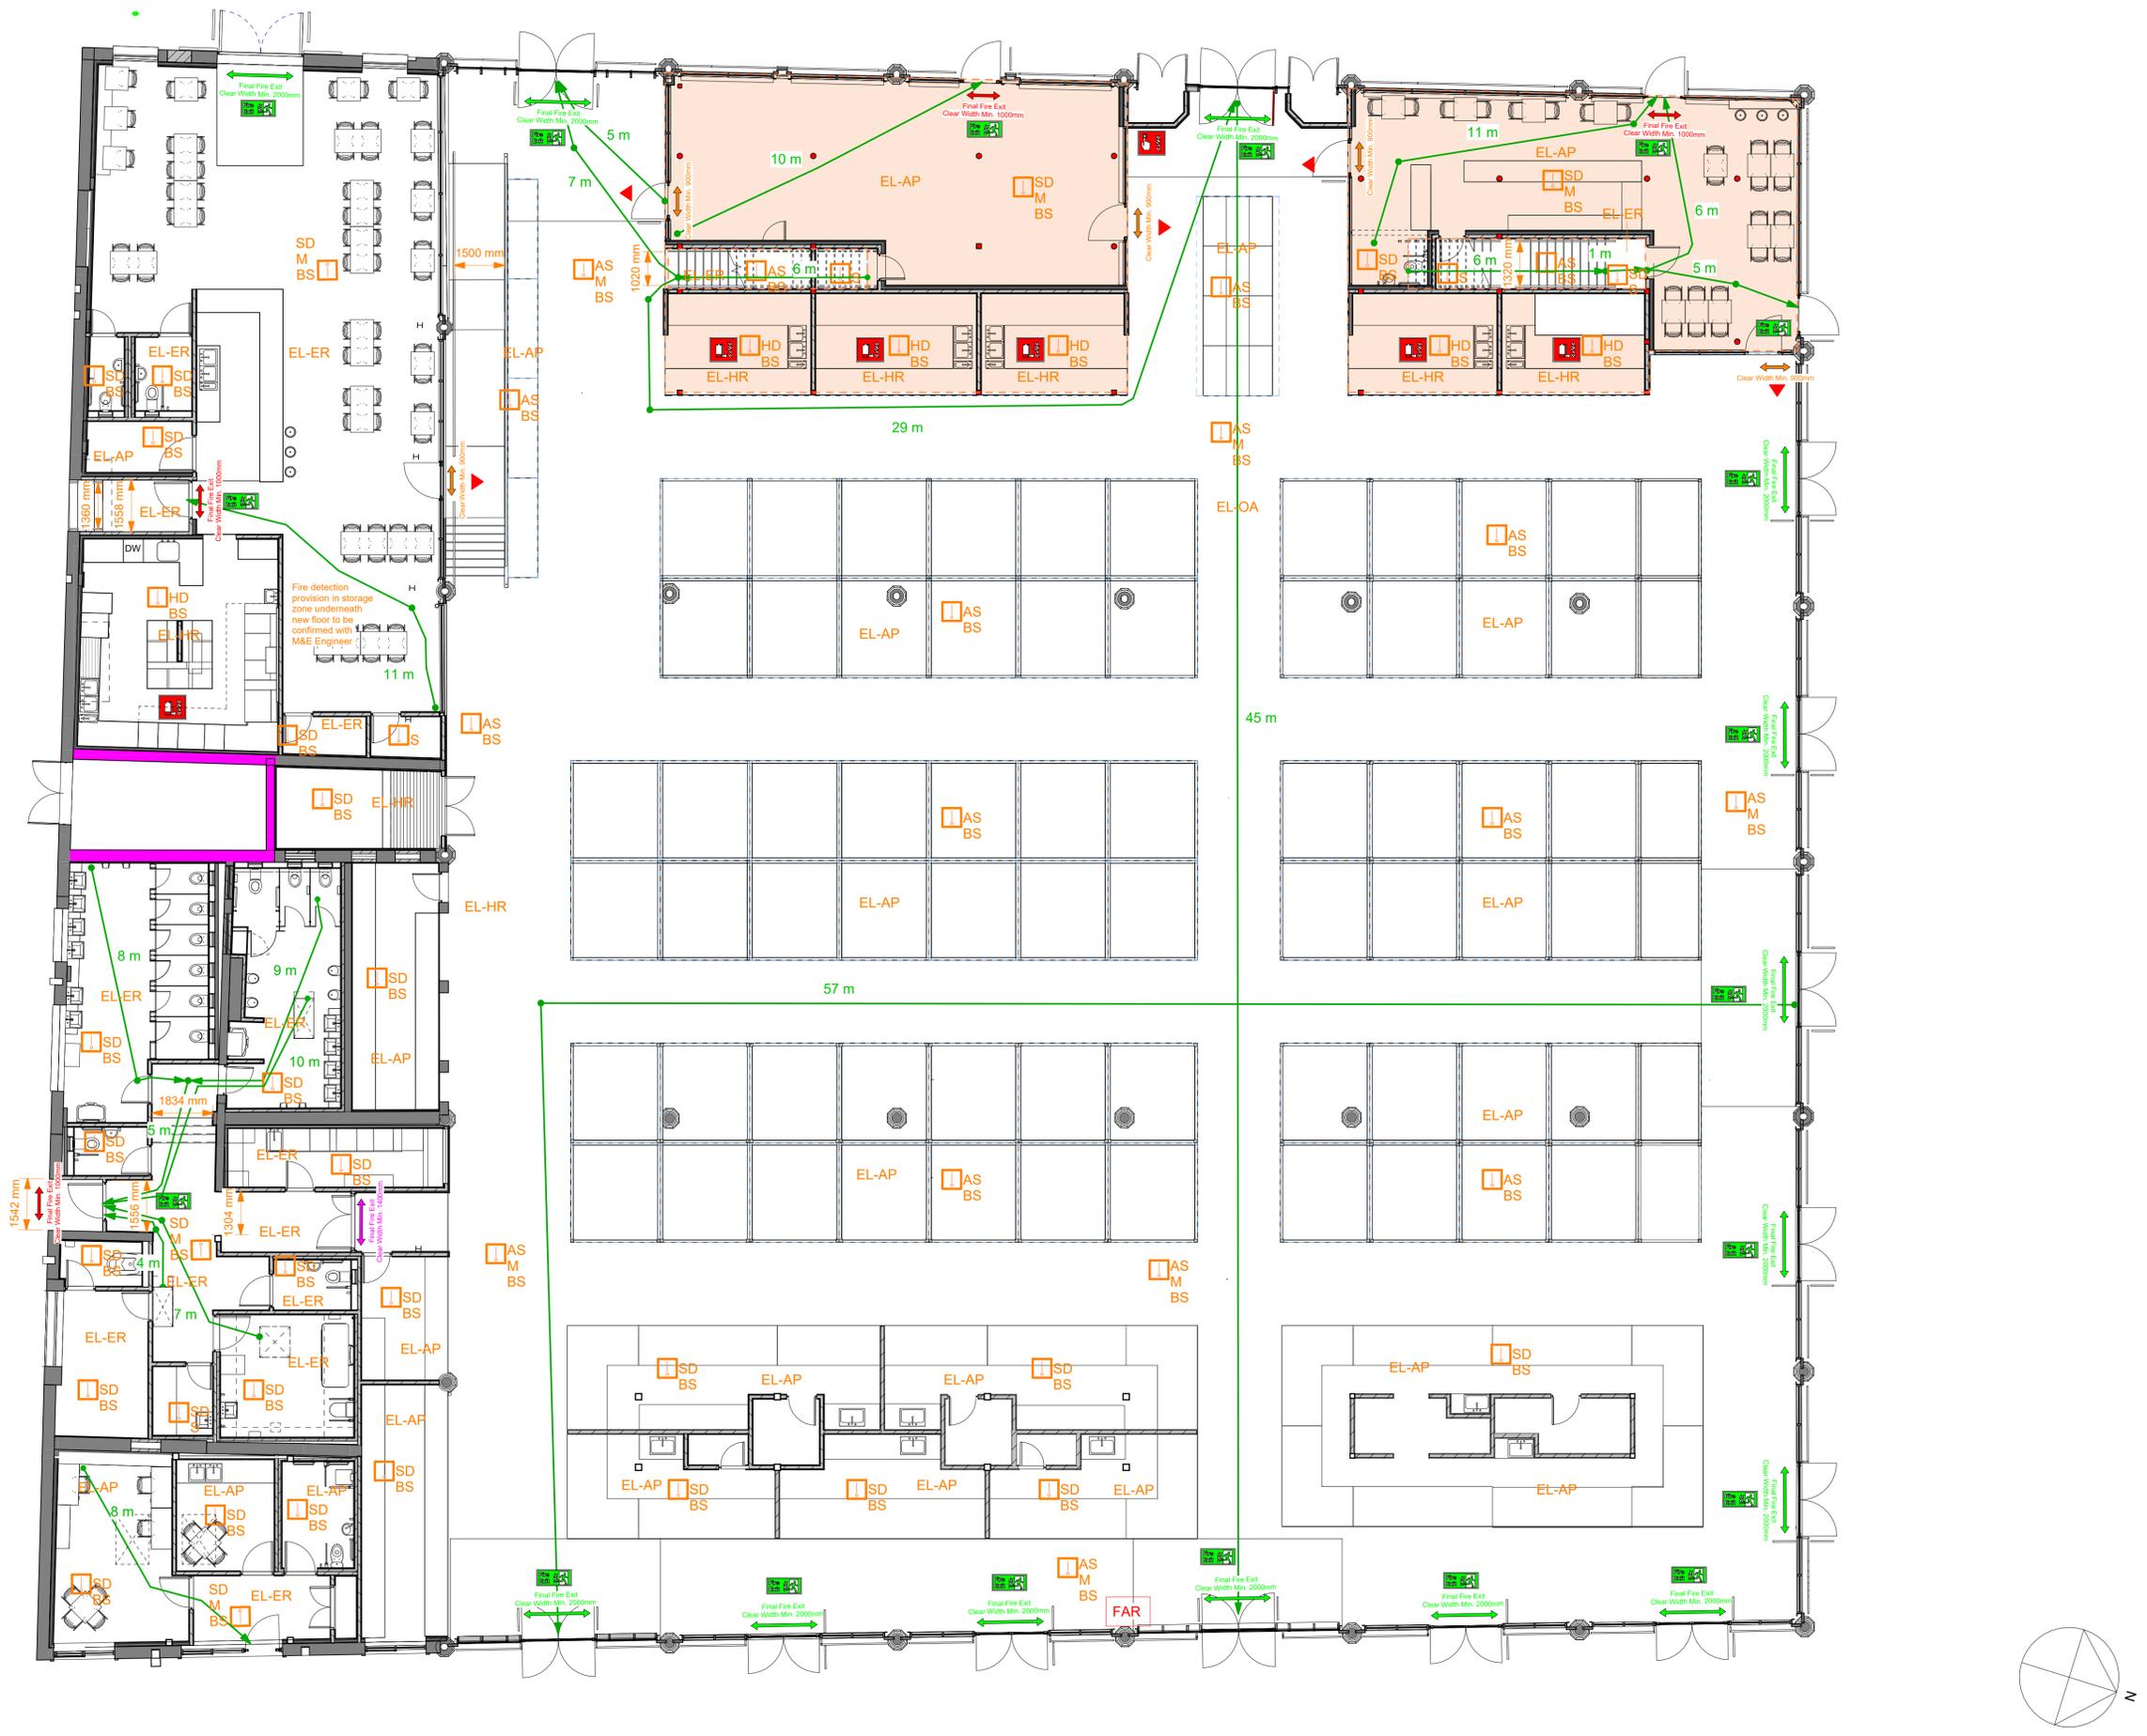

1 Market Hall & Annexe - Level 00 Fire Strategy Plan
 1: 100

