
Planning condition 32 - Electric car charging

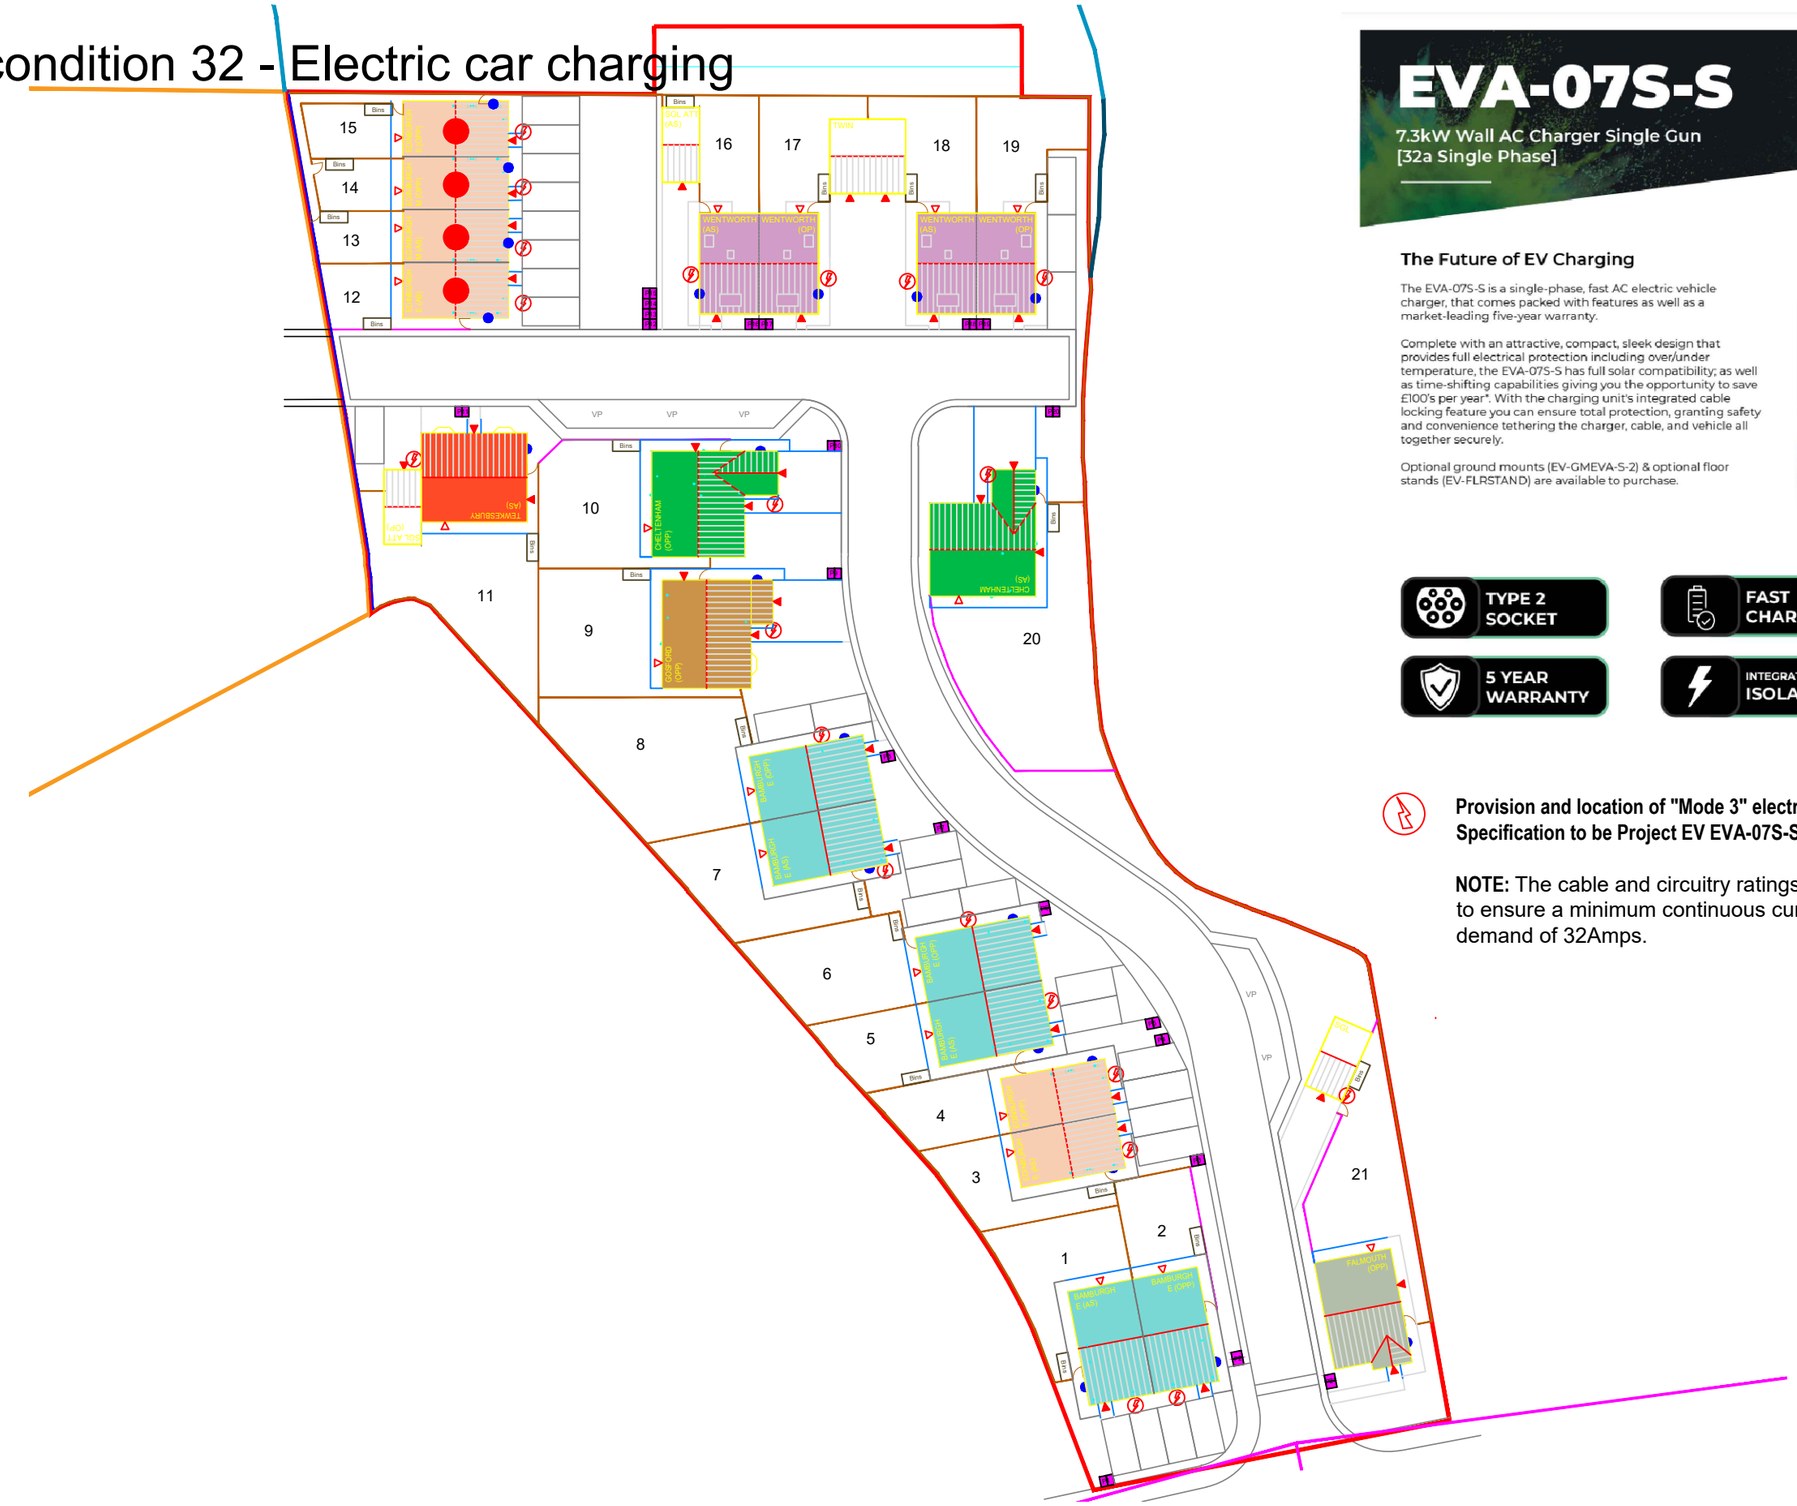

Provision and location of "Mode 3" electric car chargers fixed to dwelling
Specification to be Project EV EVA-07S-S

NOTE: The cable and circuitry ratings for the EVCP shall be of adequate size to ensure a minimum continuous current demand of 16Amps and a maximum demand of 32Amps.

N

Revision notes:		
Rev:	**Date:**	**Notes:**
A	24.06.26	Charging point added to plot 20 - CD

Revision notes:		
Rev:	**Date:**	**Notes:**
..	..	..

Revision notes:		
Rev:	**Date:**	**Notes:**
..	..	..

Date: 28.01.25

Project: Denby Lane, Grange Moor

Scale @ A3: NTS

Drawing Number: 2407-02-006 Electric car charging plan

Drawn By: CD

Revision: A

OrionHomes
SO GOOD TO COME HOME TO
Unit 5, Benton Office Park, Bennett Avenue, Horbury, Wakefield, WF4 5RA, Tel: 01924 831030