


Information Only

REV.	DESCRIPTION	INTL.	CHK.	DATE
101	Information Only	ED	ED	08.09.25

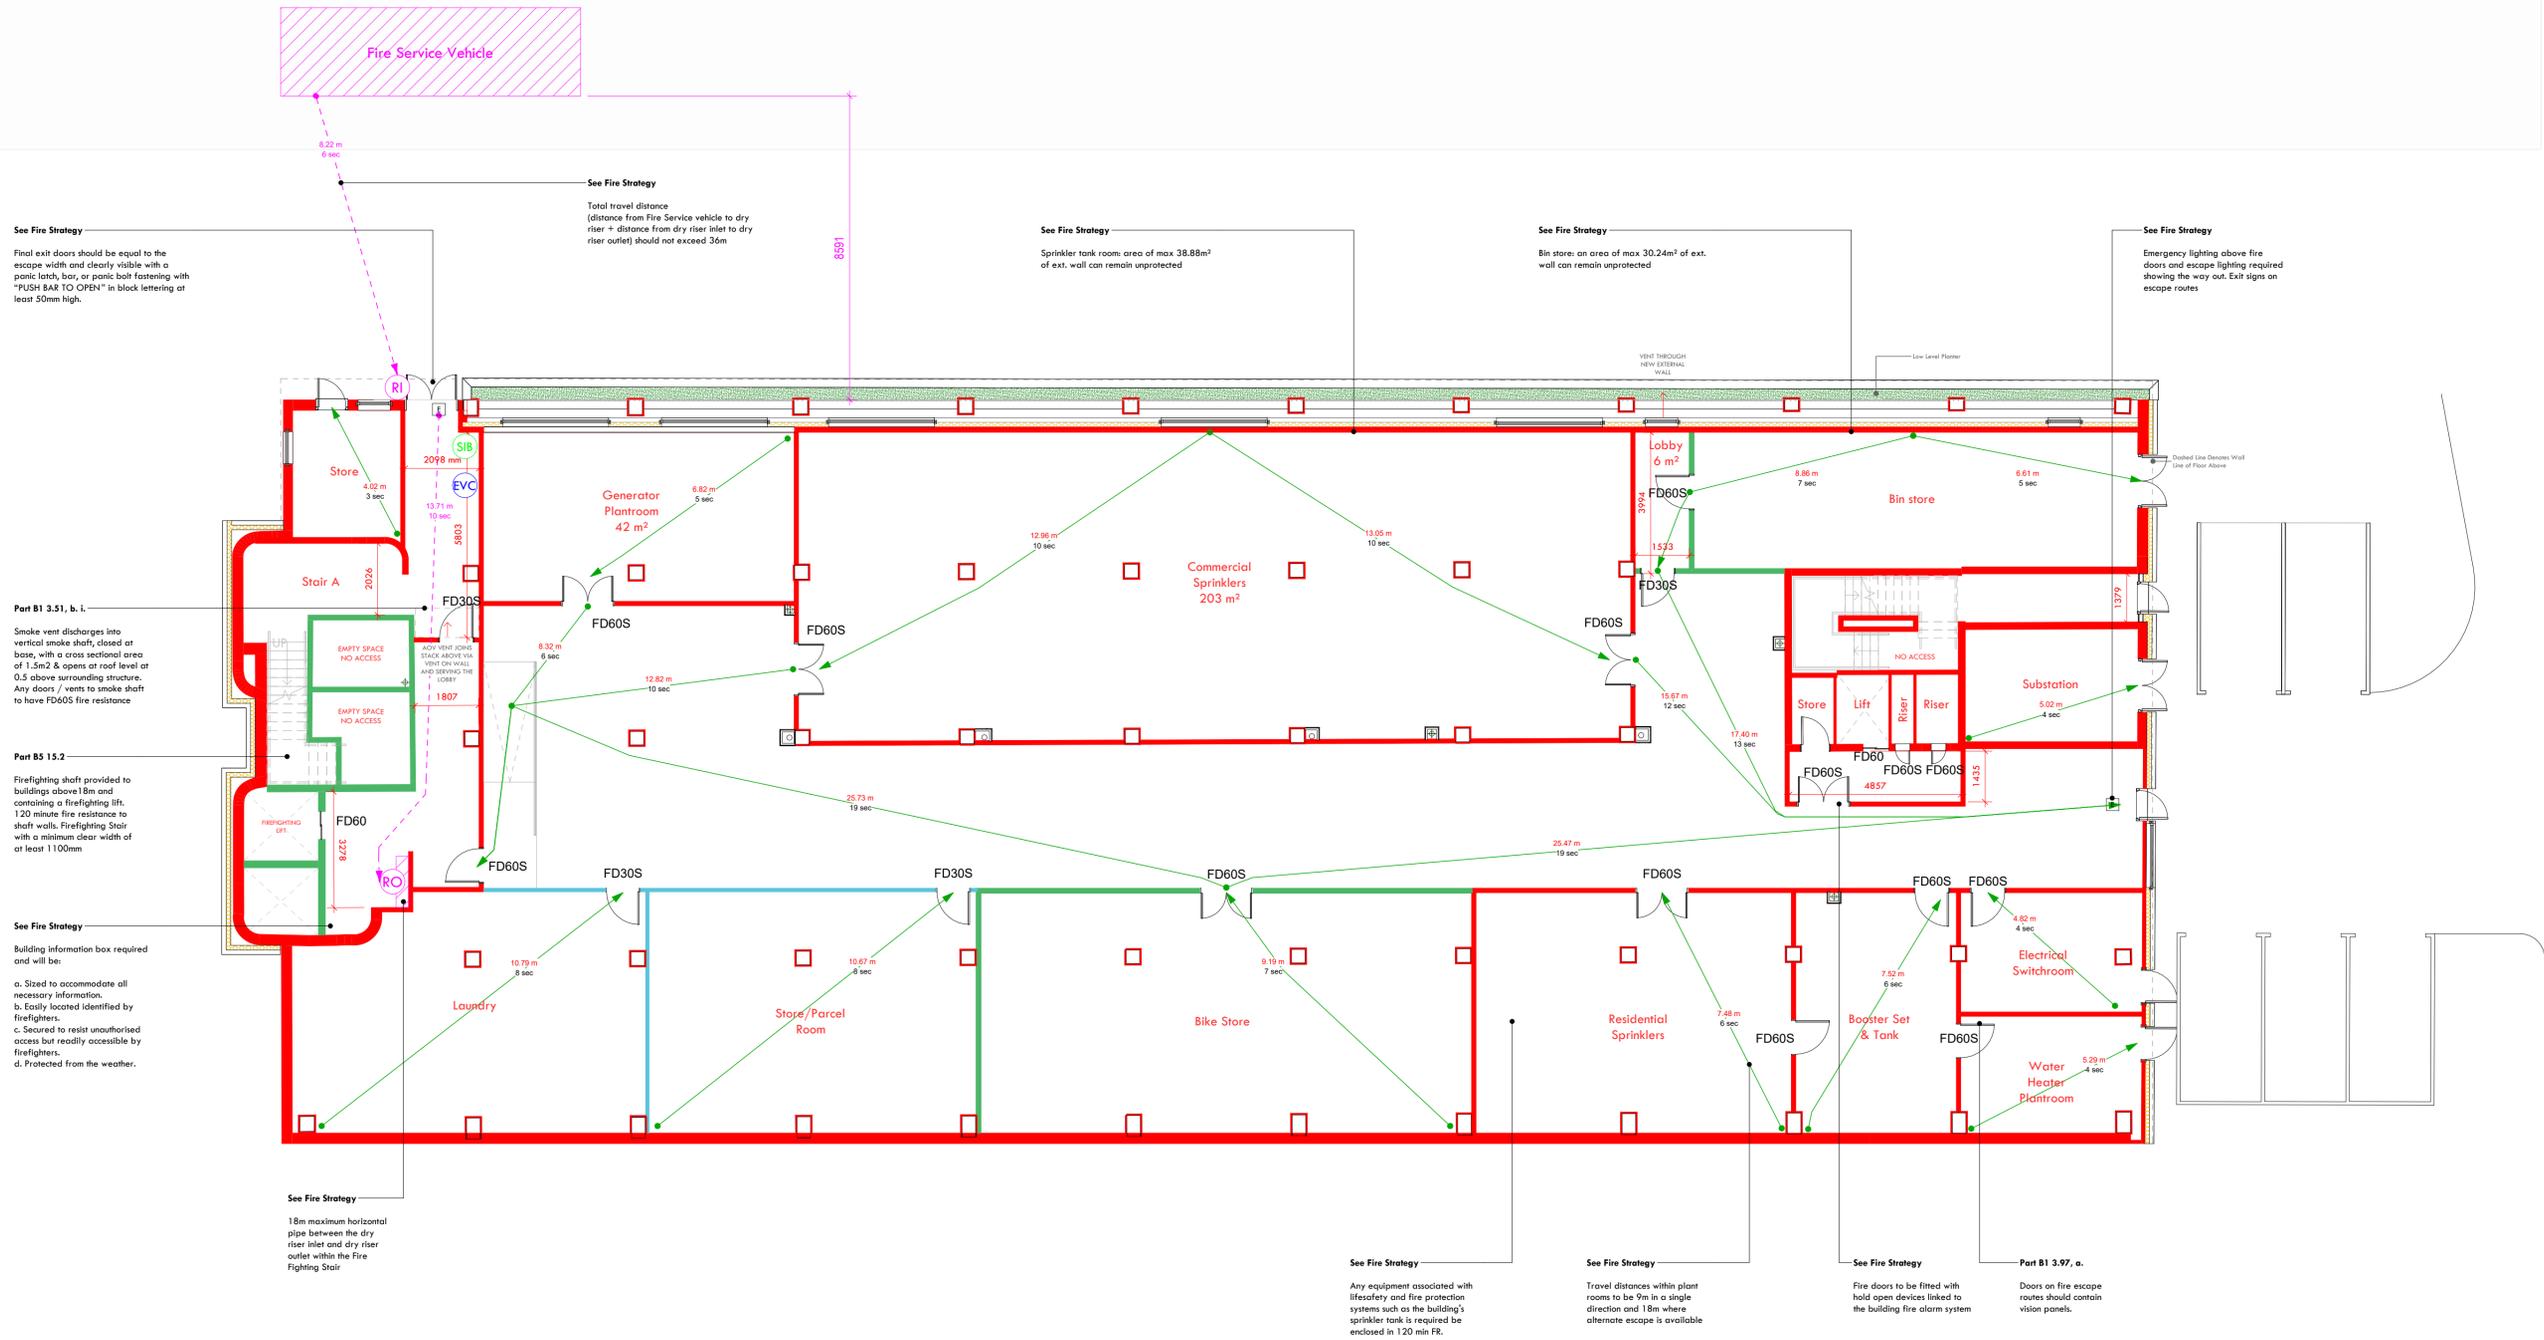

Fire Plan - Basement  
1 : 100

KEY		NOTES
	Secure Information Box	
	Emergency Voice Communication System	
	Dry Riser Inlet	
	Dry Riser Outlet	
	Multi Sensor Detector	
	120 Minutes FR	<p><b>NOTES</b></p> <ul style="list-style-type: none"> <li>-All drawings to be read in conjunction with the detailed Fire strategy report by Hoare Lea.</li> <li>-Fire stopping to every joint, imperfect fit and opening for services through a fire separating element, to comply with the requirements of ADB section 9.</li> <li>-All penetrations through fire compartments are to be appropriately protected by means of collar automatic fire and smoke dampers or appropriate materials to maintain the fire protection required. Please refer to Fire Strategy for further information.</li> <li>-Cavity barriers are to be installed to meet the recommendations of section 8 of AD-B, refer to the Fire Strategy for further information.</li> <li>-the contractor must ensure that the installation of all fire stopping, sealing and protection works.</li> <li>-For sprinkler head positions refer to design by Base, ref: BFS991-01 &amp; BFS991-02</li> <li>-All external walls to achieve a minimum Fire Rating of A2-s1, d0 or better</li> </ul>
	90 Minutes FR	
	60 Minutes FR	
	30 Minutes FR	

