
Land Adjacent to 2 Hoyle Ing Huddersfield

Noise Impact Assessment Report
Report 31295.NIA.01

Benjamin Good
2 Green Gardens
Golcar
HD7 4DG

Report 31295.NIA.01		
Revision History		
Revision	Written by	Checked by
First Issue 11/11/2025	Jamie Murray MIOA Principal Consultant	Jacob Tyler-White MIOA Principal Consultant
Disclaimer		
<p>KP Acoustics Ltd. has used reasonable skill and care to complete this technical document, within the terms of its brief and contract with the resources devoted to it by agreement with the client. We disclaim any responsibility to the client and others in respect of any matters outside the stated scope. This report is confidential to the client and we accept no responsibility to third parties to whom this report, or any part thereof, is made known. KP Acoustics Ltd. accepts no responsibility for data provided by other bodies and no legal liability arising from the use by other persons of data or opinions contained in this report.</p> <p>KP Acoustics Ltd. 2025</p>		

Contents

1.0	INTRODUCTION	1
2.0	SITE SURVEYS	1
2.1	Site Description	1
2.2	Environmental Noise Survey Procedure	1
2.3	Measurement Positions	1
2.4	Equipment.....	2
3.0	RESULTS.....	2
4.0	NOISE ASSESSMENT GUIDANCE.....	4
4.1	Local Authority Requirements	4
4.2	National Planning Policy Framework 2024 & Noise Policy Statement for England 2010.....	4
4.3	BS 8233:2014	6
4.4	WHO Guidelines for Community Noise (1999) & Night Noise Guidelines for Europe (2009) ...	7
4.5	Approved Document O (ed. 2021).....	7
4.5.1	Application	7
4.5.2	Internal Noise Level Targets	8
4.5.3	Methods to Remove Excess Heat	8
5.0	EXTERNAL BUILDING FABRIC SPECIFICATION	9
5.1	Non-Glazed Elements.....	9
5.2	Glazed Elements.....	9
6.0	VENTILATION AND OVERHEATING RELIEF	10
6.1	Ventilation Strategy	10
6.2	Openable Windows for Overheating Relief.....	11
7.0	EXTERNAL AMENITY AREA ASSESSMENT	12
8.0	CONCLUSION.....	12

List of Attachments

Appendix A Glossary of Acoustics Terminology

1.0 INTRODUCTION

KP Acoustics Ltd has been commissioned by Benjamin Good, 2 Green Gardens, Golcar, HD7 4DG to assess the suitability of the site at Land Adjacent to 2 Hoyle Ing, Linthwaire, Huddersfield, HD7 5RX for a residential development in accordance with the provisions of the National Planning Policy Framework (NPPF) and the Noise Policy Statement for England (NPSE).

This report presents the results of the environmental survey undertaken in order to measure prevailing background noise levels and outlines any necessary mitigation measures.

2.0 SITE SURVEYS

2.1 Site Description

The site is bounded by Hoyle Ing to the north, residential houses to the east and south, and industrial buildings to the west. At the time of the survey, the background noise climate was generally dominated by tree rustle and very distant road traffic noise. The industrial units to the west operate during normal daytime working hours only.

2.2 Environmental Noise Survey Procedure

A noise survey was undertaken on the proposed site as shown in Figure 2.1. The location was chosen in order to collect data representative of the worst-case levels expected on the site due to all nearby sources.

Attended noise measurements were undertaken between 12:00 and 15:00 on 27/10/2025 and between 23:00 on 27/10/2025 and 02:00 on 28/10/2025.

Noise from the nearby industrial uses (use of power tools) was only just audible above the existing noise climate and was not considered to be intrusive/distinct by the surveyor. Measurements were undertaken both with and without the contribution from the nearby industrial units.

Weather conditions were generally dry with light winds and therefore suitable for the measurement of environmental noise. The measurement procedure complied with ISO 1996-2:2017 Acoustics '*Description, measurement and assessment of environmental noise - Part 2: Determination of environmental noise levels*'.

2.3 Measurement Positions

The measurement position is as described within Table 2.1 and shown within Figure 2.1.

Icon	Descriptor	Location Description
①	Noise Measurement Position 1	<p>The microphone was installed on a tripod approximately 1.5m above ground level, as shown in Figure 2.2.</p> <p>The microphone was positioned within free-field conditions at least 3.5 metres from the nearest surface.</p>

Table 2.1 Measurement position and description

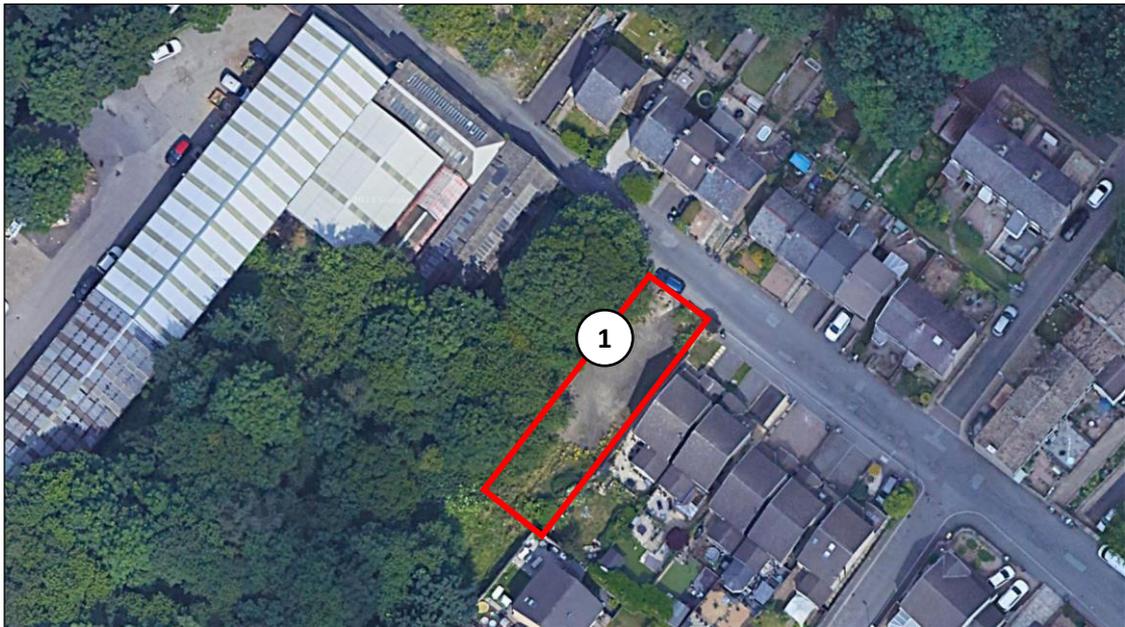


Figure 2.1 Site measurement positions (Image Source: Google Maps)

2.4 Equipment

The equipment calibration was verified before and after use and no abnormalities were observed. The equipment used is described within Table 2.2.

Measurement instrumentation		Serial no.	Calibration Date	Cert no.
SLM4	NTI Audio XL-TA2 Class 1 Sound Level Meter	A2A-09207-E0	19/08/2025	UCRT24/1289, 1290 & 1291
Larson Davis CAL200 Class 1 Calibrator – KP North		8932	19/08/2025	UCRT25/2200

Table 2.2 Measurement instrumentation

3.0 RESULTS

The $L_{Aeq,5min}$, $L_{Amax,5min}$ and $L_{A90,5min}$ acoustic parameters were measured throughout the duration of the survey.

The measured noise levels, as shown in Table 3.1, are considered representative of the noise exposure levels expected to be experienced all facades of the proposed development.

Time Period		L _{Aeq,5min} (dB)	L _{A90,5min} (dB)	L _{Afmax,5min} (dB)
Daytime	12:47:40	47	61	44
	12:53:10	49	69	44
	13:44:04	49	60	44
	13:58:12	50	59	45
	Representative Total	49	69	44
Night-time	23:15:04	44	58	34
	00:11:33	43	60	35
	00:48:24	40	50	34
	01:31:54	39	58	36
	Representative Total	42	60	34

Table 3.1 Site average noise levels for daytime and night time

Further manual measurements were undertaken to derive the noise level contribution from industrial sources nearby the proposed development. The results of these measurements are as follows:

Description		Measured Noise Level (dB, L _{Aeq,T})
Industrial sources ON	Noise measurement with industrial sources (power tools) operating, only just audible above background noise climate. BS 4142:2014 Ambient Sound Level	44
Industrial sources OFF	Noise measurement with industrial sources off/inaudible. BS 4142:2014 Residual Sound Level	48
Specific Sound Level	Derived contribution from industrial noise sources only. BS 4142:2014 Specific Sound Level	46

Table 3.2 Attended noise measurements

4.0 NOISE ASSESSMENT GUIDANCE

4.1 Local Authority Requirements

The development falls within the jurisdiction of Kirklees Council and has been granted permission (ref. 2022/62/94124/W) with conditions. The relevant condition relating to noise is repeated below.

“14. Before construction work commences or completion of enabling works a report specifying the measures to be taken to protect the development from noise from all significant noise sources that are likely to affect the proposed development including any commercial premises shall be submitted to and approved in writing by the Local Planning Authority. The report shall:

a. Determine the existing noise climate

b. Predict the noise climate in living rooms and gardens (daytime), bedrooms (night-time) and other habitable rooms of the development

c. Detail the proposed attenuation/design necessary to protect the amenity of the occupants of the new residences (including ventilation if required).

The development shall not be occupied until all works specified in the approved report have been carried out in full and such works shall be thereafter retained.”

4.2 National Planning Policy Framework 2024 & Noise Policy Statement for England 2010

The National Planning Policy Framework (NPPF) has superseded and replaces Planning Policy Guidance Note 24 (PPG24), which previously covered issues relating to noise and planning in England. Paragraph 187 of NPPF 2024 states that planning policies and decisions should contribute to the natural and local environment by:

“preventing new and existing development from contributing to, being put at unacceptable risk from, or being adversely affected by, unacceptable levels of soil, air, water or noise pollution or land instability. Development should, wherever possible, help to improve local environmental conditions such as air and water quality, taking into account relevant information such as river basin management plans.”

In addition, Paragraph 198 of the NPPF states that *‘Planning policies and decisions should also ensure that new development is appropriate for its location taking into account the likely effects (including cumulative effects) of pollution on health, living conditions and the natural environment, as well as the potential sensitivity of the site or the wider area to impacts that could arise from the development. In doing so they should’:*

- Mitigate and reduce to a minimum potential adverse impacts resulting from noise from new development – and avoid noise giving rise to significant adverse impacts on health and the quality of life
- Identify and protect tranquil areas which have remained relatively undisturbed by noise and are prized for their recreational and amenity value for this reason

The Noise Policy Statement for England (NPSE) was developed by DEFRA and published in March 2010 with the aim to ‘Promote good health and good quality of life through the effective management of noise within the context of Government policy on sustainable development.’

Noise Policy Statement England (NPSE) noise policy aims are as follows:

Through the effective management and control of environmental, neighbour and neighbourhood noise within the context of Government policy on sustainable development.

- *Avoid significant adverse impacts on health and quality of life;*
- *Mitigate and minimise adverse impacts on health and quality of life; and*
- *Where possible, contribute to the improvement of health and quality of life*

The Noise Policy Statement England (NPSE) outlines observed effect levels relating to the above, as follows:

- NOEL – No Observed Effect Level
 - This is the level below which no effect can be detected. In simple terms, below this level, there is no detectable effect on health and quality of life due to the noise.
- LOAEL – Lowest Observed Adverse Effect Level
 - This is the level above which adverse effects on health and quality of life can be detected.
- SOAEL – Significant Observed Adverse Effect Level
 - This is the level above which significant adverse effects on health and quality of life occur.

As stated in The Noise Policy Statement England (NPSE), it is not currently possible to have a single objective based measure that defines SOAEL that is applicable to all sources of noise in

all situations. Specific noise levels are not stated within the guidance for this reason, and allow flexibility in the policy until further guidance is available.

4.3 BS 8233:2014

BS 8233:2014 ‘Sound insulation and noise reduction for buildings’ describes recommended internal noise levels for residential spaces. These levels are shown in Table 4.1.

Activity	Location	07:00 to 23:00	23:00 to 07:00
Resting	Living Rooms	35 dB(A)	-
Dining	Dining Room/area	40 dB(A)	-
Sleeping (daytime resting)	Bedrooms	35 dB(A)	30 dB(A)

Table 4.1 BS8233 recommended internal background noise levels

It should be noted that the recommended internal noise levels outlined above are not applicable under “purge ventilation” conditions as defined by Approved Document F of the Building Regulations, as this should only occur occasionally (e.g. to remove odour from painting or burnt food). However, the levels above should be achieved whilst providing sufficient background ventilation, either via passive or mechanical methods.

The external building fabric would need to be carefully designed to achieve these recommended internal levels.

In addition to guidance on internal levels, BS8233:2014 also states the following with regards to noise within external amenity spaces:

‘For traditional external areas that are used for amenity space, such as gardens and patios, it is desirable that the external noise level does not exceed 50 dB $L_{Aeq,T}$, with an upper guideline value of 55 dB $L_{Aeq,T}$, which would be acceptable in noisier environments. However, it is also recognized that these guideline values are not achievable in all circumstances where development might be desirable. In higher noise areas, such as city centres or urban areas adjoining the strategic transport network, a compromise between elevated noise levels and other factors, such as the convenience of living in these locations or making efficient use of land resources to ensure development needs can be met, might be warranted. In such a situation, development should be designed to achieve the lowest practicable levels in these external amenity spaces, but should not be prohibited.’

As outlined above, the resulting noise levels in external amenity areas should not be a reason for refusal, providing that the noise levels are designed to be as low as practically possible within external amenity areas.

4.4 WHO Guidelines for Community Noise (1999) & Night Noise Guidelines for Europe (2009)

WHO Guidelines for Community Noise (1999) recommend that internal noise levels for individual events should not exceed 45dB L_{Amax} more than 10-15 times per night.

WHO Night Noise Guidelines for Europe (2009) presents guidelines for noise levels outside dwellings and discusses the relationship between these and the criteria for internal noise presented in Guidelines for Community Noise. The document states that the two should be considered complimentary and that the 1999 guidelines should be considered valid to achieve the 2009 guidelines.

4.5 Approved Document O (ed. 2021)

Approved Document O (ADO) supports Part O of Schedule 1 to the Building Regulations 2010. ADO introduces requirements for residential premises in order to prevent overheating from occurring. There are two specific requirements from ADO:

Requirement O1 (1):

To limit unwanted solar gains in summer and to provide adequate means to remove heat from the indoor environment.

Requirement O1 (2):

- (a) Account must be taken of the safety of the occupant, and their reasonable enjoyment of the residence.
- (b) Mechanical cooling may only be used where sufficient heat cannot be removed from the indoor environment without it.

The statutory guidance to support Requirement O1(2)(a) contains requirements relating to noise at night.

4.5.1 Application

The guidance within ADO applies to new residential buildings only and are defined within the following table:

Title	Purpose for which the building is intended to be used.
Residential (dwellings)	Dwellings, which includes both dwellinghouses and flats.
Residential (institutions)	Home, school or other similar establishment, where people sleep on the premises. The building may be living accommodation for the care or maintenance of any of the following. <ul style="list-style-type: none"> A. Older and disabled people, due to illness or other physical or mental condition.

Title	Purpose for which the building is intended to be used.
	B. People under the age of 5 years.
Residential (other)	Residential college, hall of residence and other student accommodation, and living accommodation for children ages 5 years or older.

Table 4.2 Residential buildings within the scope of ADO (ref. Table 0.1 of Approved Document O)

Paragraphs 3.2 and 3.3 of ADO specifically refer to noise within bedrooms at night. Whilst any habitable room could be used as a bedroom, it is proposed that the scope is confined to those rooms specifically designated as bedrooms.

4.5.2 Internal Noise Level Targets

ADO sets internal noise level targets within Paragraph 3.3 of the document:

“Windows are likely to be closed during sleeping hours if noise within bedrooms exceeds the following limits.

- a. *40dB $L_{Aeq,T}$ averaged over 8 hours (between 11pm and 7am)*
- b. *55dB L_{AFmax} more than 10 times a night (between 11pm and 7am).”*

Where an openable window for the removal of excess heat is predicted to result in the above internal noise levels to be exceeded, then the overheating mitigation strategy must adopt one of the alternative means listed within Paragraph 2.10 of ADO (presented within Section 4.7.3 of this report). This constraint applies regardless of which method is used to demonstrate compliance with Requirement O1 (1).

4.5.3 Methods to Remove Excess Heat

Paragraph 2.10 of ADO lists the means for removing excess heat from dwellings according to the following:

- Openable windows
- Ventilation louvres in external walls
- A mechanical ventilation system
- A mechanical cooling system

Where mitigation of impacts related to overheating is required, this must be led by an overheating specialist.

5.0 EXTERNAL BUILDING FABRIC SPECIFICATION

Sound reduction performance calculations have been undertaken in order to specify the minimum performance required from glazed and non-glazed elements in order to achieve the recommended internal noise levels shown in Table 4.1, taking into account average and maximum noise levels monitored during the environmental noise survey.

The contribution from industrial noise has also been considered with a target of 10 dB below the recommended targets within BS 8233:2014 (i.e. 25 dB L_{Aeq}) during daytime periods.

L_{Amax} spectrum values of night-time peaks have also been considered and incorporated into the glazing calculation in order to cater for the interior limit of 45 dB L_{Amax} for individual events, as recommended in WHO Guidelines.

5.1 Non-Glazed Elements

It is currently understood that the non-glazed building façade is comprised of the elements as shown within Table 5.1 based on the construction detail provided. The anticipated sound reduction index has been calculated, and would be expected to provide the minimum figures shown in the following table when tested in accordance with the BS EN ISO 10140 series of standards.

Element	Sound Reduction Index , dB, at Octave Band Centre Frequency, Hz					
	125	250	500	1k	2k	4k
Brickwork Cavity Wall	41	43	48	50	55	55

Table 5.1 Assumed sound reduction performance for non-glazed elements

5.2 Glazed Elements

Minimum octave band sound reduction index (SRI) values required for all glazed elements to be installed are shown in Table 5.2. The performance is specified for the whole window unit, including the frame, seals, etc. as appropriate. Sole glass performance data would not demonstrate compliance with this specification.

Glazing performance calculations have been based both on average measured night-time noise levels as well as verified against the L_{Amax} spectrum of individual events in order to comply with a maximum internal noise level of 45dB(A) in bedrooms as recommended by World Health Organisation Guidelines. The combined most robust results of these calculations are shown in Table 5.2.

Elevation	Sound Reduction Index , dB, at Octave Band Centre Frequency, Hz						R _w (C;C _{tr}), dB
	125	250	500	1k	2k	4k	
All Elevations	17	20	25	28	35	35	29 (-1;-4)

Table 5.2 Required glazing performance

The nominated glazing supplier should verify that their proposed window system meets the attenuation figures shown at each centre frequency band as shown in Table 5.2.

Example glazing types that would be expected achieve the above spectral values are shown in Table 5.3.

Elevation	Example Glazing Type
All Elevations	6/12/6

Table 5.3 Example glazing types

All major building elements should be tested in accordance with the BS EN ISO 10140 series of standards.

Independent testing at a UKAS accredited laboratory will be required in order to confirm the performance of the chosen system for an ‘actual’ configuration.

6.0 VENTILATION AND OVERHEATING RELIEF

6.1 Ventilation Strategy

Approved Document F 2021 describes the following system types for background and extract ventilation:

Ventilation System Type	Whole Dwelling Ventilation	Extract Ventilation
Natural Ventilation	Trickle ventilators	Intermittent extract fans
Continuous Mechanical Extract Ventilation (MEV)	Continuous mechanical extract (low rate) and trickle vents for supply	Continuous mechanical extract (high rate) with trickle vents providing inlet air
Mechanical Ventilation with Heat Recovery (MVHR)	Continuous mechanical supply and extract (low rate)	Continuous mechanical supply and extract (high rate)

Table 6.1 Ventilation system types as described in ADF 2021

Based on the results of the noise survey, the suitability of each system type and the required trickle ventilator performance (where appropriate) is shown in Table 6.2 below.

Elevation	ADF Ventilation System Type Suitable?			Minimum Trickle Ventilator Performance (dB $D_{n,e,w}$)
	Natural Vent	MEV	MVHR	
All Elevations	Yes	Yes	Yes	23

Table 6.2 Suitability and required performance of ventilation systems

For our assessment of trickle ventilator performance, we have assumed 1no. vents are proposed in the assessed rooms. As trickle vents introduce a weak point in the building façade, increasing the number of trickle vents will reduce the composite performance of the facade. If trickle vents are proposed, the total number of trickle vents for each sensitive space should be confirmed so that calculations can be accurately revised.

Where mechanical ventilation is proposed, systems should be designed so that the combined internal noise levels from external sources and from the mechanical ventilation meet the BS 8233: 2014 criteria shown in Table 4.1.

In all cases, purge ventilation would be provided by openable windows. As outlined in Section 4.5, the internal noise level requirement would not be applicable during purge conditions as this would only occur occasionally.

6.2 Openable Windows for Overheating Relief

Approved Document O (ADO) only applies to Bedrooms during night. The advice within this section would therefore only apply to Bedrooms during night-time hours (23:00-07:00) to ensure that the internal noise level targets of 40dB(A) $L_{eq,T}$ and 55dB(A) L_{max} are not exceeded.

Table 6.4 presents the open area of the window as a % of the floor area which would need to be achieved to ensure that sufficient attenuation is provided from outside to inside.

Elevation	Sound Reduction Required to Achieve ADO Target Internal L_{Aeq} Noise Levels	Sound Reduction Required to Achieve ADO Target Internal L_{Amax} Noise Levels	Maximum Open Area of the Window as a Percentage of the Floor Area to Achieve ADO Target Internal Noise Levels
All	2 dB	5 dB	12 %

Table 6.4 Window open areas

Note: Acoustic open area is the measurable, cross-sectional, geometric area of an opening. For a partially open window, this is considered to be the lesser of either the size of the hole in the window frame that is left by the opening light, or the combined cross-sectional area around the opening light through which air must pass to move from outside to inside. The area around a hinged opening light includes the triangular areas on the sides adjacent to the hinge, and the rectangular area on the side opposite the hinge. This should not be used for comparing the air-flow performance of elements because this will also be dependent on factors such as depth (length of air-path), surface roughness and tortuosity.

The overheating model should inform the design team whether the % open areas above would be sufficient to remove excess heat. In the event they are insufficient, other options to limit solar gains into the building should be investigated (such as those outlined in Section 2.7 of Approved Document O), or other means of removing excess heat should be explored (as outlined in Section 2.10 of the Approved Document).

Where the assessment has resulted in a maximum allowable free area of 0%, it should be noted that this does not mean that natural ventilation for overheating relief is not possible. The ADO assessment methodology assumes a maximum noise reduction through an open window, which could be improved upon by the use of specific window designs or other passive methods of cooling such as louvred wall vents.

Where mitigation of impacts related to overheating is required, this must be led by an overheating specialist. We would be happy to review the acoustic implications of any proposed mitigation strategies, though this would require a more detailed assessment.

7.0 EXTERNAL AMENITY AREA ASSESSMENT

External amenity areas are proposed to the rear of the properties at ground floor. Based on the measured noise levels provided in Table 3.1, the predicted ambient noise levels within the amenity areas is 49 dB $L_{Aeq,16h}$. This meets the BS8233:2014 target guidance for noise in external amenity areas, and therefore the proposed location for external areas are considered

8.0 CONCLUSION

An environmental noise survey has been undertaken at Land Adjacent to 2 Hoyle Ing, Linthwaire, Huddersfield, HD7 5RX allowing the assessment of daytime and night-time levels likely to be experienced by the proposed development.

Measured noise levels allowed a robust glazing specification to be proposed which would provide internal noise levels for all residential environments of the development commensurate to the design range of BS8233:2014.

The maximum openable area for bedroom windows with the development has been presented based upon the requirements of Approved Document O.

An assessment of the external amenity areas with the development has been undertaken. The noise levels within the external amenity areas are in line with the guidance presented within BS8233:2014.

GENERAL ACOUSTIC TERMINOLOGY

Decibel scale - dB

In practice, when sound intensity or sound pressure is measured, a logarithmic scale is used in which the unit is the 'decibel', dB. This is derived from the human auditory system, where the dynamic range of human hearing is so large, in the order of 10^{13} units, that only a logarithmic scale is the sensible solution for displaying such a range.

Decibel scale, 'A' weighted - dB(A)

The human ear is less sensitive at frequency extremes, below 125Hz and above 16Khz. A sound level meter models the ears variable sensitivity to sound at different frequencies. This is achieved by building a filter into the Sound Level Meter with a similar frequency response to that of the ear, an A-weighted filter where the unit is dB(A).

L_{eq}

The sound from noise sources often fluctuates widely during a given period of time. An average value can be measured, the equivalent sound pressure level L_{eq} . The L_{eq} is the equivalent sound level which would deliver the same sound energy as the actual fluctuating sound measured in the same time period.

L_{10}

This is the level exceeded for no more than 10% of the time. This parameter is often used as a "not to exceed" criterion for noise.

L_{90}

This is the level exceeded for no more than 90% of the time. This parameter is often used as a descriptor of "background noise" for environmental impact studies.

L_{max}

This is the maximum sound pressure level that has been measured over a period.

Octave Bands

In order to completely determine the composition of a sound it is necessary to determine the sound level at each frequency individually. Usually, values are stated in octave bands. The audible frequency region is divided into 11 such octave bands whose centre frequencies are defined in accordance with international standards. These centre frequencies are: 16, 31.5, 63, 125, 250, 500, 1000, 2000, 4000, 8000 and 16000 Hertz.

Environmental noise terms are defined in BS7445, *Description and Measurement of Environmental Noise*.

APPLIED ACOUSTIC TERMINOLOGY

Addition of noise from several sources

Noise from different sound sources combines to produce a sound level higher than that from any individual source. Two equally intense sound sources operating together produce a sound level which is 3dB higher than a single source and 4 sources produce a 6dB higher sound level.

Attenuation by distance

Sound which propagates from a point source in free air attenuates by 6dB for each doubling of distance from the noise source. Sound energy from line sources (e.g. stream of cars) drops off by 3dB for each doubling of distance.

Subjective impression of noise

Hearing perception is highly individualised. Sensitivity to noise also depends on frequency content, time of occurrence, duration of sound and psychological factors such as emotion and expectations. The following table is a guide to explain increases or decreases in sound levels for many scenarios.

Change in sound level (dB)	Change in perceived loudness
1	Imperceptible
3	Just barely perceptible
6	Clearly noticeable
10	About twice as loud

Transmission path(s)

The transmission path is the path the sound takes from the source to the receiver. Where multiple paths exist in parallel, the reduction in each path should be calculated and summed at the receiving point. Outdoor barriers can block transmission paths, for example traffic noise. The effectiveness of barriers is dependent on factors such as its distance from the noise source and the receiver, its height and construction.

Ground-borne vibration

In addition to airborne noise levels caused by transportation, construction, and industrial sources there is also the generation of ground-borne vibration to consider. This can lead to structure-borne noise, perceptible vibration, or in rare cases, building damage.

Sound insulation - Absorption within porous materials

Upon encountering a porous material, sound energy is absorbed. Porous materials which are intended to absorb sound are known as absorbents, and usually absorb 50 to 90% of the energy and are frequency dependent. Some are designed to absorb low frequencies, some for high frequencies and more exotic designs being able to absorb very wide ranges of frequencies. The energy is converted into both mechanical movement and heat within the material; both the stiffness and mass of panels affect the sound insulation performance.