
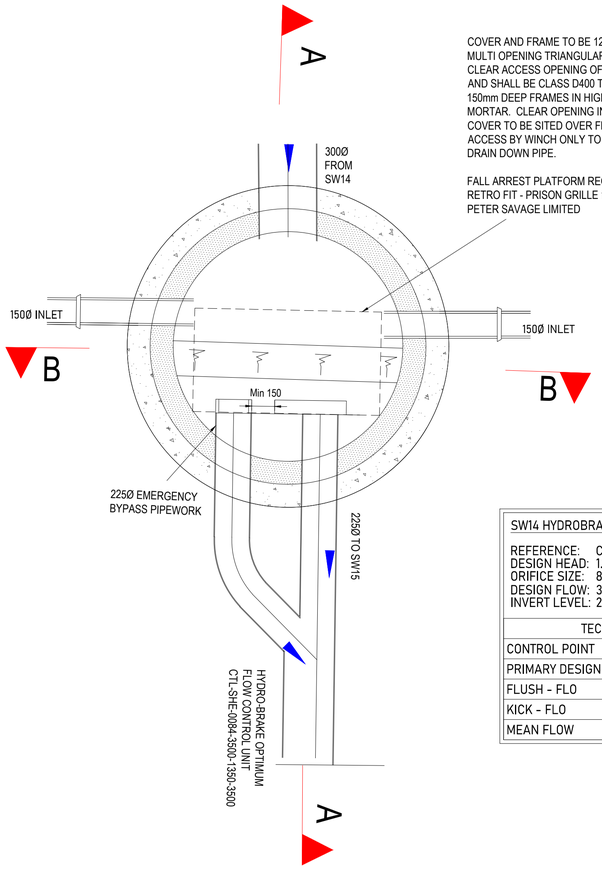


COVER AND FRAME TO BE 1220MM x 675mm MULTI OPENING TRIANGULAR COVERS, WITH A CLEAR ACCESS OPENING OF 1220mm x 675mm AND SHALL BE CLASS D400 TO BS EN 124 WITH 150mm DEEP FRAMES IN HIGHWAYS BEDDED ON MORTAR. CLEAR OPENING IN COVER SLAB AND COVER TO BE SITED OVER FLOW CONTROL. ACCESS BY WINCH ONLY TO FLOW CONTROL & DRAIN DOWN PIPE.

FALL ARREST PLATFORM REQUIRED - KD19 RETRO FIT - PRISON GRILLE 1220 X 675MM BY PETER SAVAGE LIMITED

PLAN ON FLOW CONTROL MANHOLE SW14

SCALE 1:20

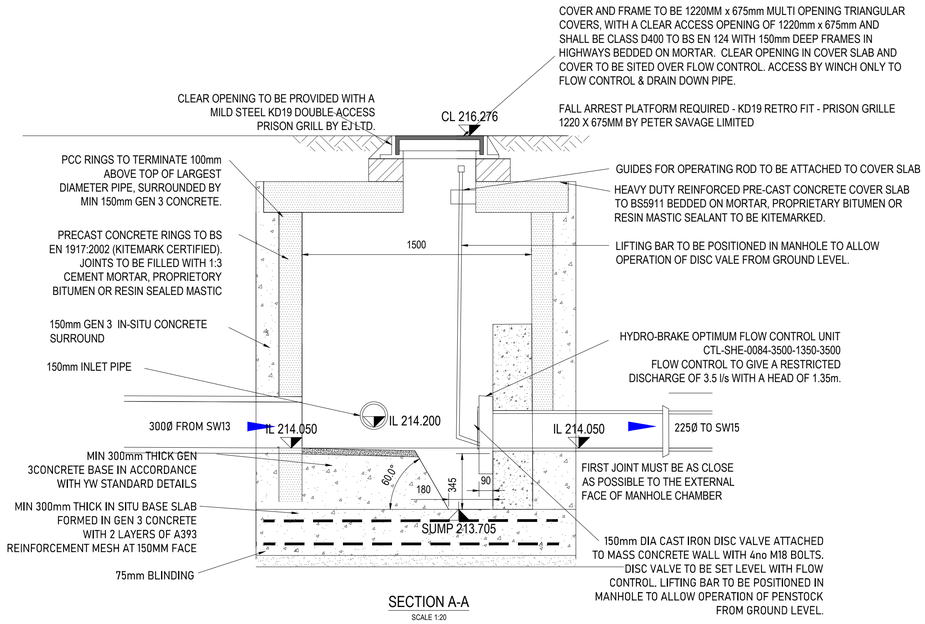

SECTION A-A


SCALE 1:20

SW14 HYDROBRAKE DETAILS

REFERENCE: CTL-SHE-0084-3500-1350-3500
DESIGN HEAD: 1.35m
ORIFICE SIZE: 82mm
DESIGN FLOW: 3.50 l/s
INVERT LEVEL: 214.050m


TECHNICAL SPECIFICATION		
CONTROL POINT	HEAD (m)	FLOW (l/s)
PRIMARY DESIGN	1.350	3.500
FLUSH - FLO	0.367	3.323
KICK - FLO	0.747	2.667
MEAN FLOW		2.973

MANHOLE NO.	SW14
COVER LEVEL	216.276
INVERT LEVELS	214.050
PIPE DIAMETERS	300
MANHOLE SIZE	1500
COVER TYPE	D400
MANHOLE TYPE	FLOW CONTROL
MANHOLE DEPTH	2.571

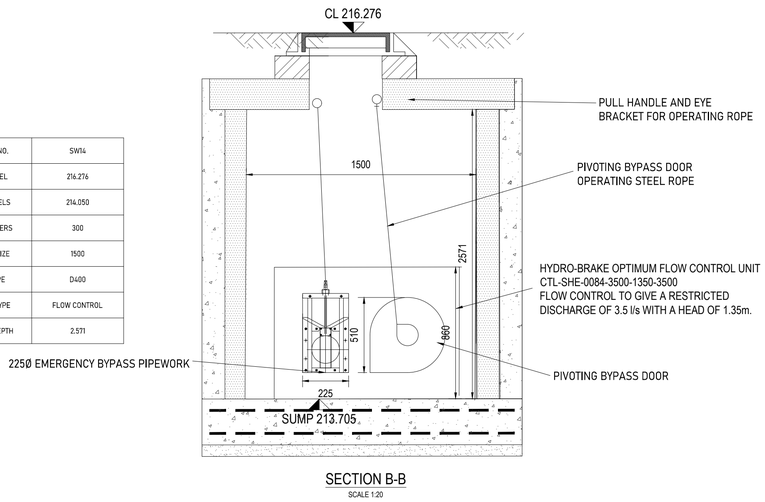

SECTION B-B

SCALE 1:20



REFER TO MANUFACTURERS DETAILS (EVS LIMITED - YORKSHIRE WATER APPROVED MANUFACTURER) FOR PENSTOCK INSTALLATION MANUAL.

PENSTOCK WALL MOUNT DETAIL

NOT TO SCALE

LIFTING BAR TO BE POSITIONED IN MANHOLE TO ALLOW OPERATION OF PENSTOCK FROM GROUND LEVEL. BYPASS PENSTOCK RISING STEM WITH CAP FOR TEE KEY OPERATION MANUFACTURED FROM CAST IRON BY EVS LIMITED. 375x375mm CLOSE FRAME WALL MOUNTED BI-DIRECTIONAL NON RISING PENSTOCK ATTACHED TO MASS CONCRETE WALL WITH 12 No. M16 BOLTS. DISK VALVE TO BE SET LEVEL WITH FLOW CONTROL.

OPERATING ROD TO BE POSITIONED SO COVER CANNOT BE SHUT WHILST DISC VALVE IN OPEN POSITION. CONSTRUCTED FROM MILD STEEL TO BS4360 GRADE 43A.

IF TEE KEY IS TO BE USED WITH THE OPERATING ROD AND IS SPECIFIC TO THE PRODUCT USED THEN THE TEE KEY IS TO BE HANDED OVER TO THE YORKSHIRE WATER CLERK OF WORKS FOR FUTURE USE IF REQUIRED.

ANY DISMANTLING OF THE FLOW CONTROL FOR MAINTENANCE PURPOSES SHOULD TAKE THE OPPORTUNITY TO REPLACE THE NEOPRENE SEAL BEFORE REMOUNTING

HEALTH & SAFETY:

1. CONTRACTOR SHOULD BE AWARE OF GENERAL CONSTRUCTION RISKS TO PREVENT SLIPS, TRIPS AND FALLS AND TAKE NECESSARY PRECAUTIONS WITHOUT SPECIAL INSTRUCTION.

ROADS & DRAINAGE

2. CONTRACTOR TO PROVIDE TRENCH SUPPORTS AS APPROPRIATE AND ENSURE THAT PLANT REMAINS A SAFE DISTANCE FROM TRENCHES PRIOR TO INSTALLING DRAINAGE
3. THE TIME THAT EXCAVATIONS ARE OPEN ON SITE SHOULD BE KEPT TO A MINIMUM AND ALL TRENCHES SHOULD BE SURROUNDED BY A BARRIER.
4. CONNECTIONS TO EXISTING SEWERS TO BE MADE BY APPROVED CONTRACTOR ONLY.
5. CONTRACTOR TO MAKE OPERATIVES AWARE OF ASSOCIATED DANGERS TO HEALTH SUCH AS LEPTOSPIROSIS (WEILS DISEASE) AND RECOMMENDED PRECAUTIONS. ADEQUATE WELFARE FACILITIES AND PROTECTIVE CLOTHING TO BE PROVIDED AS REQUIRED.
6. UNFINISHED MANHOLES MUST BE COVERED WITH LOAD BEARING MATERIALS AND SURROUNDED WITH BARRIER.
7. THE FIRST MANHOLE FROM THE CONNECTION TO THE (EXISTING) PUBLIC SEWER SHOULD, WHEN CONSTRUCTED, BE FITTED WITH A SCREEN IN ORDER TO PREVENT DEBRIS ENTERING THE PUBLIC SEWER. THE SCREEN SHOULD NOT BE REMOVED UNTIL IMMEDIATELY PRIOR TO OCCUPATION OF PREMISES TO BE SERVED BY THE SEWER.

PIPES & CABLES

8. CONTRACTOR TO OBTAIN ALL SERVICE RECORDS PRIOR TO WORKS COMMENCING.
9. SERVICE RECORDS TO BE REFERRED TO PRIOR TO WORK COMMENCING. CONTRACTOR TO PROCEED WITH CAUTION AND SERVICES TO BE LOCATED BY HAND DIG AND PROTECTED ACCORDINGLY.

EXCAVATION/FILL

10. CONTRACTOR TO ENSURE RELEVANT MEASURES ARE TAKEN TO KEEP PLANT AND PEOPLE A SAFE DISTANCE FROM STEEP SLOPES DURING THE WORKS.
11. CONTRACTOR TO ENSURE THAT PROCEDURES ARE IN PLACE TO KEEP PEOPLE A SAFE DISTANCE FROM WORKING PLANT WHERE NECESSARY.
12. CONTRACTOR TO REFER TO GROUND INVESTIGATION REPORT FOR CONTAMINATION TESTS AND TO PROVIDE ADEQUATE WELFARE FACILITIES AND PROTECTIVE CLOTHING AS REQUIRED.

DRAINAGE SPECIFICATIONS FOR YORKSHIRE WATER

1. ALL ADOPTABLE SEWER WORKS AND MATERIALS TO BE IN ACCORDANCE WITH "CODE FOR ADOPTION", THE RELEVANT BRITISH/EUROPEAN AND YORKSHIRE WATER'S STANDARDS/REQUIREMENTS/ADDENDUM TO THE MECHANICAL AND ELECTRICAL SPECIFICATION AND KITEMARKED.
2. MANHOLE COVERS SHALL/MUST HAVE A CLEAR OPENING OF 600mm AND SHALL BE CLASS D400 TO BS EN 124 WITH 150mm DEEP FRAMES IN HIGHWAYS.
3. FILLED GROUND MUST BE FILLED AND CONSOLIDATED UNDER THE SUPERVISION AND TO THE SATISFACTION OF YORKSHIRE WATER BEFORE ANY SEWER WORKS ARE CARRIED OUT.
4. YORKSHIRE WATER IS NOT OBLIGED TO ACCEPT FILTER DRAIN/LAND DRAINAGE RUN-OFF INTO THE PUBLIC SEWER NETWORK OR ADOPTABLE DRAINAGE SYSTEM (**DIRECTLY OR INDIRECTLY**). AN ALTERNATIVE METHOD OF DISPOSAL OF THE LAND DRAINAGE RUN-OFF WILL THEREFORE BE REQUIRED AND YOU WILL HAVE TO LIAISE WITH THE LOCAL AUTHORITY. LAND DRAINAGE SECTION WITH REGARD TO THE DISPOSAL OF THE FILTER DRAIN/LAND DRAINAGE RUN-OFF.
5. COVER SLABS MUST CARRY THE BSI KITEMARK OR WILL BE REJECTED BY YORKSHIRE WATER INSPECTOR, WHERE THE CLEAR OPENING OF THE KITEMARKED PRODUCT IS DIFFERENT TO THAT OF THE COVER AND FRAME, A LOADING BEARING SLAB SHOULD BE FITTED ABOVE THE COVER SLAB TO BRING THE SIZE DOWN TO 600mm X 600mm FOR THE YORKSHIRE WATER SPECIFIED COVER SIZE. PLEASE REFER TO CONCRETE PIPE SYSTEMS ASSOCIATION (**CPSA**), "TECHNICAL BULLETIN' ISSUED AUTUMN 2004 FOR KITEMARKED COVER SLAB OPENING SIZES.
6. SULPHATE RESISTANT CEMENT (**C20-DC2**) AND PRECAST CONCRETE PRODUCTS MUST BE USED OR A LABORATORY REPORT PROVIDED PROVING THAT SUCH PRECAUTIONS ARE NOT NECESSARY.
7. THE ADOPTABLE SEWERS SHOULD BE A MINIMUM OF 1m AND MANHOLES 0.5m FROM KERB FACES AND SERVICE MARGINS.
8. SEWERS MUST HAVE 5 METRES CLEARANCE FROM TREES AND HEDGES.
9. SEWERS TO BE LAID IN CLASS "S" BEDDING (150mm GRANULAR BED AND SURROUND). WHERE DEPTH OF COVER TO TOP OF THE SEWER IS LESS THAN 1.2m IN HIGHWAYS AND VERGES (OR LESS THAN 900mm IN NONE VEHICULAR ACCESS AREAS) THEN A CONCRETE SLAB SHOULD BE PROVIDE ABOVE GRANULAR BED AND SURROUND.
10. BEDDING AND BACKFILL MATERIAL TO CONFORM TO THE REQUIREMENT OF WATER INDUSTRY SPECIFICATION 4-08-02 (**TABLE A2**).
11. THE CHAMBER SIZE OF MANHOLES WITH MORE THAN ONE CONNECTION IN THEM MAY NEED TO BE INCREASED AN INCREMENT TO ACCOMMODATE THE CONNECTIONS AND BENDS.
12. YORKSHIRE WATER POLICY IS THAT TYPE "C" BRICK MANHOLES AND 1050mm DIA MANHOLE RINGS ARE NOT PREFERRED. INSTEAD IT IS PREFERRED THAT YOU USE A TYPE "B" MANHOLE WITH 1200mm DIA OR 1500mm DIA RINGS, WITH THE OPENING SITED OVER THE CHANNEL WHERE DEPTH OF COVER TO PIPE SOFFIT IS 1 - 1.5m.
13. ALL ADOPTABLE PLASTIC SEWER PIPES TO BE KITEMARKED (CERTIFIED TO WIS 4-35-01 AND BS/EN1476), ADOPTABLE PLASTIC SEWER PIPES TO BE LAID IN MAXIMUM 3 METRE LENGTHS UNLESS THERE IS A SPECIFIC OPERATIONAL NEED TO LAY LONGER LENGTHS. PLASTIC CHANNEL SECTIONS IN MANHOLES ARE NOT ACCEPTABLE AND YORKSHIRE WATER WOULD PREFER CLAYWARE CHANNEL IN MANHOLES. PLASTIC CHANNELS ARE DIFFICULT TO SET IN CONCRETE BECAUSE THEY FLOAT AND A SATISFACTORY FINISH CANNOT BE OBTAINED ON THE BENCHING.
14. THE MINIMUM CRUSHING STRENGTH FOR CLAY PIPES SHOULD BE AS FOLLOWS: 100mm DIA. 40kN/m, 150mm DIA 40kN/m, 225mm DIA 45kN/m AND 300mm DIA. 72kN/m. THE MINIMUM CRUSHING STRENGTH FOR CONCRETE PIPES SHOULD BE -(CLASS 120 TO EN 1916/BS5911-1 2002). PLASTIC PIPES SHOULD CONFORM TO WIS 4-35-01 AND BS EN13476.
15. WHERE A B125 COVER AND FRAME HAS BEEN APPROVED, THIS MUST NOT BE COATED IN PLASTIC AND MUST HAVE LIFTING EYES SUITABLY SIZED TO ACCOMMODATE STANDARD LIFTING KEYS. SCREW DOWN COVERS ARE NOT ACCEPTABLE.

OTHER DRAINAGE NOTES

16. ALL PRIVATE DRAINAGE WORKS SHALL BE CARRIED OUT IN ACCORDANCE WITH BUILDING REGULATIONS 2002 EDITION.
17. CONTRACTOR TO ESTABLISH POSITION SIZE AND DEPTH OF ALL EXISTING SEWERS AND SERVICES PRIOR TO COMMENCEMENT ON SITE.
18. THE CONTRACTOR SHALL ALLOW FOR THE PROTECTION, TEMPORARY AND PERMANENT SUPPORT, AND TEMPORARY AND PERMANENT DIVERSION WORKS, AS NECESSARY TO ALL EXISTING SERVICES.
19. THE CONTRACTOR SHALL ALLOW FOR ALL TRAFFIC MANAGEMENT IN CONNECTION WITH ROAD AND SEWER WORKS.
20. THE CONTRACTOR SHALL ALLOW FOR KEEPING SEWER TRENCHES AND EXCAVATIONS AS DRY AS PRACTICABLE BY PUMPING FROM TEMPORARY SUMPS AND DEWATERING AS APPROPRIATE, THE POINT AND METHOD OF DISCHARGE TO BE AGREED WITH THE DRAINAGE AUTHORITY.
21. FOR PIPE SPECIFICATION PLEASE REFER TO ADDITIONAL NOTES.
22. VITRIFIED CLAY PIPES AND FITTINGS SHALL COMPLY WITH THE RELEVANT PROVISIONS OF BS EN295 AND BS 65 RESPECTIVELY AND BE KITEMARKED. ALL PIPES SHALL BE EXTRA STRENGTH TO BS 65 OR EQUIVALENT BS EN295 PIPE CRUSHING STRENGTH.
23. PRECAST CONCRETE PRODUCTS SHALL COMPLY WITH THE RELEVANT PROVISIONS OF BS 5911 AND BE KITEMARKED. CONCRETE PIPES TO BE CLASS 120 UNLESS NOTED OTHERWISE.
24. GULLY GRATES AND FRAMES SHALL COMPLY WITH THE RELEVANT PROVISIONS OF BS EN124 AND BE OF A NON-ROCKING DESIGN WITH CAPTIVE HINGE ACCESS AND BE KITEMARKED. LOAD CLASS D400 FOR ROADS AND SERVICE YARD AREAS, CLASS C250 TO BE USED IN CAR PARKING AREAS.
25. BACKFILLING AND REINSTATEMENT TO TRENCHES IN PUBLIC HIGHWAYS SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS AND SPECIFICATIONS OF THE ADOPTING AUTHORITY, OR, IN THE ABSENCE OF SUCH, IN ACCORDANCE WITH THE REQUIREMENTS OF "THE STREET WORKS REGULATIONS 1992" AND RELEVANT PROVISIONS OF H.A.U.C. "SPECIFICATION FOR THE REINSTATEMENT OF OPENINGS IN HIGHWAYS" JUNE 1992, BOTH UNDER SECTION 71 OF THE NEW ROADS AND STREET WORKS ACT 1991.
26. ALL TRADITIONAL RAINWATER PIPE DOWN COMERS TO DISCHARGE TO TRAPPED GULLIES.
27. ALL SIPHONIC DRAINAGE DOWN COMERS TO MANUFACTURER SPECIFICATION.
28. ALL ROAD GULLIES ARE TO BE TRAPPED GULLIES.
29. ALL GULLY LEADS TO BE 150mm DIAMETER.
30. ALL REDUNDANT EXISTING DRAINAGE TO BE GRUBBED UP OR GROUTED, ANY EXISTING LIVE DRAINAGE SHOULD BE REPORTED TO THE ENGINEER AND RECONNECTED.
31. ALL ROAD GULLIES & LEADS TO BE CLEARED OF DEBRIS UPON COMPLETION OF WORKS.
32. THE CONTRACTOR MUST ENSURE THAT ANY OF THE EXISTING DRAINAGE WHICH IS LIVE IS KEPT CLEAR OF DEBRIS AND SHOULD ALLOW FOR JETTING THROUGH THE NEW & EXISTING DRAINAGE UPON COMPLETION.
33. CONTRACTOR TO TAKE MEASURES TO PROTECT HIS OPERATIVES WITH RESPECT TO THE PRESENCE OF GAS IN SEWER TRENCHES AND MANHOLES THROUGH THE USE OF GAS MONITORING EQUIPMENT AND BREATHING APPARATUS AS REQUIRED.
34. CONTRACTOR TO APPLY FOR SEWER PERMITS AND ROAD OPENING PERMITS AS NECESSARY FROM THE APPROPRIATE AUTHORITIES, PRIOR TO COMMENCING WORKS.
35. WHERE PLASTIC PIPES ARE INSTALLED PRIOR TO GETTING APPROVAL THEN A LIGHT LINE CCTV SURVEY AND REPORT (ELECTRONIC DEFLECTION TESTING) OF THE PROSPECTIVELY ADOPTABLE SEWERS ARE REQUIRED PRIOR TO APPROVAL AT THE DEVELOPERS EXPENSE.

Date	Revisions	Drawn	Checked	Rev
22.06.2026	FIRST ISSUE	NA	AE	1

Dwg Status: TENDER

NORTH EAST
0191 2585632

YORKSHIRE
0113 535 3500

RWO CONSULTING ENGINEERS

WWW.RWO.GROUP
INFO@RWO.GROUP

Client: YORKSHIRE COUNTY PROPERTIES

Project: DENBY LANE
GRANGE MOOR

Title: SW14 FLOW CONTROL DETAILS

DO NOT SCALE	Scale @ A1: 20	Drawn SR	Checked AE	Date 22.06.2026
Job No Y22054		Dwg No D703		Rev 1