

UPPER GROUND FLOOR


AUTOMATIC FIRE/SMOKE
DETECTION SYSTEM TO
BS: 5839
EMERGENCY LIGHTING TO
BS: 5266

KEY

- CP ⊕ CALL POINT
- SD ⊗ SMOKE DETECTOR
- HD ⊗ HEAT DETECTOR

OCCUPANCY LEVELS BASED ON
ADB2 TABLE D1

UPPER GROUND FLOOR	36
LOWER GROUND FLOOR	19
TOTAL	55

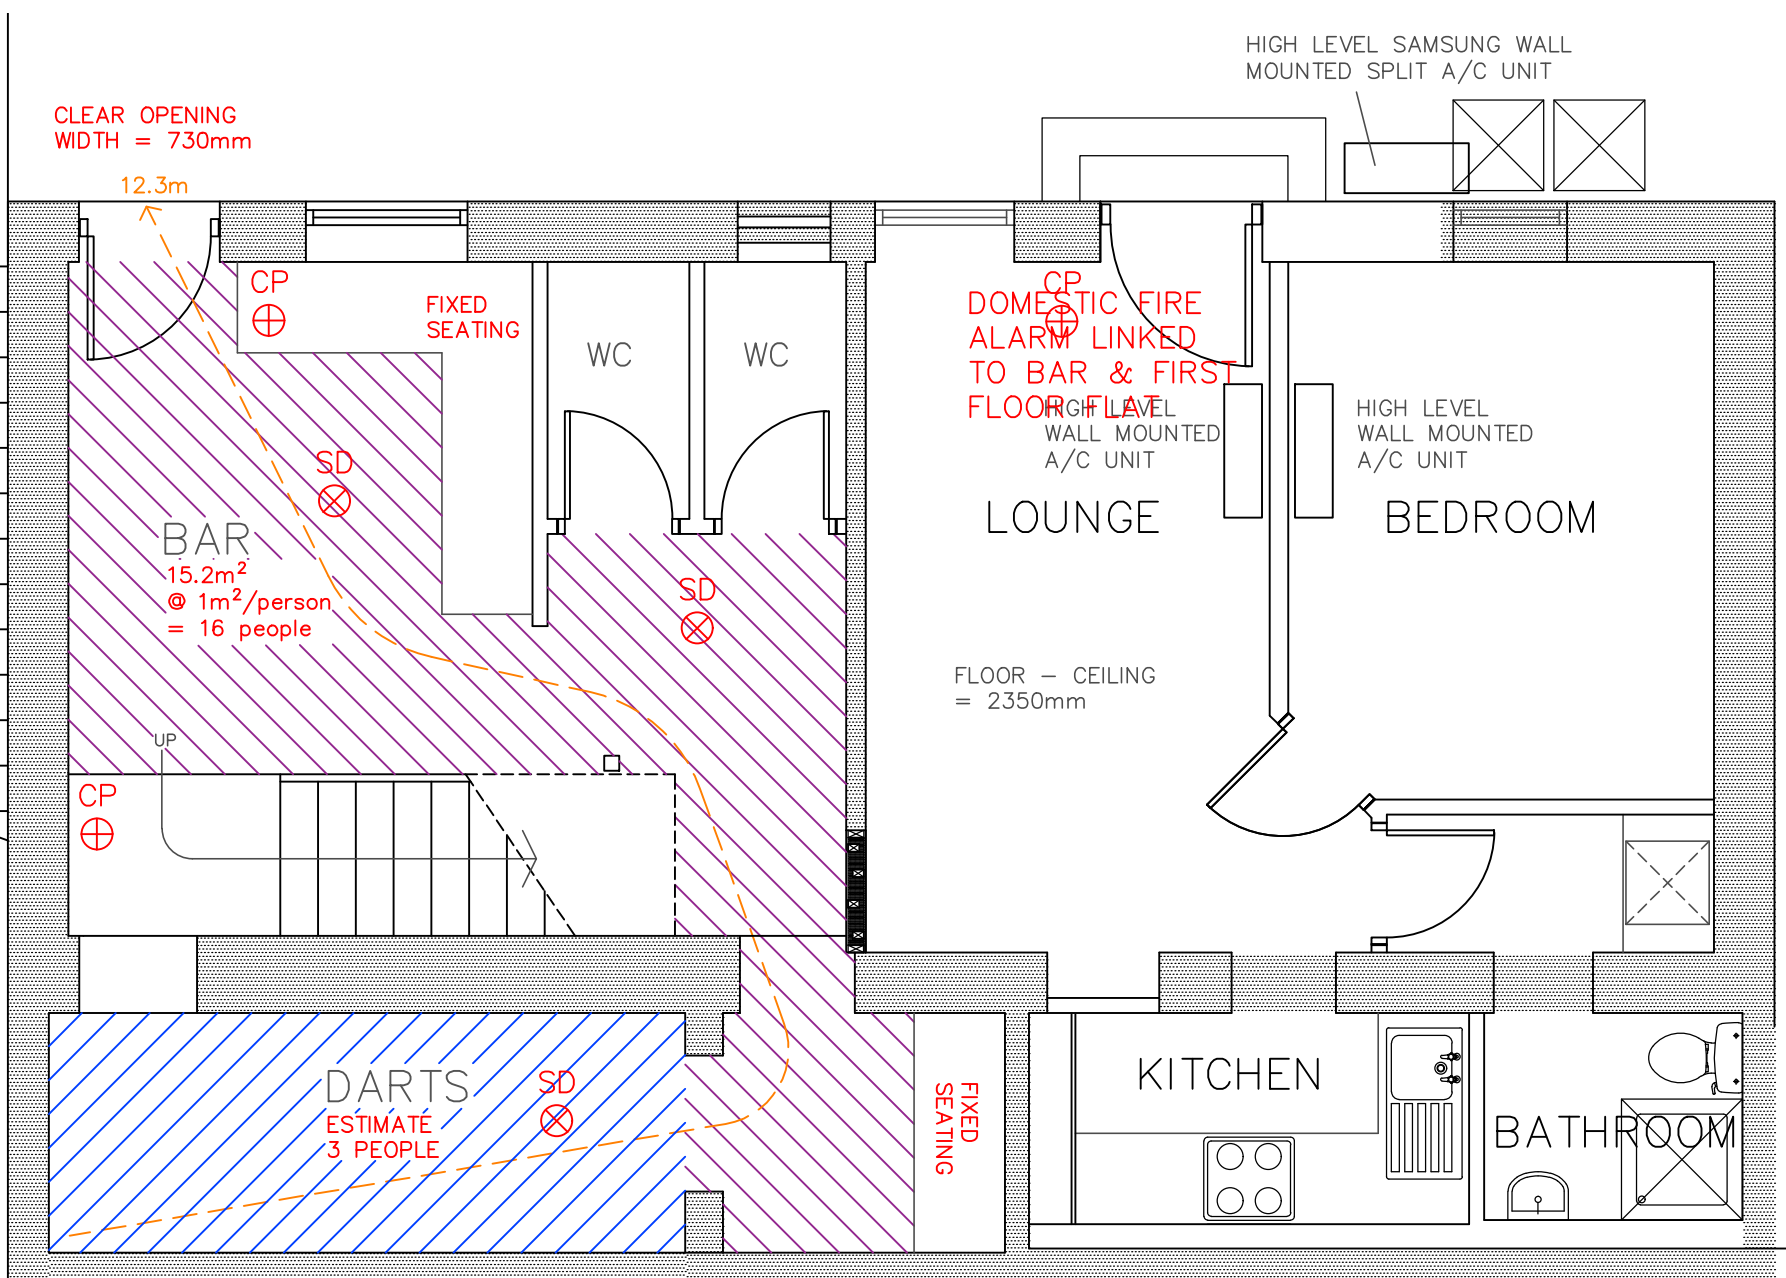

LOWER GROUND FLOOR