

TD Jagger Ltd  
3 Richmond House  
Caldene Business Park  
Mytholmroyd  
HX7 5QJ

For the attention of Mr T Jagger

12<sup>th</sup> June 2026

Dear Thomas

**RCE6909 – JL Brierley Ltd**

The following arrangement has been revised with respect to the protection of the canal boundary wall at the JL Brierley project. I am satisfied that the manufacturers state that it is suitable for restraint against the relevant potential HGV loadings as set out in BS6180 and BS6399 (and the relevant Eurocode standards), provided the posts are at 1.6m centres.

The reinforced concrete base slab at a depth of 250mm can easily accommodate the loadings applied.

Refer to Figure 1 for proposed detail.

I hope the contents of this letter are of assistance. Should you have any queries arising, please do not hesitate to contact me.

Yours sincerely

For and on behalf of Rose Consulting Engineers



Dr Paul Rose BEng(Hons) PhD CEng MStructE MICE  
Director

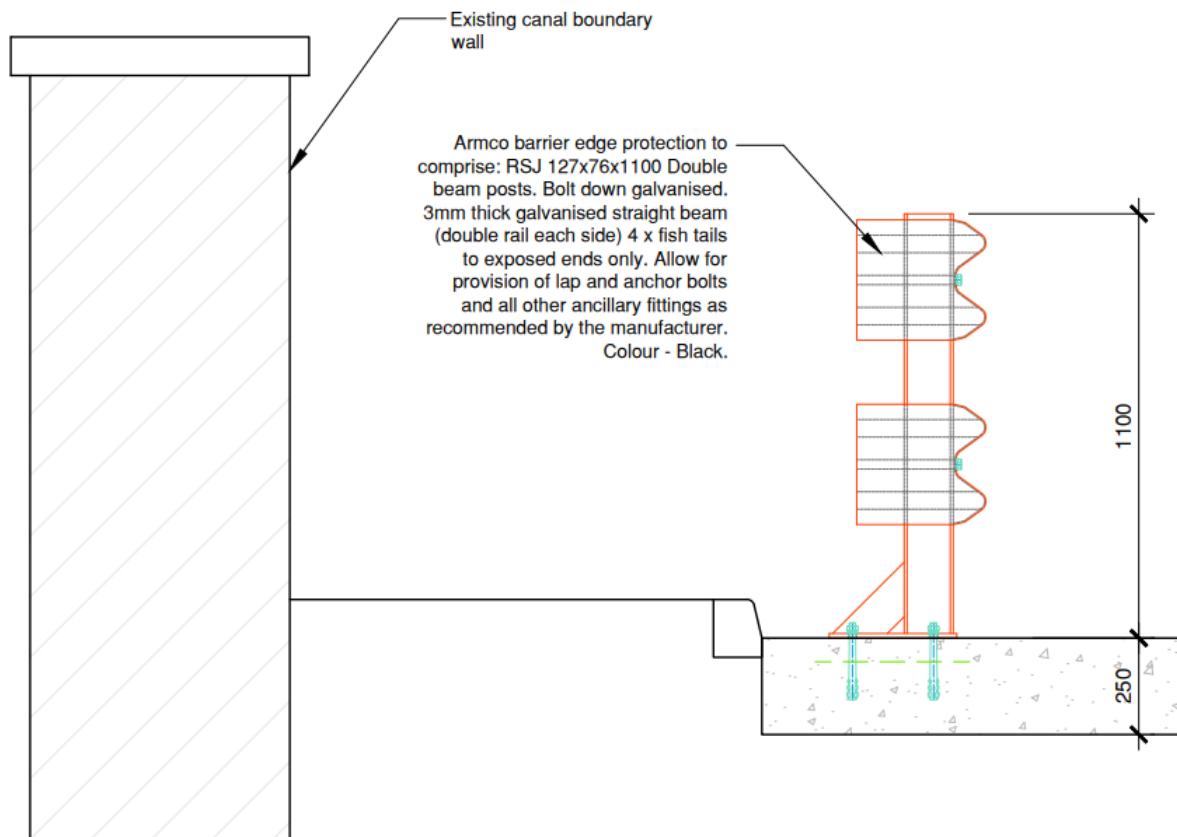


Figure 1 – Proposed barrier formation