



SUBSTATION DOORS TO MEET SPECIFICATION WITH VENTILATION OPENINGS, IN 2590x2400mm HIGH BRICKWORK OPENING

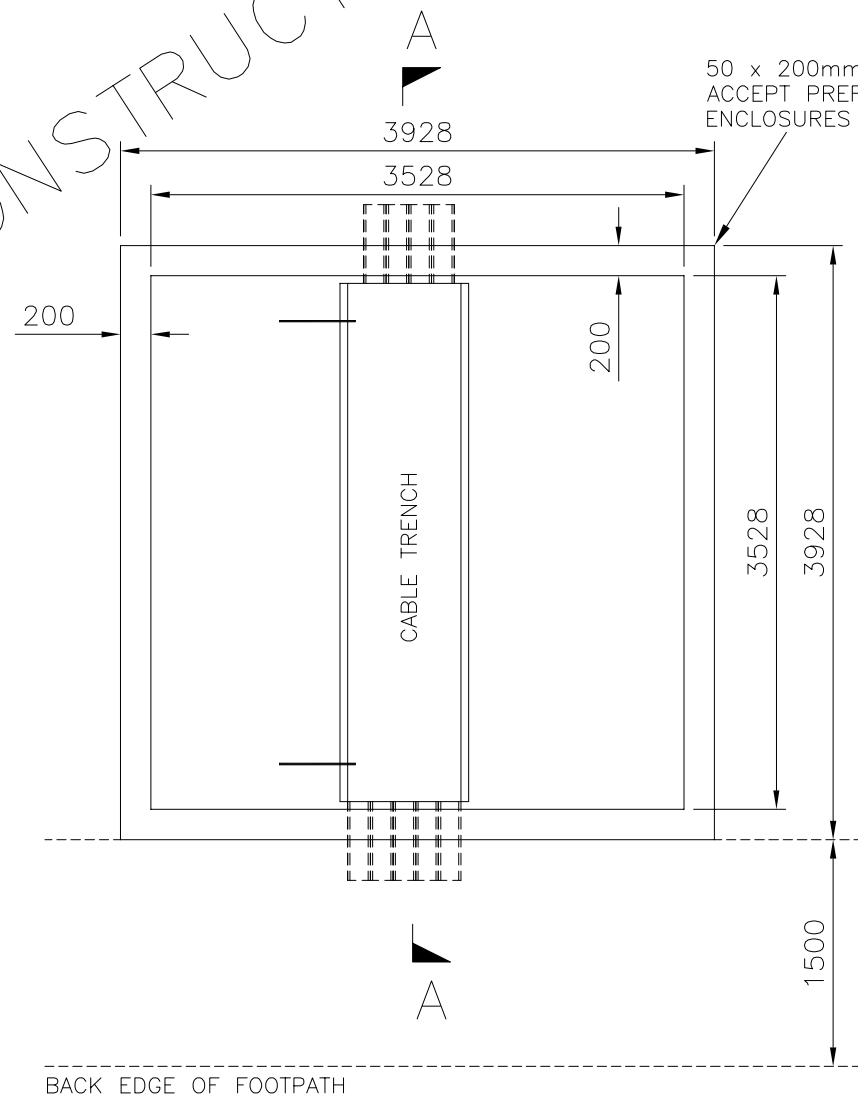

NOTES

Substation doors to be set back a minimum of 1500mm from back edge of footpath. Any proposed reduction in this clearance to be approved by Northern Powergrid following submission of site specific risk assessment and operational method statement.

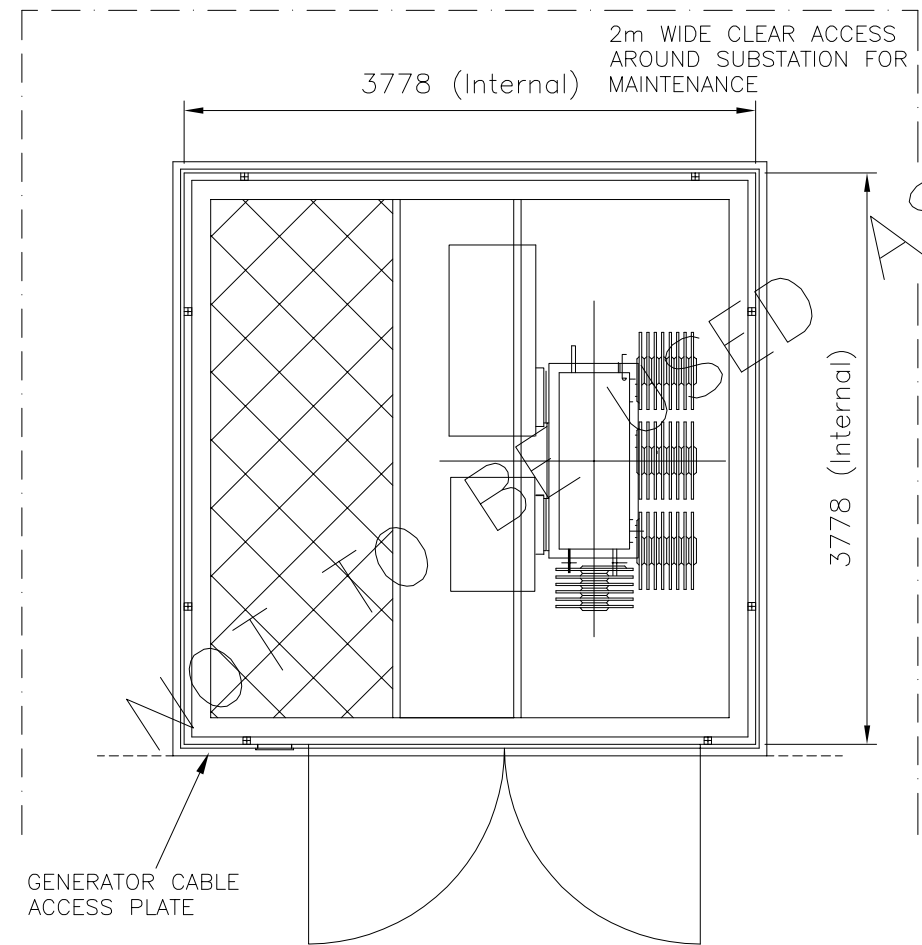

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

Manufacturer Details

315 - 1000kVA SLIDE IN UDE IN PREFABRICATED ENCLOSURE

Sheet No.

Scale

1

AS SHOWN

Prepared By

TM

Document Details

GENERAL ARRANGEMENT / PLAN & ELEVATIONS

Revised

Grid Reference

Ref No.

C1063405

Historic Drawing No.

Date Issued

17.05.16

Checked By

JJ

Revision

A

Notes