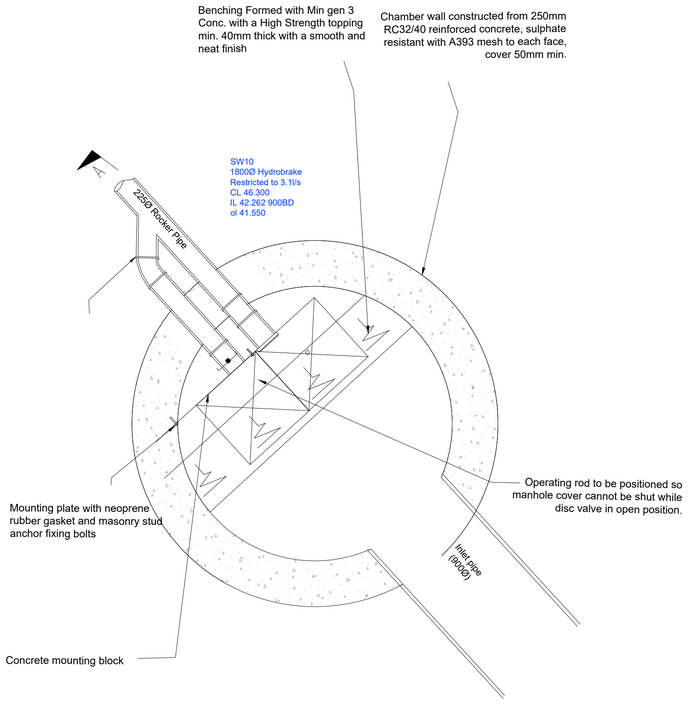

PLAN ON SW10 (1:20)

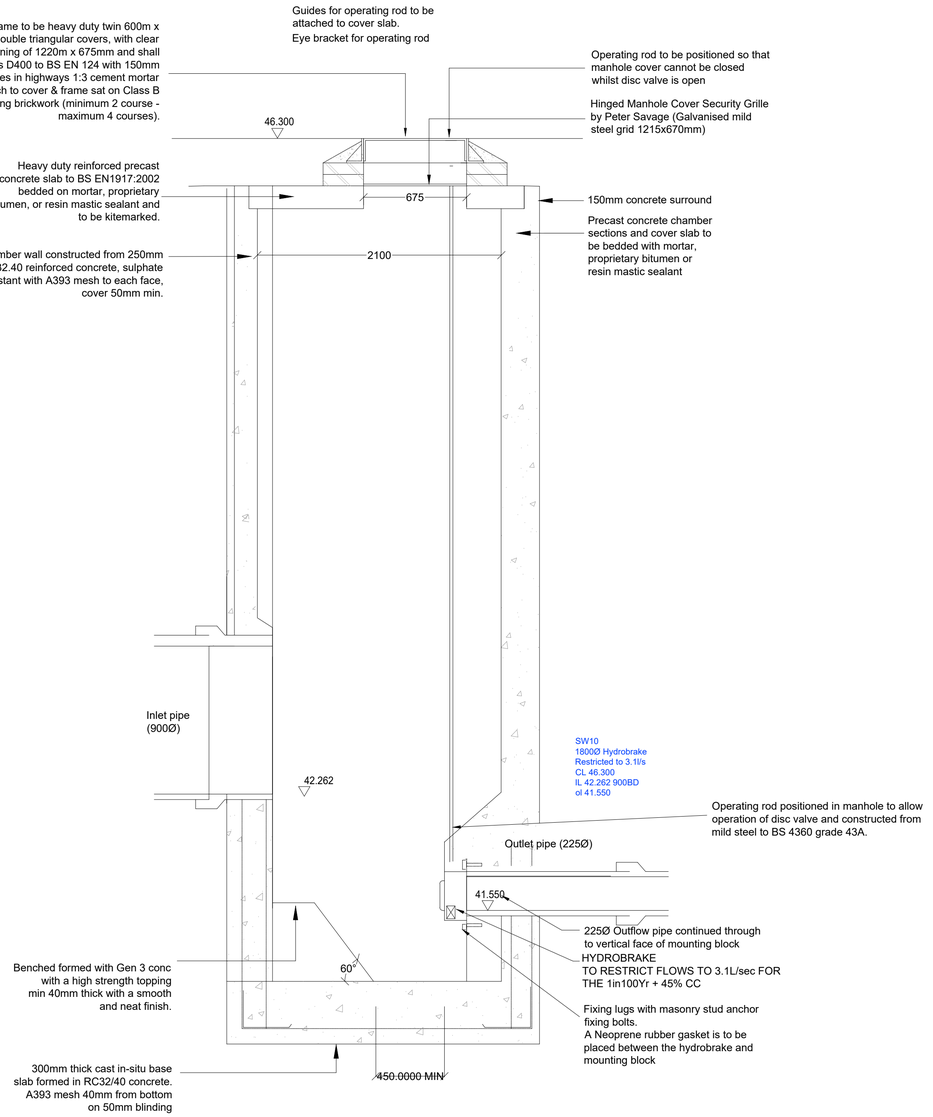

SECTION A-A THROUGH SW10 (1:20)

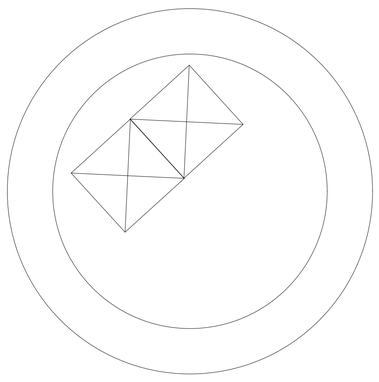

COVER SLAB ARRANGEMENT (1:20)

The benching to Manholes shall be boxed-out and benched in accordance with standard manhole details and the following conditions:

1. Where access into Manholes is restricted and the required headroom cannot be achieved.
2. Where the pipe internal diameters are 1050mm or greater.
3. The width of boxed out benching shall be 750mm.
4. all access ladders or step irons must continue in accordance with standard manhole details.

All boxing-out of the benching within manholes shall be approved by Yorkshire Water before work commences.

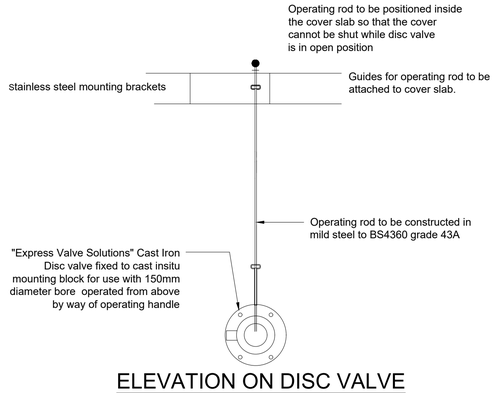

ELEVATION ON DISC VALVE

To Suit KD19 - Retro Fit

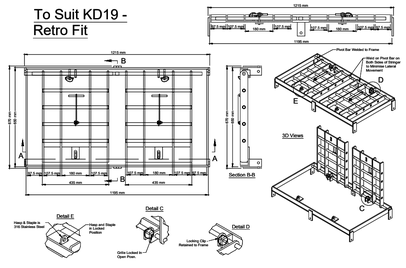

WREKIN FALL ARREST GRILLE

This drawing is copyright of DART Engineers Ltd and must not be copied or reproduced in any way without written consent.
DO NOT SCALE OFF THIS DRAWING

Status

No.	Revision	Date	Drwn

DART ENGINEERS LTD
CIVIL AND STRUCTURAL ENGINEERING

CONTACT
e: andy@dart-engineers.com
e: robt@dart-engineers.com
m: 07725281902
w: www.dart-engineers.com

CLIENT
WORDWORTH PROPERTIES

PROJECT
LONG LANE

DRAWING TITLE
S104 Flow Control

Drawn	Chkd	Date	Scale
HD	RT	30.09.24	1/20

Sheet Size	Drawing No.	Revision
A1	23590-DR-C-0104-2	P2