



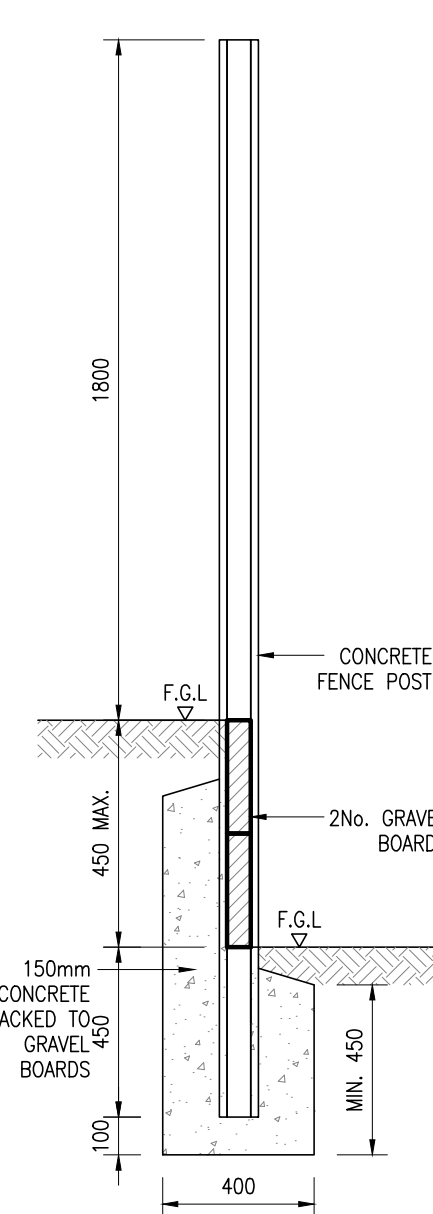


TYPICAL CONCRETE
POST/GRAVEL
BOARD FENCE

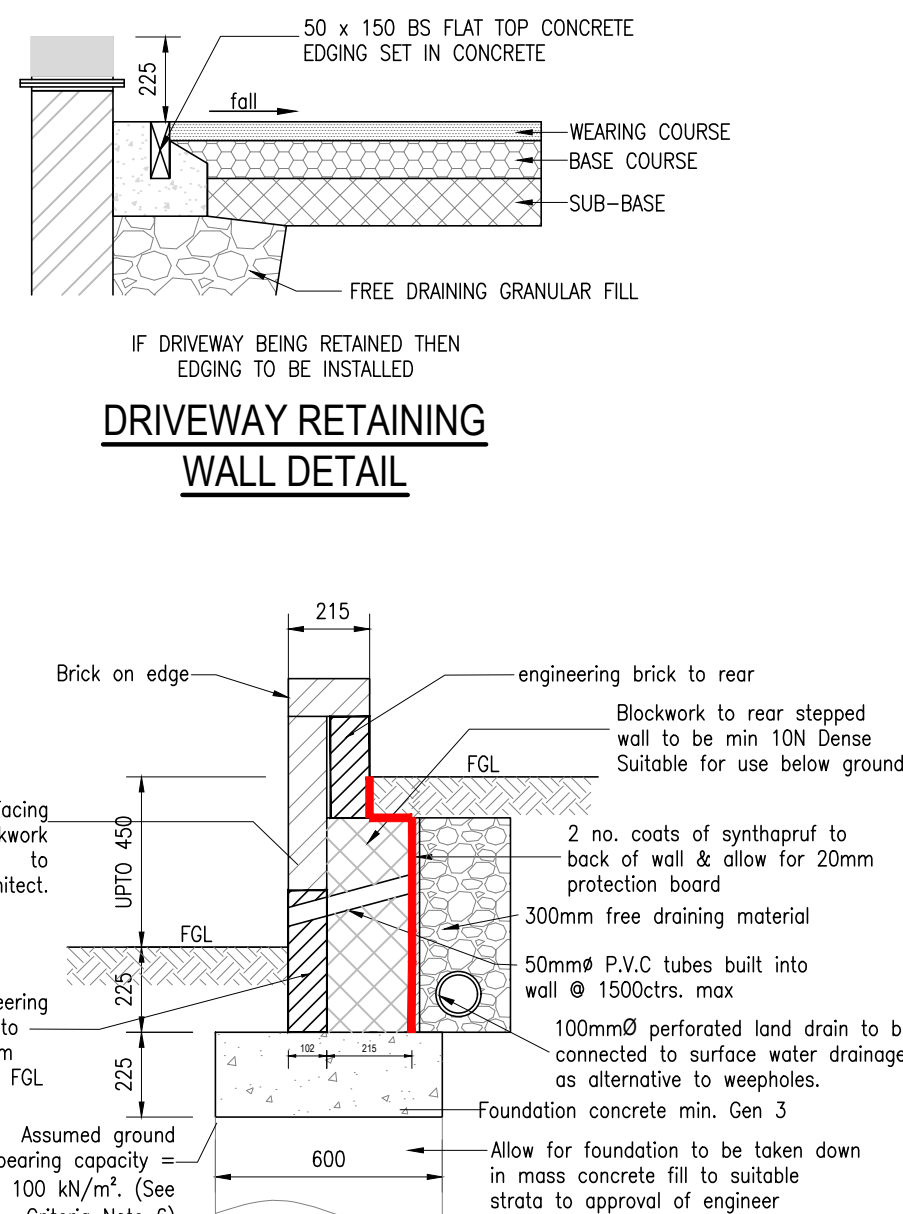


DRIVEWAY RETAINING
WALL DETAIL


TYPICAL RETAINING WALL
(UP TO 450mm)

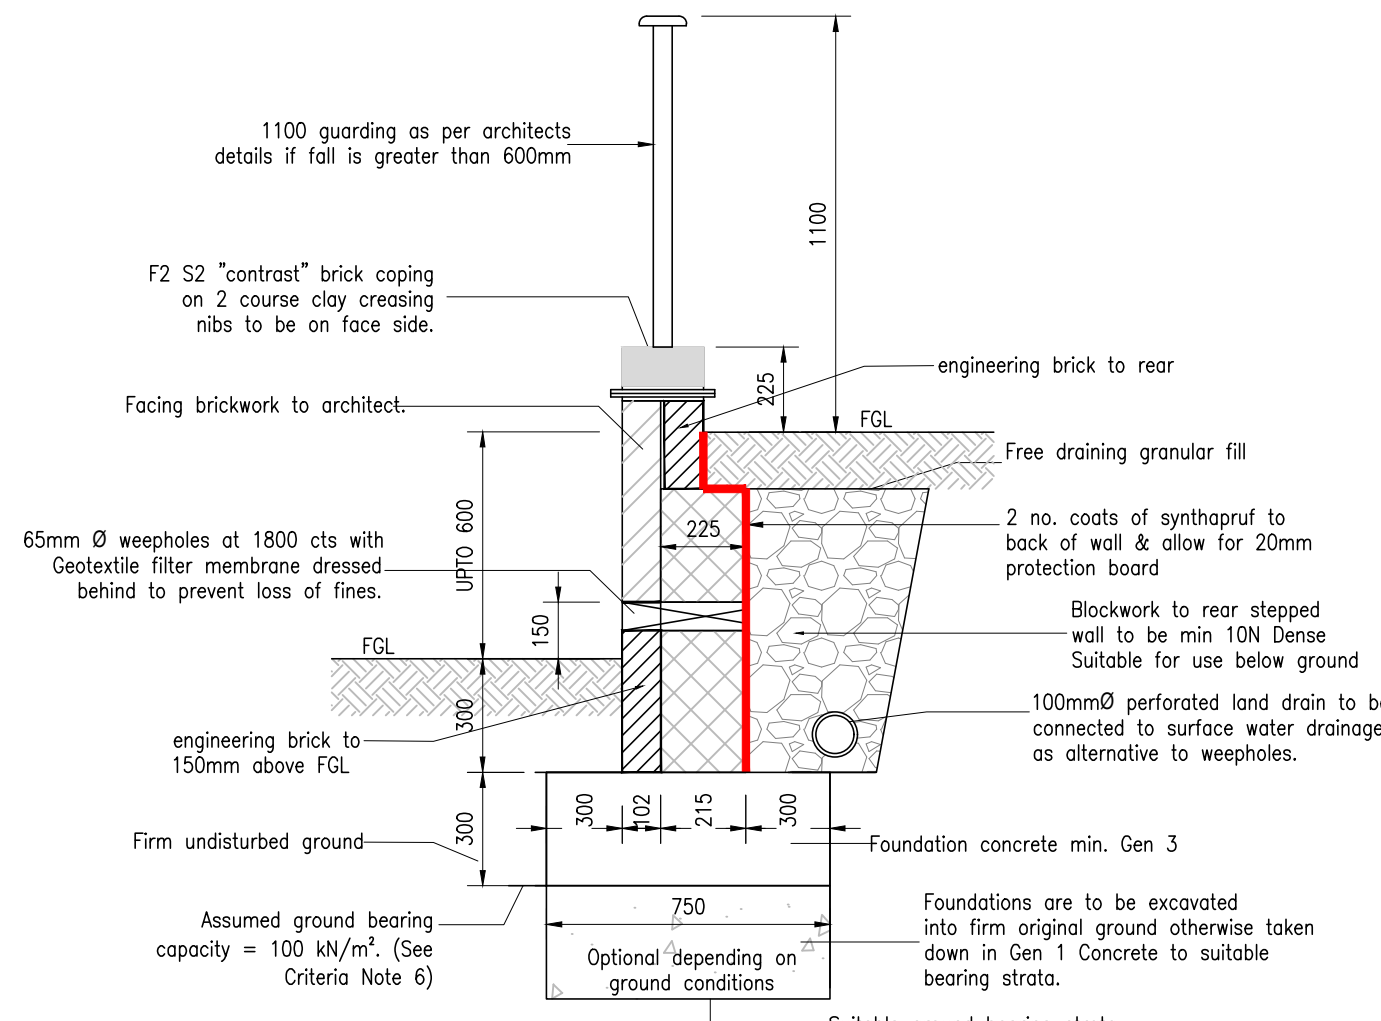


TYPICAL RETAINING WALL
(UP TO 600mm)

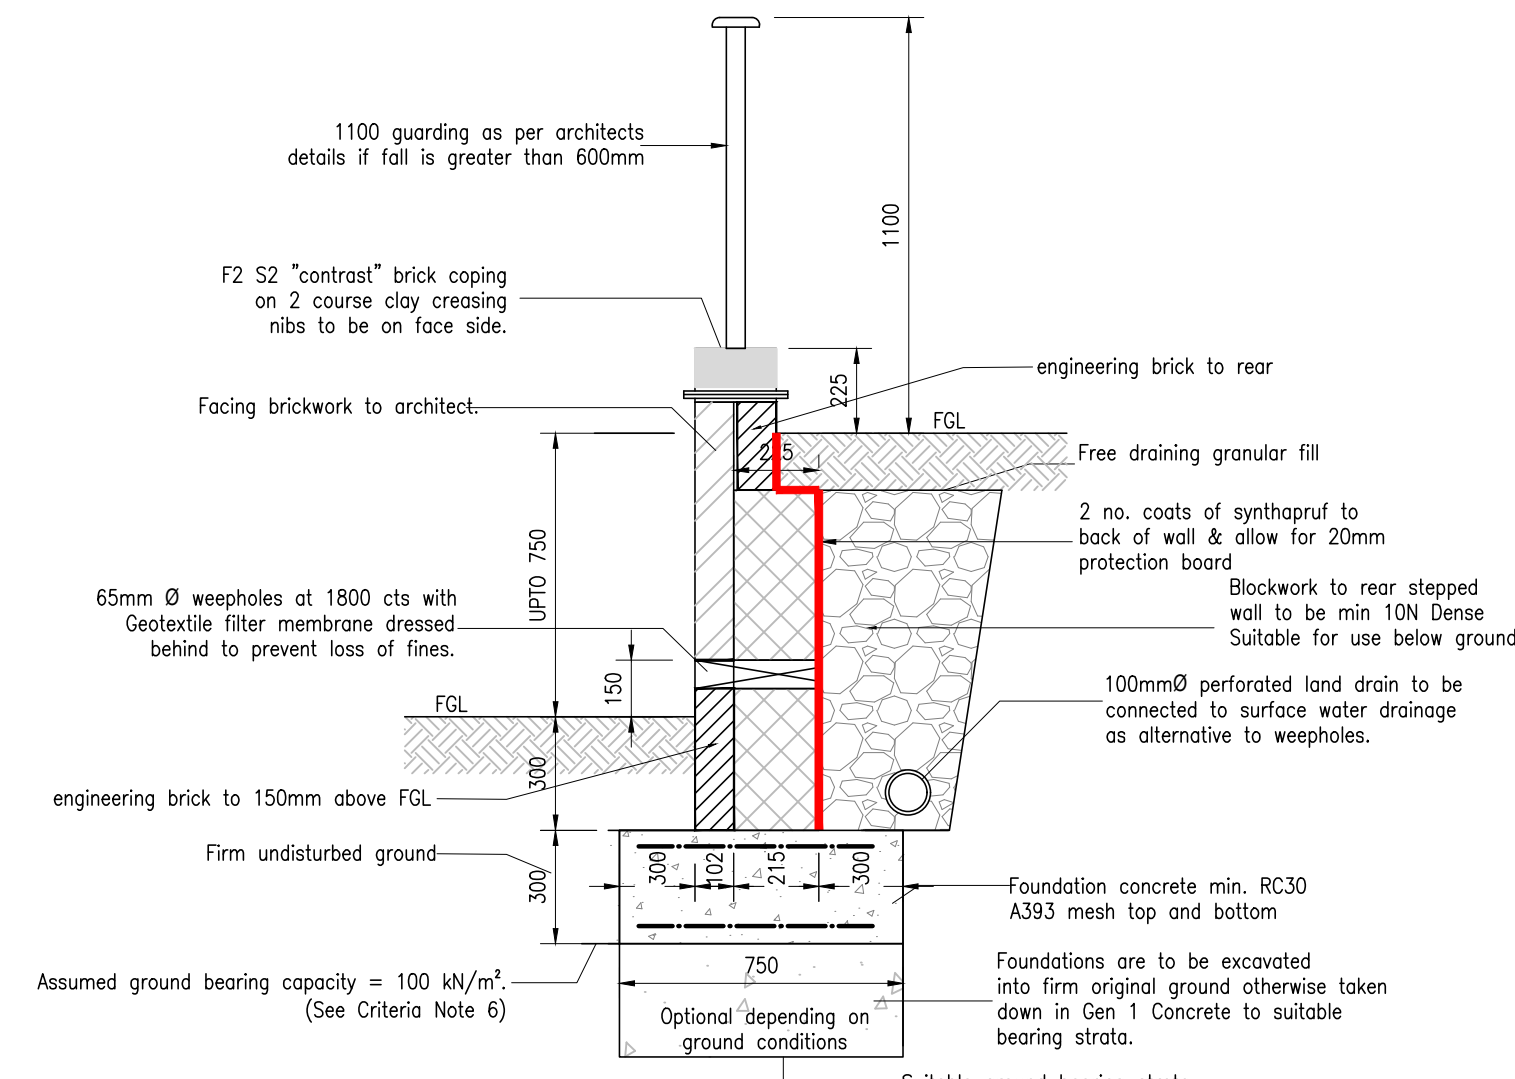


TYPICAL RETAINING WALL
(UP TO 750mm)

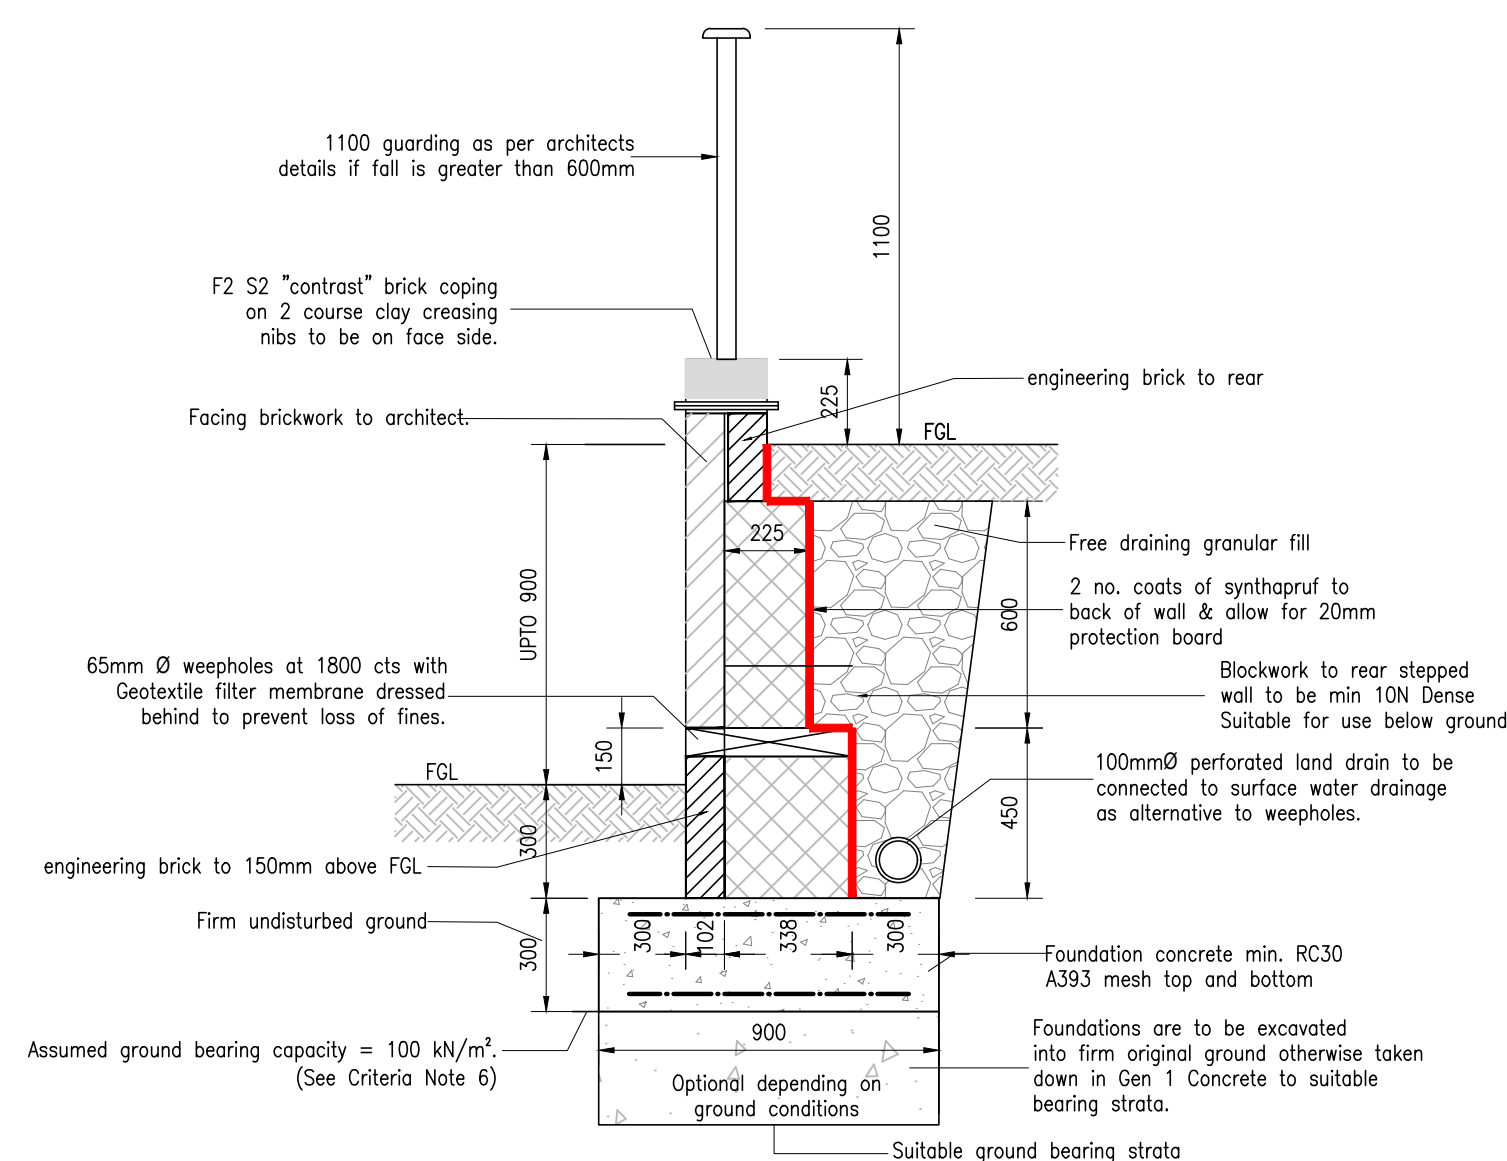

TYPICAL RETAINING WALL
(UP TO 900mm)

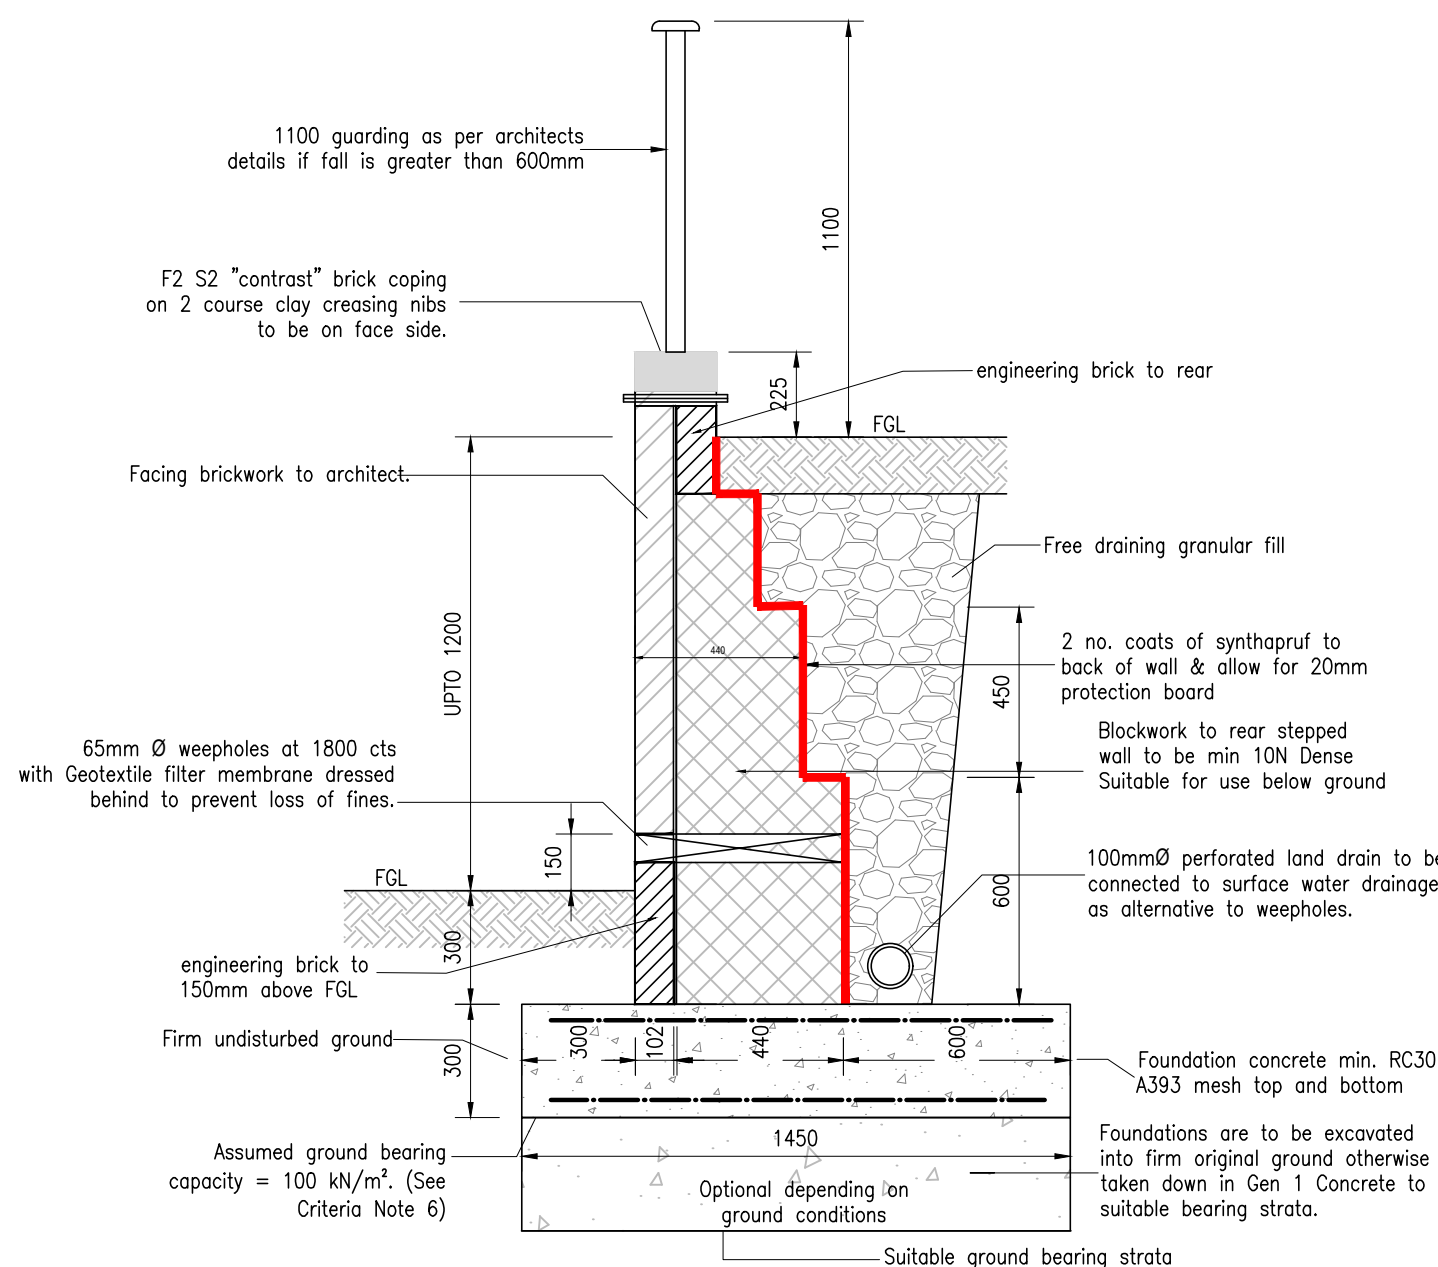

TYPICAL RETAINING WALL
(UP TO 1200mm)

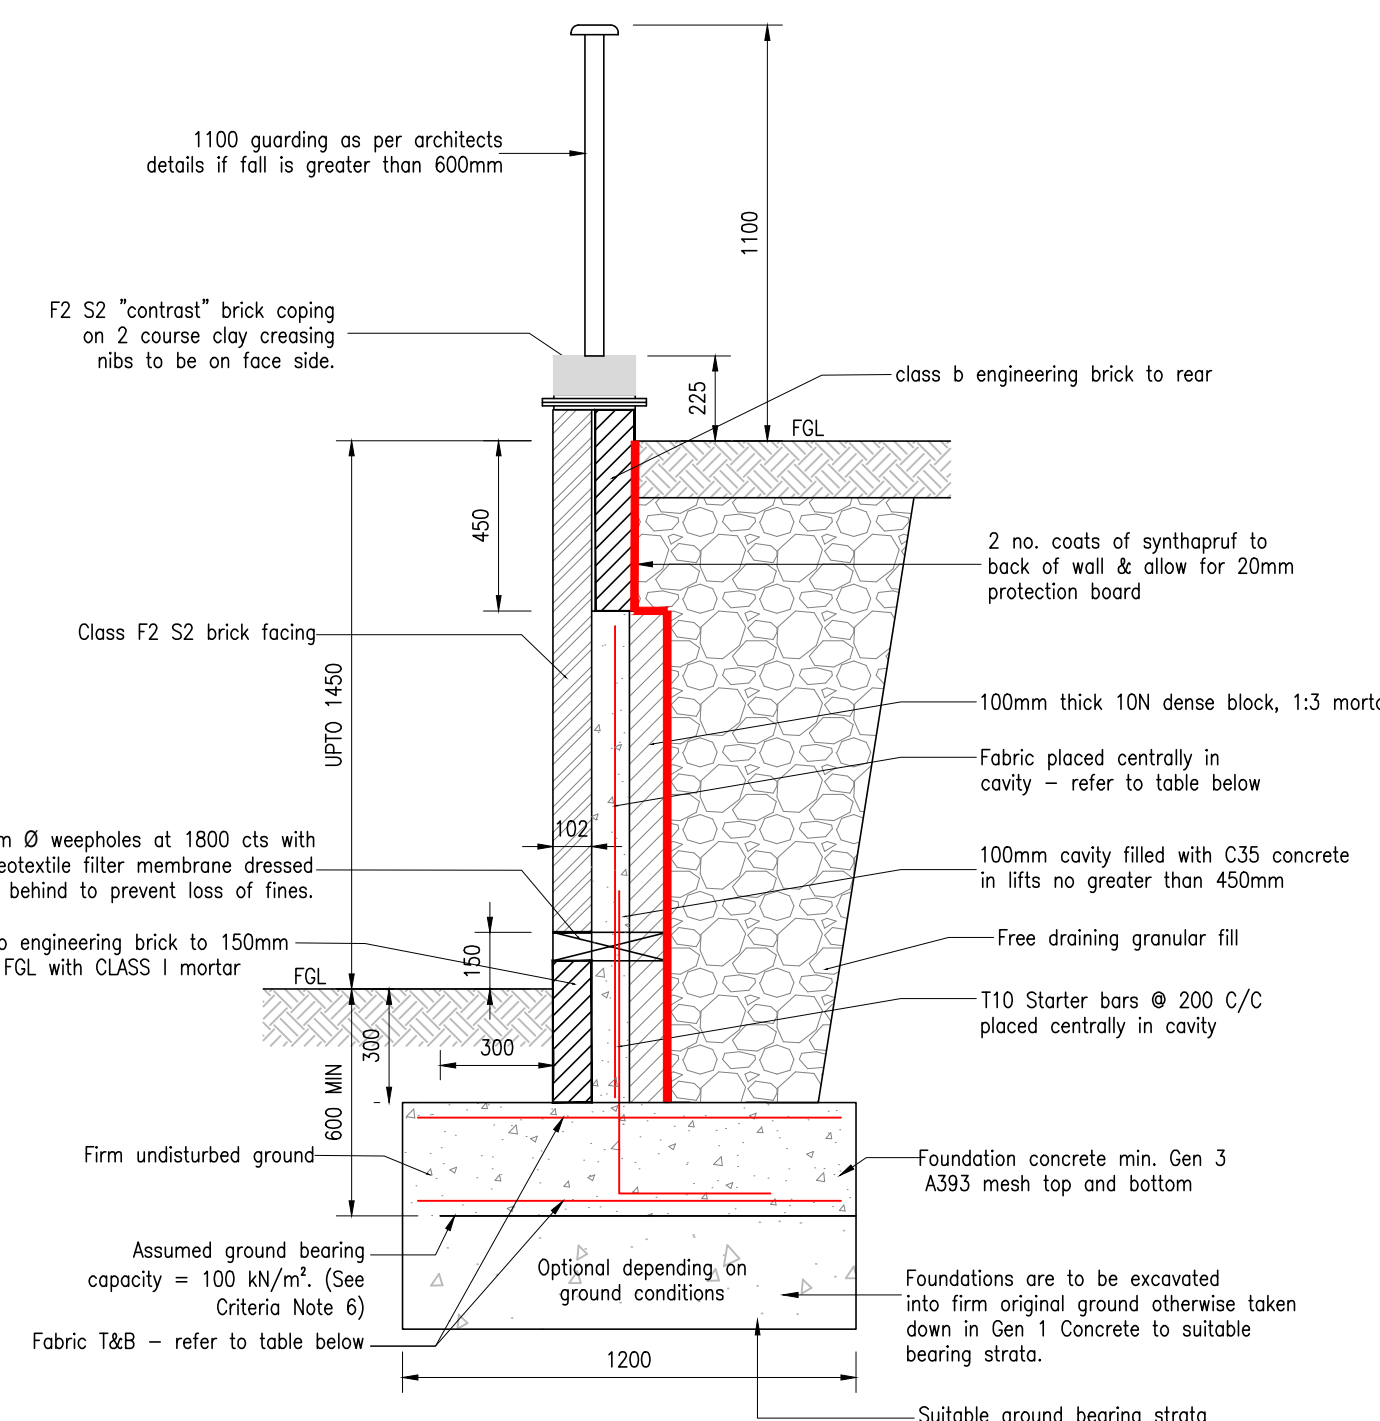

TYPICAL RETAINING WALL
(UP TO 1450mm)

GENERAL NOTES

- FOUNDATION CONCRETE TO BE MIN GEN 3 UNLESS NOTED OTHERWISE
 - GRANULAR BACKFILL CAN BE PLACED AFTER 10 DAYS OF COMPLETING WALL.
 - MOVEMENT JOINTS (12mm) ARE TO BE POSITIONED AT NO GREATER THAN 10 METER CENTERS IN THE BRICK WALL. SEE NHBC DETAIL 6.1-S21.
 - SUB-CONTRACTOR RESPONSIBLE FOR CONSTRUCTION OF WALL AND FOOTINGS AND IS TO TAKE ALL NECESSARY SAFEGUARDS TO ENSURE STABILITY OF GROUND AND STRUCTURES BEHIND WALL DURING THE WORKS AND UP TO THE BACKFILLING OF WALL.
- ## CRITERIA FOR USE OF RETAINING WALL DETAILS
- GROUND BEHIND WALL IS ONLY GARDEN AREA AND DOES NOT SLOPE MORE THAN 10°
 - THE FOUNDATION IS CONSTRUCTED IN UNDISTURBED FIRM GROUND HAVING A SAFE GROUND BEARING PRESSURE OF 100 kN/m²
 - IF EITHER CONDITIONS ARE NOT CORRECT THEN STRUCTURAL ENGINEER IS TO BE NOTIFIED.

P01	18/02/2026	PRELIMINARY ISSUE	CJD	KOB	KOB
REV	DATE	DESCRIPTION	BY	CHK	APP

DRAWING STATUS:	PRELIMINARY
-----------------	-------------

CLIENT:	WESTSHIELD
---------	------------

ARCHITECT:	BERNARD TAYLOR PARTNERSHIPS
------------	-----------------------------

PROJECT:	DOWKER STREET MILNESBRIDGE HUDDERSFIELD
----------	---

TITLE:	TYPICAL RETAINING WALLS DETAILS
--------	---------------------------------

STATUS:	PROJECT No:	PROJECT	ORIGINATOR	VOL/SYS	LEVEL	TYPE	ROLE	DRAWING No.	REV:
S2	223-043	DSH - AJP	-XX -00	-DR	-C	1450	P01		

SCALE @ A1:	DESIGNED:	DRAWN:	CHECKED:	APPROVED:	DATE:
1:20	CJD	CJD	KOB	KOB	FEB 2026