Environmental Noise Solutions Limited

Suite 24
Doncaster Business Innovation Centre
Ten Pound Walk
Doncaster
DN4 5HX

Proposed Residential Development
Newsome Mills, Ruth Street, Newsome Village, Huddersfield

Noise Impact Assessment

For:
Connect Housing

13th February 2026

Ref: NIA-12437-26-12799-v1 Newsome Mill
Author: T. Crabb BSc(hons), MIOA

Contents

1 Introduction 1

1.1 Overview 1

1.2 Site Description and Development Proposals 1

2 Policy Context and Assessment Guidance 3

2.1 National Planning Policy Framework 3

2.2 Noise Policy Statement for England 3

2.3 Planning Practice Guidance on Noise 4

2.4 ProPG Planning and Noise: New Residential Development 4

2.5 Approved Document O 5

3 Noise Survey 6

3.1 Overview 6

3.2 Summary 6

3.3 Analysis 7

4 Noise Assessment 8

4.1 Design Noise Levels 8

4.2 External Noise Amenity 8

4.3 Internal Noise Amenity 8

5 Mitigation of Overheating 11

6 Summary and Conclusions 12

Appendix 1 – Abbreviations and Definitions 13

Appendix 2 – Noise Measurement Positions 14

Appendix 3 – Indicative Glazing/Ventilation Markup (Mill Block) 15

Appendix 4 – Approved Document O Assessment 16

1 Introduction

1.1 Overview

Environmental Noise Solutions Ltd (ENS) has been commissioned by Connect Housing to undertake a noise impact assessment for a residential development on the former Newsome Mills site at Ruth Street, Newsome, Huddersfield, HD4 6JF (hereafter referred to as 'the site').

The objectives of the noise impact assessment were to:

- Determine external noise levels at the site
- Assess the potential impact of the external noise climate on the proposed residential development with reference to relevant guidelines
- Provide recommendations for a scheme of sound attenuation works, as necessary, to protect future occupants of the proposed residential development from a loss of amenity due to noise

This report details the methodology and results of the assessment and provides recommendations for the building envelope (fenestration and ventilation) and boundary treatments. It has been prepared to accompany a planning application to be submitted to Kirklees Council.

The report has been prepared for Connect Housing for the sole purpose described above and no extended duty of care to any third party is implied or offered. Third parties referring to the report should consult Connect Housing and ENS as to the extent to which the findings may be appropriate for their use.

A glossary of acoustic terms used in the main body of the text is contained in Appendix 1.

1.2 Site Description and Development Proposals

The site is located in a mixed-use setting in Newsome, circa 1.5 kilometres to the south of Huddersfield, as shown (highlighted in red) in Figure 1.1.

Figure 1.1: Location of Development



The ambient noise climate at the site is characterised by road traffic noise on Ruth Street and the wider surrounding road network, with occasional noise from commercial premises on the opposite side of Ruth Street.

Development proposals are for:

- A 4-storey block containing 44 no. apartments with ground floor ancillary areas (Mill Block)
- A terrace containing 6 no. townhouses and 4 no. apartments (Block 1)
- A terrace containing 6 no. townhouses and 4 no. apartments (Block 2)
- 4 no. semi-detached dwellings (Block 3)
- Associated landscaping, parking and access roads

In relation to relevant planning history, it is noted that planning permission for a residential development at the site is currently sought under Planning Application ref: 2023/62/91300/W, submitted to Kirklees Council in May 2023. The application was accompanied by a Noise Impact Assessment (ref: NIA-10746-23-10931-v1, dated February 2023) prepared by ENS.

Whilst the application is still pending, a consultation response received from Pollution & Noise Control at Kirklees Council in July 2023 commented that the findings of the noise report were accepted, and recommended the following planning condition:

'Before the development is first brought into use all works which form part of the sound attenuation scheme as specified in the Noise Impact Assessment authored by ENS dated 13 February 2023 Ref NIA-10746-23-10931-v1:

a) shall be completed; and
b) written evidence to demonstrate that the specified noise levels have been achieved shall be submitted to and approved in writing by the Local Planning Authority.

If it cannot be demonstrated that the noise levels specified in the aforementioned Noise Report have been achieved, the development shall not be brought into use until a further scheme incorporating further measures to achieve those noise levels has been submitted to and approved in writing by the Local Planning Authority.

All works comprised within those further measures shall be completed and written evidence to demonstrate that the aforementioned noise levels have been achieved shall be submitted to and approved in writing by the Local Planning Authority before the development is first brought into use.'

Whilst the application is still pending, it is evident that noise should not represent a constraint to residential development at the site.

2 Policy Context and Assessment Guidance

2.1 National Planning Policy Framework

The National Planning Policy Framework (NPPF)[1] was updated in February 2025 and sets out the Government's planning policies for England and how these are expected to be applied.

Where issues of noise impact are concerned the NPPF provides brief guidance in paragraph 187 where it states that planning policies and decisions should contribute to and enhance the natural and local environment by:

'preventing new and existing development from contributing to, being put at unacceptable risk from, or being adversely affected by, unacceptable levels of…..noise pollution'.

Paragraph 198 advises that:

'Planning policies and decisions should also ensure that new development is appropriate for its location taking into account the likely effects (including cumulative effects) of pollution on health, living conditions and the natural environment, as well as the potential sensitivity of the site or the wider area to impacts that could arise from the development. In doing so they should…..mitigate and reduce to a minimum potential adverse impacts resulting from noise from new development – and avoid noise giving rise to significant adverse impacts on health and the quality of life'.

The NPPF also refers to the 2010 DEFRA publication, the Noise Policy Statement for England (NPSE) which reinforces and supplements the NPPF.

2.2 Noise Policy Statement for England

The Noise Policy Statement for England[2] (NPSE) sets out the long-term vision of promoting good health and a good quality of life through the effective management of noise within the context of Government policy on sustainable development. This long-term vision is supported by the following aims:

- Avoid significant adverse impacts on health and quality of life
- Mitigate and minimise adverse impacts on health and quality of life
- Where possible, contribute to the improvement of health and quality of life

The NPSE describes the following levels at which noise impacts may be identified:

- NOEL – No Observed Effect Level. This is the level below which no effect can be detected. In simple terms, below this level, there is no detectable effect on health and quality of life due to the noise
- LOAEL – Lowest Observed Adverse Effect Level. This is the level above which adverse effects on health and quality of life can be detected
- SOAEL – Significant Observed Adverse Effect Level. This is the level above which significant adverse effects on health and quality of life occur

According to the explanatory notes in the statement, where a noise level falls between the lowest observable adverse effect level (LOAEL) and a level which represents a significant observable adverse effect level (SOAEL):

'….all reasonable steps should be taken to mitigate and minimise adverse effects on health and quality of life whilst also taking into consideration the guiding principles of sustainable development. This does not mean that such effects cannot occur.'

1 National Planning Policy Framework. Ministry of Housing, Communities and Local Government (2021)
2 Government Department for Environment, Food and Rural Affairs. Noise Policy Statement for England. March 2010.

2.3 Planning Practice Guidance on Noise

Planning Practice Guidance[3] (PPG) is an online resource which provides additional guidance and elaboration on the NPPF. It advises that the Local Planning Authority should consider the acoustic environment in relation to:

- Whether or not a significant adverse effect is occurring or likely to occur
- Whether or not an adverse effect is occurring or likely to occur
- Whether or not a good standard of amenity can be achieved

In line with the Explanatory Note of the NPSE, the PPG references the LOAEL and SOAEL in relation to noise impact. It also provides examples of outcomes that could be expected for a given perception level of noise, plus actions that may be required to bring about a desired outcome. However, in line with the NPSE, no objective noise levels are provided for LOAEL or SOAEL.

The PPG also provides general advice on the typical options available for mitigating noise, suggesting that Local Plans may include noise standards applicable to proposed developments within the Local Authority's administrative boundary, although it states that:

'Care should be taken, however, to avoid these being implemented as fixed thresholds as specific circumstances may justify some variation being allowed'.

The subjective nature of noise means that there is not a simple relationship between noise levels and the impact on those affected. This will depend on how various factors combine in any particular situation. The following guidance documents provide some meaningful context.

2.4 ProPG Planning and Noise: New Residential Development

ProPG Planning and Noise: New Residential Development (ProPG)[4] was published in 2017 by the Association of Noise Consultants, Institute of Acoustics and the Chartered Institute of Environmental Health.

Stage 2: Element 2 of ProPG sets indoor ambient noise levels for residential dwellings based on the guidance contained in British Standard 8233:2014 'Guidance on Sound Insulation and Noise Reduction for Buildings'[5] (BS 8233), see Table 2.1.

Table 2.1: Indoor Ambient Noise Levels in Dwellings

Activity	Location	Good Indoor Ambient Noise Levels	
Resting	Living Room	35 dB $L_{Aeq\ (0700\text{-}2300)}$	-
Dining	Dining Room/Area	40 dB $L_{Aeq\ (0700\text{-}2300)}$	-
Sleeping (daytime resting)	Bedroom	35 dB $L_{Aeq\ (0700\text{-}2300)}$	30 dB $L_{Aeq\ (2300\text{-}0700)}$ 45 dB $L_{AFMax\ (2300\text{-}0700)}$

Note 4 to the above table states:

'A guideline value may be set in terms of SEL or $L_{Amax,F}$, depending on the character and number of events per night. Sporadic noise events could require separate values. In most circumstances in noise sensitive rooms at night (e.g. bedrooms) good acoustic design can be used so that individual noise events do not normally exceed 45dB $L_{Amax,F}$ more than 10 times a night.'

3 Planning Practice Guidance on Noise: http://planningguidance.planningportal.gov.uk/blog/guidance/noise/

4 'ProPG Planning and Noise: New Residential Development (ProPG)', 2017. Association of Noise Consultants (ANC), Institute of Acoustics (IOA) and the Chartered Institute of Environmental Health (CIEH)

5 British Standards Institution (2014). *British Standard 8233:2014 Guidance on Sound Insulation and Noise Reduction for Buildings.*

Note 5 to the above table states:

'Where it is not possible to meet internal target levels with windows open, internal noise levels can be assessed with windows closed, however any façade openings used to provide whole dwelling ventilation (e.g. trickle ventilators) should be assessed in the "open" position and, in this scenario, the internal L_{Aeq} target levels should not normally be exceeded, subject to the further advice in Note 7'.

This is consistent with the guidance contained within the PPG, which states that:

'... consideration should also be given to whether adverse internal effects can be completely removed by closing windows and, in the case of new residential development, if the proposed mitigation relies on windows being kept closed most of the time. In both cases a suitable alternative means of ventilation is likely to be necessary. Further information on ventilation can be found in the Building Regulations'.

On the basis of the above, the following criteria (with windows closed and an alternative means of ventilation provided) are considered appropriate for the proposed development and considered to represent good resting and sleeping conditions:

- ≤ 35 dB $L_{Aeq\ (0700\text{-}2300)}$ in habitable rooms during the daytime
- ≤ 30 dB $L_{Aeq\ (2300\text{-}0700)}$ in bedrooms during the night-time
- 45 dB L_{AFMax} not regularly exceeded during the night-time

With regard to external amenity, ProPG reflects the advice given in BS 8233 as follows:

'The acoustic environment of external amenity areas that are an intrinsic part of the overall design should always be assessed and noise levels should ideally not be above the range 50–55 dB $L_{Aeq,16hr}$.'

'These guideline values may not be achievable in all circumstances where development might be desirable. In such a situation, development should be designed to achieve the lowest practicable noise levels in these external amenity spaces.'

2.5 Approved Document O

Approved Document O, 2021 is written in support of Part O of Schedule 1 to the Building Regulations 2010. The approved document details methods of addressing overheating of residential dwellings and is applicable only across England.

The approved document has the following relevant guidance in Section 3 regarding noise ingress into buildings:

'In locations where external noise may be an issue (for example, where the local planning authority considered external noise to be an issue at the planning stage), the overheating mitigation strategy should take account of the likelihood that windows will be closed during sleeping hours (11pm to 7am).

Windows are likely to be closed during sleeping hours if noise within bedrooms exceeds the following limits.

- *40dB $L_{Aeq,T}$, averaged over 8 hours (between 11pm and 7am)*
- *55dB L_{Amax}, more than 10 times a night (between 11pm and 7am)'*

3 Noise Survey

3.1 Overview

In order to determine the level of external noise affecting the proposed development, noise monitoring was carried out on Tuesday 24th January and Monday 20th January 2023.

The adopted noise monitoring positions (shown in Appendix 2) were as follows:

- MP1 was located on Ruth Street in front of the former mill façade
- MP2 was located on the NE development boundary on Hart Street
- MP3 was located on the SW development boundary towards Lockwood Scar
- MP3 was located on the NW development boundary

Noise measurements were undertaken in free field conditions at 4 metres above ground level using Bruel & Kjaer 2250 Type 1 integrating sound level meters. Each meter was connected to a windshield covered microphone positioned at the locations detailed above.

The measurement system calibration was verified immediately before and after the survey period using a Bruel & Kjaer Type 4231 calibrator. No drift in calibration levels greater than 0.5 dB was noted.

Measurements consisted of A–weighted broadband parameters including L_{Aeq}, L_{A10} L_{A90}, and L_{AFmax} together with linear octave band data.

The noted weather conditions during the survey were dry with wind speeds < 5 m/s. Weather conditions were therefore considered appropriate for noise monitoring.

3.2 Summary

Table 3.1 presents a summary of the noise data for each measurement session, at each measurement position, rounded to the nearest decibel.

Table 3.1: Summary of Noise Measurement Data

Position	Date	Time	L_{Aeq} (dB)	L_{A90} (dB)	L_{A10} (dB)	L_{AFMax} (dB)	Comment
MP1	24/01/2023	1315–1345	53	42	55	71	Traffic on Ruth Street dominant, one occasion of transient noise from metal shutters opposite site
		1400–1700	55	40	58	80	
	30/01/2023	0416–0700	54	39	53	80	
MP2	24/01/2023	1315–1415	46	43	48	60	Distant road traffic
	30/01/2023	0409–0509	45	42	47	61	
MP3	24/01/2023	1517–1617	48	45	50	62	Traffic on Ruth Street dominant, infrequent noise from Lockwood Scar
MP4	24/01/2023	1416–1516	45	43	47	61	Distant road traffic
	30/01/2023	0512–0612	47	43	49	59	

3.3 Analysis

The noise environment at MP1 was predominantly due to road traffic on Ruth Street.

For the prediction of daytime road traffic noise, the Department of Transport's Memorandum on the Calculation of Road Traffic Noise (CRTN) explains that the following shortened measurement procedure may be used. Measurements of L_{A10} are made over any three consecutive hours between 10:00 and 17:00 hours. Using $L_{A10\,(3\,hour)}$ as the arithmetic mean of the three consecutive values of hourly L_{A10}, the $L_{A10\,(18\,hour)}$ can be calculated from the equation:

$$L_{A10\,(18\,hour)} = L_{A10\,(3\,hour)} - 1\ dB$$

A study prepared by TRL Limited on behalf of the Department for Environment, Food and Rural Affairs (DEFRA) entitled 'Converting the UK Traffic Noise Index $L_{A10\,(18\,hour)}$ to EU Noise Indices for Noise Mapping' presents a methodology for calculating daytime $L_{Aeq\,(0700\text{-}2300)}$ and night-time $L_{Aeq\,(2300\text{-}0700)}$ ambient noise levels based on the $L_{A10\,(18\,hour)}$ noise levels, as follows:

$$L_{Aeq\,(0700\text{-}2300)} = 10 * \log\left(\frac{[(10\text{^}((0.95 * L_{A10\,(18\,hour)} + 1.44)/10)*12] + [10\text{^}((0.97 * L_{A10\,(18\,hour)} - 2.87)/10)*4])}{16}\right)$$

$$L_{Aeq\,(2300\text{-}0700)} = 0.90 * L_{A10,\,18\,hour} - 3.77$$

Based on the above formulae, the daytime and night-time ambient noise levels at MP1 are calculated at **55 dB $L_{Aeq\,(0700-2300)}$** and **48 dB $L_{Aeq\,(2300-0700)}$** respectively.

Whilst traffic flows along Ruth Street were relatively low, maximum noise level events from passing vehicles were typically **80 dB L_{AFMax}** due to the close proximity of the road. Consequently, it is the control of discrete event maxima during the night-time which governs the mitigation requirements in road-fronting bedrooms.

Noise levels measured elsewhere on the site (MP2-MP4) were in the range of 45 to 48 dB $L_{Aeq,T}$, with little variation in the level over the night-time periods and typical $L_{Amax,F}$ not exceeding 62 dBA.

4 Noise Assessment

4.1 Design Noise Levels

The noise climate across the site is generally controlled by local and distant road traffic noise.

Design noise levels for habitable rooms fronting onto Ruth Street are as follows:

- 55 dB $L_{Aeq\ (0700\text{-}2300)}$ during the daytime
- 48 dB $L_{Aeq\ (2300\text{-}0700)}$ during the night-time
- 80 dB L_{AFMax} during the night-time

All other plots are expected to have levels no greater than:

- ≤ 48 dB $L_{Aeq,\ T}$ during the daytime
- ≤ 47 dB $L_{Aeq,\ T}$ during the night-time
- ≤ 62 dB $L_{Amax,F}$ during the night-time

4.2 External Noise Amenity

All measurement locations show external noise levels to be below the BS 8233 upper guideline level of 55 dB $L_{Aeq,(0700\text{-}2300)}$ for external living areas. As rear garden areas will benefit from localised screening provided by the new building massing or garden fences, noise levels are expected to be ≤ 50 dB $L_{Aeq,16hr}$. External noise levels are therefore expected to be suitable for external amenity areas without any specific mitigation.

4.3 Internal Noise Amenity

In order to calculate the sound insulation requirements of the building envelope for habitable rooms throughout the development, the Building Research Establishment (BRE) building envelope insulation calculation spreadsheet was used. This spreadsheet is based on the calculation methodology advocated in BS 8233. The spreadsheet allows input of external noise levels, typical room dimensions and reverberation time together with parameters for the various elements of the building envelope and calculates the internal noise level in terms of the external noise level metric (L_{Aeq} and L_{AFMax} in this case).

Apartments Fronting onto Ruth Street

In order to control discrete event maxima from Ruth Street, it is recommended that road-fronting apartments of the Mill Block are provided with a mechanical ventilation strategy. Appropriate ventilation solutions include:

- A System 3 mechanical extract ventilation (MEV) system
- A fully ducted mechanical ventilation system with heat recovery (MVHR)

Approved Document F 'Ventilation' (ADF) states that where MEV is used, background ventilators of at least 4000 mm² EA must be provided to each habitable room, with 1 no. ventilator required per bedroom and 2 no. ventilators required in living rooms.

To avoid compromising the sound insulation performance of the façade, any ventilators should be rated at least **41 dB $D_{n,e,w}+C_{tr}$** per 4000 mm² EA (vent open), such as:

- Invisivent EVO AK Ultra acoustic **over-frame** vents
- Ryton AAC125HP acoustic wall vent

Ventilators are not required with an MVHR system.

Bedrooms in these apartments should be fitted with enhanced laminated glazing rated at least **35 dB R_w+C_{tr}** (such as 6 mm glass / 16 mm Argon / 8.8 Pilkington Optiphon).

As evidenced in the calculation sheet below, this configuration will provide circa 35 dB(A) sound insulation from external to internal at the site.

Figure 4.1: Example BRE Calculation Spreadsheet

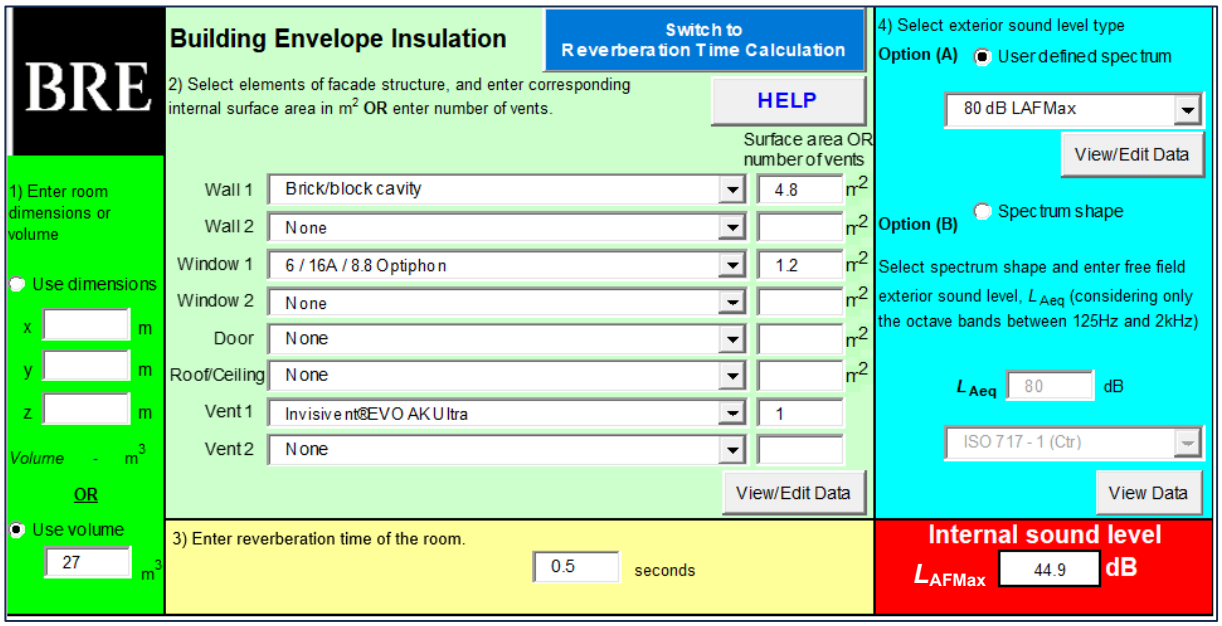

Remaining habitable rooms in these apartments may be fitted with standard glazing rated at least **25 dB R_w+C_{tr}** (such as 4 mm glass / 6–20 mm cavity / 4 mm glass) in conjunction with above-frame trickle vents rated at least **32 dB $D_{n,e,w}$** per 4000 mm² EA (vent open) such as the Invisivent EVO AK Basic.

As evidenced in the calculation sheet below, this configuration will provide circa 25 dB(A) sound insulation from external to internal at the site.

Figure 4.2: Example BRE Calculation Spreadsheet

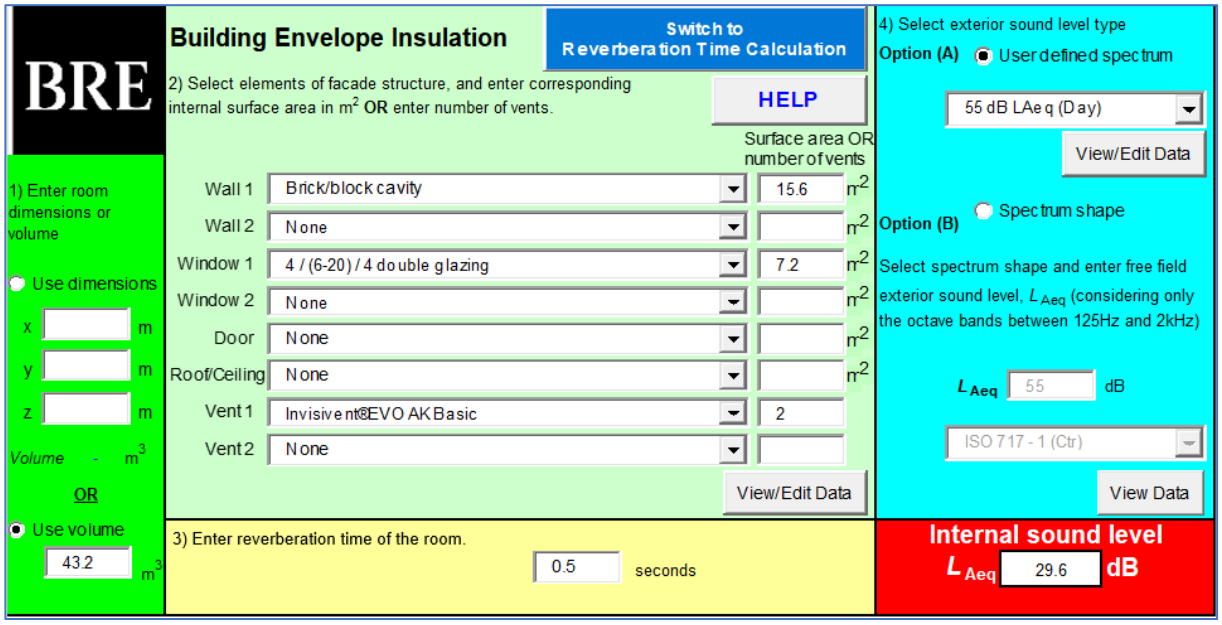

Remaining Plots

Habitable rooms on the rear of the Mill Block and throughout Blocks 1–3 (set back/screened from Ruth Street) may be fitted with double glazing rated at least **25 dB R_w+C_{tr}** in conjunction with trickle vents rated at least **32 dB $D_{n,e,w}$** per 4000 mm² EA (vent open) such as the Titon Trimvent Select Xtra S13 with XC13 canopy or the Invisivent EVO AK Basic.

This configuration will provide circa 25 dB(A) sound insulation from external to internal at the site.

Summary

See Appendix 3 for indicative glazing/ventilation markup.

The resultant internal noise levels are set out in the table below.

Table 4.1 – External Noise Levels and Resultant Internal Noise Levels

Location	External Noise Level	Reduction	Resultant Internal Level
Mill Block bedrooms fronting onto Ruth Street	≤ 55 dB $L_{Aeq\ (0700\text{-}2300)}$ ≤ 48 dB $L_{Aeq\ (2300\text{-}0700)}$ ≤ 80 dB L_{AFMax}	–35 dB	≤ 20 dB $L_{Aeq\ (0700\text{-}2300)}$ ≤ 13 dB $L_{Aeq\ (2300\text{-}0700)}$ ≤ 45 dB L_{AFMax}
Mill Block living rooms fronting onto Ruth Street	≤ 55 dB $L_{Aeq\ (0700\text{-}2300)}$	–25 dB	≤ 30 dB $L_{Aeq\ (0700\text{-}2300)}$
Remaining Apartments	≤ 48 dB $L_{Aeq\ (0700\text{-}2300)}$ ≤ 47 dB $L_{Aeq\ (2300\text{-}0700)}$ ≤ 62 dB L_{AFMax}	–25 dB	≤ 23 dB $L_{Aeq\ (0700\text{-}2300)}$ ≤ 22 dB $L_{Aeq\ (2300\text{-}0700)}$ ≤ 37 dB L_{AFMax}

General Points

The following points should be noted:

- The glazing recommendations apply to the window within a sealed unit. It is the responsibility of the window supplier to ensure that the window frame does not compromise the performance of the glazing.
- When selecting a glazing system to satisfy the requirements outlined above, it is important to ensure that the R_w+C_{tr} value is achieved (rather than simply the R_w value). Published R_w values tend to be higher than corresponding R_w+C_{tr} values; therefore, incorrect selection could result in an overestimation of sound reduction performance which in turn could result in higher internal noise levels.
- The opening and free area of the ventilation units should be checked by a mechanical service engineer before designs are finalised. Should the equivalent open area be insufficient to meet the minimum requirements of ADF, it may be necessary to increase the number of units per habitable room. Where this applies, the required sound reduction of the ventilation units may need to be increased accordingly
- Internal noise levels due to mechanical ventilation plant should not exceed 26 dB(A) in bedrooms and 30 dB(A) in living rooms

5 Mitigation of Overheating

ADO states that for moderate risk locations (i.e. outside of London) the minimum free area of the open window should be at least 4% of the floor area of the room.

As the open area varies as a function of the floor area, for a typical floor-to-ceiling height of 2.4m, a free area of 4% of the floor area equates to an external to internal noise reduction of 10 dB.

With reference to the internal targets contained in ADO, it is assumed that open windows can form the overheating mitigation strategy with no additional ventilation or cooling, providing the external noise levels outside bedrooms at night do not exceed **50 dB $L_{Aeq\ (2300\text{-}0700)}$** and **65 dB L_{AFMax}** (more than 10 times).

Based on the results of the noise surveys at the site, it is assumed that road-fronting bedroom windows of the Mill Block would be closed during night-time hours (see Appendix 4 for façade locations where bedroom windows are assumed to be closed during night-time hours).

This information should be provided to the overheating assessor for the site, in order to determine the extent of additional mitigation required to comply with ADO.

For remaining bedrooms, windows may be opened to the minimum free area of 4% of the floor area, meaning that the overheating mitigation strategy is not constrained by acoustics.

6 Summary and Conclusions

A noise impact assessment has been undertaken for the proposed residential development on the site of the former Newsome Mills at Ruth Street, Newsome, Huddersfield, HD4 6JF.

The noise environment at the site is predominantly due to road traffic noise on Ruth Street and the surrounding road network, with no other significant noise sources noted.

A scheme of sound insulation works has been developed to protect the proposed residential development from the ambient noise climate.

Appendix 1 – Abbreviations and Definitions

Sound Pressure Level (L_p)
The basic unit of sound measurement is the sound pressure level. As the pressures to which the human ear responds can range from 20 µPa to 200 Pa, a linear measurement of sound levels would involve many orders of magnitude. Consequently, the pressures are converted to a logarithmic scale and expressed in decibels (dB) as follows:

$L_p = 20 \log_{10}(p/p_o)$

Where L_p = sound pressure level in dB; p = rms sound pressure in Pa; and p_o = reference sound pressure (20 µPa).

A-weighting
A frequency filtering system in a sound level meter, which approximates under defined conditions the frequency response of the human ear. The A-weighted sound pressure level, expressed in dB(A), has been shown to correlate well with subjective response to noise.

Equivalent continuous A-weighted sound pressure level, $L_{Aeq, T}$
The value of the A-weighted sound pressure level in decibels of continuous steady sound that within a specified time interval, T, has the same mean-square sound pressure as a sound that varies with time. $L_{Aeq, 16h}$ (07:00 to 23:00 hours) and $L_{Aeq, 8h}$ (23:00 to 07:00 hours) are used to qualify daytime and night-time noise levels.

$L_{A10, T}$
The A-weighted sound pressure level in decibels exceeded for 10% of the measurement period, T. $L_{A10, 18h}$ is the arithmetic mean of the 18 hourly values from 06:00 to 24:00 hours.

$L_{A90, T}$
The A-weighted sound pressure level of the residual noise in decibels exceeded 90% of a given time interval, T. L_{A90} is typically taken as representative of background noise.

$L_{AF\ max}$
The maximum A-weighted noise level recorded during the measurement period. The subscript 'F' denotes fast time weighting, slow time weighting 'S' is also used.

Single Event Level / Sound Exposure Level (SEL or L_{AE})
The energy produced by a discrete noise event averaged over one second, regardless of the event duration. This allows for comparison between different noise events which occur over different lengths of time.

Weighted Sound Reduction Index (R_W)
Single number quantity which characterises the airborne sound insulation properties of a material or building element over a defined range of frequencies (R_W is used to characterise the insulation of a material or product that has been measured in a laboratory).

Appendix 2 – Noise Measurement Positions



Appendix 3 – Indicative Glazing/Ventilation Markup (Mill Block)



All Floor Levels

Enhanced laminated glazing rated at least 35 dB R_W+Ctr

MEV with acoustic vents rated at least 41 dB Dn,e,w+Ctr per 4000 mm2 (vent open) **or**
MVHR (no vents)

Standard double glazing rated at least 25 dB R_W+Ctr

MEV with vents rated at least 32 dB Dn,e,w per 4000 mm2 (vent open)
or
MVHR (no vents)

Standard glazing rated at 25 dB Rw+Ctr with vents rated at least 32 dB Dn,e,w per 4000 mm2 (vent open)

Appendix 4 – Approved Document O Assessment

